



**HARRIS COUNTY PSYCHIATRIC CENTER RENOVATION  
UNITS: 1C, 2E, 3B, 3C, 3D & 3E**



**2800 S MacGREGOR WAY, HOUSTON, TX 77021**

**ISSUE FOR BID**

**OCTOBER 14, 2016**

**MEP ENGINEER**

**Shah Smith and Associates  
2825 S. Wilcrest Dr #350  
Houston, TX 77042  
p. (713) 780-7563  
Firm No. F-2113**

**ARCHITECT**

**PBK Architects, Inc.  
11 Greenway Plaza, 22nd Floor  
Houston, Texas 77046  
p. (713) 965-0608  
Firm No. F-3709**





## DRAWING INDEX

- GENERAL**
- G0.00 COVER SHEET
  - G0.01 SHEET INDEX, DRAWING CONVENTIONS, AND LOCATION MAP
  - G0.02 ADA GUIDELINES
  - G0.03 SIGNAGE TYPES

- ARCHITECTURAL**
- A1.01 COMPOSITE PLAN - FIRST FLOOR
  - A1.02 COMPOSITE PLAN - SECOND FLOOR
  - A1.03 COMPOSITE PLAN - THIRD FLOOR
  - A2.01C SCHEDULES - FIRST FLOOR UNIT 1C
  - A2.02C FIRST FLOOR UNIT 1C
  - A2.03C FIRST FLOOR UNIT 1C - SIGNAGE PLAN
  - A2.04E SCHEDULES - SECOND FLOOR UNIT 2E
  - A2.05E SECOND FLOOR UNIT 2E
  - A2.06E SECOND FLOOR UNIT 2E - SIGNAGE PLAN
  - A2.07B SCHEDULES - THIRD FLOOR UNIT 3B
  - A2.08B THIRD FLOOR UNIT 3B
  - A2.09B THIRD FLOOR UNIT 3B - SIGNAGE PLAN
  - A2.10C SCHEDULES - THIRD FLOOR UNIT 3C
  - A2.11C THIRD FLOOR UNIT 3C
  - A2.12C THIRD FLOOR UNIT 3C - SIGNAGE PLAN
  - A2.13D SCHEDULES - THIRD FLOOR UNIT 3D
  - A2.14D THIRD FLOOR UNIT 3D
  - A2.15D THIRD FLOOR UNIT 3D - SIGNAGE PLAN
  - A2.16E SCHEDULES - THIRD FLOOR UNIT 3E
  - A2.17E THIRD FLOOR UNIT 3E
  - A2.18E THIRD FLOOR UNIT 3E - SIGNAGE PLAN
  - A2.19C FIRST FLOOR FINISH PLAN - UNIT 1C
  - A2.20E SECOND FLOOR FINISH PLAN - UNIT 2E
  - A2.21B THIRD FLOOR FINISH PLAN - UNIT 3B
  - A2.22C THIRD FLOOR FINISH PLAN - UNIT 3C
  - A2.23D THIRD FLOOR FINISH PLAN - UNIT 3D
  - A2.24E THIRD FLOOR FINISH PLAN - UNIT 3E
  - A4.01 ENLARGED PLANS
  - A6.20 INTERIOR ELEVATIONS & ENLARGED PLANS PARTITION TYPES
  - A7.00 MILLWORK SECTIONS
  - A10.01 REFLECTED CEILING PLAN - UNIT 1C FIRST FLOOR
  - A10.02 REFLECTED CEILING PLAN - UNIT 2E SECOND FLOOR
  - A10.03 REFLECTED CEILING PLAN - UNIT 3B THIRD FLOOR
  - A10.04 REFLECTED CEILING PLAN - UNIT 3C THIRD FLOOR
  - A10.05 REFLECTED CEILING PLAN - UNIT 3D THIRD FLOOR
  - A10.06 REFLECTED CEILING PLAN - UNIT 3E THIRD FLOOR


- ELECTRICAL**
- E0.01 ELECTRICAL LEGEND AND SYMBOLS AND ABBREVIATIONS
  - E0.02 LUMINAIRE SCHEDULE
  - E1.01C LEVEL 02 LIGHTING PLAN - AREA 1C
  - E1.02E LEVEL 02 LIGHTING PLAN - AREA 2E
  - E1.03B LEVEL 03 LIGHTING PLAN - AREA 3B
  - E1.03C LEVEL 03 LIGHTING PLAN - AREA 3D
  - E1.03D LEVEL 03 LIGHTING PLAN - AREA 3E
  - E1.03E LEVEL 03 LIGHTING PLAN - AREA 3C

- PLUMBING**
- P0.01 PLUMBING LEGEND, GENERAL NOTES, AND SPECIFICATIONS
  - PD2.01C FIRST FLOOR PLUMBING DEMOLITION PLAN - AREA C
  - PD2.02E SECOND FLOOR PLUMBING DEMOLITION PLAN - AREA E
  - PD2.03B THIRD FLOOR PLUMBING DEMOLITION PLAN - AREA B
  - PD2.03C THIRD FLOOR PLUMBING DEMOLITION PLAN - AREA C
  - PD2.03D THIRD FLOOR PLUMBING DEMOLITION PLAN - AREA D
  - PD2.03E THIRD FLOOR PLUMBING DEMOLITION PLAN - AREA E
  - P2.01C FIRST FLOOR PLUMBING RENOVATION PLAN - AREA C
  - P2.02E SECOND FLOOR PLUMBING RENOVATION PLAN - AREA E
  - P2.03B THIRD FLOOR PLUMBING RENOVATION PLAN - AREA B
  - P2.03C THIRD FLOOR PLUMBING RENOVATION PLAN - AREA C
  - P2.03D THIRD FLOOR PLUMBING RENOVATION PLAN - AREA D
  - P2.03E THIRD FLOOR PLUMBING RENOVATION PLAN - AREA E

## ABBREVIATIONS

A.D.	AREA DRAIN	GCMU	GLAZED CONCRETE MASONRY UNIT	PT.	POINT
A.D.A.	AMERICANS WITH DISABILITIES ACT	GEN.	GENERAL	PTD.	PAINTED
A.F.F.	ABOVE FINISH FLOOR	GL.	GLASS / GLAZING	Q.T.	QUARRY TILE
A.F.G.	ABOVE FINISH GRADE	GR.	GRADE	R / RAD	RADIUS
A.H.J.	AUTHORITY HAVING JURISDICTION	GT.	GLAZED TILE PAVER	RD	ROOF DRAIN
A.I.C.	AIR CONDITIONING	GYP.	GYPSPUM DRYWALL	RE., REF.	REFER TO / REFERENCE / SEE
ACP.	ACOUSTICAL PANEL	H.W.	HOT WATER	REINF.	REINFORCE (D), (ING)
ACT.	ACOUSTICAL TILE	HC	HANDICAPPED ACCESSIBLE	RECD.	REQUIRED
ADJ.	ADJUSTABLE	HM	HOLLOW METAL FRAME	RES.	RESILIENT
ALT.	ALTERNATE	HORIZ.	HORIZONTAL	REV.	REVISION (S), REVISED
ALUM.	ALUMINUM	HT.	HEIGHT	RF	RECREATIONAL RESILIENT FLOORING
ASPH.	ASPHALT	I.D.	INSIDE DIAMETER	RG.	RELOCATABLE PAINTED GYPSUM BOARD
∠	ANGLE	I.P.S.	IRON PIPE SIZE	RSS.	ROD STOCK AND SEALANT
B.U.R.	BUILT UP ROOF	INSUL.	INSULATE (ED), (ION)	S.C.	SEALED CONCRETE
BD.	BOARD	INT.	INTERIOR	S.D.	SOAP DISPENSER
BLDG.	BUILDING	JT.	JOINT	SCHED	SCHEDULE
BLK.	BLOCK	L.P.	LIGHT POLE	SCPL.	SOLID CORE PLASTIC LAMINATE
BM.	BEAM	LAM.	LAMINATE (D)	SECT	SECTION
C	CHANNEL	LAV.	LAVATORY	SHT	SHEET
C.J.	CONTROL JOINT	LT.	LIGHT	SIM	SIMILAR
C.M.U.	CONCRETE MASONRY UNIT	LT. WT.	LIGHTWEIGHT	SPC	SPECIAL COATING SYSTEM
C.W.	COLD WATER	M.O.	MASONRY OPENING	SPEC	SPECIFICATION (S)
CAB.	CABINET	MAS.	MASONRY	SQ.	SQUARE
CABT	CABINET	MATL.	MATERIAL (S)	SS.	SOUND STRIP
CFMF	COLD FORMED METAL FRAMING	MAX.	MAXIMUM	SS, STL.	STAINLESS STEEL
CL.	CENTERLINE	MB.	MARKER BOARD	STL.	STEEL
CL.G.	CEILING	MECH.	MECHANICAL	STRUC.	STRUCTURAL
COL.	COLUMN	MEM.	MEMBRANE	SUSP.	SUSPENDED
COMP.	COMPRESSIBLE	MEM. WP.	MEMBRANE WATERPROOFING	SVDF	SHEET VINYL DANCE FLOORING
CONC.	CONCRETE	MEP	MECHANICAL, ELECTRICAL AND PLUMBING	SVF	SHEET VINYL FLOORING
COND.	CONDITION	MEZZ.	MEZZANINE	T.A.S.	TEXAS ACCESSIBILITY STANDARDS
CORR.	CORRIDOR	MFR.	MANUFACTURE (R)	T.B.	TACK BOARD
CPT.	CARPET (ED)	MH.	MANHOLE	T.D.R.	TOWEL DISPENSER AND RECEPTAL
CT.	CERAMIC TILE	MIN.	MINIMUM	T.O.	TOP OF
CTS.K.	COUNTER SINK	MISC.	MISCELLANEOUS	T.O.B.	TOP OF (WOOD) BLOCKING
D	DRYER	MOD.	MODULAR	T.O.M.	TOP OF MASONRY
D.F.	DRINKING FOUNTAIN	MOD.	MODULAR	T.O.S.	TOP OF STEEL
D.P.	DAMP PROOFING	MTL.	METAL	T.T.D.	TOILET TISSUE DISPENSER
D.S.	DOWN SPOUT	MTP.	METAL TOILET PARTITION	TEL.	TELEPHONE
DIA.	DIAMETER	N.D.	NAPKIN DISPOSAL	TERR.	TERRAZZO
DIM.	DIMENSION	N.I.C.	NOT IN CONTRACT	THK	THICK (NESS)
DTL.	DETAIL	N.T.S.	NOT TO SCALE	TYP	TYPICAL
DWG.	DRAWING	N.V.	NAPKIN VENDOR NUMBER	U.N.O.	UNLESS NOTED OTHERWISE
E.J.	EXPANSION JOINT	NO.	NUMBER	UR.	URINAL
E.Q.	EQUAL	O.C.	ON CENTER (S)	V	VENT
EA.	EACH	O.C.E.W.	ON CENTER EACH WAY	V.C.T.	VINYL COMPOSITION TILE
EDF.	ELECTRIC DRINKING FOUNTAIN	O.D.	OUTSIDE DIAMETER	V.I.F.	VERIFY IN FIELD
EL.	ELEVATION (HEIGHT)	O.F.C.I.	OWNER FURNISHED, CONTRACTOR INSTALLED	VENT.	VENTILATING, VENTILATED
ELECT.	ELECTRICAL	O.H.	OPPOSITE HAND	VER.	VERIFY
ELEV.	ELEVATION (DRAWING)	OPNG.	OPENING	VERT.	VERTICAL
EQUIP.	EQUIPMENT	OPP.	OPPOSITE	VGB.	(PREFINISHED) VINYL CLAD GYPSUM BOARD
EXIST.	EXISTING	P. LAM.	PLASTIC LAMINATE	VWC.	VINYL WALL COVERING
EXP.	EXPANSION	P.C.	PRECAST	W	WASHING MACHINE
EXT.	EXTERIOR	P.H.	PAPER HOLDER	W.P.	WATER PROOFING
F.E.	FIRE EXTINGUISHER	P.L.	PROPERTY LINE	W.S.	WEATHERSTRIP
F.E.C.	FIRE EXTINGUISHER CABINET	P.P.	POWER POLE	W.W.	WATER WELL
F.H.C.	FIRE HOSE CABINET	P.W.B.	PREFINISHED WALL BOARD	W.W.F.	WELDED WIRE FABRIC
FB.	FACE BRICK	PL.	PLATE	W/	WITH
FD.	FLOOR DRAIN	PLUMB.	PLUMBING	WC	WATER CLOSET
FIN.	FINISH (ED)	PLYWD.	PLYWOOD	WD	WOOD
FIKT.	FIXTURE	POL.	POLISHED	WDW	WINDOW
FLOOR (ING)	FLOOR (ING)	PRE.	PAIR	WT	WEIGHT
FLSHG.	FLASHING	PREFIN.	PREFINISHED		
FLUOR.	FLUORESCENT				
G.B.	GRAB BAR				
G.I.	GALVANIZED IRON				
GA.	GALVE				
GALV.	GALVANIZED				

## SITE LOCATION MAP

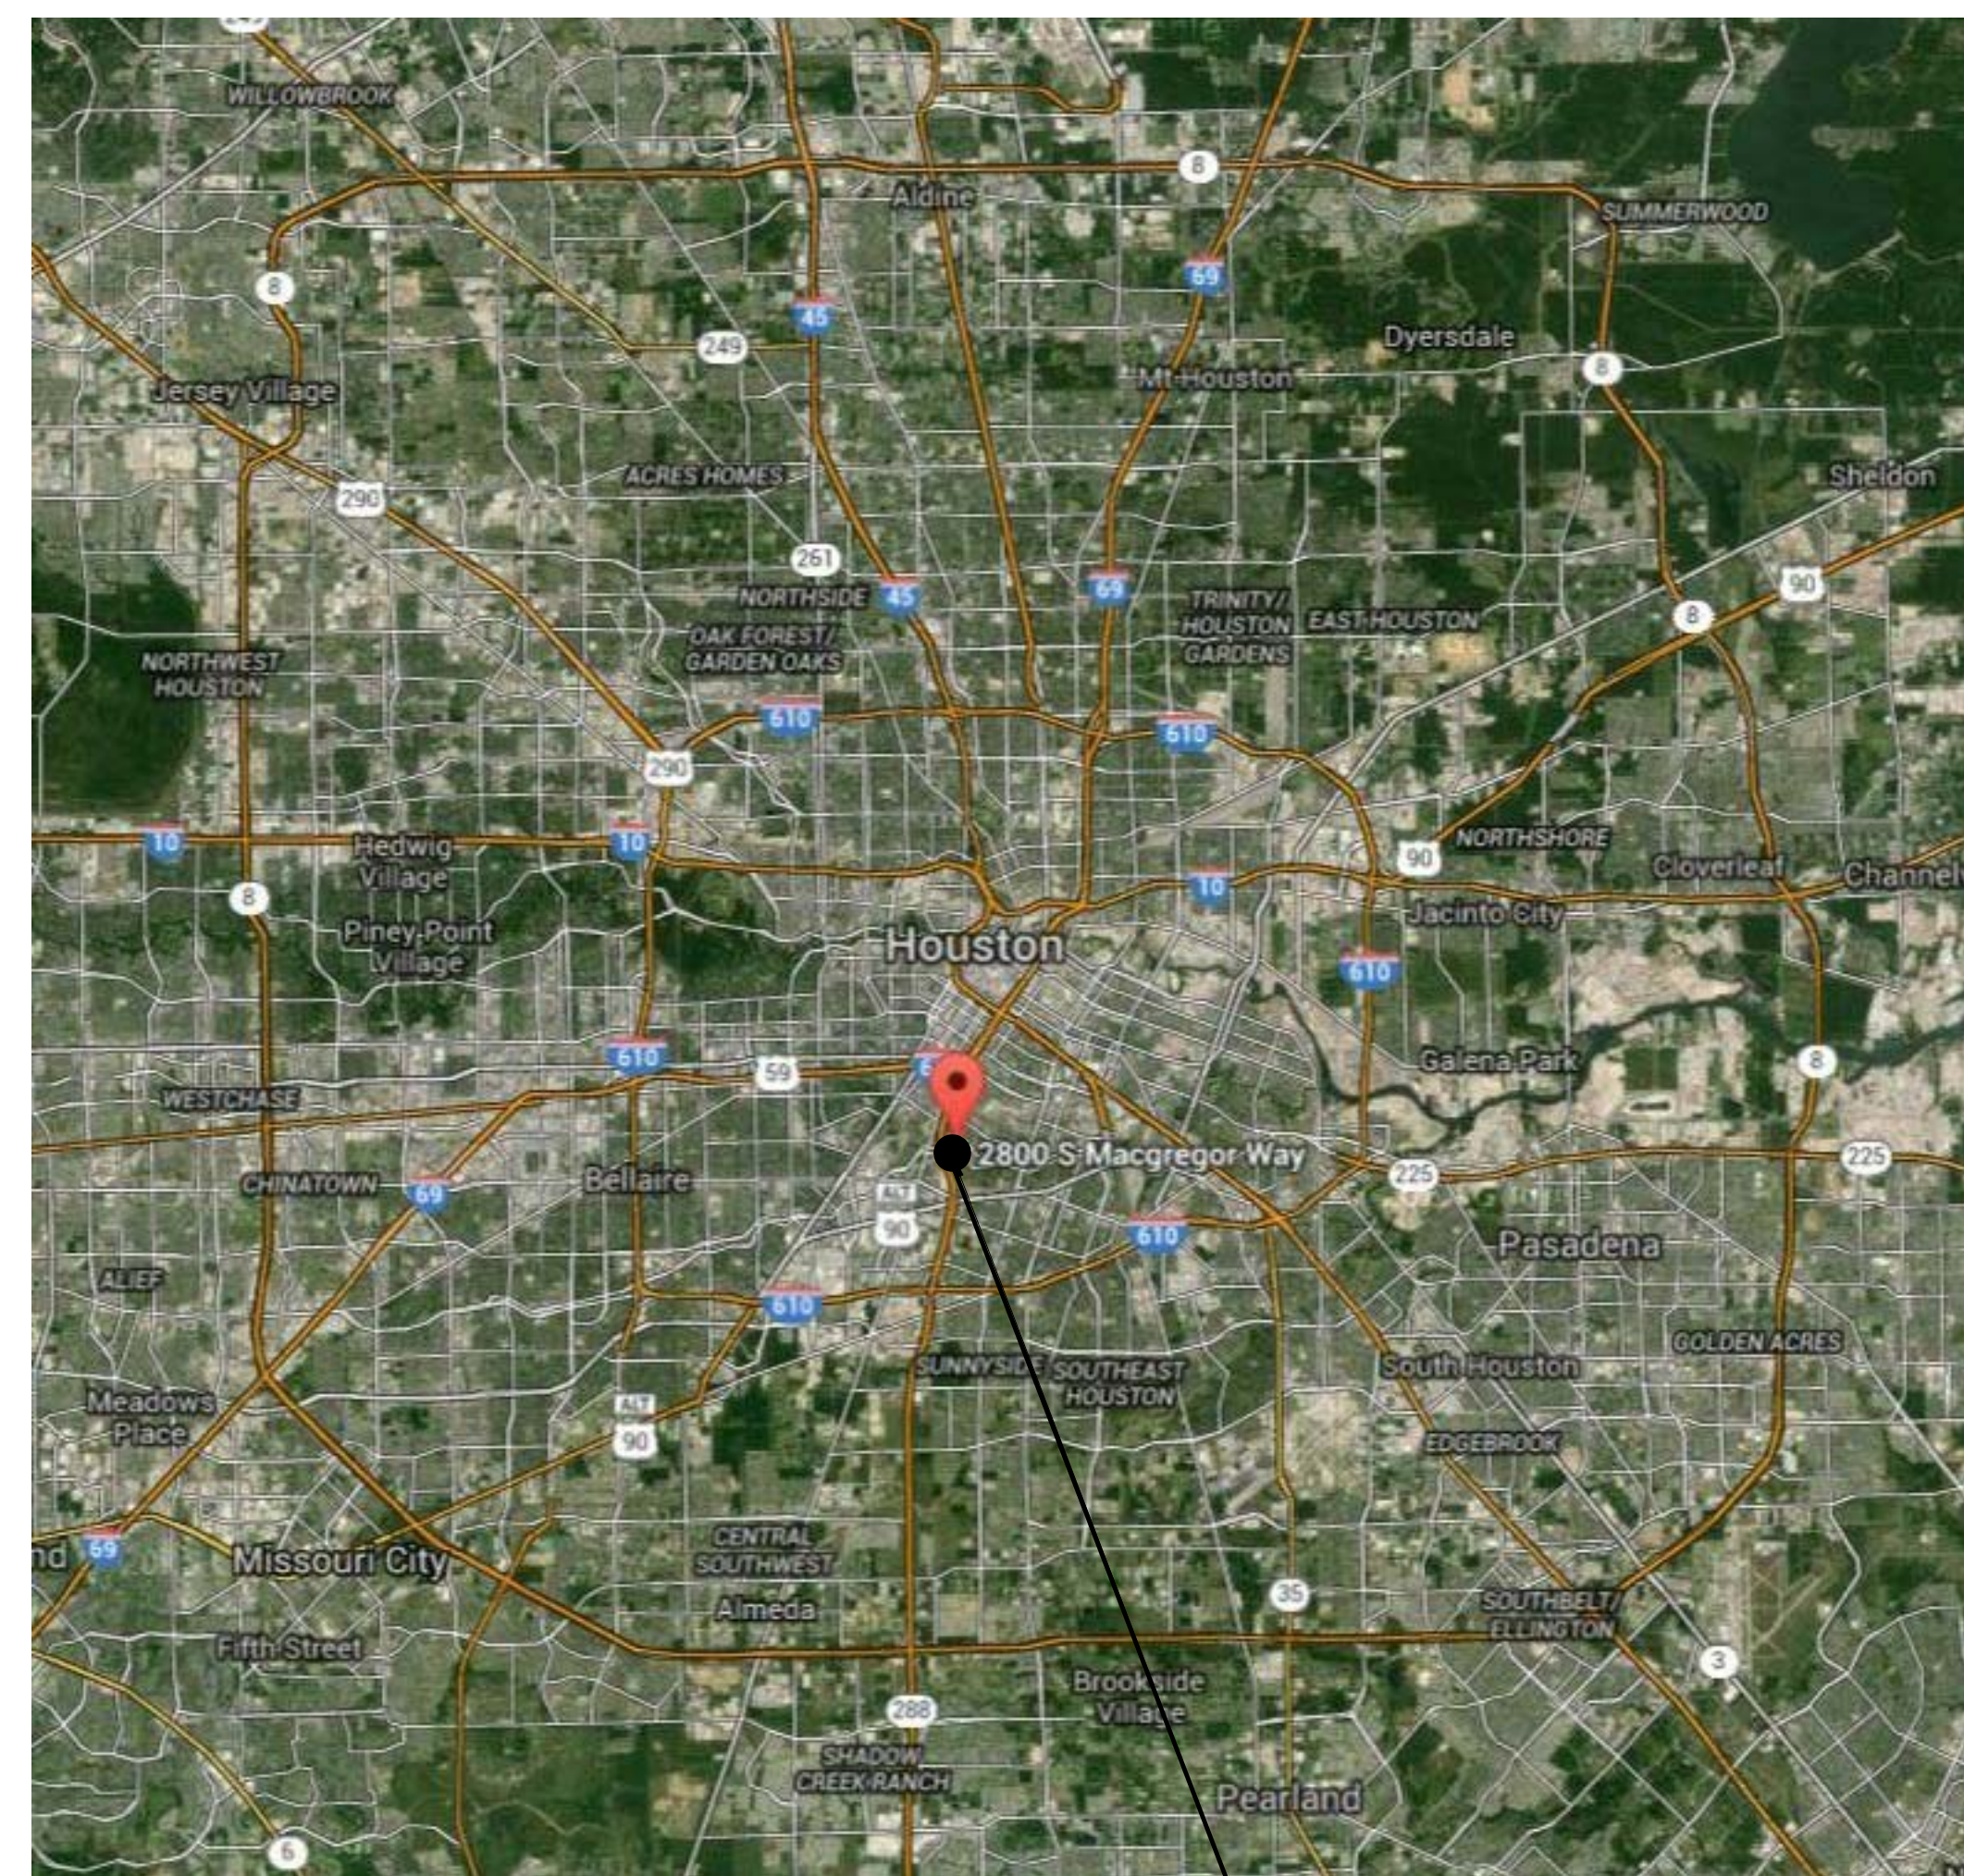

## DRAWING CONVENTIONS

PROPERTY LINE  
AREA DRAIN  
EXISTING ELEVATION  
FINISH GRADE ELEVATION  
NORTH SYMBOL  
COLUMN LINE  
FLOOR LINE  
MATCH LINE  
SECTION CALLOUT SYMBOL  
EXTERIOR ELEVATION SYMBOL  
INTERIOR ELEVATION SYMBOL  
DOOR DESIGNATION  
WINDOW DESIGNATION  
PARTITION TYPE  
EXISTING PARTITION  
NEW PARTITION  
REVISION NUMBER  
DETAIL ENLARGED  
PLAN OR DETAIL ENLARGED  
DETAIL SECTIONS AND VERTICAL SECTIONS  
DIMENSIONS

SPOT ELEVATION  
SPOT COORDINATE  
MATCH LINE  
SHEET NUMBER ON WHICH CONTINUATION IS FOUND  
PROPERTY LINE  
FENCING (WITH POSTS)  
BREAK LINE  
KEY NOTE  
ROOM NAME AND NUMBER  
FIRE HOSE CABINET (RECESSED AND SURFACE MOUNTED)  
FIRE EXTINGUISHER CABINET (RECESSED AND SURFACE MOUNTED)  
EQUIPMENT DESIGNATION  
TOILET ACCESSORY SYMBOL  
SHOWER HEAD  
FLOOR SINK  
FLOOR DRAIN  
OVERFLOW DRAIN AND ROOF DRAIN  
OVERFLOW DRAIN  
ROOF DRAIN  
ROOF TOP UNIT REFER TO MECHANICAL FOR TYPE  
GRAPHIC SCALE  
SCALE: 1" = 4'-0"

NOTE: All dimensions to face of wall unless otherwise noted.

## MATERIALS CONVENTIONS

<b>02 SITE CONSTRUCTION</b>	<b>06 WOODS AND PLASTICS</b>
<b>03 CONCRETE</b>	
<b>04 MASONRY</b>	
	<b>07 THERMAL &amp; MOISTURE PROTECTION</b>
	<b>08 GLAZING</b>
<b>05 METALS</b>	
	<b>09 FINISHES</b>

## SHEET NUMBERING

SHEET NUMBER **A2.01A** BUILDING AREA

SEQUENCE (01 - 99... etc.)

SHEET DISCIPLINE TYPE

DISCIPLINE  
G - GENERAL (Cover, AD Sheets)  
C - CIVIL  
L - LANDSCAPE  
D - DEMO  
A - ARCHITECTURAL  
S - STRUCTURAL  
I - INTERIORS  
M - MECHANICAL  
E - ELECTRICAL  
P - PLUMBING  
T - TECHNOLOGY

0 - GENERAL  
1 - SITE PLANS & DETAILS  
2 - FLOOR PLANS (Note: Flip Sheets are Schedules)  
3 - ROOF  
4 - ADA & ENLARGED PLANS  
5 - PLAN DETAILS  
6 - EXTERIOR/INTERIOR ELEVATIONS  
7 - PARTITION TYPES & WALL SECTIONS  
8 - CASEWORK ELEVATIONS  
9 - WINDOWS, DOORS, FRAME ELEVATIONS & DETAILS  
10 - REFLECTED CEILING PLANS & DETAILS



TOILET ACCESSORIES		
LABEL	DESCRIPTION	REMARKS
TA1	SOAP DISPENSER	NOT USED
TA2	24" X 48" MIRROR	
TA3	RECESSED TOILET PAPER DISPENSER	
TA4	RECESSED PAPER TOWEL DISPENSER	
TA5	GRAB BARS AT TYPICAL H.C. TOILET STALL	
TA6	SANITARY NAPKIN DISPENSER	NOT USED
TA7	SANITARY NAPKIN DISPOSAL	NOT USED
TA8	MOP & BROOM HOLDER	NOT USED
TA9	GRAB BARS AT ACCESSIBLE SHOWER	
TA10	FOLDING SHOWER BENCH	NOT USED
TA11	CLOTHES HOOK	
TA12	SHOWER CURTAIN, TRACK AND HOOKS	
TA13	ELECTRIC HAND DRYER	NOT USED
TA14	COMBO PAPER TOWEL DISPENSER/TRASH RECEPTACLE	NOT USED
TA15	GRAB BARS AT ALTERNATE ACCESSIBLE TOILET STALL	NOT USED
TA16	CHANGING STATION	NOT USED
TA17	TRASH RECEPTACLE	NOT USED



**NOTE:** ALL TOILET ACCESSORIES SHALL BE CONTRACTOR FURNISHED AND INSTALLED UNLESS NOTED OTHERWISE

- COORDINATE FINAL LOCATIONS WITH ARCHITECT PRIOR TO INSTALLATION.
- CONTRACTOR IS TO VERIFY ALL HEIGHTS OF ACCESSORIES TO COMPLY WITH ADA.
- REFER TO ALL FINISHES AND COLORS IN FINISH SCHEDULE. VERIFY ALL PATTERNS WITH ARCHITECT.
- ALIGN MIRROR ON CENTER OF LAVATORY.
- ONE HOOK INSIDE DOOR AT SINGLE TOILET ROOMS AND ONE HOOK AT EACH SHOWER.

DESCRIPTION	Ages: ADULT
WATER CLOSET: To Top of Seat	17"-19"
Grab Bars:	33"-36"
URINAL: Max. to Rim of Basin	17"
<b>LAVATORIES:</b>	
Frontal Approach:	
Min. Knee Clearance	29"
Max. To Top	34"
Side Approach:	
Max. To Top	34"
<b>FIXED OR BUILT-IN:</b>	
Height of Tables or Counter:	28"-34"
Knee Clearance: Max.	27"
<b>Shelves &amp; Dispensers: Max. Height to Control Device</b>	
Frontal Approach: Max.	48"
Side Approach: Max.	54"
<b>DRINKING FOUNTAINS:</b>	
Max. to Spout	36"
Knee Clearance: Min.	27"
<b>SWITCHES AND CONTROLS</b>	
Frontal Approach - Max.	48"
Side Approach - Max.	54"
MIRROR (to bottom of reflective surface - max.)	40" max.
TOILET PAPER DISPENSER (to Center of Roll)	19"
PAPER TOWEL DISPENSER (to Operating Mechanism)	48"
<b>SHOWER</b>	
Top of Seat	17"-19"
Grab Bar	33"-36"
Max. to Hand Shower Head Mounting	48"
CHALKBOARDS/TACKBOARDS	COORDINATE WITH OWNER PRIOR TO INSTALLATION TO ESTABLISH MOUNTING HGT.

**NOTE:** ACCESSORIES, FIXTURES, AND DEVICES LISTED HERE ARE INTENDED TO BE REPRESENTATIVE OF ALL POSSIBLE CONDITIONS. NOT ALL CONDITIONS APPLY TO THIS PROJECT. REFER TO PLANS AND ELEVATIONS FOR PROJECT-SPECIFIC CONDITIONS.

HARRIS COUNTY PSYCHIATRIC CENTER RENOVATION UNITS: 1C, 2E, 3B, 3C, 3D & 3E

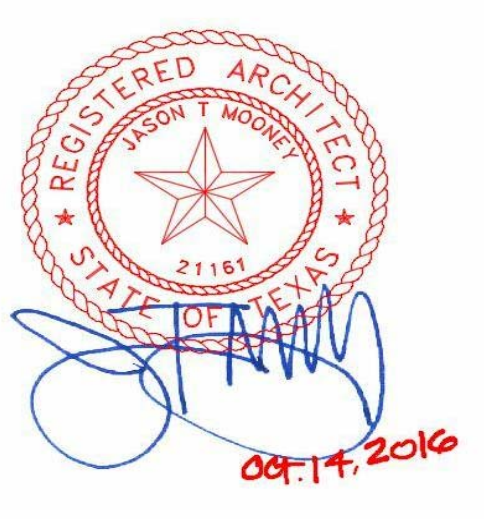
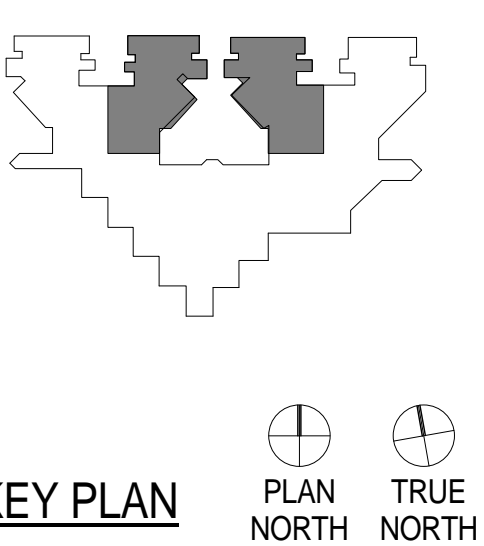


CLIENT		
UT HEALTH		
PROJECT NUMBER		
16106		
DATE:	OCTOBER 14, 2016	
DRAWN BY:	VG/BG	
CHECKED BY:	JM/CS	
REVISIONS		
No.	Description	Date

ISSUE FOR BID


ADA GUIDELINES

G0.02

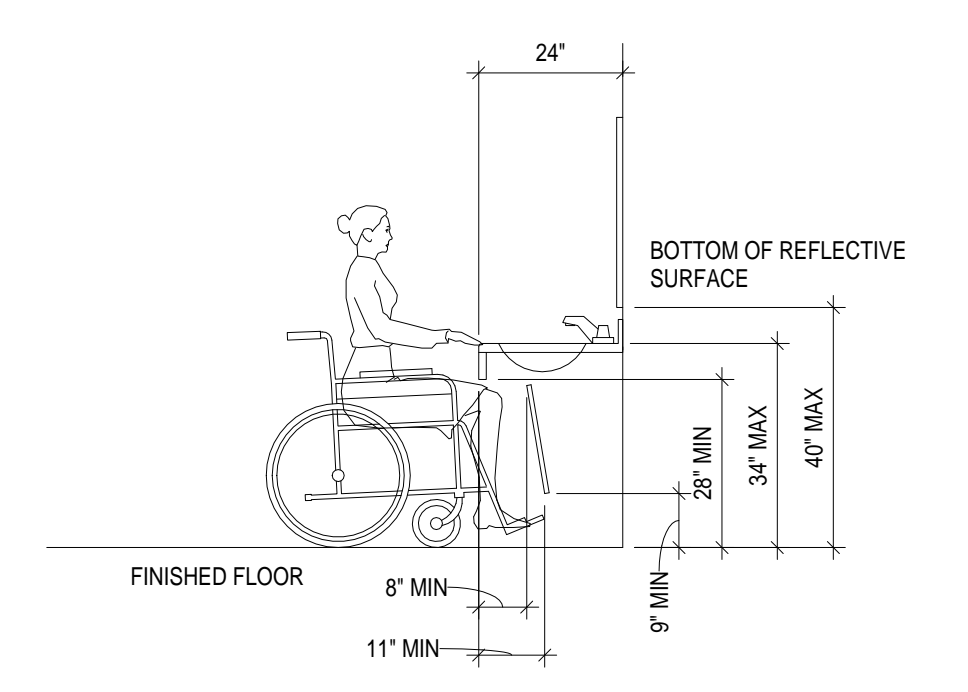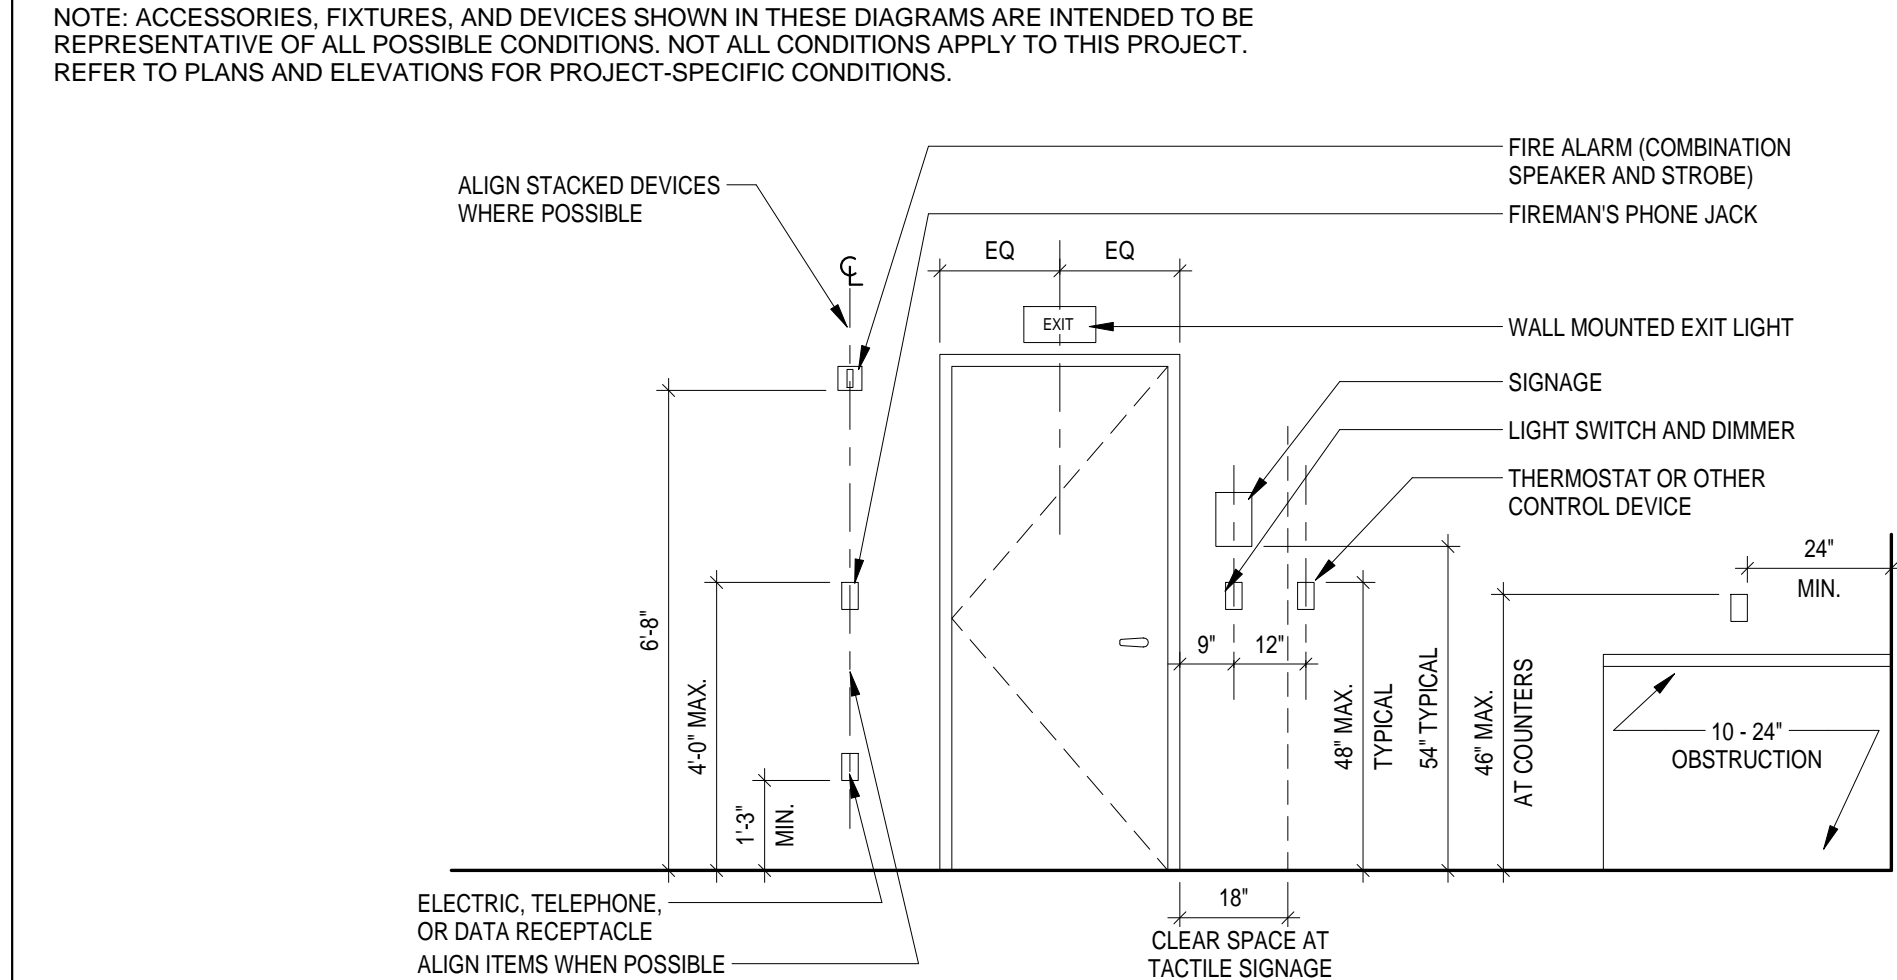

10 MISC. MOUNTING HEIGHTS  
3/8" = 1'-0"


9 ACCESSIBLE VANITY  
3/8" = 1'-0"

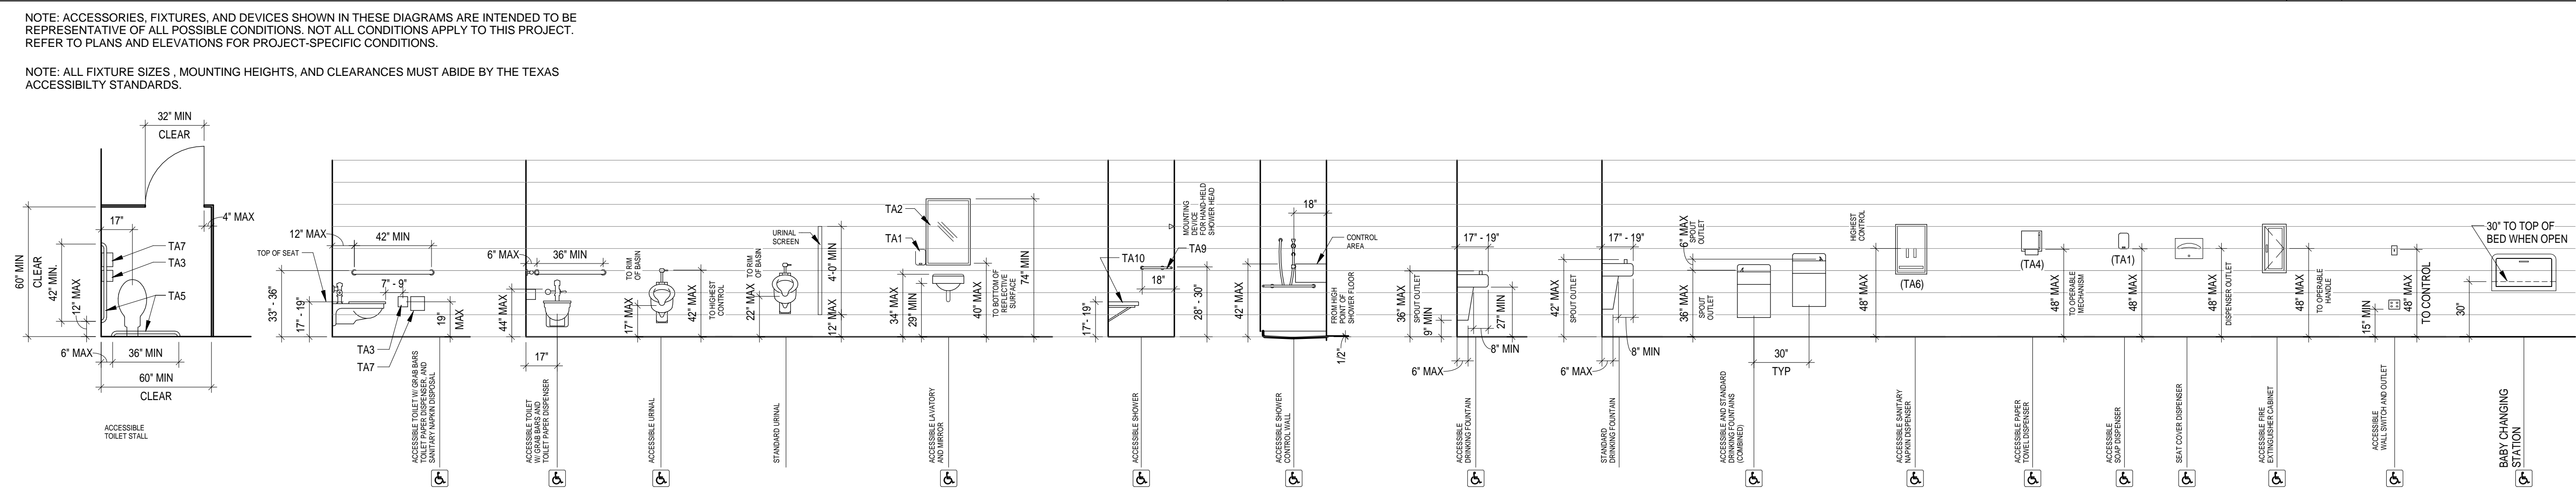

6 ADA STANDARDS  
1/4" = 1'-0"



**HARRIS COUNTY PSYCHIATRIC  
CENTER RENOVATION UNITS: 1C,  
2E, 3B, 3C, 3D & 3E**

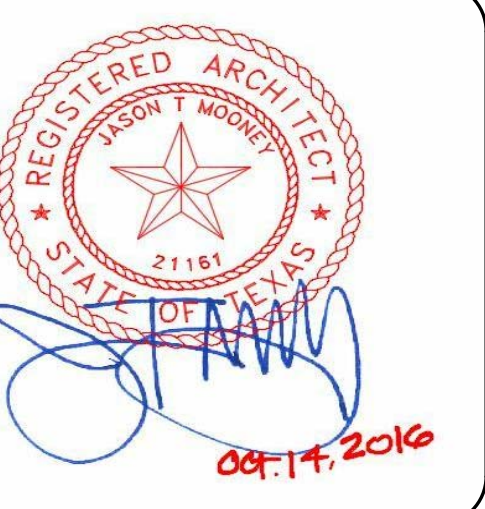


CLIENT	UT HEALTH
PROJECT NUMBER	16106
DATE:	OCTOBER 14, 2016
DRAWN BY:	VICTORIA GARCIA
CHECKED BY:	JASON MOONEY
REVISIONS	

No.	Description	Date


ISSUE FOR BID

**SIGNAGE TYPES**

**G0.03**

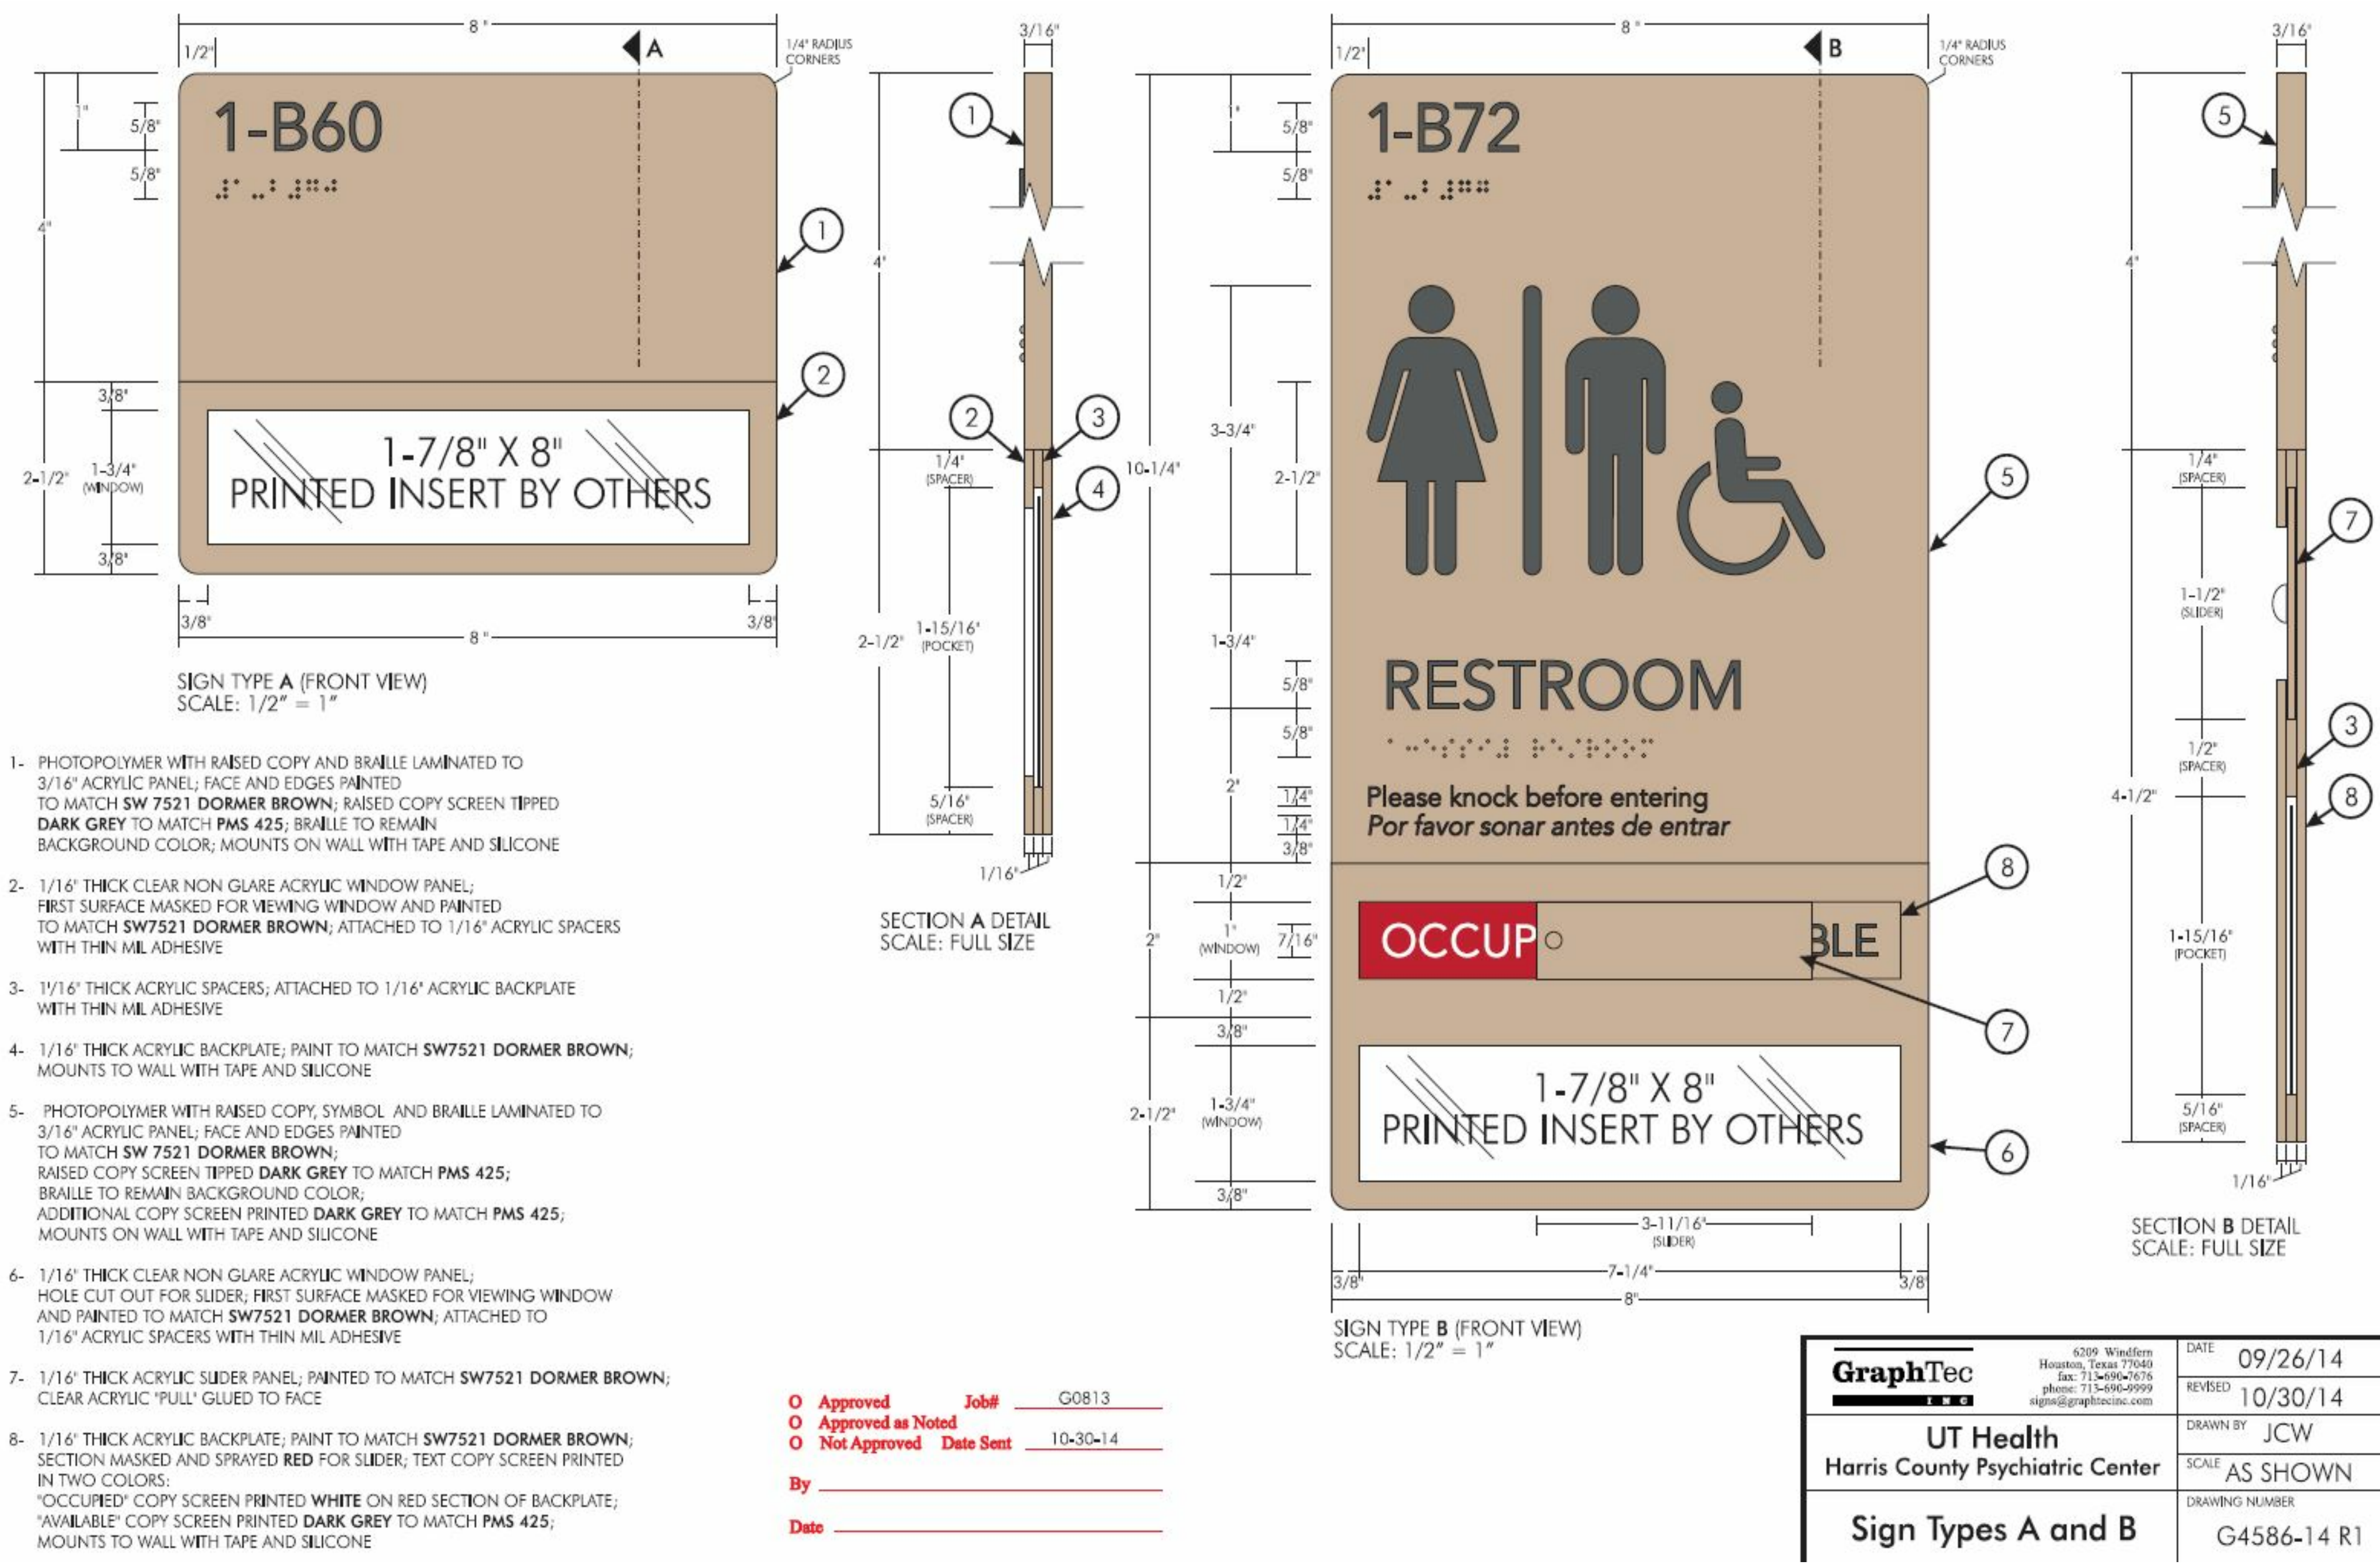

Approved	Job#	G0813
Approved as Noted		
Not Approved	Date Sent	10-30-14
By		
Date		

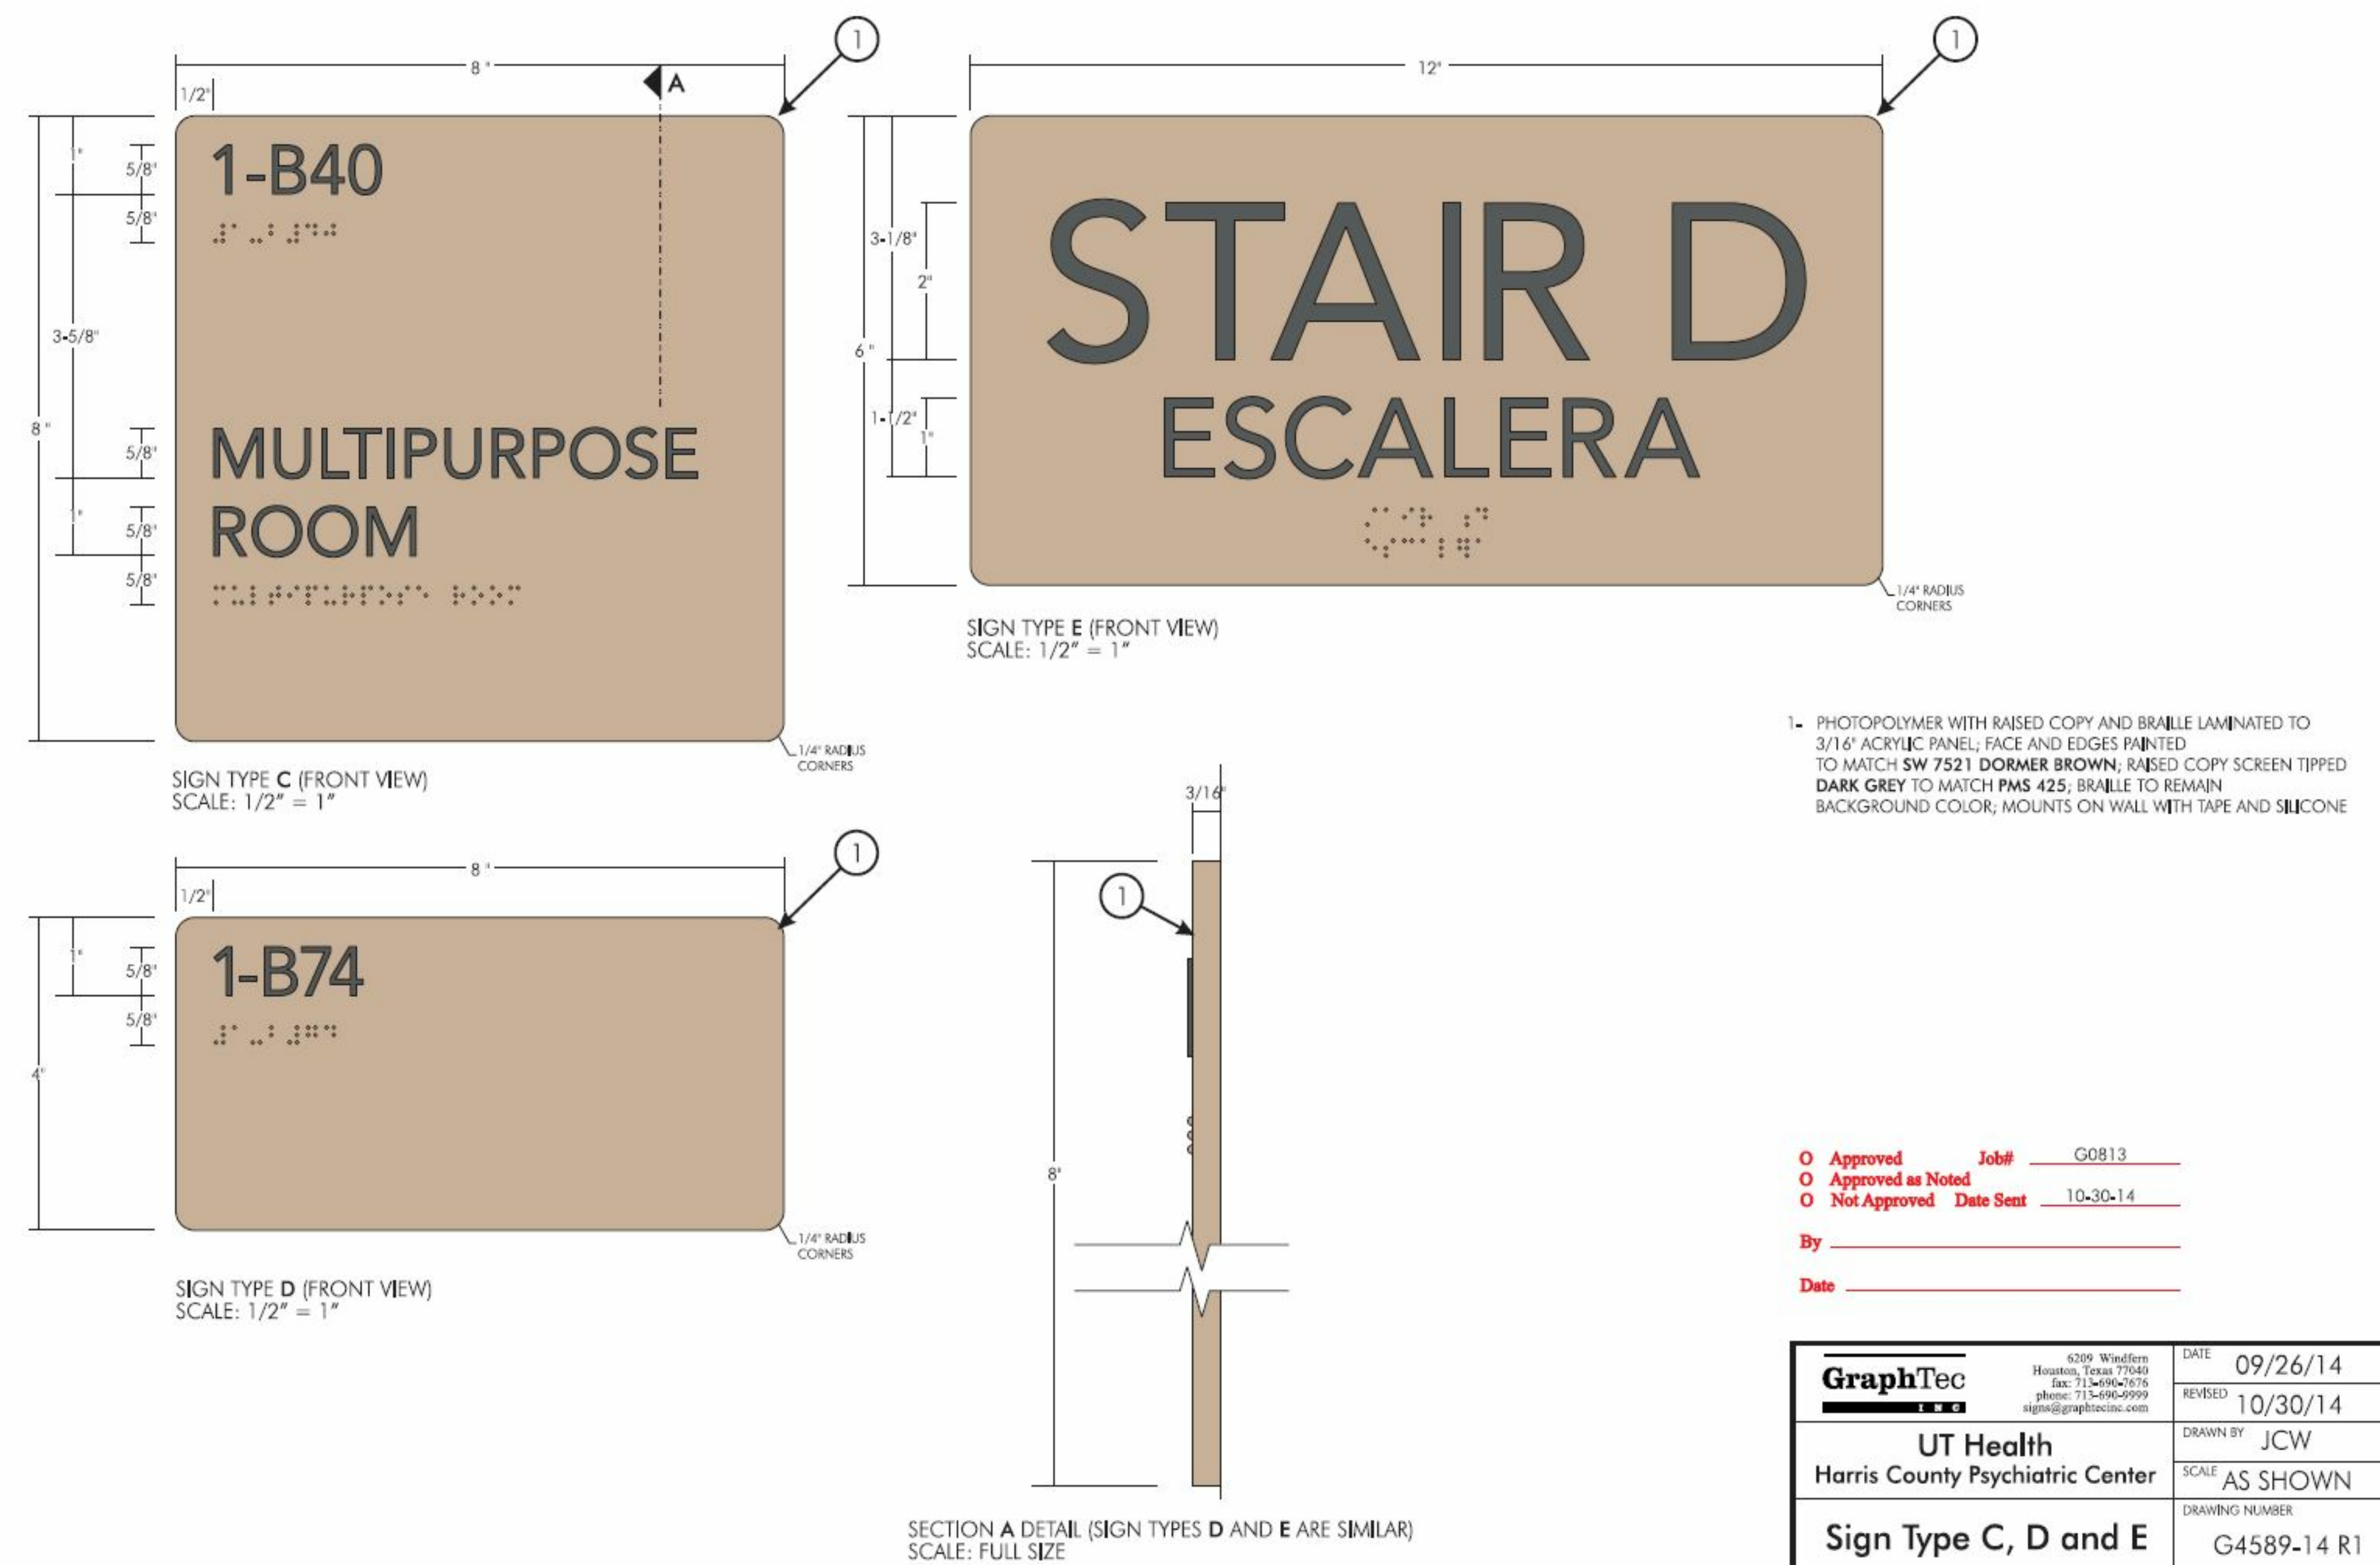



Approved	Job#	G0813
Approved as Noted		
Not Approved	Date Sent	10-30-14
By		
Date		

NOTE: SIGNAGE TYPES FOR REFERENCE ONLY

NOTE: SIGNAGE TYPES FOR REFERENCE ONLY



HARRIS COUNTY PSYCHIATRIC  
CENTER RENOVATION UNITS: 1C,  
2E, 3B, 3C, 3D & 3E

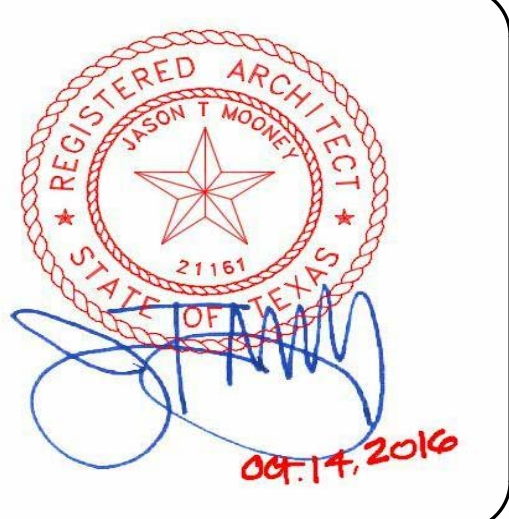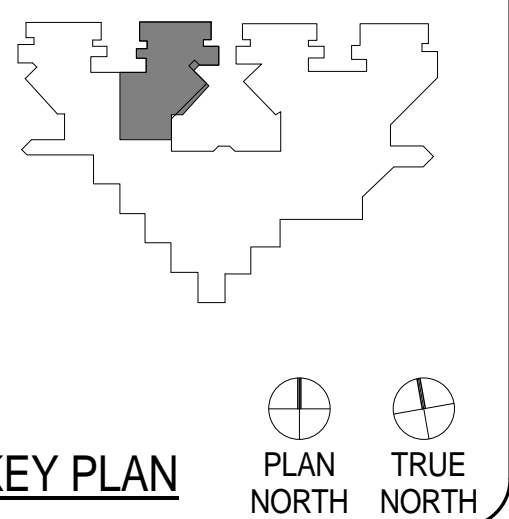

CLIENT UT HEALTH		
PROJECT NUMBER 16106		
DATE:	OCTOBER 14, 2016	
DRAWN BY:	VG/BG	
CHECKED BY:	JM/CS	
REVISIONS		
No.	Description	Date



ISSUE FOR BID  
**COMPOSITE PLAN -  
FIRST FLOOR**

**A1.01**

PROJECT GENERAL INFORMATION	
Name of Project	HARRIS COUNTY PSYCHIATRIC CENTER RENOVATION UNITS 1C, 2E, 3B, 3C, 3D, & 3E
Building/ Facility Name:	HARRIS COUNTY PSYCHIATRIC CENTER
Location/ Address:	2800 S. MaGREGOR WAY, HOUSTON, TX 77021
Description of Project:	INTERIOR RENOVATION OF EXISTING PATIENT UNITS
Applicable Building Codes :	N/A
Accessibility	2012 TEXAS ACCESSIBILITY STANDARDS
Overall Type of Construction:	TYPE EXISTING I-B
Mixed Type of Construction:	N/A
Occupancy Classification(s):	I-2
Overall Use of Building:	PSYCHIATRIC FACILITY
High Rise Building:	N/A
Automatic Fire Sprinkler System :	YES (EXISTING)
Type of Automatic Fire Sprinkler System:	EXISTING; RE: MEP DRAWINGS
Standpipe System	RE: MEP DRAWINGS
Active Fire Safety Systems:	EXISTING
Maximum Common Path (A-2 & A-3/ B w/ sprinkler) :	100 FT (I-2 OCCUPANCY WITHIN CARE SUITE)
Maximum Exit Distance (A-2 & A-3/ B w/ sprinkler) :	200 FT
Corridor Fire Resistance Rating	0 HRS (MUST BE SMOKE TIGHT)
Corridor Width	8 FT (WHERE REQUIRED FOR BED MOVEMENT) OR AS SHOWN 96 INCHES

ALLOWABLE HEIGHTS AND AREAS	
Occupancy Classification	I-2
Allowable Height Stories (w/ sprinkler increase)	5
Allowable Height in Feet (w/ sprinkler increase)	180
Allowable Area (SF)	UL
Frontage Increase (###%) (SF)	N/A
Sprinkler Increase (###%) (SF)	N/A
Total Allowable Area per Story (SF)	UL

LIFE SAFETY LEGEND	
	EXISTING SMOKE PARTITION
	EXISTING SMOKE PARTITION (SP)
	EXISTING SMOKE BARRIER (SB) / 30min
	EXISTING FIRE BARRIER (F) / 1hr
	EXISTING FIRE BARRIER (F) / 2hr
	EXISTING FIRE BARRIER (F) / 3hr
	EXISTING PARTITION
	NEW PARTITION
	EXISTING EXIT LOCATION
	FIRE RATING OF DOOR IN MINUTES
	EXISTING FIRE EXTINGUISHER CABINET
	EXISTING FIRE EXTINGUISHER
	EXIT LIGHT FIXTURE W/ DIRECTION, SOLID FILL DENOTES FACE OF EXIT FIXTURE
	LONGEST ROUTE TO AN EXIT
	MHO

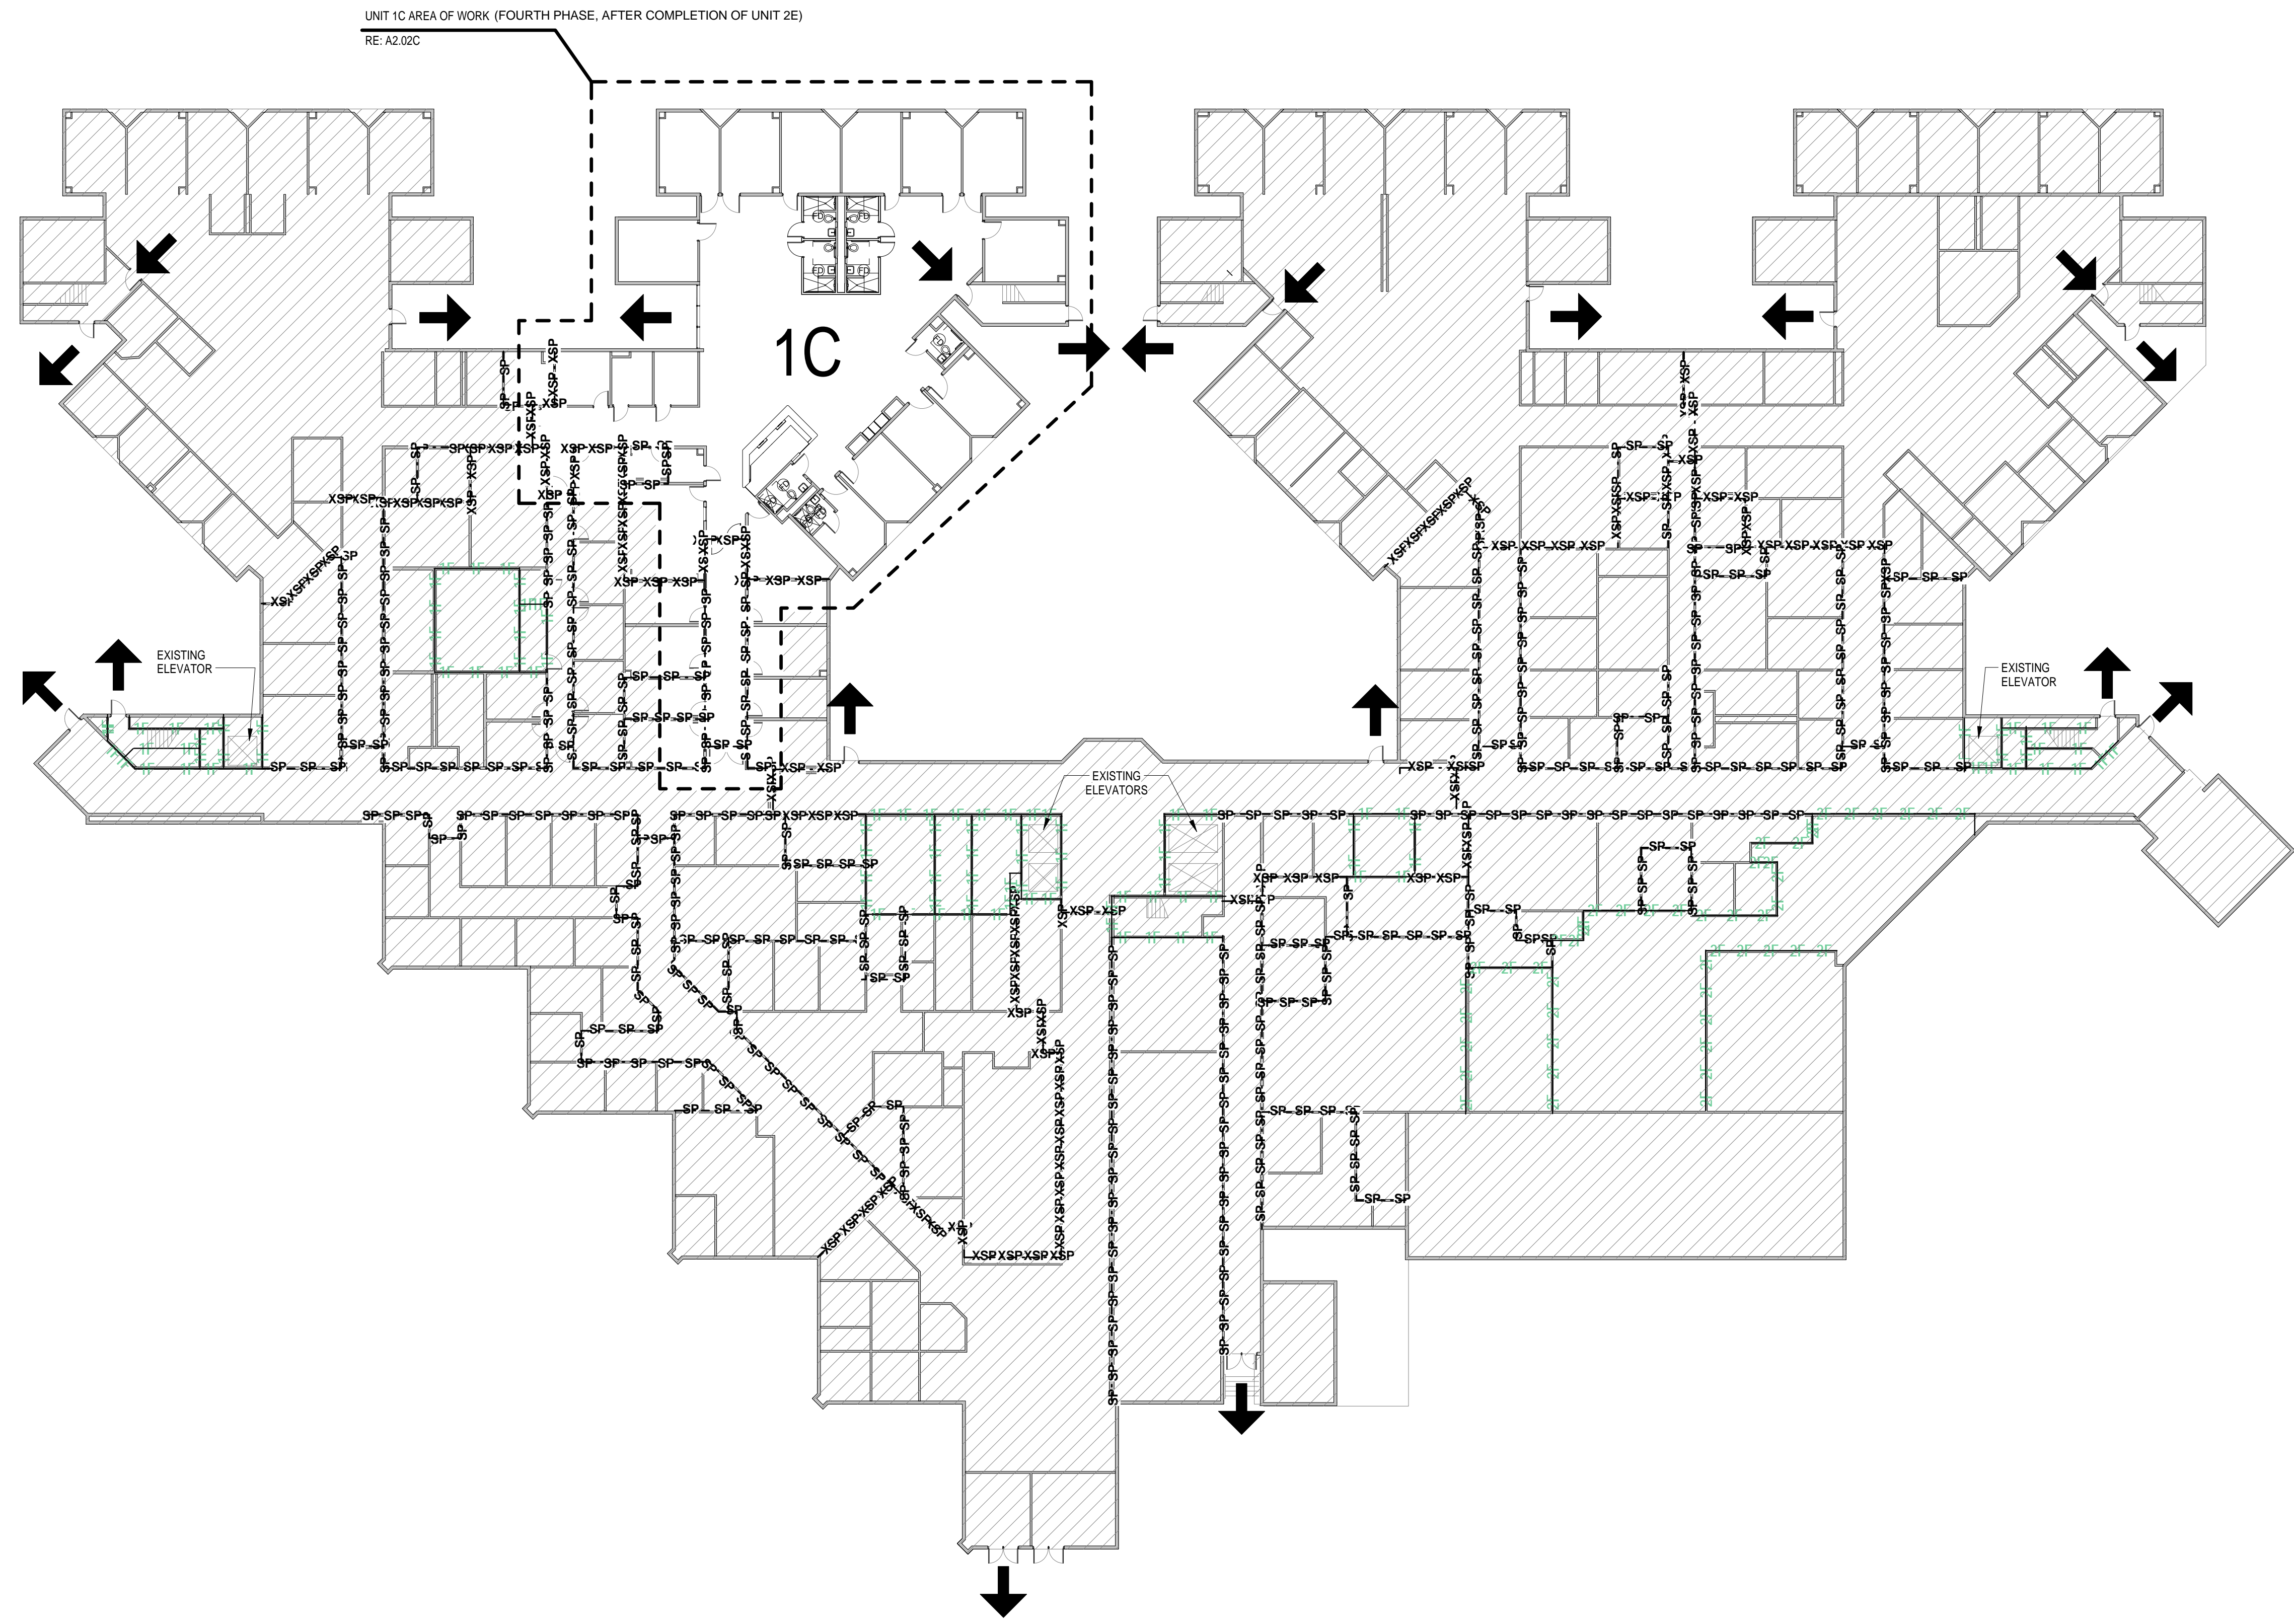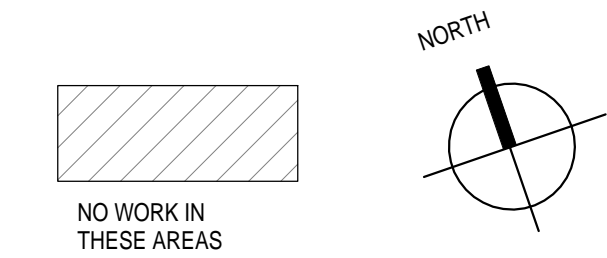

UNIT 1C AREA OF WORK (FOURTH PHASE, AFTER COMPLETION OF UNIT 2E)  
RE: A2.02C




PROJECT GENERAL INFORMATION	
Name of Project	HARRIS COUNTY PSYCHIATRIC CENTER RENOVATION UNITS 1C, 2E, 3B, 3C, 3D, & 3E
Building/ Facility Name:	HARRIS COUNTY PSYCHIATRIC CENTER
Location/ Address:	2800 S. MARGREGOR WAY, HOUSTON, TX 77021
Description of Project:	INTERIOR RENOVATION OF EXISTING PATIENT UNITS
Applicable Building Codes :	N/A
Accessibility	2012 TEXAS ACCESSIBILITY STANDARDS
Overall Type of Construction:	TYPE EXISTING I-B
Mixed Type of Construction:	N/A
Occupancy Classification(s):	I-2
Overall Use of Building:	PSYCHIATRIC FACILITY
High Rise Building:	N/A
Automatic Fire Sprinkler System :	YES (EXISTING)
Type of Automatic Fire Sprinkler System :	EXISTING, RE: MEP DRAWINGS
Standpipe System	RE: MEP DRAWINGS
Active Fire Safety Systems:	EXISTING
Maximum Common Path (A-2 & A-3/ B w/ sprinkler) :	100 FT (I-2 OCCUPANCY WITHIN CARE SUITE)
Maximum Exit Distance (A-2 & A-3/ B w/ sprinkler) :	200 FT
Corridor Fire Resistance Rating	0 HRS (MUST BE SMOKE TIGHT)
Corridor Width	8 FT (WHERE REQUIRED FOR BED MOVEMENT) OR AS SHOWN 96 INCHES

OCCUPANT INFORMATION							
Query (Occupants)	Number of Occupants	Egress Stair Width (in.)		Exits		Egress Door Width (in.)	
		Required (.2')	Provided	Required	Provided	Required	Provided
First Floor							
Second Floor							
Third Floor							


ALLOWABLE HEIGHTS AND AREAS	
Occupancy Classification	I-2
Allowable Height Stories (w/ sprinkler increase)	5
Allowable Height in Feet (w/ sprinkler increase)	180
Allowable Area (SF)	UL
Frontage Increase (###%) (SF)	N/A
Sprinkler Increase (###%) (SF)	N/A
Total Allowable Area per Story (SF)	UL

LIFE SAFETY LEGEND

- EXISTING SMOKE PARTITION
- EXISTING SMOKE PARTITION (SP)
- EXISTING SMOKE BARRIER (SB) / 30min
- EXISTING FIRE BARRIER (F) / 1hr
- EXISTING FIRE BARRIER (F) / 2hr
- EXISTING FIRE BARRIER (F) / 3hr
- EXISTING PARTITION
- NEW PARTITION
- EXISTING EXIT LOCATION
- FIRE RATING OF DOOR IN MINUTES
- EXISTING FIRE EXTINGUISHER CABINET
- EXISTING FIRE EXTINGUISHER
- EXIT LIGHT FIXTURE W/ DIRECTION, SOLID FILL DENOTES FACE OF EXIT FIXTURE
- LONGEST ROUTE TO AN EXIT
- MAGNETIC HOLD OPEN


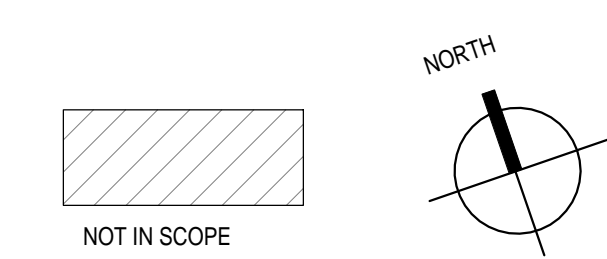


UNIT 2E AREA OF WORK (THIRD PHASE, AFTER COMPLETION OF UNIT 3E)  
RE: A2.05

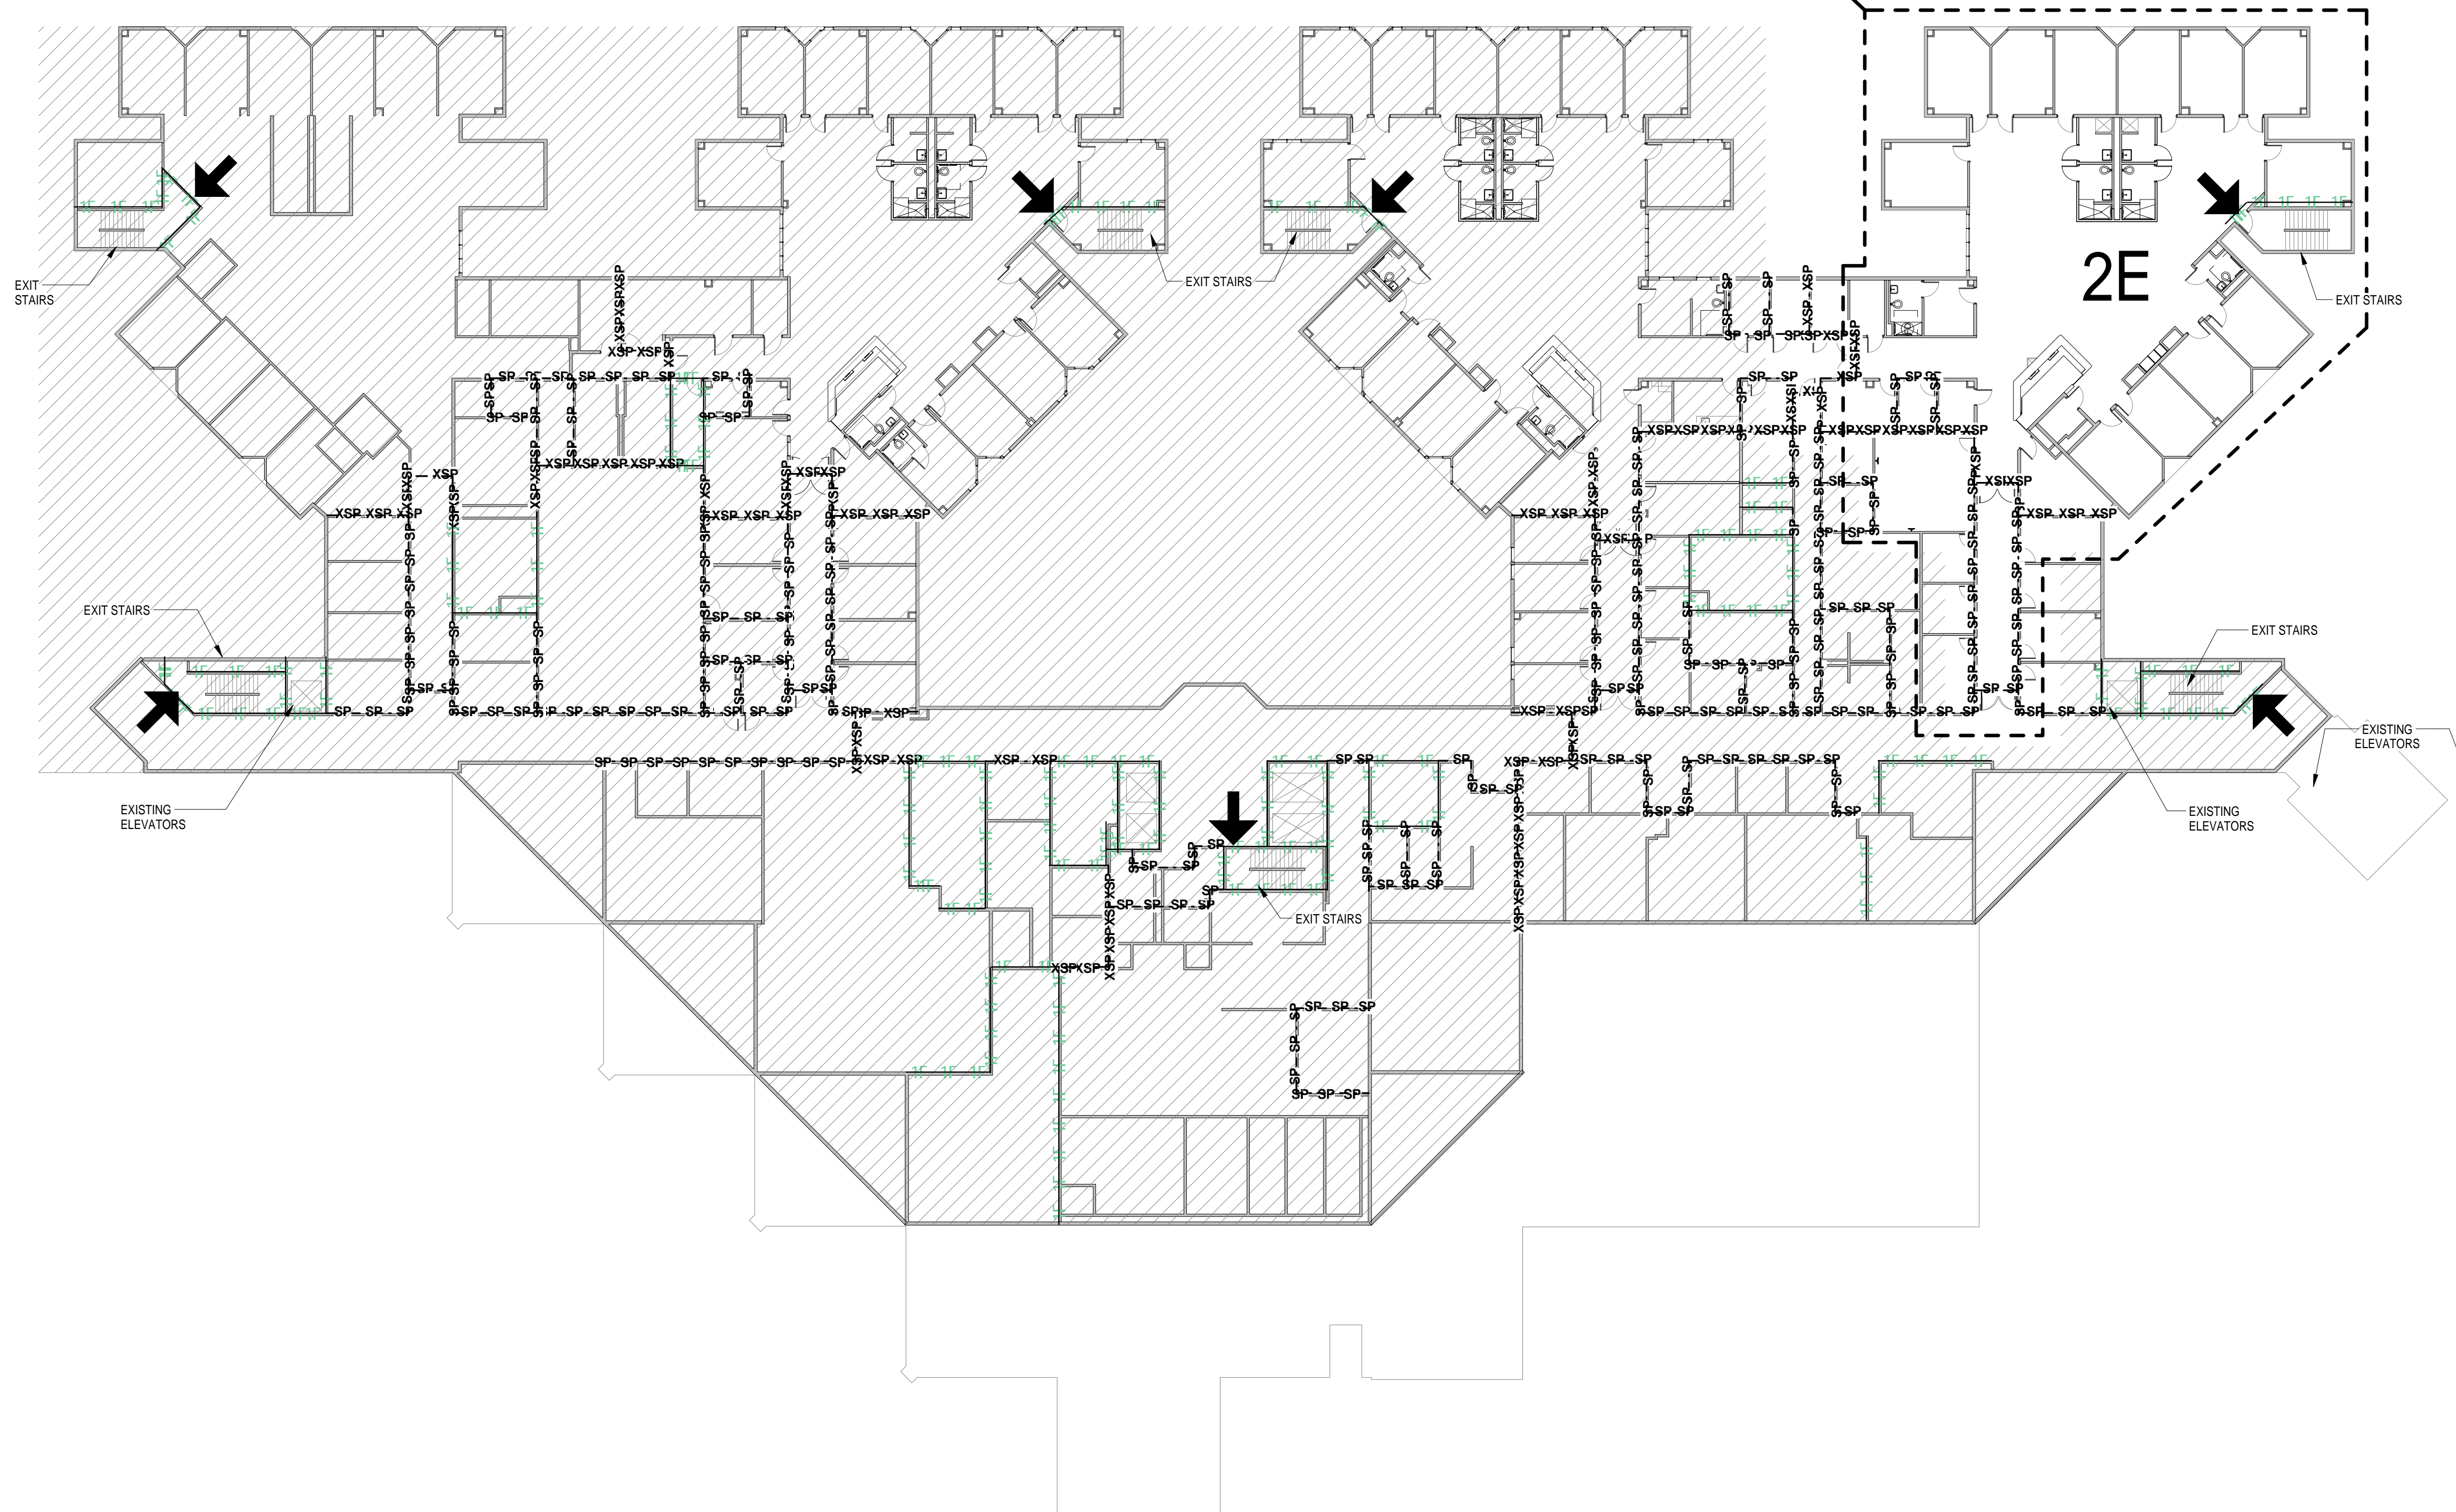



**HARRIS COUNTY PSYCHIATRIC CENTER RENOVATION UNITS: 1C, 2E, 3B, 3C, 3D & 3E**

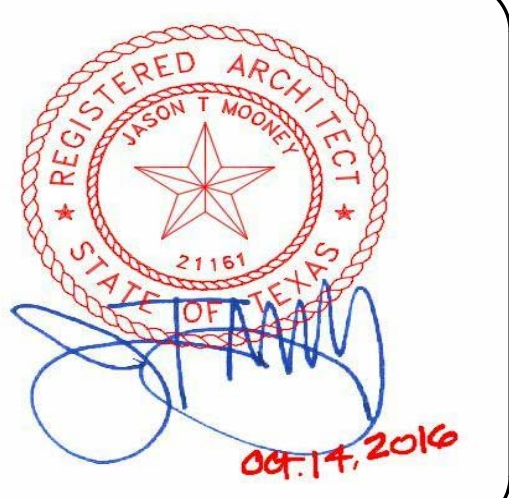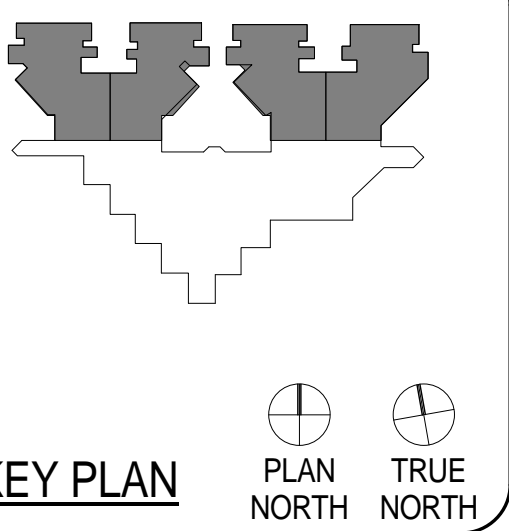

CLIENT UT HEALTH		
PROJECT NUMBER 16106		
DATE:	OCTOBER 14, 2016	
DRAWN BY:	VG/BG	
CHECKED BY:	JM/CS	
REVISIONS		
No.	Description	Date

ISSUE FOR BID  
**COMPOSITE PLAN - THIRD FLOOR**

**A1.03**



PROJECT GENERAL INFORMATION	
Name of Project	HARRIS COUNTY PSYCHIATRIC CENTER RENOVATION UNITS 1C, 2E, 3B, 3C, 3D, & 3E
Building/ Facility Name:	HARRIS COUNTY PSYCHIATRIC CENTER
Location/ Address:	2800 S. MAGREGOR WAY, HOUSTON, TX 77021
Description of Project:	INTERIOR RENOVATION OF EXISTING PATIENT UNITS
Applicable Building Codes :	N/A
Accessibility	2012 TEXAS ACCESSIBILITY STANDARDS
Overall Type of Construction:	TYPE EXISTING I-B
Mixed Type of Construction:	N/A
Occupancy Classification(s):	I-2
Overall Use of Building:	PSYCHIATRIC FACILITY
High Rise Building:	N/A
Automatic Fire Sprinkler System :	YES (EXISTING)
Type of Automatic Fire Sprinkler System :	EXISTING; RE: MEP DRAWINGS
Standpipe System	RE: MEP DRAWINGS
Active Fire Safety Systems:	EXISTING
Maximum Common Path (A-2 & A-3/ B w/ sprinkler) :	100 FT (I-2 OCCUPANCY WITHIN CARE SUITE)
Maximum Exit Distance (A-2 & A-3/ B w/ sprinkler) :	200 FT
Corridor Fire Resistance Rating	0 HRS (MUST BE SMOKE TIGHT)
Corridor Width	8 FT (WHERE REQUIRED FOR BED MOVEMENT) OR AS SHOWN 96 INCHES

OCCUPANT INFORMATION							
Query (Occupants)	Number of Occupants	Egress Stair Width (in.)		Exits		Egress Door Width (in.)	
		Required (.2')	Provided	Required	Provided	Required	Provided
First Floor							
Second Floor							
Third Floor							


ALLOWABLE HEIGHTS AND AREAS	
Occupancy Classification	I-2
Allowable Height Stories (w/ sprinkler increase)	5
Allowable Height in Feet (w/ sprinkler increase)	180
Allowable Area (SF)	UL
Frontage Increase (###%) (SF)	N/A
Sprinkler Increase (###%) (SF)	N/A
Total Allowable Area per Story (SF)	UL

**LIFE SAFETY LEGEND**

- EXISTING SMOKE PARTITION
- EXISTING SMOKE PARTITION (SP)
- EXISTING SMOKE BARRIER (SB) / 30min
- EXISTING FIRE BARRIER (F) / 1hr
- EXISTING FIRE BARRIER (F) / 2hr
- EXISTING FIRE BARRIER (F) / 3hr
- EXISTING PARTITION
- NEW PARTITION
- EXISTING EXIT LOCATION
- FIRE RATING OF DOOR IN MINUTES
- EXISTING FIRE EXTINGUISHER CABINET
- EXISTING FIRE EXTINGUISHER
- EXIT LIGHT FIXTURE W/ DIRECTION, SOLID FILL DENOTES FACE OF EXIT FIXTURE
- LONGEST ROUTE TO AN EXIT
- MAGNETIC HOLD OPEN

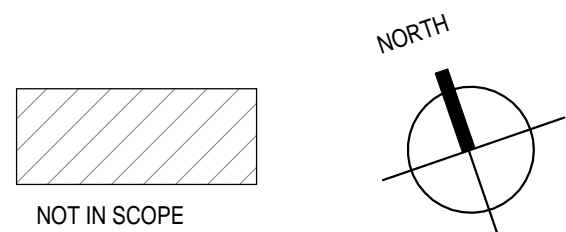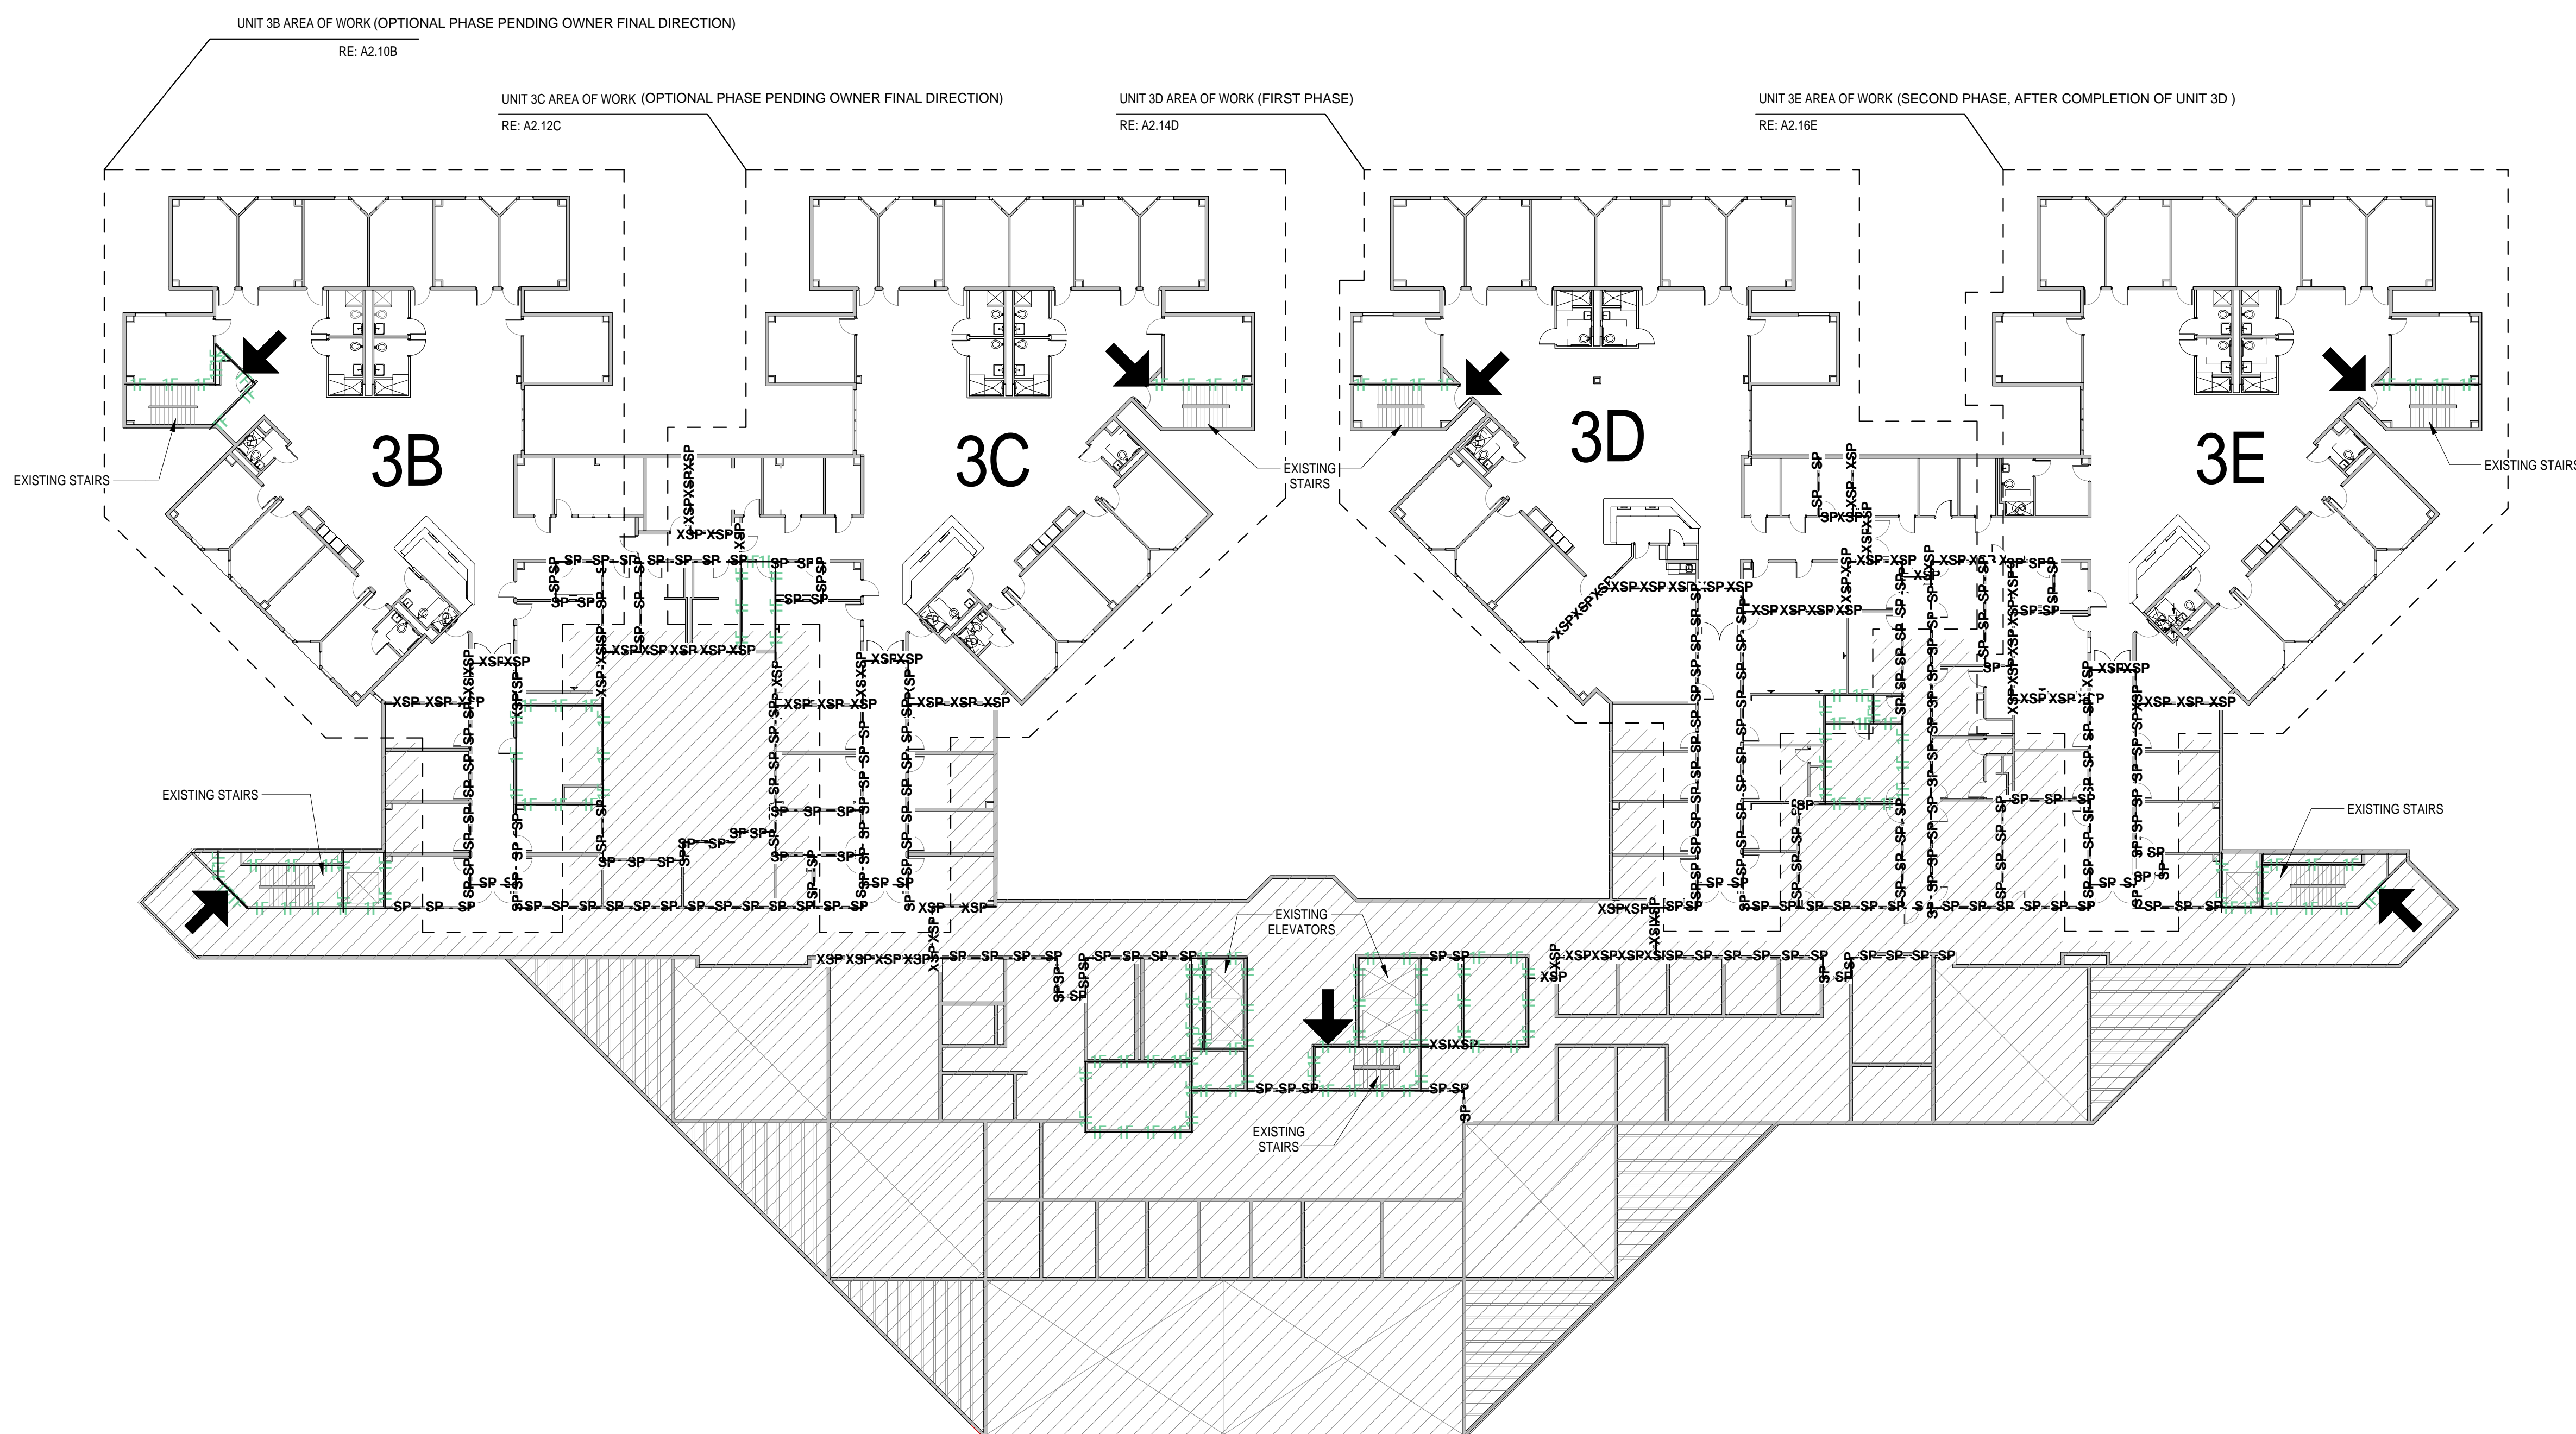



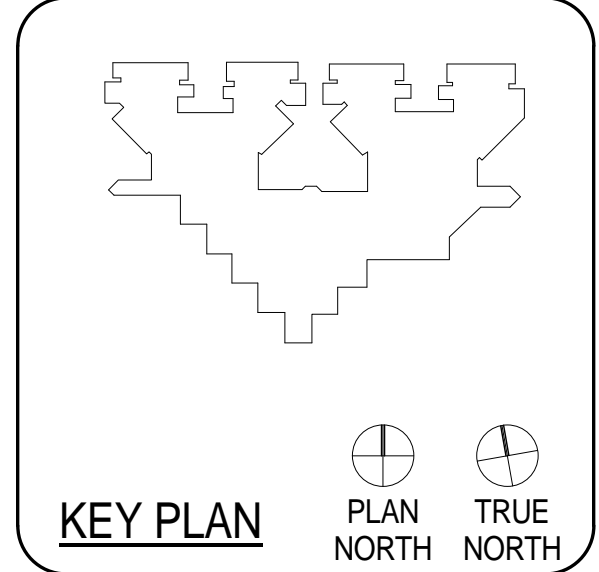

CLIENT	UT HEALTH
PROJECT NUMBER	16106
DATE:	OCTOBER 14, 2016
DRAWN BY:	Author
CHECKED BY:	Checker

No.	Description	Date

ISSUE FOR BID

**SCHEDULES - FIRST FLOOR UNIT 1C**

**A2.01C**

WT	ELEV.	DOOR			FRAME			DETAILS				REMARKS		
		PAIR /SIN /GLE	W	H	ELEV.	W	H	SILL	JAMB	HEAD	H.W.		FIRE RATING LABEL	
1-C29	B	S	3'-0"	7'-0"	SC WD	1	3'-4"	7'-4"	EXIST.	EXIST.	EXIST.	EXISTING	N/A	ADD GLASS LITE TO EXISTING DOOR
1-C23	A	S	3'-0"	7'-0"	SC WD	1	3'-4"	7'-4"	HM	3/A2.01C	2/A2.01C	SEE BELOW	N/A	
1-C24	A	S	3'-0"	7'-0"	SC WD	1	3'-4"	7'-4"	HM	3/A2.01C	2/A2.01C	SEE BELOW	N/A	
1-C26	A	S	3'-0"	7'-0"	SC WD	1	3'-4"	7'-4"	HM	3/A2.01C	2/A2.01C	SEE BELOW	N/A	
1-C27	A	S	3'-0"	7'-0"	SC WD	1	3'-4"	7'-4"	HM	3/A2.01C	2/A2.01C	SEE BELOW	N/A	
1-C35	B	S	3'-0"	7'-0"	SC WD	1	3'-4"	7'-4"	EXIST.	EXIST.	EXIST.	EXISTING	N/A	ADD GLASS LITE TO EXISTING DOOR
1-C41	B	S	3'-0"	7'-0"	SC WD	1	3'-4"	7'-4"	EXIST.	EXIST.	EXIST.	EXISTING	N/A	ADD GLASS LITE TO EXISTING DOOR

- DOOR HARDWARE IS TO "MATCH EXISTING", BUT SHOULD CONSIST OF THE FOLLOWING COMPONENTS:
- EA. SELECT HINGES SL57 FULL-SURFACE GEARED CONTINUOUS HINGES
  - EA. PUSH/PULL SET TO MATCH EXISTING, INSTALL PUSH PLATE ON INTERIOR (RESTROOM SIDE) OF DOOR, PULL ON EXTERIOR (COMMON AREA SIDE) OF DOOR, AND PROVIDE (1) LOCKSET FOR STAFF USE ON EXTERIOR (COMMON AREA SIDE) OF DOOR TO MATCH EXISTING
  - EA. IVES WS407CCV (WALL BUMPER)/FS436 (FLOOR DOME) DOOR STOP
  - EA. IVES SR64 DOOR SILENCERS
  - NO CLOSERS

<p><b>1 DOOR TYPE &amp; FRAME 1C</b> 1/4" = 1'-0"</p>	<p><b>2 INT-STUD-DOOR-HM-HEAD-DTL</b> 1 1/2" = 1'-0"</p>	<p><b>3 INT-STUD-DOOR-HM-JAMB-DTL</b> 1 1/2" = 1'-0"</p>	<p><b>4 DOUBLE EGRESS HEAD DTL</b> 1 1/2" = 1'-0"</p>	<p><b>5 DOUBLE EGRESS JAMB DTL</b> 1 1/2" = 1'-0"</p>
---	--	--	---	---



**DEMOLITION - KEYED NOTES**

- NOTE: REFER TO ENLARGED PLANS FOR ADDITIONAL KEYED NOTE LOCATIONS IF NOT VISIBLE ON THIS SHEET.
- 01 TYPICAL: REMOVE EXISTING MILLWORK AND/OR TRASH UNIT AND STORE FOR REINSTALLATION; COORDINATE EXACT REQUIREMENTS IN FIELD.
  - 02 REMOVE ALL EXISTING FLOORING, WALL FINISHES, FIXTURES AND ACCESSORIES; REFER TO MEP DRAWINGS FOR ADDITIONAL INFO PERTAINING TO FIXTURES; PREP EXISTING SUBSTRATES TO REMAIN FOR RECEIPT OF NEW FINISHES
  - 03 REMOVE EXISTING DOOR AND FRAME; SALVAGE DOORS AND RETURN TO BUILDING STOCK; RE: RENOVATION PLAN
  - 04 TYPICAL: REMOVE ALL WALL-MOUNTED ACCESSORIES (IE, BULLETIN BOARDS, SIGNAGE, ETC.) AND STORE FOR REINSTALLATION; COORDINATE EXACT REQUIREMENTS IN FIELD
  - 05 REMOVE EXISTING VINYL OR TILE FLOORING AND WALL BASE; PREP EXISTING SUBSTRATE FOR RECEIPT OF NEW FINISHES; RE: FINISH PLANS; COORDINATE TEMPORARY REMOVAL OF ANY FURNITURE AND EQUIPMENT WITH OWNER
  - 06 DEMOLISH EXISTING NURSE STATION
  - 07 DEMOLISH EXISTING WALLS WHERE INDICATED DASHED; COORDINATE EXACT REQUIREMENTS IN FIELD
  - 08 EXISTING CHASE WALL TO REMAIN; REMOVE FINISHES ONLY
  - 09 REMOVE EXISTING NOURISHMENT STATION/DOORS; NOURISHMENT STATION TO REMAIN; PROTECT IN PLACE
  - 10 EXISTING TELEPHONE BANK/MILLWORK TO REMAIN; PROTECT IN PLACE
  - 11 COORDINATE WITH OWNER TEMPORARY REMOVAL OF EXISTING SIGNAGE, WALL-MOUNTED ACCESSORIES AND WALL-MOUNTED DEVICES TO PREPARE FOR APPLICATION OF NEW WALL FINISHES, TYPICAL THROUGHOUT
  - 12 REMOVE EXISTING FLOORING ONLY
  - 13 ALTERNATE NO. 1C-05; RE: SPECS
  - 14 EXISTING FLOORING AND WALL BASE TO REMAIN
  - 15 REMOVE EXISTING FLOORING AND WALL BASE; PREP EXISTING SUBSTRATE FOR RECEIPT OF NEW FINISHES; RE: FINISH PLANS; COORDINATE TEMPORARY REMOVAL OF ANY FURNITURE AND EQUIPMENT WITH OWNER
  - 16 ALTERNATE NO. 1C-01; RE: SPECS

**RENOVATION - KEYED NOTES**

- NOTE: REFER TO ENLARGED PLANS FOR ADDITIONAL KEYED NOTE LOCATIONS IF NOT VISIBLE ON THIS SHEET.
- 01 INSTALL SCHEDULED FLOORING & BASE; RE: FINISH PLAN
  - 02 APPLY SCHEDULED WALL FINISH THROUGHOUT; RE: FINISH PLAN
  - 03 REINSTALL EXISTING MILLWORK, WALL-MOUNTED DEVICES, AND EQUIPMENT AS NEEDED; COORDINATE WITH OWNER IN FIELD
  - 04 INSTALL NEW CEILING, WALL FINISHES, PLUMBING FIXTURES AND FLOORING FINISHES
  - 05 RE-PAINT ALL EXISTING WALLS WITHIN THIS AREA WITH PT-1; EXISTING FLOORING IS ALSO TO BE REMOVED AS PART OF BASE SCOPE OF WORK - FLOORING REPLACEMENT AND WALL PAINTING SHALL BOTH OCCUR OVER THE COURSE OF ONE WEEKEND (FRIDAY THROUGH SUNDAY); COORDINATE REMOVAL AND REINSTALLATION OF ANY FURNITURE, FIXTURES, AND EQUIPMENT ITEMS IN FIELD WITH OWNER
  - 06 IN LIEU OF TYPICAL WALL PAINT, APPLY CHALKBOARD PAINT TO EXISTING WALL OPPOSITE FROM PATIENT BEDS IN THE ROOM (CONFIRM IN FIELD); CHALKBOARD PAINT IS TO EXTEND FROM EXISTING DESK HEIGHT TO ALIGN WITH THE TOP OF THE EXISTING DOOR FRAME AND FOR THE FULL LENGTH OF THE WALL
  - 07 ALTERNATE NO. 1C-01; RE: SPECS
  - 08 ALTERNATE NO. 1C-02; RE: SPECS
  - 09 REMOVE THE EXISTING NURSE STATION AND REPLACE WITH A NEW NURSE STATION TO MATCH THE CONFIGURATION AND FINISHES AS BUILT IN UNITS 1D AND 2B WITH EXCEPTIONS AS NOTED AND DEPICTED IN DETAILS WITHIN; MODIFY EXISTING CORING WITH THE FLOOR SLAB AS NEEDED TO ACCOMMODATE THE NEW NURSE STATION CONFIGURATION; EXISTING CEILING IS TO REMAIN IN THIS AREA, NO FURROWS ARE TO BE INSTALLED ABOVE THE NEW NURSE STATION
  - 10 ALTERNATE NO. 1C-03; RE: SPECS
  - 11 RE: INTERIOR ELEVATIONS FOR EXISTING NOURISHMENT STATION MODIFICATIONS
  - 12 ALTERNATE NO. 1C-05; RE: SPECS

**GENERAL DEMOLITION NOTES:**

- 1. THE DEMOLITION PLAN OUTLINES SOME OF THE SCOPE OF THE WORK INVOLVED FOR THE DEMOLITION PHASE OF THIS PROJECT. CONTRACTOR SHALL REVIEW ALL SHEETS FOR ADDITIONAL DEMO SCOPE.
- 2. CONTRACTOR SHALL VERIFY EXISTING SITE AND BUILDING CONDITIONS AND DIMENSIONS IN THE FIELD PRIOR TO COMMENCING DEMOLITION ACTIVITIES. CONTRACTOR SHALL NOT SCALE DRAWINGS. CONTRACTOR WILL NOTIFY ARCHITECT OF ANY DISCREPANCIES IN WRITING.
- 3. AFTER AWARD OF THE CONTRACT, CHANGE ORDER REQUESTS FOR ADDITIONAL MONEY WILL NOT BE APPROVED IF THE WORK COULD HAVE BEEN ANTICIPATED DURING A SITE VISIT BY THE CONTRACTOR.
- 4. CONTRACTOR WILL BE REQUIRED TO REPAIR, REPLACE, OR PATCH EXISTING BUILDINGS, DRIVEWAYS, SIDEWALKS, CANOPIES, AND/OR PARKING AREAS DISTURBED BY DEMOLITION.
- 5. CONTRACTOR WILL BE REQUIRED TO REGRADE AND HYDROMULCH AREAS AFFECTED BY DEMOLITION.
- 6. ALL FURNITURE WILL BE REMOVED OR RELOCATED BY THE OWNER AS NECESSARY PRIOR TO THE OCCURRENCE OF THIS PROJECT. CONTRACTOR SHALL COORDINATE WITH OWNER AS REQUIRED.
- 7. REMOVE EXISTING CONSTRUCTION TO THE EXTENT INDICATED ON THE DRAWINGS. SHOULD ANY DAMAGE OCCUR TO ANY EXISTING CONSTRUCTION TO REMAIN, THE CONTRACTOR SHALL REPAIR THE DAMAGE TO MATCH EXISTING ADJACENT CONSTRUCTION.
- 8. CONTRACTOR IS TO VERIFY THE EXACT LOCATION OF ALL EXISTING UTILITIES PRIOR TO DEMOLITION ACTIVITIES.
- 9. CONTRACTOR SHALL REMOVE DEBRIS REGULARLY AS NECESSARY TO ELIMINATE INTERFERENCE WITH ROADS, STREET, WALKS, AND ALL OTHER ADJACENT FACILITIES.
- 10. CONTRACTOR IS RESPONSIBLE FOR CONSTRUCTION OF TEMPORARY DUST AND/OR SOUND PARTITIONS BETWEEN CONSTRUCTION AREA AND AREAS NOT IN SCOPE AS NECESSARY; DEMOLITION ACTIVITIES SHALL BE PERFORMED SO AS TO PRODUCE MINIMAL DISTURBANCE TO EXISTING FACILITY AND OCCUPANTS (I.E. MINIMIZE EXCESSIVE AND PROLONGED NOISE LEVELS AND DUST).
- 11. NOTIFY THE BUILDING OWNER OF ANY MATERIALS, FIXTURES, ETC. TO BE REMOVED THAT ARE DEEMED SALVAGEABLE. TURN OVER ANY REQUESTED ITEMS TO THE BUILDING OWNER IN GOOD CONDITION.
- 12. THE CONTRACTOR SHALL REMOVE ALL TRASH AND DEBRIS FROM THE SITE ON A DAILY BASIS.
- 13. MAINTAIN THE INTEGRITY OF ALL EXISTING RATED WALLS. FIRE SEAL ANY PENETRATIONS WITH UL APPROVED ASSEMBLY.
- 14. WHEN UNANTICIPATED MECHANICAL, ELECTRICAL, OR STRUCTURAL ELEMENTS THAT CONFLICT WITH THE INTENDED FUNCTION OR DESIGN ARE ENCOUNTERED, DETERMINE THE NATURE AND EXTENT OF THE CONFLICT AND NOTIFY THE ARCHITECT IMMEDIATELY FOR RESOLUTION.
- 15. CONTRACTOR SHALL PROVIDE TRAFFIC HANDLING MEASURES AS NECESSARY TO PROTECT THE GENERAL PUBLIC AT ALL TIMES, AND AS REQUIRED BY GOVERNING AUTHORITIES.
- 16. DO NOT INTERRUPT EXISTING UTILITIES, EXCEPT WHEN AUTHORIZED IN WRITING BY AUTHORITIES HAVING JURISDICTION. PROVIDE TEMPORARY SERVICES DURING INTERRUPTIONS TO EXISTING UTILITIES, AS ACCEPTABLE TO GOVERNING AUTHORITIES.
- 17. WHEN UTILITY SERVICES ARE REQUIRED TO BE REMOVED, RELOCATED, OR ABANDONED, PROVIDE BYPASS CONNECTIONS TO MAINTAIN CONTINUITY OF SERVICE BEFORE PROCEEDING WITH DEMOLITION.
- 18. PRIOR TO COMMENCEMENT WITH ANY DEMOLITION WORK, CONTRACTOR SHALL IDENTIFY ALL ELECTRICAL CIRCUITS SERVICING THE AREA INVOLVED WITH THIS DEMOLITION. THOSE CIRCUITS SHALL THEN BE LOCKED OUT AND TAGGED OUT IF THEY DO NOT SERVICE ANY OF THE REMAINING BUILDING. THOSE CIRCUITS WHICH ARE IDENTIFIED TO SERVICE BOTH THE AREA TO BE DEMOLISHED AND THE REMAINING BUILDING SHALL BE SPLIT SO AS TO KILL ALL ELECTRICAL POWER TO THE AREA TO BE DEMOLISHED WHILE MAINTAINING POWER TO THE REMAINDER OF THE BUILDING.
- 19. CONTRACTOR TO RELOCATE UTILITIES & EQUIPMENT AS REQUIRED TO ACCOMMODATE NEW PLUMBING REQUIREMENTS FOR NEW RENOVATION WORK.
- 20. REFER TO DEMOLITION PLUMBING PLANS FOR EXTENT OF CONCRETE SLAB TO BE REMOVED AND REPLACED OR UNDER FLOOR PIPING INSTALLATION.
- 21. EXISTING WALLS (OR PORTIONS OF WALLS) TO BE REMOVED SHALL BE CUT FLUSH WHERE INTERSECTING WITH WALLS TO REMAIN. REMAINING WALLS TO BE PATCHED AND FINISHED SMOOTH.
- 22. NEW OPENING TO BE CUT IN EXISTING WALLS SHALL BE SAW-CUT AT LOCATIONS INDICATED TO THE HEIGHT AND WIDTH INDICATED. NEW UNITS SHALL BE INSTALLED TO SUPPORT EXISTING WALL CONSTRUCTION ON ABOVE AS INDICATED ON THE DRAWINGS, OR IF NOT INDICATED, AS REQUIRED FOR NEW WALL CONSTRUCTION PER STRUCTURAL DRAWINGS, IF PROVIDED.
- 23. WHERE EXISTING INTERIOR WALLS ARE REPLACED OR REMOVED, REMOVE MEP SYSTEMS BACK TO PANEL OR MECHANICAL ROOM OR FARTHEST POSSIBLE POINT WITHOUT DISTURBING EXISTING CONSTRUCTION; REMOVE EXISTING MECHANICAL EQUIPMENT, RELOCATE POWER PER MEP DRAWINGS.
- 24. REFER TO MEP DRAWINGS FOR DEMOLITION OF MEP SYSTEMS; IDENTIFY WORK REQUIRED BY THIS CONTRACTOR WHICH MAY AFFECT DEMOLITION AND/OR REPAIRS OF ARCHITECTURAL ELEMENTS. COORDINATE WITH RELATED SUBS THE EXTENT OF ALL DEMOLITION WORK.
- 25. PATCH FLOORS, WALLS/CEILING WHICH REMAIN AT LOCATIONS WHERE PIPES, CONDUITS, ETC. ARE REMOVED AS REQUIRED TO MATCH EXISTING CONDITIONS OR TO RECEIVE NEW FINISHES.
- 26. WHERE EXISTING FINISH FLOOR IS REMOVED, PREPARE SURFACE TO RECEIVE NEW FLOORING.
- 27. NOTIFY ARCHITECT & OWNER OF ANY POSSIBLE ASBESTOS CONTAINING MATERIALS DISCOVERED BEFORE PROCEEDING WITH WORK; PROTECT INTERIOR CONSTRUCTION TO REMAIN DURING DEMOLITION AND CONSTRUCTION.
- 28. CONTRACTOR TO OBTAIN ALL NECESSARY PERMITS BEFORE COMMENCING WORK.
- 29. CONTRACTOR TO PROVIDE ALL NECESSARY SHORING FOR PROTECTION OF EXISTING STRUCTURE AND FOUNDATION TO REMAIN.
- 30. ALL DASHED LINES ARE DEMOLITION LINES UNLESS NOTED OTHERWISE.
- 31. REMOVE ALL CARPET WAINSCOT FROM ALL LOCATIONS IN EACH UNIT.

**GENERAL NOTES**



- 1. VERIFY DIMENSIONS AND EXISTING CONDITIONS BEFORE COMMENCING WORK. REPORT DISCREPANCIES TO THE ARCHITECT PRIOR TO PROCEEDING WITH AFFECTED WORK.
- 2. REFLECTING CEILING PLAN DIMENSIONS ARE REFERENCED FROM FINISHED SURFACES UNLESS NOTED OTHERWISE. CEILING HEIGHTS ARE DIMENSIONED FROM FLOOR TO FINISHED CEILING HEIGHT.
- 3. DIMENSIONS NOTED AS "FIELD VERIFY" SHALL BE CHECKED AT THE SITE BY THE CONTRACTOR AND REVIEWED WITH THE ARCHITECT BEFORE INCORPORATING INTO THE WORK.
- 4. DO NOT SCALE DRAWING. WRITTEN DIMENSIONS TAKE PRECEDENCE. IF CLARIFICATION IS REQUIRED IN ORDER TO DETERMINE THE INTENT OF THE CONTRACT DOCUMENTS, CONTACT THE ARCHITECT.
- 5. NOTES OR DIMENSIONS LABELED "TYPICAL" SHALL APPLY TO SITUATIONS THAT ARE THE SAME OR SIMILAR.
- 6. ALL INTERIOR PARTITIONS SHALL BE KEYED AS REFERENCE SHEET A7.00 FOR PARTITION TYPES.
- 7. ALL DIMENSIONS ARE TO FACE OF FINISHED WALL UNLESS NOTED OTHERWISE.
- 8. ALL SPACES WITH FLOOR DRAINS TO HAVE FINISHED FLOORS SLOPED TO DRAIN NOT TO EXCEED ONE IN FIFTY.
- 9. ALL FLOOR FINISH CHANGES SHALL OCCUR AT THE CENTERLINE OF DOORS UNLESS NOTED OTHERWISE. ALL FLOOR FINISH CHANGES SHALL HAVE THRESHOLDS OR REDUCER STRIPS.
- 10. ALL DOORS IN INTERIOR GYP. BO STUD WALLS SHALL BE SET 4" OFF THE PERP. ADJ. WALL ON THE HINGE SIDE OF THE DOOR UNLESS NOTED OTHERWISE. THE CONTRACTOR SHALL CONTACT THE ARCHITECT IF ANY CONFLICT OCCURS.
- 11. PROVIDE VINYL REDUCERS AT ALL DISSIMILAR FLOOR MATERIALS UNLESS OTHERWISE NOTED.
- 12. UNLESS OTHERWISE NOTED, ALL ELECTRICAL AND MECHANICAL OPERABLE DEVICES SHALL BE MOUNTED WITH THE HIGHEST OPERABLE CONTROL AT 42" AFF.
- 13. ALL REQUIRED CLEARANCES, AS DESCRIBED IN THE TEXAS ACCESSIBILITY STANDARDS (TAS) OF THE ARCHITECTURAL BARRIERS ACT ARTICLE 902, TEXAS CIVIL STATUTES (2012) FOR COUNTERTOPS, ALL PLUMBING FIXTURES INCLUDING DRINKING FOUNTAINS, LAVATORIES, URINALS, AND TOILETS WILL BE STRICTLY ENFORCED.



**ARCHITECTURE**  
 PBK ARCHITECTS  
 11 Greenway Plaza, 22nd Floor  
 Houston, TX 77046  
 713-865-9068 P  
 713-961-4571 F  
 TX Firm # F-1709  
 PBK.com

**MEP**  
 SHAH SMITH AND ASSOCIATES  
 2625 S. Wilshire Dr. #300  
 HOUSTON, TX 77042  
 (713) 790-7563


**HARRIS COUNTY PSYCHIATRIC  
 CENTER RENOVATION UNITS: 1C,  
 2E, 3B, 3C, 3D & 3E**

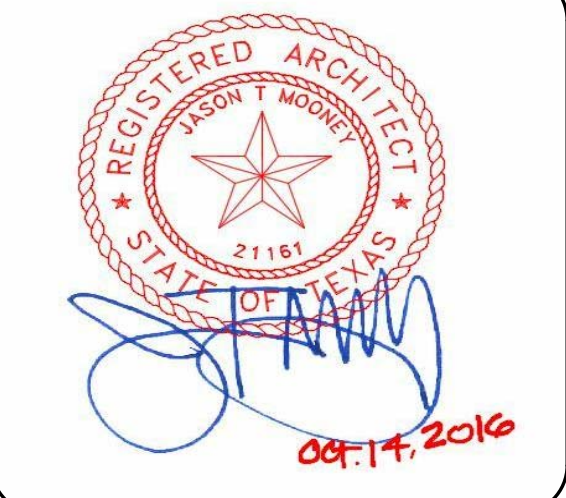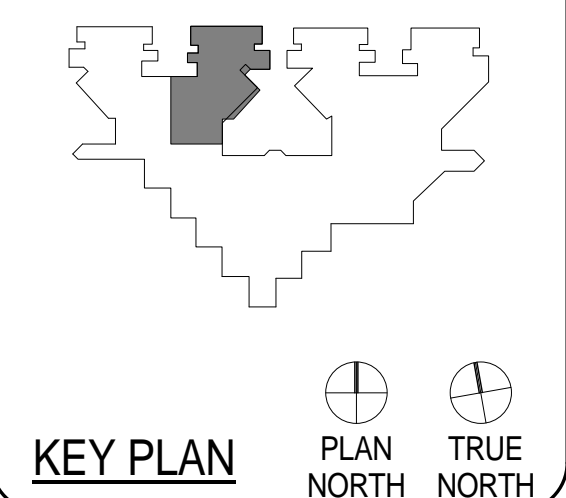

CLIENT	UT HEALTH	
PROJECT NUMBER	16106	
DATE:	OCTOBER 14, 2016	
DRAWN BY:	VG/BG	
CHECKED BY:	JM/CS	
REVISIONS		
No.	Description	Date


ISSUE FOR BID  
**FIRST FLOOR UNIT  
 1C**

**A2.02C**

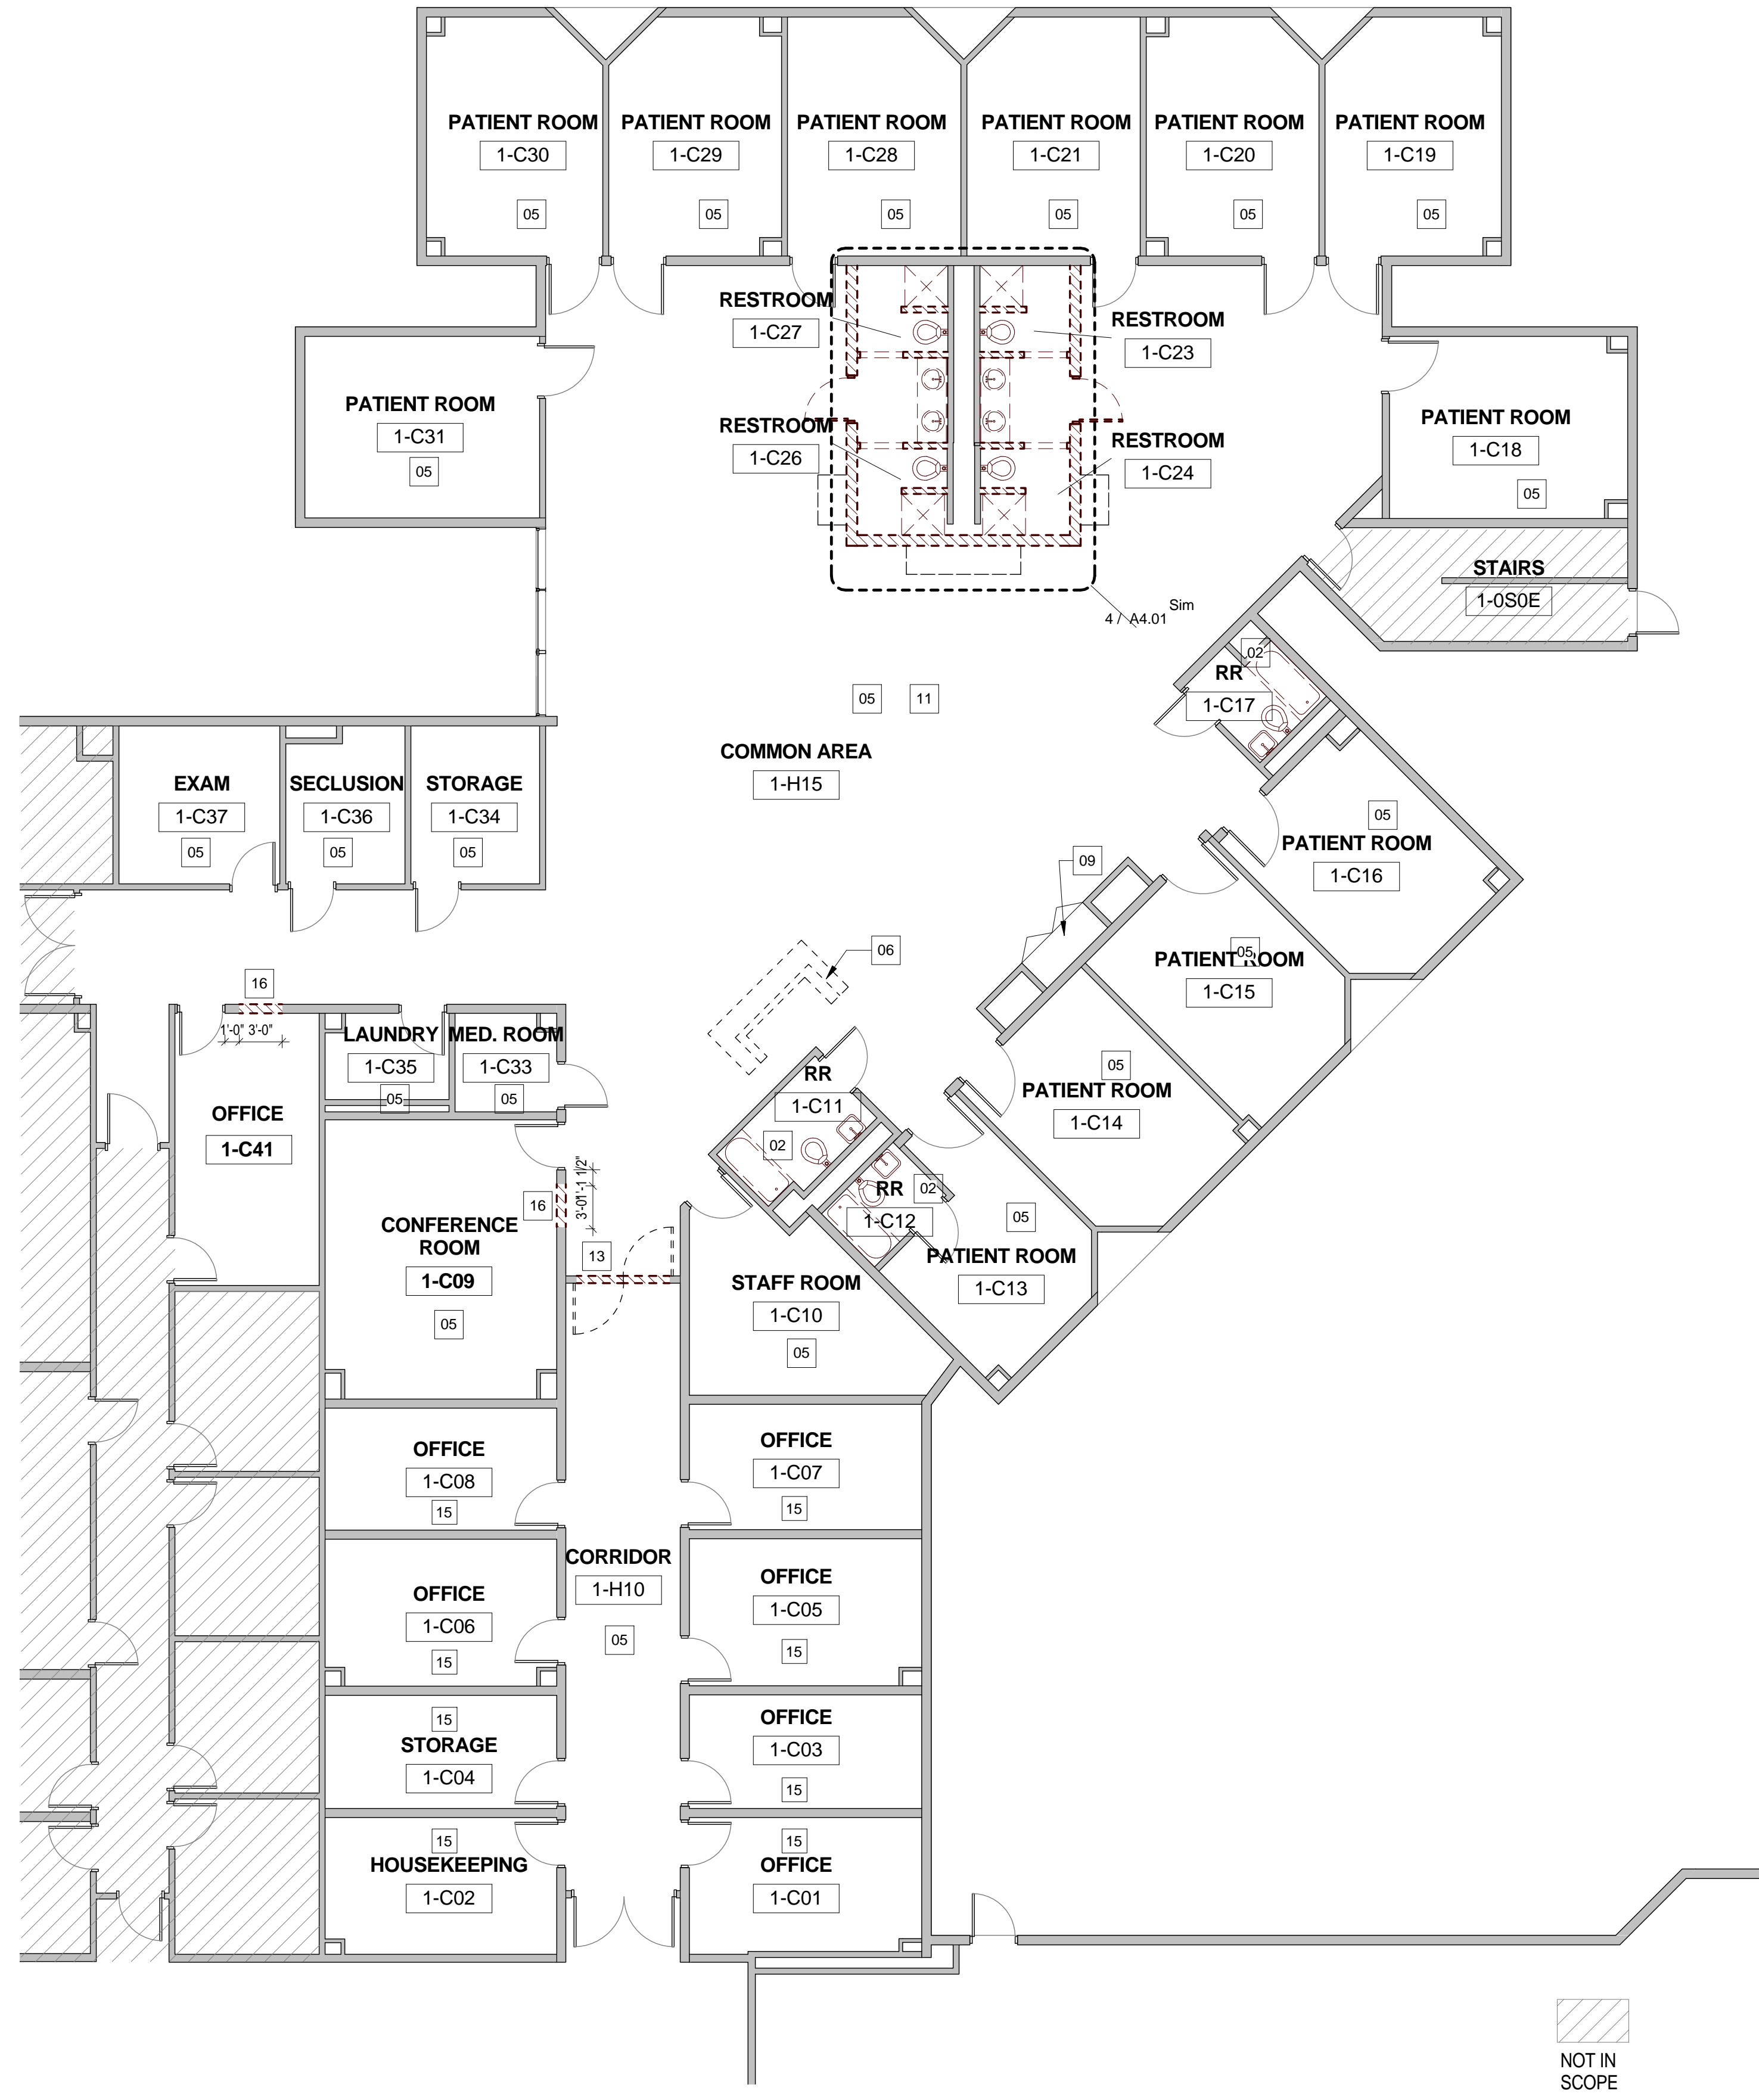



HARRIS COUNTY PSYCHIATRIC  
CENTER RENOVATION UNITS: 1C,  
2E, 3B, 3C, 3D & 3E

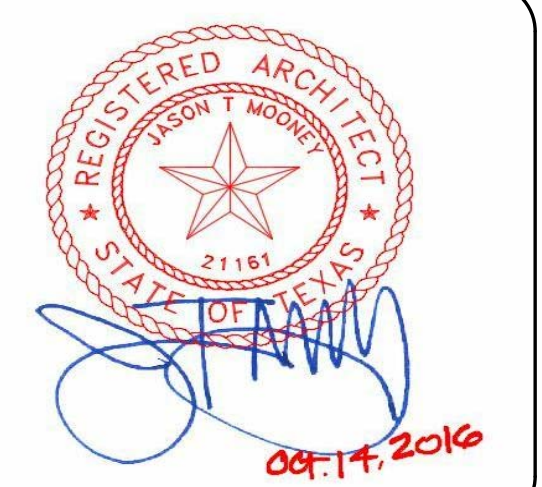


CLIENT	UT HEALTH	
PROJECT NUMBER	16106	
DATE:	OCTOBER 14, 2016	
DRAWN BY:	BG	
CHECKED BY:	JM/CJS	
REVISIONS		
No.	Description	Date

ISSUE FOR BID

FIRST FLOOR UNIT  
1C - SIGNAGE PLAN

A2.03C

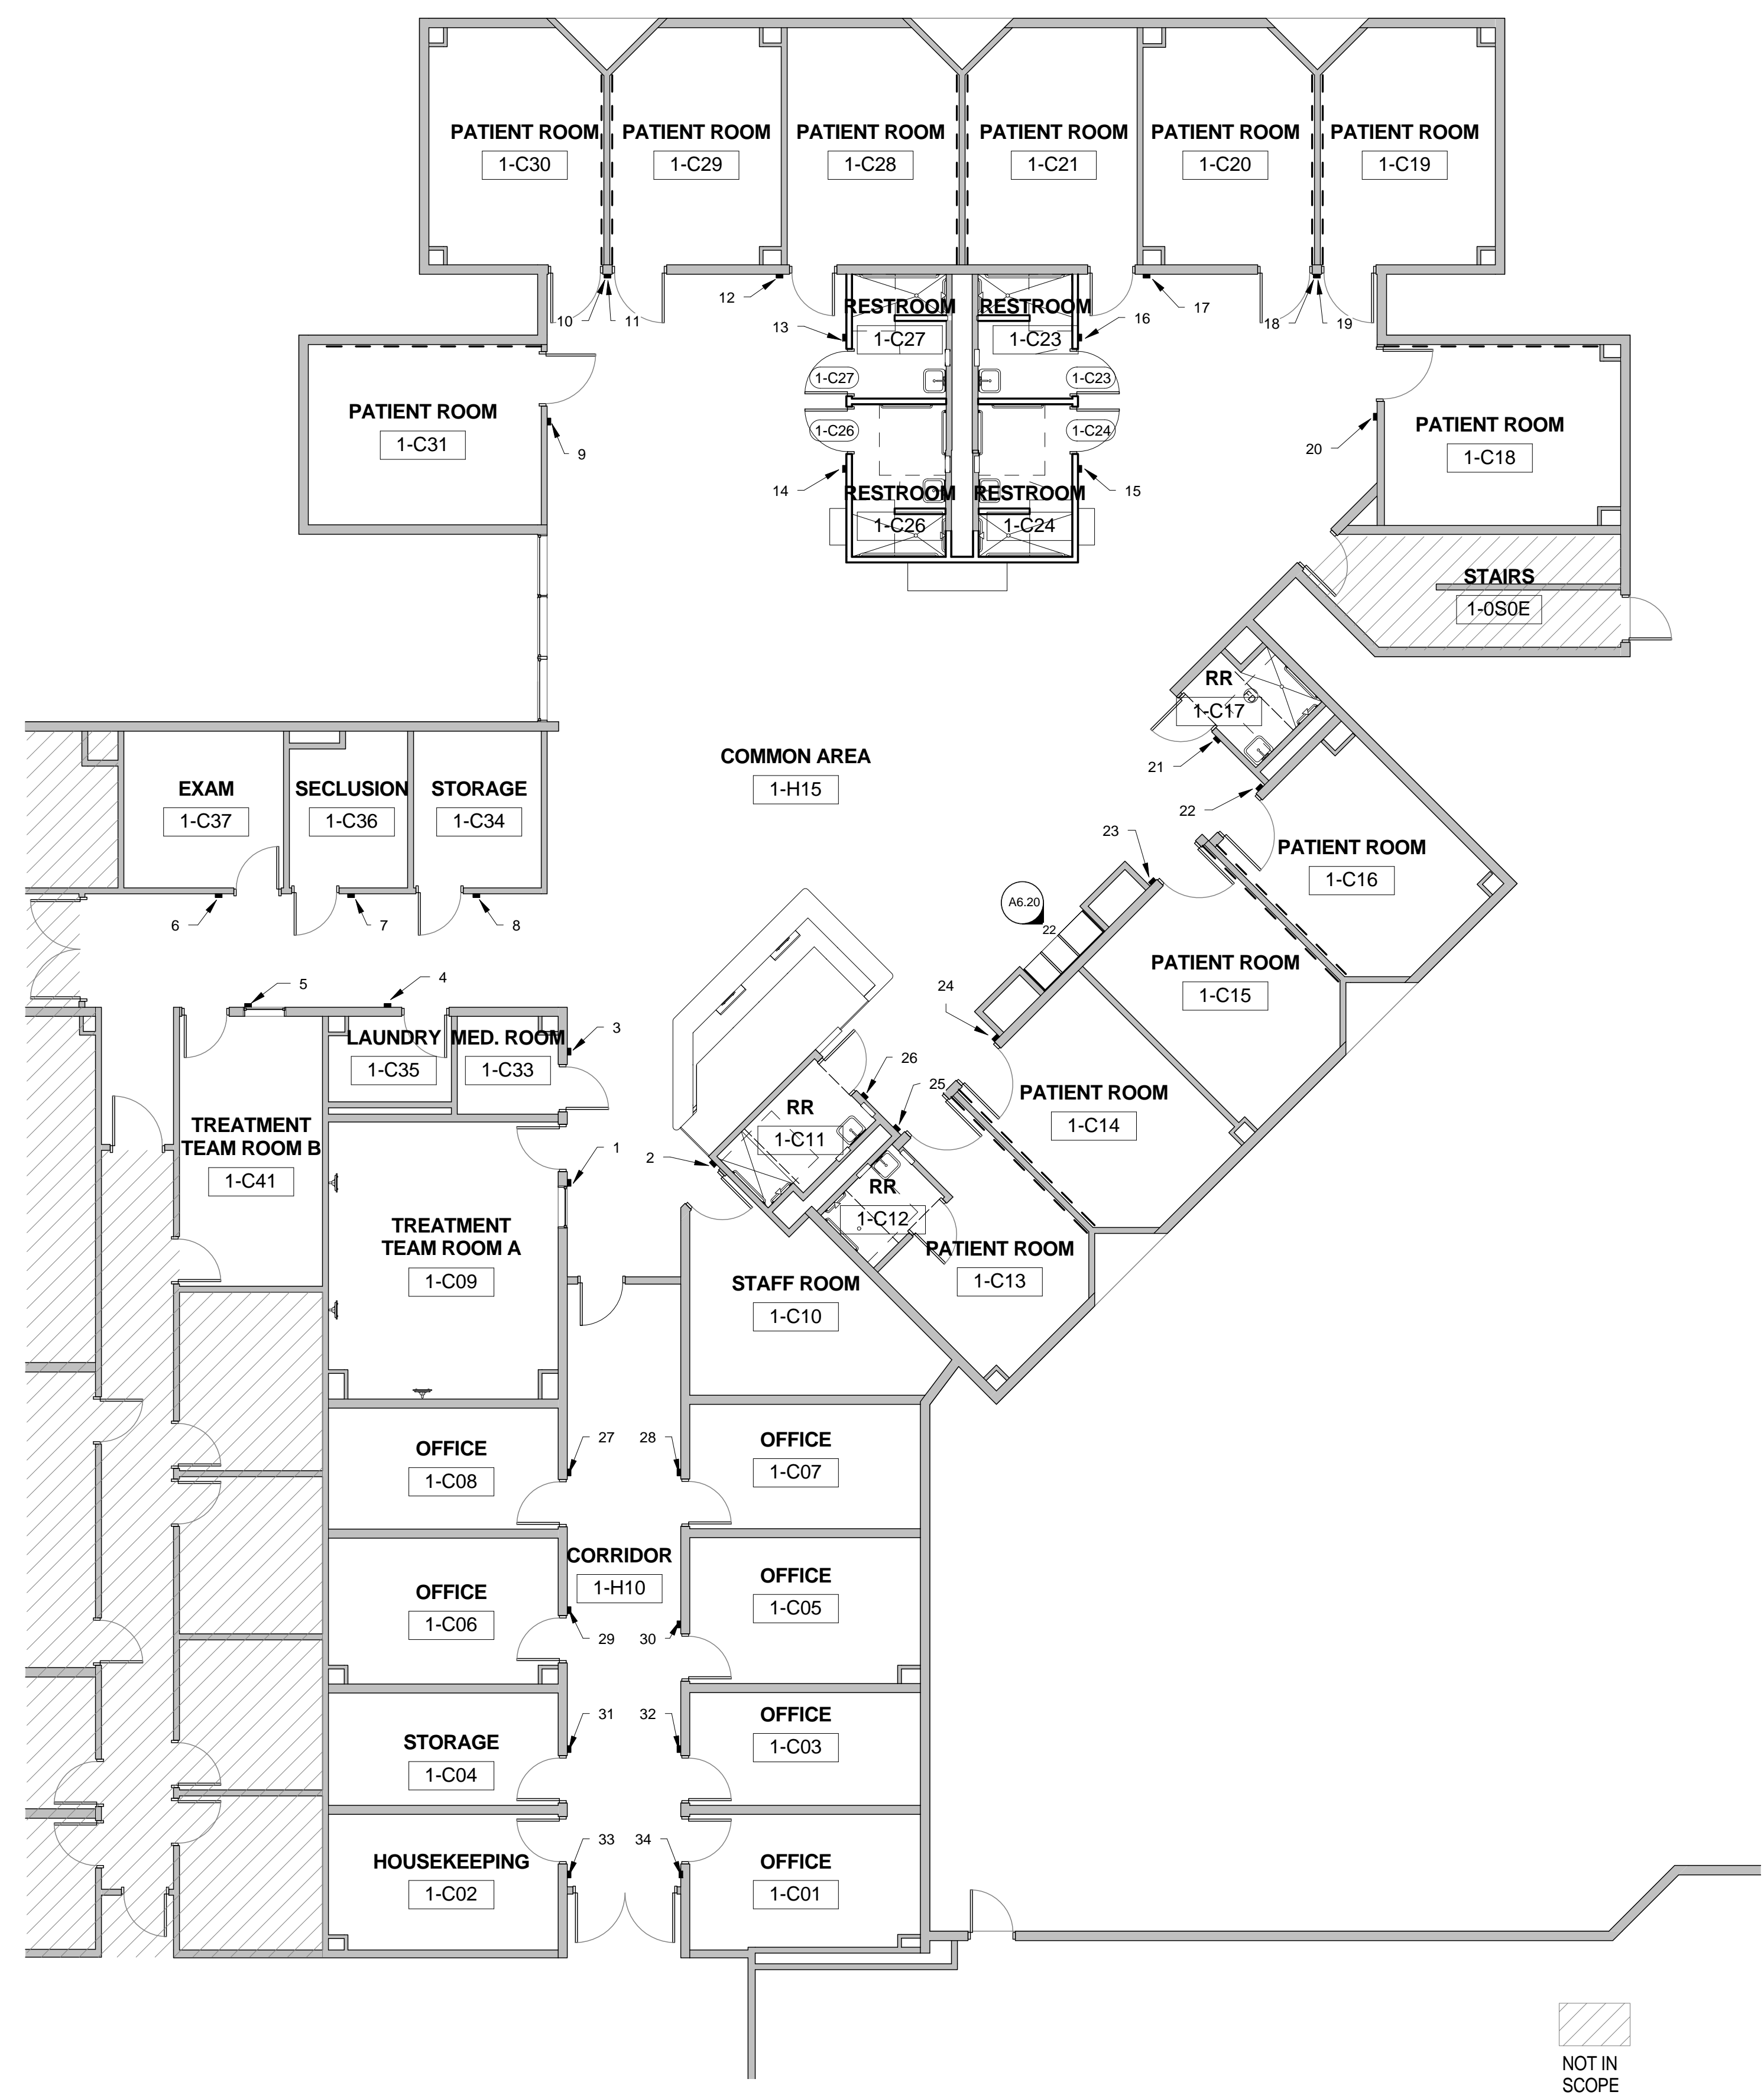


SIGN #	SIGN TYPE	LOCATION	DETAIL	MESSAGE	20	D	1-C18	RE: G4589-14 R1	LINE 1: 1-C18
1	C	1-C09	RE: G4589-14 R1	LINE 1: 1-C09 LINE 2: (ADA BRAILLE: 1-C09) LINE 3: N/A LINE 4: N/A LINE 5: CONFERENCE LINE 6: ROOM LINE 7: (ADA BRAILLE: CONFERENCE ROOM) LINE 8: N/A LINE 9: 1-C10 LINE 2: (ADA BRAILLE: 1-C10) LINE 3: N/A LINE 4: N/A LINE 5: STAFF ROOM LINE 6: (ADA BRAILLE: STAFF ROOM) LINE 7: N/A LINE 1: 1-C33 LINE 2: (ADA BRAILLE: 1-C33) LINE 3: N/A LINE 4: N/A LINE 5: MEDICATION LINE 6: ROOM LINE 7: (ADA BRAILLE: MEDICATION ROOM) LINE 8: N/A LINE 9: 1-C35 LINE 2: (ADA BRAILLE: 1-C35) LINE 3: N/A LINE 4: N/A LINE 5: LAUNDRY LINE 6: (ADA BRAILLE: LAUNDRY) LINE 7: N/A LINE 1: 1-C41 LINE 2: (ADA BRAILLE: 1-C41) LINE 3: N/A LINE 4: N/A LINE 5: TREATMENT TEAM ROOM B LINE 6: (ADA BRAILLE: TREATMENT TEAM ROOM B) LINE 7: N/A LINE 1: 1-C37 LINE 2: (ADA BRAILLE: 1-C37) LINE 3: N/A LINE 4: N/A LINE 5: EXAM ROOM LINE 1: 1-C36 LINE 2: (ADA BRAILLE: 1-C36) LINE 3: N/A LINE 4: N/A LINE 5: SECLUSION LINE 6: (ADA BRAILLE: SECLUSION) LINE 7: N/A LINE 1: 1-C34 LINE 2: (ADA BRAILLE: 1-C34) LINE 3: N/A LINE 4: N/A LINE 5: STORAGE LINE 6: (ADA BRAILLE: STORAGE) LINE 7: N/A LINE 1: 1-C31 LINE 2: (ADA BRAILLE: 1-C31) LINE 3: N/A LINE 4: N/A LINE 5: CORRIDOR LINE 1: 1-C30 LINE 2: (ADA BRAILLE: 1-C30) LINE 3: N/A LINE 4: N/A LINE 5: 1-C29 LINE 2: (ADA BRAILLE: 1-C29) LINE 3: N/A LINE 4: N/A LINE 5: 1-C28 LINE 2: (ADA BRAILLE: 1-C28) LINE 3: N/A LINE 4: N/A LINE 5: 1-C27 LINE 2: (ADA BRAILLE: 1-C27) LINE 3: N/A LINE 4: N/A LINE 5: 1-C26 LINE 2: (ADA BRAILLE: 1-C26) LINE 3: N/A LINE 4: N/A LINE 5: 1-C25 LINE 2: (ADA BRAILLE: 1-C25) LINE 3: N/A LINE 4: N/A LINE 5: 1-C24 LINE 2: (ADA BRAILLE: 1-C24) LINE 3: N/A LINE 4: N/A LINE 5: 1-C23 LINE 2: (ADA BRAILLE: 1-C23) LINE 3: N/A LINE 4: N/A LINE 5: 1-C22 LINE 2: (ADA BRAILLE: 1-C22) LINE 3: N/A LINE 4: N/A LINE 5: 1-C21 LINE 2: (ADA BRAILLE: 1-C21) LINE 3: N/A LINE 4: N/A LINE 5: 1-C20 LINE 2: (ADA BRAILLE: 1-C20) LINE 3: N/A LINE 4: N/A LINE 5: 1-C19 LINE 2: (ADA BRAILLE: 1-C19) LINE 3: N/A LINE 4: N/A LINE 5: 1-C18 LINE 2: (ADA BRAILLE: 1-C18) LINE 3: N/A LINE 4: N/A LINE 5: 1-C17 LINE 2: (ADA BRAILLE: 1-C17) LINE 3: N/A LINE 4: MALE + FEMALE UNISEX IMAGE LINE 5: IMAGE LINE 6: IMAGE LINE 7: N/A LINE 8: BATHROOM LINE 9: (ADA BRAILLE: BATHROOM) LINE 10: PLEASE KNOCK BEFORE ENTERING LINE 11: POR FAVOR SONAR ANTES DE ENTRAR LINE 12: SLIDER PANEL LINE 13: N/A LINE 14: INSERT LINE 1: 1-C16 LINE 2: (ADA BRAILLE: 1-C16) LINE 3: N/A LINE 4: N/A LINE 5: 1-C15 LINE 2: (ADA BRAILLE: 1-C15) LINE 3: N/A LINE 4: N/A LINE 5: 1-C14 LINE 2: (ADA BRAILLE: 1-C14) LINE 3: N/A LINE 4: N/A LINE 5: 1-C13 LINE 2: (ADA BRAILLE: 1-C13) LINE 3: N/A LINE 4: N/A LINE 5: 1-C11 LINE 2: (ADA BRAILLE: 1-C11) LINE 3: N/A LINE 4: MALE + FEMALE UNISEX IMAGE LINE 5: IMAGE LINE 6: IMAGE LINE 7: N/A LINE 8: BATHROOM LINE 9: (ADA BRAILLE: BATHROOM) LINE 10: PLEASE KNOCK BEFORE ENTERING LINE 11: POR FAVOR SONAR ANTES DE ENTRAR LINE 12: SLIDER PANEL LINE 13: N/A LINE 14: INSERT LINE 1: 1-C08 LINE 2: (ADA BRAILLE: 1-C08) LINE 3: N/A LINE 4: N/A LINE 5: INSERT LINE 1: 1-C07 LINE 2: (ADA BRAILLE: 1-C07) LINE 3: N/A LINE 4: N/A LINE 5: INSERT LINE 1: 1-C06 LINE 2: (ADA BRAILLE: 1-C06) LINE 3: N/A LINE 4: N/A LINE 5: INSERT LINE 1: 1-C05 LINE 2: (ADA BRAILLE: 1-C05) LINE 3: N/A LINE 4: N/A LINE 5: INSERT LINE 1: 1-C04 LINE 2: (ADA BRAILLE: 1-C04) LINE 3: N/A LINE 4: N/A LINE 5: INSERT LINE 1: 1-C03 LINE 2: (ADA BRAILLE: 1-C03) LINE 3: N/A LINE 4: N/A LINE 5: INSERT LINE 1: 1-C02 LINE 2: (ADA BRAILLE: 1-C02) LINE 3: N/A LINE 4: N/A LINE 5: INSERT LINE 1: 1-C01 LINE 2: (ADA BRAILLE: 1-C01) LINE 3: N/A LINE 4: N/A LINE 5: INSERT LINE 9: (ADA BRAILLE: ADA MEN'S) LINE 10: PLEASE KNOCK BEFORE ENTERING LINE 11: POR FAVOR SONAR ANTES DE ENTRAR LINE 12: SLIDER PANEL LINE 13: N/A LINE 14: INSERT LINE 1: 1-C24 LINE 2: (ADA BRAILLE: 1-C24) LINE 3: N/A LINE 4: FEMALE + WHEELCHAIR IMAGE LINE 5: IMAGE LINE 6: IMAGE LINE 7: N/A LINE 8: ADA MEN'S LINE 9: (ADA BRAILLE: ADA MEN'S) LINE 10: PLEASE KNOCK BEFORE ENTERING LINE 11: POR FAVOR SONAR ANTES DE ENTRAR LINE 12: SLIDER PANEL LINE 13: N/A LINE 14: INSERT LINE 1: 1-C23 LINE 2: (ADA BRAILLE: 1-C23) LINE 3: N/A LINE 4: FEMALE IMAGE LINE 5: IMAGE LINE 6: IMAGE LINE 7: N/A LINE 8: WOMEN'S LINE 9: (ADA BRAILLE: WOMEN'S) LINE 10: PLEASE KNOCK BEFORE ENTERING LINE 11: POR FAVOR SONAR ANTES DE ENTRAR LINE 12: SLIDER PANEL LINE 13: N/A LINE 14: INSERT LINE 1: 1-C21 LINE 2: (ADA BRAILLE: 1-C21) LINE 3: N/A LINE 4: N/A LINE 5: 1-C20 LINE 2: (ADA BRAILLE: 1-C20) LINE 3: N/A LINE 4: N/A LINE 5: 1-C19 LINE 2: (ADA BRAILLE: 1-C19) LINE 3: N/A LINE 4: N/A					

NOTE: REFER TO ELEVATION FOR MOUNTING HEIGHTS. SIGNS 10, 11 AND 18, 19 MUST BE MOUNTED ONE ABOVE THE OTHER WITHIN ACCEPTABLE ADA MOUNTING HEIGHTS.  
V.1.1 WALL SPACES FOR SIGN WIDTHS. NOTIFY ARCHITECTS OF SIGNS NEEDING TO BE SHORTENED TO FIT AT DESIGNATED LOCATION.

NOT IN SCOPE



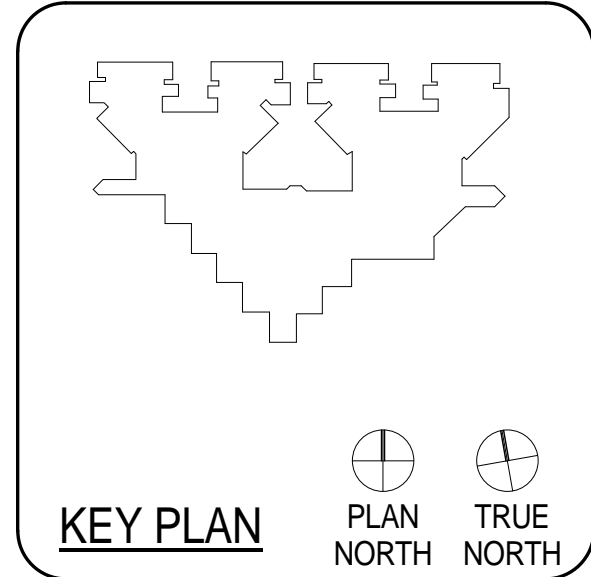

CLIENT  
UT HEALTH  
PROJECT NUMBER  
16106  
DATE: OCTOBER 14, 2016  
DRAWN BY: Author  
CHECKED BY: Checker

No.	Description	Date

ISSUE FOR BID  
**SCHEDULES -  
SECOND FLOOR  
UNIT 2E**  
**A2.04E**

MARK	ELEV.	DOOR				FRAME				DETAILS				FIRE RATING LABEL	REMARKS
		PAIR /SIN /GLE	SIZE W x H		MATL	ELEV.	SIZE W x H		MATL	SILL	JAMB	HEAD	H.W.		
			W	H			W	H							
2-E18	B	S	3'-0"	7'-0"	SC WD	1	3'-4"	7'-4"	EXIST.	EXIST.	EXISTING	EXISTING	N/A	ADD GLASS LITE TO EXISTING DOOR	
2-E60	B	S	3'-0"	7'-0"	SC WD	1	3'-4"	7'-4"	EXIST.	EXIST.	EXISTING	EXISTING	N/A	ADD GLASS LITE TO EXISTING DOOR	
2-E63	A	S	3'-0"	7'-0"	SC WD	1	3'-4"	7'-4"	EXIST.	EXIST.	EXISTING	2	N/A		
2-E75	A	S	3'-0"	7'-0"	SC WD	1	3'-4"	7'-4"	HM	3/A2.04E	2/A2.04E	1	N/A		
2-E76	A	S	3'-0"	7'-0"	SC WD	1	3'-4"	7'-4"	HM	3/A2.04E	2/A2.04E	1	N/A		
2-E77	A	S	3'-0"	7'-0"	SC WD	1	3'-4"	7'-4"	HM	3/A2.04E	2/A2.04E	1	N/A		
2-E78	A	S	3'-0"	7'-0"	SC WD	1	3'-4"	7'-4"	HM	3/A2.04E	2/A2.04E	1	N/A		
2-E87	B	S	3'-0"	7'-0"	SC WD	1	3'-4"	7'-4"	EXIST.	EXIST.	EXISTING	EXISTING	N/A	ADD GLASS LITE TO EXISTING DOOR	
2-EH04	C	P	7'-0"	7'-0"	EXISTING	2	7'-4"	7'-4"	EXIST	EXIST.	EXISTING	1	N/A	SALVAGE EXISTING HARDWARE AND REINSTALL; RE-USE EXISTING GLASS LITE; EXISTING FRAME W/ NEW PAINT FINISH; RE: ALTERNATE NO. 2E-08	

**HARDWARE SET 1**




DOOR HARDWARE IS TO 'MATCH EXISTING', BUT SHOULD CONSIST OF THE FOLLOWING COMPONENTS:

- A. (1) EA. SELECT HINGES SL57 FULL-SURFACE GEARED CONTINUOUS HINGES
- B. (1) EA. \*PUSH/PULL SET TO MATCH EXISTING; INSTALL PUSH PLATE ON INTERIOR (RESTROOM SIDE) OF DOOR, PULL ON EXTERIOR (COMMON AREA SIDE) OF DOOR, AND PROVIDE (1) LOCKSET FOR STAFF USE ON EXTERIOR (COMMON AREA SIDE) OF DOOR TO MATCH EXISTING
- C. (1) EA. IVES WS407CCV (WALL BUMPER)/FS436 (FLOOR DOME) DOOR STOP
- D. (3) EA. IVES SR64 DOOR SILENCERS
- E. NO CLOSERS

**HARDWARE SET 2**

DOOR HARDWARE IS TO 'MATCH EXISTING', BUT SHOULD CONSIST OF THE FOLLOWING COMPONENTS:

- A. (1) EA. SELECT HINGES SL57 FULL-SURFACE GEARED CONTINUOUS HINGES
- B. (1) EA. STORAGE FUNCTION LOCK SET IN HARDWARE TO MATCH EXISTING; COORDINATE WITH OWNER.
- C. (1) EA. IVES WS407CCV (WALL BUMPER)/FS436 (FLOOR DOME) DOOR STOP
- D. (3) EA. IVES SR64 DOOR SILENCERS
- E. NO CLOSERS

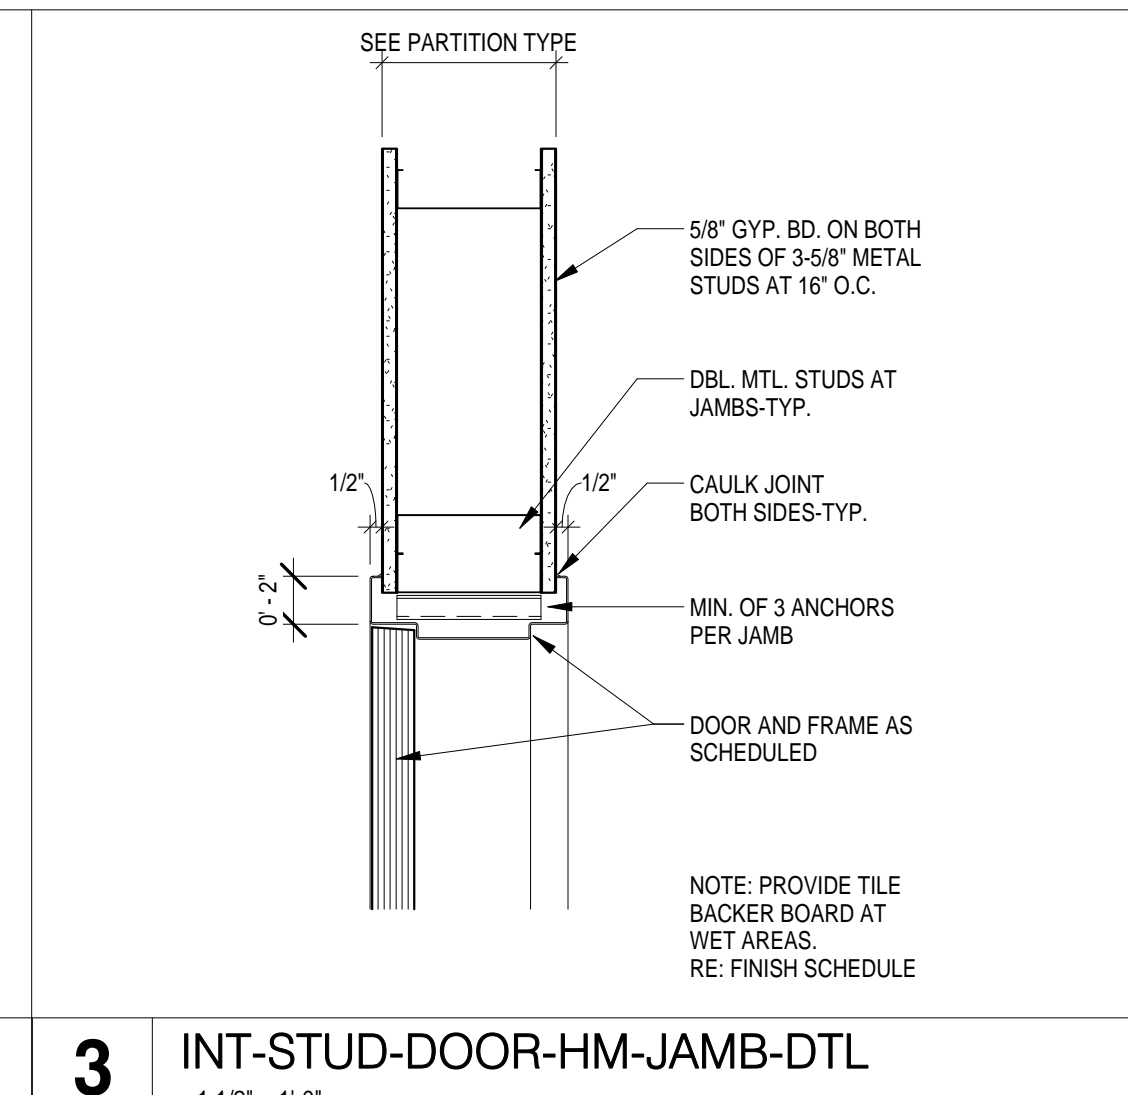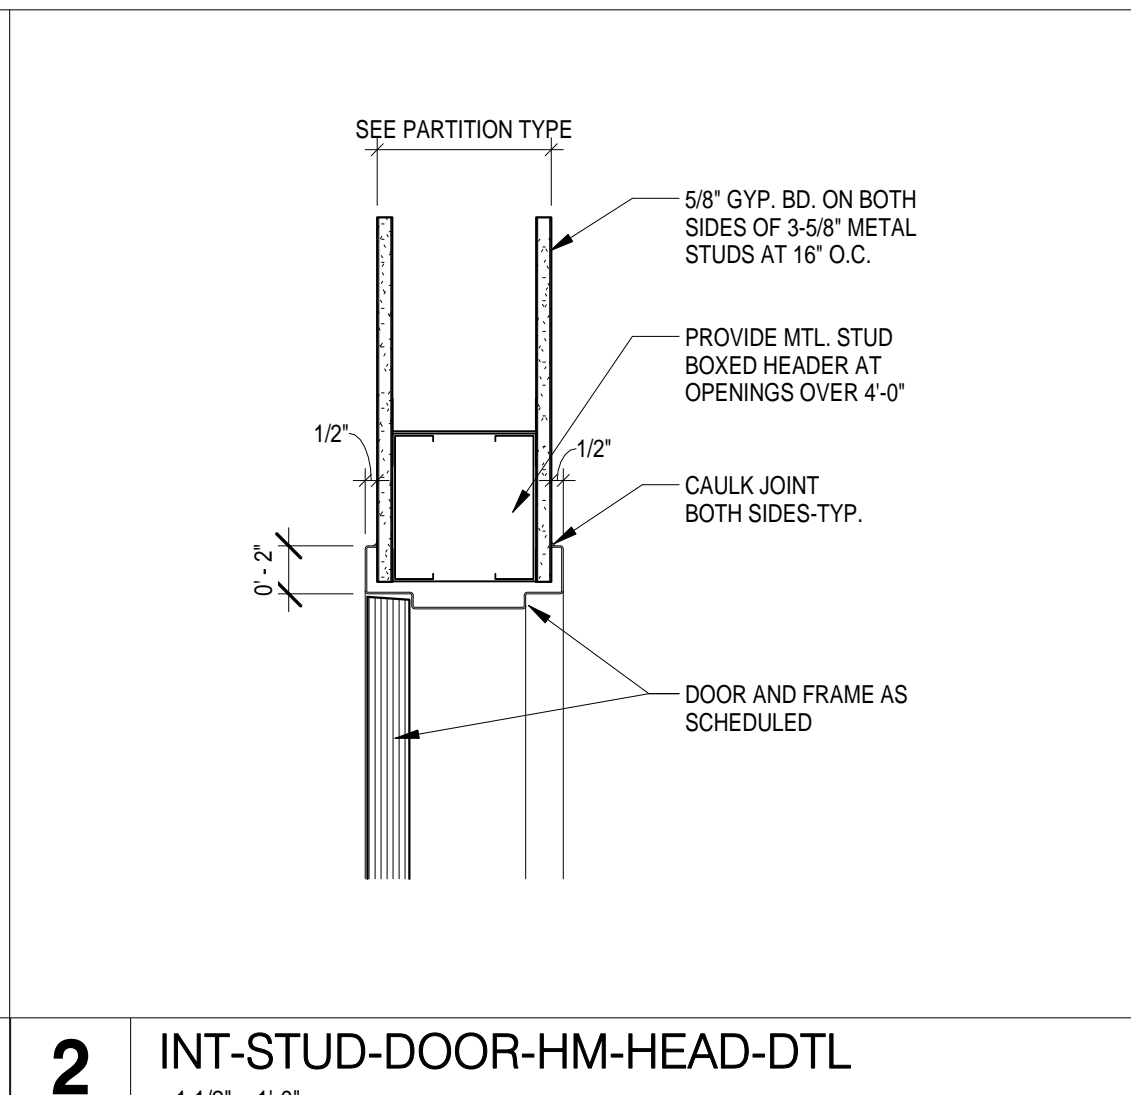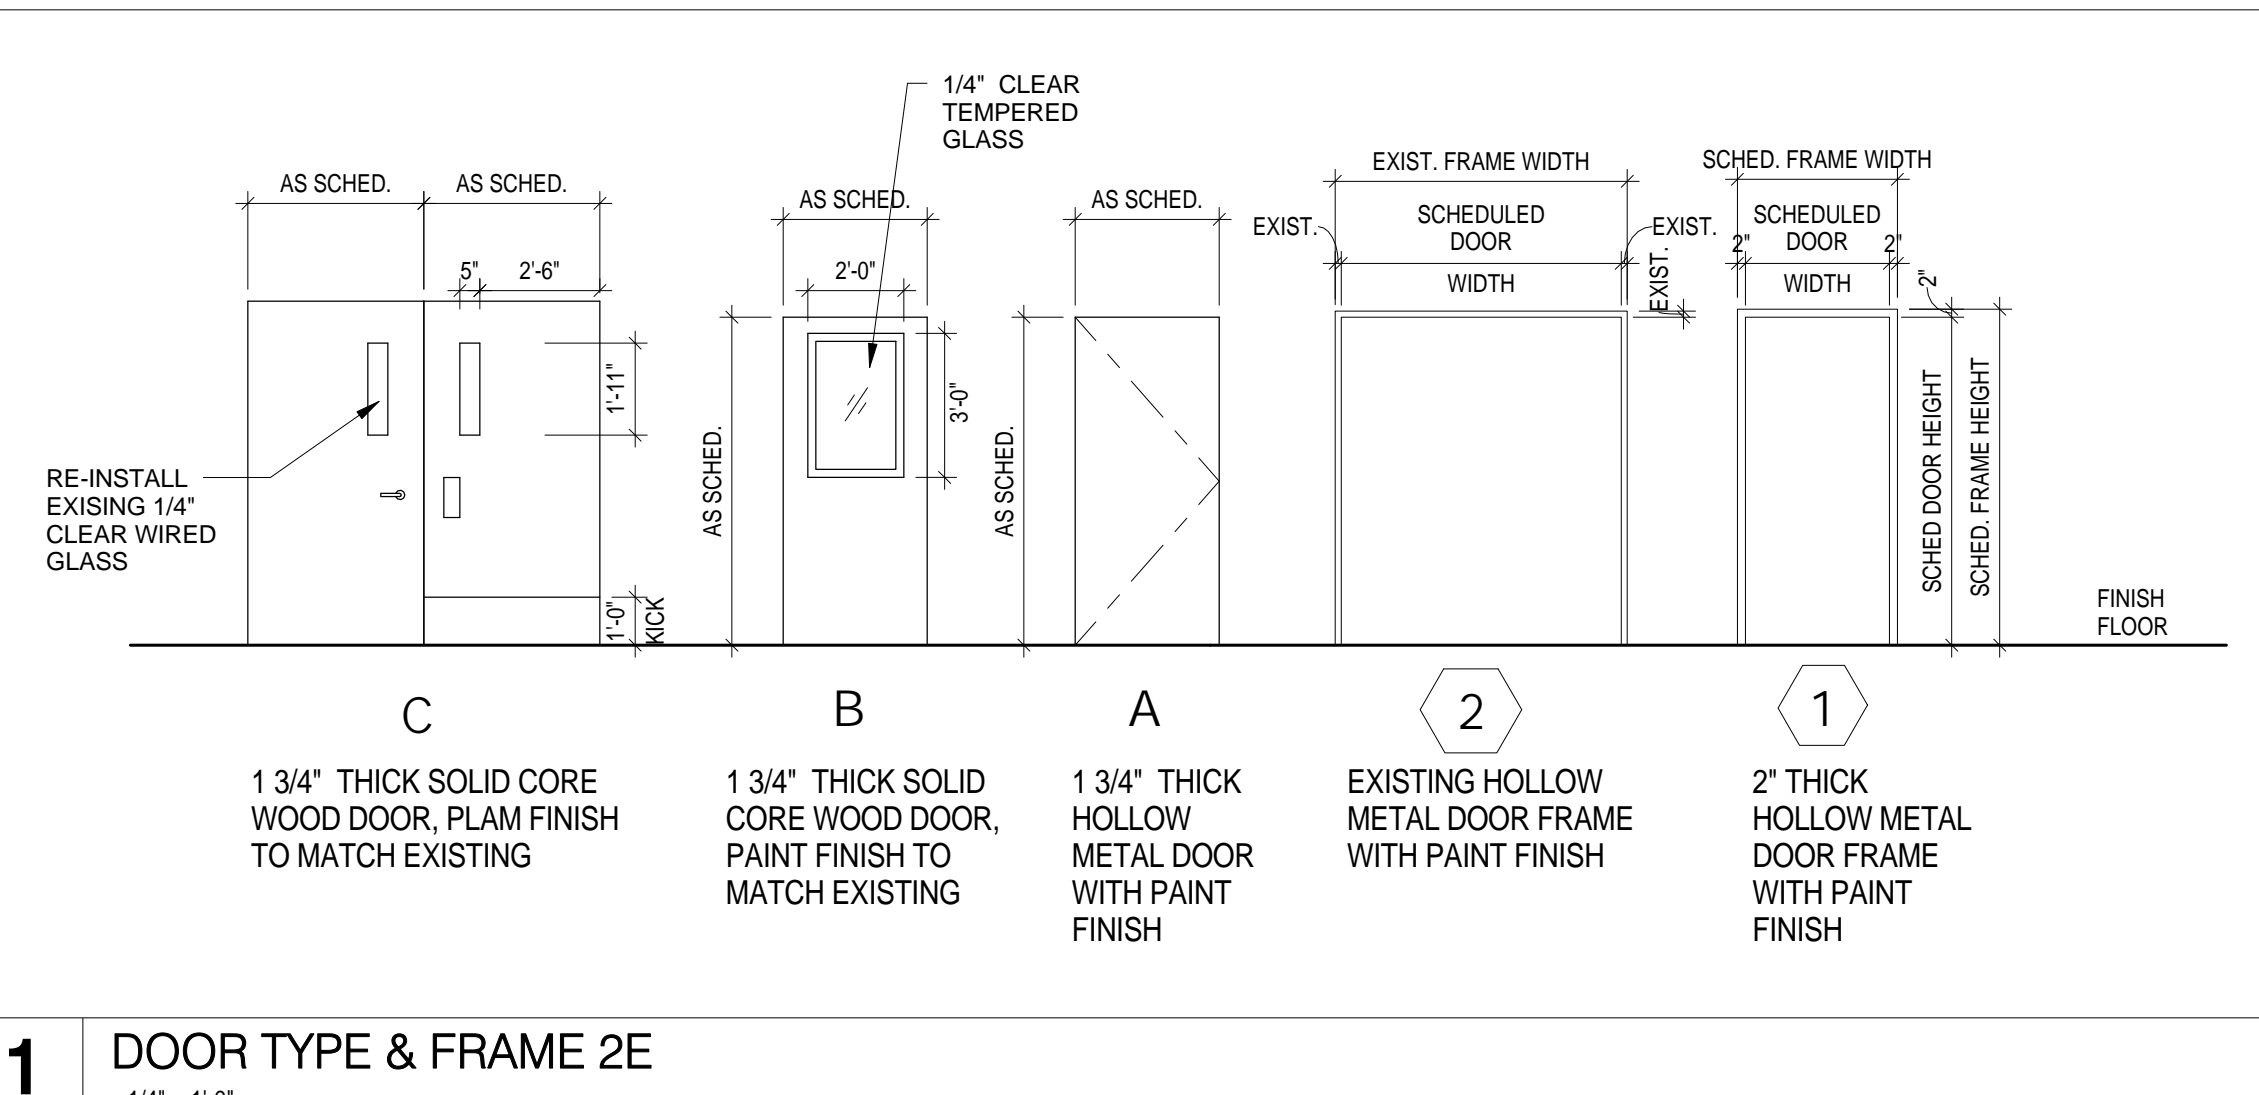



**DEMOLITION - KEYED NOTES**

- NOTE: REFER TO ENLARGED PLANS FOR ADDITIONAL KEYED NOTE LOCATIONS IF NOT VISIBLE ON THIS SHEET.
- 01 TYPICAL - REMOVE EXISTING MILLWORK AND/OR TRASH UNIT AND STORE FOR REINSTALLATION; COORDINATE EXACT REQUIREMENTS IN FIELD.
  - 02 REMOVE ALL EXISTING FLOORING, WALL FINISHES, FIXTURES AND ACCESSORIES; REFER TO MEP DRAWINGS FOR ADDITIONAL INFO PERTAINING TO FIXTURES, PREP EXISTING SUBSTRATES TO REMAIN FOR RECEIPT OF NEW FINISHES.
  - 03 REMOVE EXISTING DOOR AND FRAME; SALVAGE DOORS AND RETURN TO BUILDING STOCK; RE: RENOVATION PLAN
  - 04 TYPICAL - REMOVE ALL WALL-MOUNTED ACCESSORIES (IE, BULLETIN BOARDS, SIGNAGE, ETC.) AND STORE FOR REINSTALLATION; COORDINATE EXACT REQUIREMENTS IN FIELD
  - 05 REMOVE EXISTING VINYL OR TILE FLOORING AND WALL BASE; PREP EXISTING SUBSTRATE FOR RECEIPT OF NEW FINISHES; RE: FINISH PLANS; COORDINATE TEMPORARY REMOVAL OF ANY FURNITURE AND EQUIPMENT WITH OWNER
  - 06 DEMOLISH EXISTING NURSE STATION
  - 07 DEMOLISH EXISTING WALLS WHERE INDICATED DASHED; COORDINATE EXACT REQUIREMENTS IN FIELD
  - 08 EXISTING CHASE WALL TO REMAIN; REMOVE FINISHES ONLY
  - 09 REMOVE EXISTING NOURISHMENT STATION/DOORS; NOURISHMENT STATION TO REMAIN; PROTECT IN PLACE
  - 10 EXISTING TELEPHONE BANK/MILLWORK TO REMAIN; PROTECT IN PLACE
  - 11 COORDINATE WITH OWNER TEMPORARY REMOVAL OF EXISTING SIGNAGE, WALL-MOUNTED ACCESSORIES AND WALL-MOUNTED DEVICES TO PREPARE FOR APPLICATION OF NEW WALL FINISHES, TYPICAL THROUGHOUT
  - 12 REMOVE EXISTING FLOORING ONLY
  - 13 ALTERNATE NO. 2E-05; RE: SPECS
  - 14 EXISTING FLOORING AND WALL BASE TO REMAIN
  - 15 REMOVE EXISTING FLOORING AND WALL BASE; PREP EXISTING SUBSTRATE FOR RECEIPT OF NEW FINISHES; RE: FINISH PLANS; COORDINATE TEMPORARY REMOVAL OF ANY FURNITURE AND EQUIPMENT WITH OWNER
  - 16 ALTERNATE NO. 2E-01; RE: SPECS

**RENOVATION - KEYED NOTES**

- NOTE: REFER TO ENLARGED PLANS FOR ADDITIONAL KEYED NOTE LOCATIONS IF NOT VISIBLE ON THIS SHEET.
- 01 INSTALL SCHEDULED FLOORING & BASE; RE: FINISH PLAN
  - 02 APPLY SCHEDULED WALL FINISH THROUGHOUT; RE: FINISH PLAN
  - 03 RENSTALL EXISTING MILLWORK, WALL-MOUNTED DEVICES, AND EQUIPMENT AS NEEDED; COORDINATE WITH OWNER IN FIELD
  - 04 INSTALL NEW CEILING, WALL FINISHES, PLUMBING FIXTURES AND FLOORING FINISHES
  - 05 RE-PANT ALL EXISTING WALLS WITHIN THIS AREA WITH PT-1; EXISTING FLOORING IS ALSO TO BE REMOVED AS PART OF BASE SCOPE OF WORK. FLOORING REPLACEMENT AND WALL PAINTING SHALL BOTH OCCUR OVER THE COURSE OF ONE WEEKEND (FRIDAY THROUGH SUNDAY); COORDINATE REMOVAL AND REINSTALLATION OF ANY FURNITURE, FIXTURES, AND EQUIPMENT ITEMS IN FIELD WITH OWNER
  - 06 IN LIEU OF TYPICAL WALL PAINT, APPLY CHALKBOARD PAINT TO EXISTING WALL OPPOSITE FROM PATIENT BEDS IN THE ROOM (CONFIRM IN FIELD); CHALKBOARD PAINT IS TO EXTEND FROM EXISTING DESK HEIGHT TO ALIGN WITH THE TOP OF THE EXISTING DOOR FRAME AND FOR THE FULL LENGTH OF THE WALL
  - 07 ALTERNATE NO. 2E-01; RE: SPECS
  - 08 ALTERNATE NO. 2E-02; RE: SPECS
  - 09 REMOVE THE EXISTING NURSE STATION AND REPLACE WITH A NEW NURSE STATION TO MATCH THE CONFIGURATION AND FINISHES AS BUILT IN UNITS 1D AND 2B WITH EXCEPTIONS AS NOTED AND DEPICTED IN DETAILS WITHIN; MODIFY EXISTING CORING WITHIN THE FLOOR SLAB AS NEEDED TO ACCOMMODATE THE NEW NURSE STATION CONFIGURATION; EXISTING CEILING IS TO REMAIN IN THIS AREA, NO FURR-DOWNS ARE TO BE INSTALLED ABOVE THE NEW NURSE STATION
  - 10 ALTERNATE NO. 2E-03; RE: SPECS
  - 11 RE: INTERIOR ELEVATIONS FOR EXISTING NOURISHMENT STATION MODIFICATIONS
  - 12 ALTERNATE NO. 2E-05; RE: SPECS

**GENERAL DEMOLITION NOTES:**

1. THE DEMOLITION PLAN OUTLINES SOME OF THE SCOPE OF THE WORK INVOLVED FOR THE DEMOLITION PHASE OF THIS PROJECT. CONTRACTOR SHALL REVIEW ALL SHEETS FOR ADDITIONAL DEMO SCOPE.
2. CONTRACTOR SHALL VERIFY EXISTING SITE AND BUILDING CONDITIONS AND DIMENSIONS IN THE FIELD PRIOR TO COMMENCING DEMOLITION ACTIVITIES. CONTRACTOR SHALL NOT SCALE DRAWINGS. CONTRACTOR WILL NOTIFY ARCHITECT OF ANY DISCREPANCIES IN WRITING.
3. AFTER AWARD OF THE CONTRACT, CHANGE ORDER REQUESTS FOR ADDITIONAL MONEY WILL NOT BE APPROVED IF THE WORK COULD HAVE BEEN ANTICIPATED DURING A SITE VISIT BY THE CONTRACTOR.
4. CONTRACTOR WILL BE REQUIRED TO REPAIR, REPLACE, OR PATCH EXISTING BUILDINGS, DRIVEWAYS, SIDEWALKS, CANOPIES, AND/OR PARKING AREAS DISTURBED BY DEMOLITION.
5. CONTRACTOR WILL BE REQUIRED TO REGRADE AND HYDROMULCH AREAS AFFECTED BY DEMOLITION.
6. ALL FURNITURE WILL BE MOVED OR RELOCATED BY THE OWNER AS NECESSARY PRIOR TO THE DEMOLITION WORK OF THIS PROJECT. CONTRACTOR SHALL COORDINATE WITH OWNER AS REQUIRED.
7. REMOVE EXISTING CONSTRUCTION TO THE EXTENT INDICATED ON THE DRAWINGS. SHOULD ANY DAMAGE OCCUR TO ANY EXISTING CONSTRUCTION TO REMAIN, THE CONTRACTOR SHALL REPAIR THE DAMAGE TO MATCH EXISTING/ADJACENT CONSTRUCTION.
8. CONTRACTOR IS TO VERIFY THE EXACT LOCATION OF ALL EXISTING UTILITIES PRIOR TO DEMOLITION ACTIVITIES.
9. CONTRACTOR SHALL REMOVE DEBRIS REGULARLY AS NECESSARY TO ELIMINATE INTERFERENCE WITH ROADS, STREET, WALKS, AND ALL OTHER ADJACENT FACILITIES.
10. CONTRACTOR IS RESPONSIBLE FOR CONSTRUCTION OF TEMPORARY DUST AND/OR SOUND PARTITIONS BETWEEN CONSTRUCTION AREA AND AREAS NOT IN SCOPE AS NECESSARY. DEMOLITION ACTIVITIES SHALL BE PERFORMED SO AS TO PRODUCE MINIMAL DISTURBANCE TO EXISTING FACILITY AND OCCUPANTS (I.E. MINIMIZE EXCESSIVE AND PROLONGED NOISE LEVELS AND DUST).
11. NOTIFY THE BUILDING OWNER OF ANY MATERIALS, FIXTURES, ETC. TO BE REMOVED THAT ARE DEEMED SALVAGEABLE. TURN OVER ANY REQUESTED ITEMS TO THE BUILDING OWNER IN GOOD CONDITION.
12. THE CONTRACTOR SHALL REMOVE ALL TRASH AND DEBRIS FROM THE SITE ON A DAILY BASIS.
13. MAINTAIN THE INTEGRITY OF ALL EXISTING RATED WALLS, FIRE SEAL ANY PENETRATIONS WITH U.L. APPROVED ASSEMBLY.
14. WHEN UNANTICIPATED MECHANICAL, ELECTRICAL, OR STRUCTURAL ELEMENTS THAT CONFLICT WITH THE INTENDED PLUNION OR DESIGN ARE ENCOUNTERED, DETERMINE THE NATURE AND EXTENT OF THE CONFLICT AND NOTIFY THE ARCHITECT IMMEDIATELY FOR RESOLUTION.
15. CONTRACTOR SHALL PROVIDE TRAFFIC HANDLING MEASURES AS NECESSARY TO PROTECT THE GENERAL PUBLIC AT ALL TIMES, AND AS REQUIRED BY GOVERNING AUTHORITIES.
16. DO NOT INTERRUPT EXISTING UTILITIES, EXCEPT WHEN AUTHORIZED IN WRITING BY AUTHORITIES HAVING JURISDICTION. PROVIDE TEMPORARY SERVICES DURING INTERRUPTIONS TO EXISTING UTILITIES, AS ACCEPTABLE TO GOVERNING AUTHORITIES.
17. WHEN UTILITY SERVICES ARE REQUIRED TO BE REMOVED, RELOCATED, OR ABANDONED, PROVIDE BYPASS CONNECTIONS TO MAINTAIN CONTINUITY OF SERVICE BEFORE PROCEEDING WITH DEMOLITION.
18. PRIOR TO COMMENCEMENT WITH ANY DEMOLITION WORK, CONTRACTOR SHALL IDENTIFY ALL ELECTRICAL CIRCUITS SERVING THE AREA INVOLVED WITH THIS DEMOLITION. THOSE CIRCUITS SHALL THEN BE LOCKED OUT AND TAGGED OUT IF THEY DO NOT SERVICE ANY OF THE REMAINING BUILDING. THOSE CIRCUITS WHICH ARE IDENTIFIED TO SERVICE BOTH THE AREA TO BE DEMOLISHED AND THE REMAINING BUILDING SHALL BE SPLIT SO AS TO KILL ALL ELECTRICAL POWER TO THE AREA TO BE DEMOLISHED WHILE MAINTAINING POWER TO THE REMANDER OF THE BUILDING.
19. CONTRACTOR TO RE-LOCATE UTILITIES & EQUIPMENT AS REQUIRED TO ACCOMMODATE NEW PLUMBING REQUIREMENTS FOR NEW RENOVATION WORK.
20. REFER TO DEMOLITION PLUMBING PLANS FOR EXTENT OF CONCRETE SLAB TO BE REMOVED AND REPLACED FOR UNDER FLOOR PIPING INSTALLATION.
21. EXISTING WALLS (OR PORTIONS OF WALLS) TO BE REMOVED SHALL BE CUT FLUSH WHERE INTERSECTING WITH WALLS TO REMAIN. REMAINING WALLS TO BE PATCHED AND FINISHED SMOOTH.
22. NEW OPENING TO BE CUT IN EXISTING WALLS SHALL BE SAW-CUT AT LOCATIONS INDICATED TO THE HEIGHT AND WIDTH INDICATED. NEW UNTELS SHALL BE INSTALLED TO SUPPORT EXISTING WALL CONSTRUCTION ABOVE AS INDICATED ON THE DRAWINGS, OR IF NOT INDICATED, AS REQUIRED FOR NEW WALL CONSTRUCTION PER STRUCTURAL DRAWINGS, IF PROVIDED.
23. WHERE EXISTING INTERIOR WALLS ARE REPLACED OR REMOVED, REMOVE MEP SYSTEMS BACK TO PANEL OR MECHANICAL ROOM OR FARTHEST POSSIBLE POINT WITHOUT DISTURBING EXISTING CONSTRUCTION. REMOVE EXISTING MECHANICAL EQUIPMENT. RELOCATE POWER PER MEP DRAWINGS.
24. REFER TO MEPP DRAWINGS FOR DEMOLITION OF MEPP SYSTEMS. IDENTIFY WORK REQUIRED BY THIS CONTRACTOR WHICH MAY AFFECT DEMOLITION AND/OR REPAIRS OF ARCHITECTURAL ELEMENTS. COORDINATE WITH RELATED SUBS THE EXTENT OF ALL DEMOLITION WORK.
25. PATCH FLOORS, WALLS CEILINGS WHICH REMAIN AT LOCATIONS WHERE PIPES, CONDUITS, ETC. ARE REMOVED AS REQUIRED TO MATCH EXISTING CONDITIONS OR TO RECEIVE NEW FINISHES.
26. WHERE EXISTING FINISH FLOOR IS REMOVED, PREPARE SURFACE TO RECEIVE NEW FLOORING.
27. NOTIFY ARCHITECT & OWNER OF ANY POSSIBLE ASBESTOS CONTAINING MATERIALS DISCOVERED BEFORE PROCEEDING WITH WORK. PROTECT INTERIOR CONSTRUCTION TO REMAIN DURING DEMOLITION AND CONSTRUCTION.
28. CONTRACTOR TO OBTAIN ALL NECESSARY PERMITS BEFORE COMMENCING WORK.
29. CONTRACTOR TO PROVIDE ALL NECESSARY SHORING FOR PROTECTION OF EXISTING STRUCTURE AND FOUNDATION TO REMAIN.
30. ALL DASHED LINES ARE DEMOLITION LINES UNLESS NOTED OTHERWISE.
31. REMOVE ALL CARPET WASTECUT FROM ALL LOCATIONS IN EACH UNIT.

**GENERAL NOTES**



1. VERIFY DIMENSIONS AND EXISTING CONDITIONS BEFORE COMMENCING WORK. REPORT DISCREPANCIES TO THE ARCHITECT PRIOR TO PROCEEDING WITH AFFECTED WORK.
2. REFLECTING CEILING PLAN DIMENSIONS ARE REFERENCED FROM FINISHED SURFACES UNLESS NOTED OTHERWISE. CEILING HEIGHTS ARE DIMENSIONED FROM FLOOR TO FINISHED CEILING HEIGHT.
3. DIMENSIONS NOTED AS "FIELD VERIFY" SHALL BE CHECKED AT THE SITE BY THE CONTRACTOR AND REVIEWED WITH THE ARCHITECT BEFORE INCORPORATING INTO THE WORK.
4. DO NOT SCALE DRAWING. WRITTEN DIMENSIONS TAKE PRECEDENCE. IF CLARIFICATION IS REQUIRED IN ORDER TO DETERMINE THE INTENT OF THE CONTRACT DOCUMENTS, CONTACT THE ARCHITECT.
5. NOTES OR DIMENSIONS LABELED "TYPICAL" SHALL APPLY TO SITUATIONS THAT ARE THE SAME OR SIMILAR.
6. ALL INTERIOR PARTITIONS SHALL BE KEYED AS REFERENCE SHEET A7.00 FOR PARTITION TYPES.
7. ALL DIMENSIONS ARE TO FACE OF FINISHED WALL UNLESS NOTED OTHERWISE.
8. ALL SPACES WITH FLOOR DRAINS TO HAVE FINISHED FLOORS SLOPED TO DRAIN NOT TO EXCEED ONE IN FIFTY.
9. ALL FLOORS FINISH CHANGES SHALL OCCUR AT THE CENTERLINE OF DOORS UNLESS NOTED OTHERWISE. ALL FLOOR FINISH CHANGES SHALL HAVE THRESHOLDS OR REDUCER STRIPS.
10. ALL DOORS IN INTERIOR GYP. BD STUD WALLS SHALL BE SET 4" OFF THE PERP. ADJ. WALL ON THE HINGE SIDE OF THE DOOR UNLESS NOTED OTHERWISE. THE CONTRACTOR SHALL CONTACT THE ARCHITECT IF ANY CONFLICT OCCURS.
11. PROVIDE VINYL REDUCER AT ALL DISSIMILAR FLOOR MATERIALS UNLESS OTHERWISE NOTED.
12. UNLESS OTHERWISE NOTED, ALL ELECTRICAL AND MECHANICAL OPERABLE DEVICES SHALL BE MOUNTED WITH THE HIGHEST OPERABLE CONTROL AT 42" AFF.
13. ALL REQUIRED CLEARANCES, AS DESCRIBED IN THE TEXAS ACCESSIBILITY STANDARDS (TAS) OF THE ARCHITECTURAL BARRIERS ACT ARTICLE 9102, TEXAS CIVIL STATUTES (2012) FOR COUNTERTOPS, ALL PLUMBING FIXTURES INCLUDING DRINKING FOUNTAINS, LAVATORIES, URINALS, AND TOILETS WILL BE STRICTLY ENFORCED.



**ARCHITECTURE**  
 PBK ARCHITECTS  
 11 Greenway Plaza, 22nd Floor  
 Houston, TX 77046  
 713-965-9600 P  
 713-961-4571 F  
 TX Firm F-1709  
 PBK.com

**MEP**  
 SHAH SMITH AND ASSOCIATES  
 2625 S. Wilshire Dr. #300  
 HOUSTON, TX 77042  
 (713) 790 - 7563



**HARRIS COUNTY PSYCHIATRIC  
 CENTER RENOVATION UNITS: 1C,  
 2E, 3B, 3C, 3D & 3E**

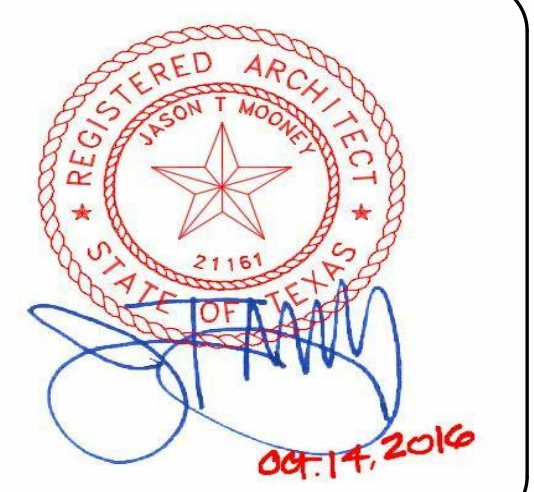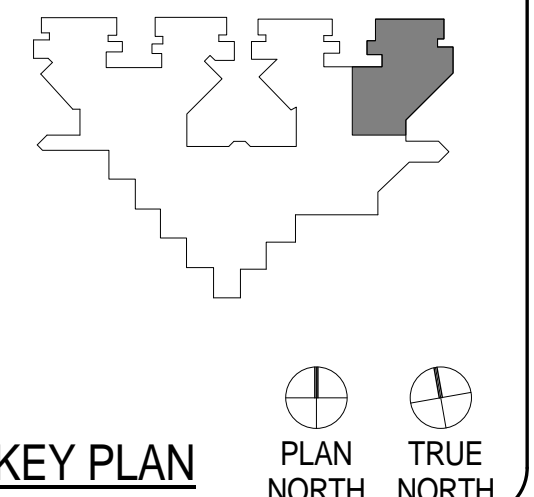

CLIENT UT HEALTH		
PROJECT NUMBER 16106		
DATE:	OCTOBER 14, 2016	
DRAWN BY:	Author	
CHECKED BY:	Checker	
REVISIONS		
No.	Description	Date




ISSUE FOR BID  
**SECOND FLOOR  
 UNIT 2E**

**A2.05E**

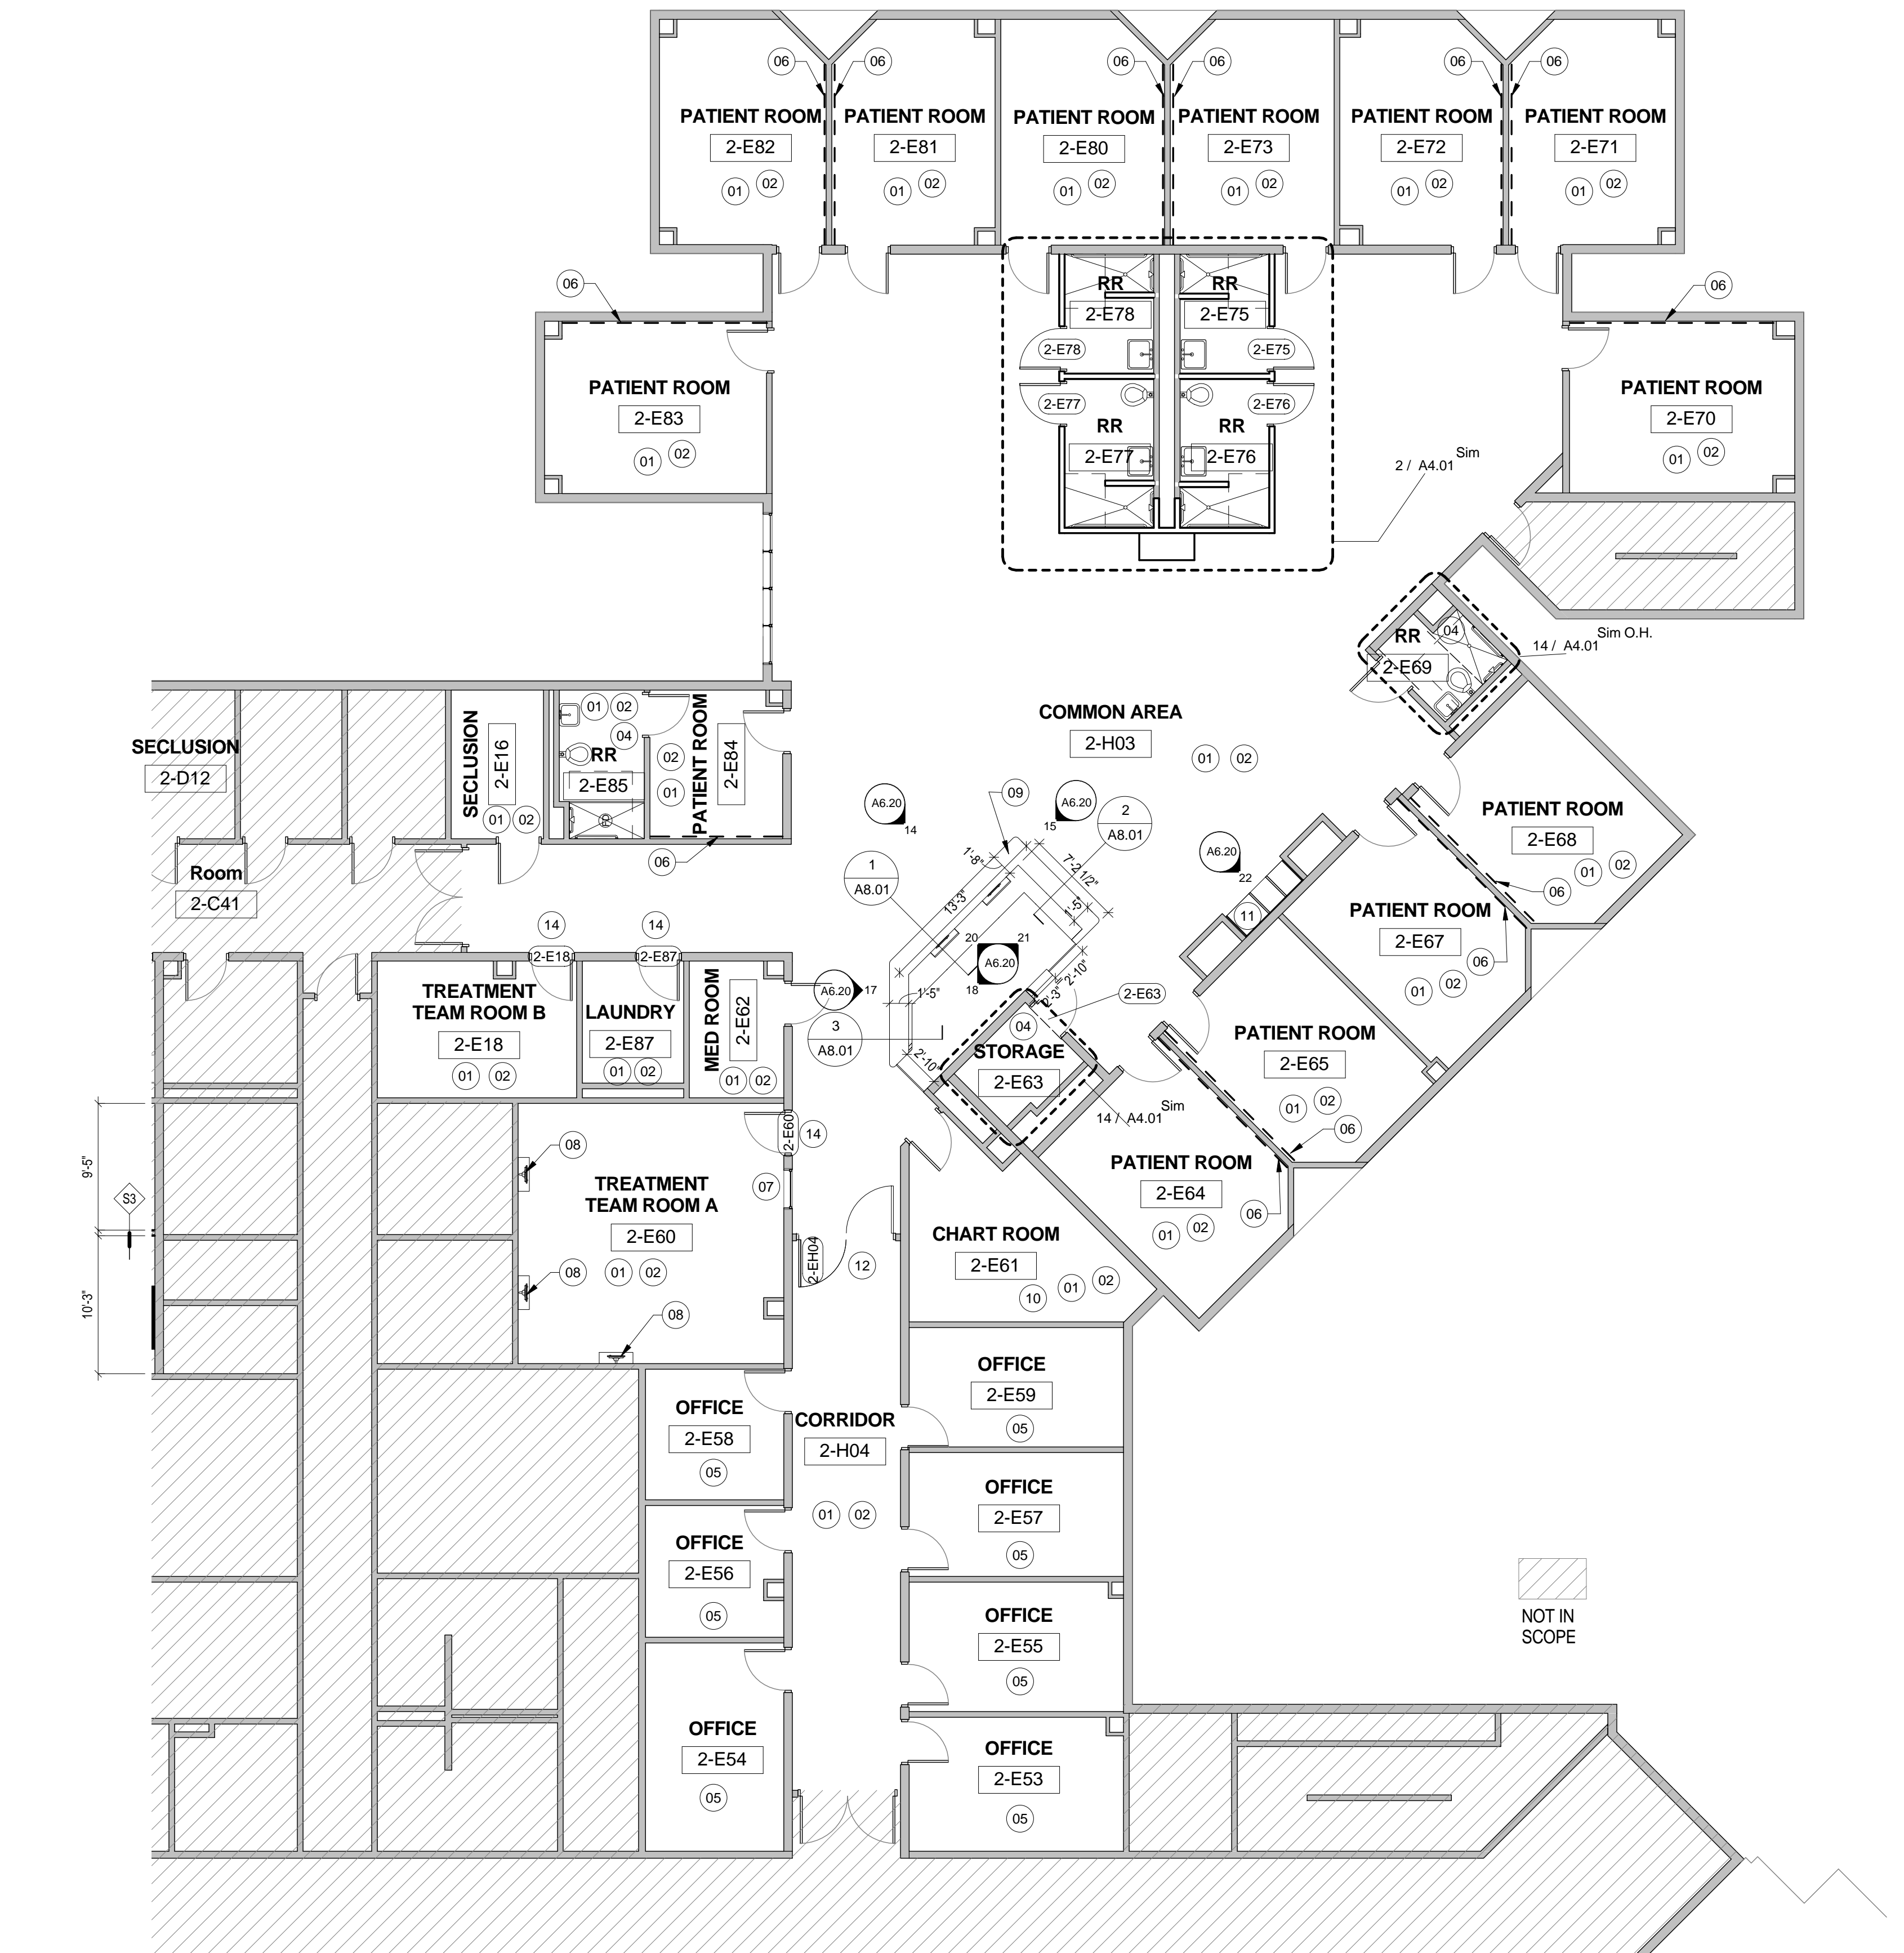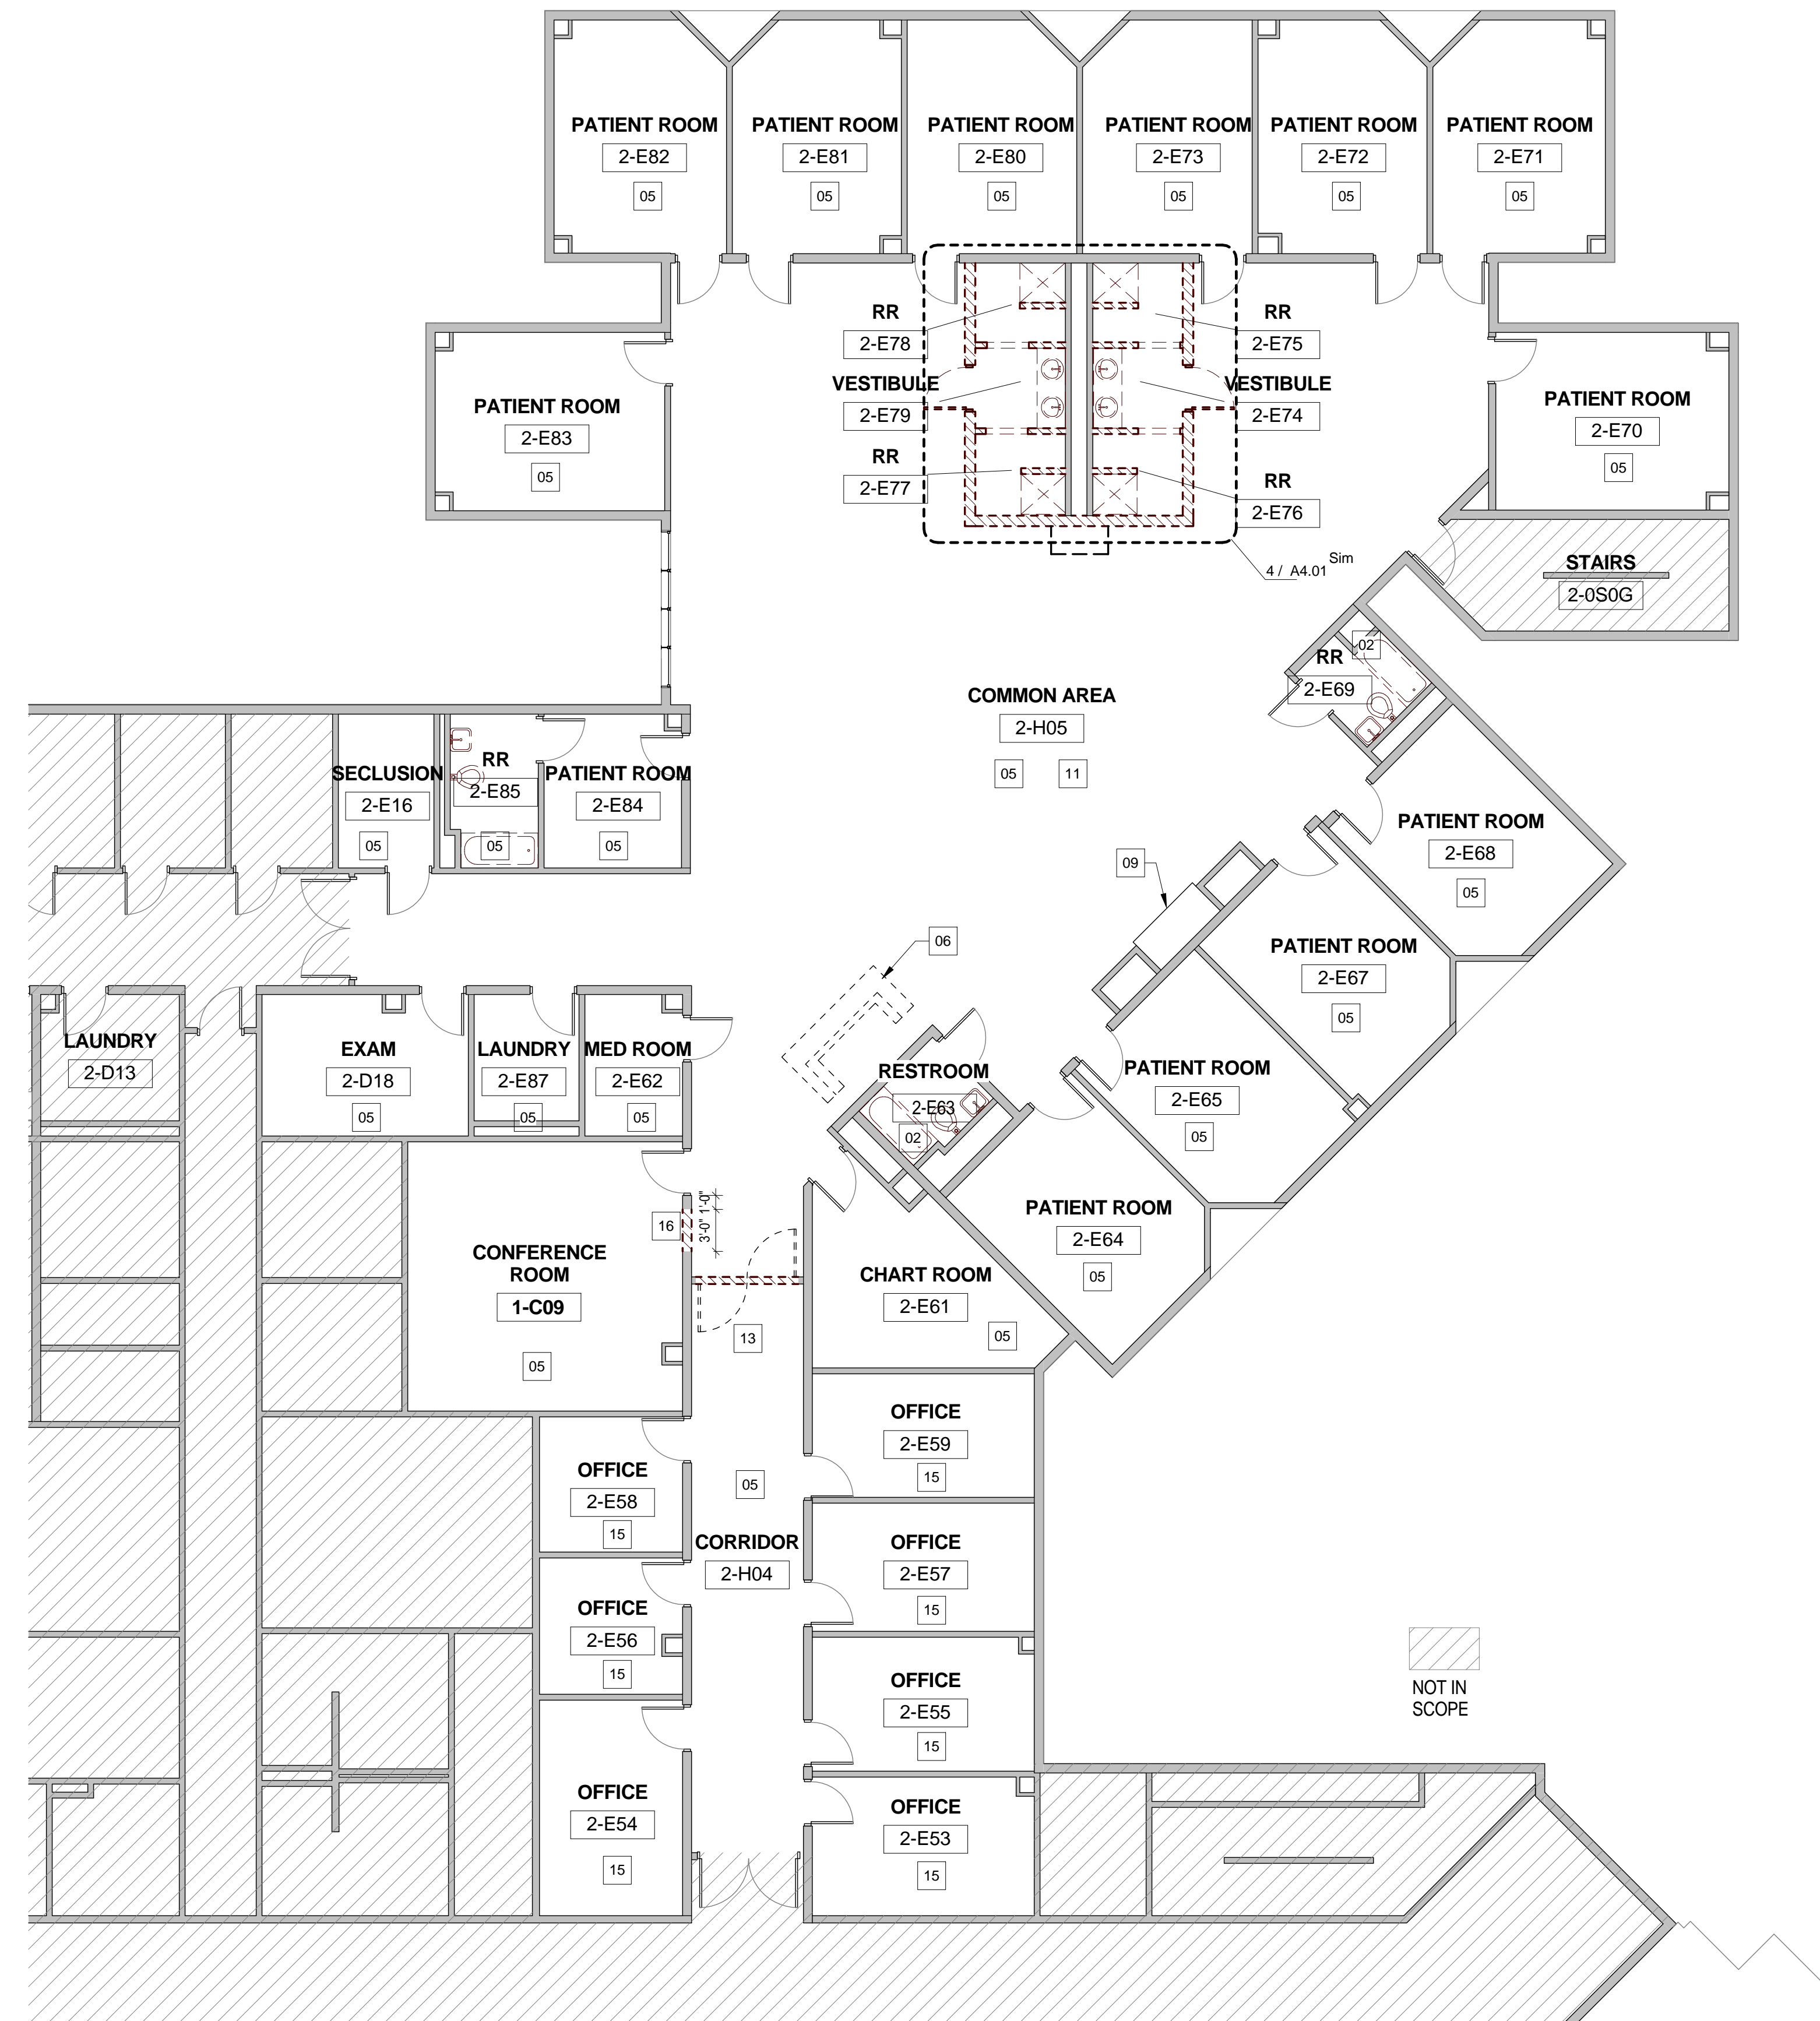



**HARRIS COUNTY PSYCHIATRIC  
 CENTER RENOVATION UNITS: 1C,  
 2E, 3B, 3C, 3D & 3E**

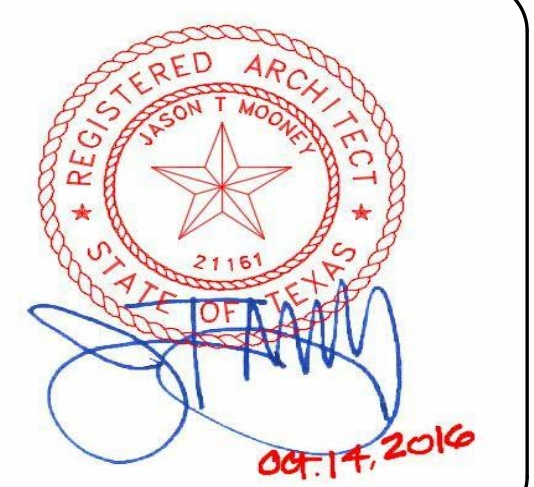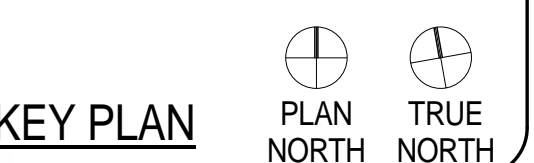


CLIENT	UT HEALTH
PROJECT NUMBER	16106
DATE:	OCTOBER 14, 2016
DRAWN BY:	Author
CHECKED BY:	Checker

No.	Description	Date

ISSUE FOR BID  
**SECOND FLOOR  
 UNIT 2E - SIGNAGE  
 PLAN**

**A2.06E**

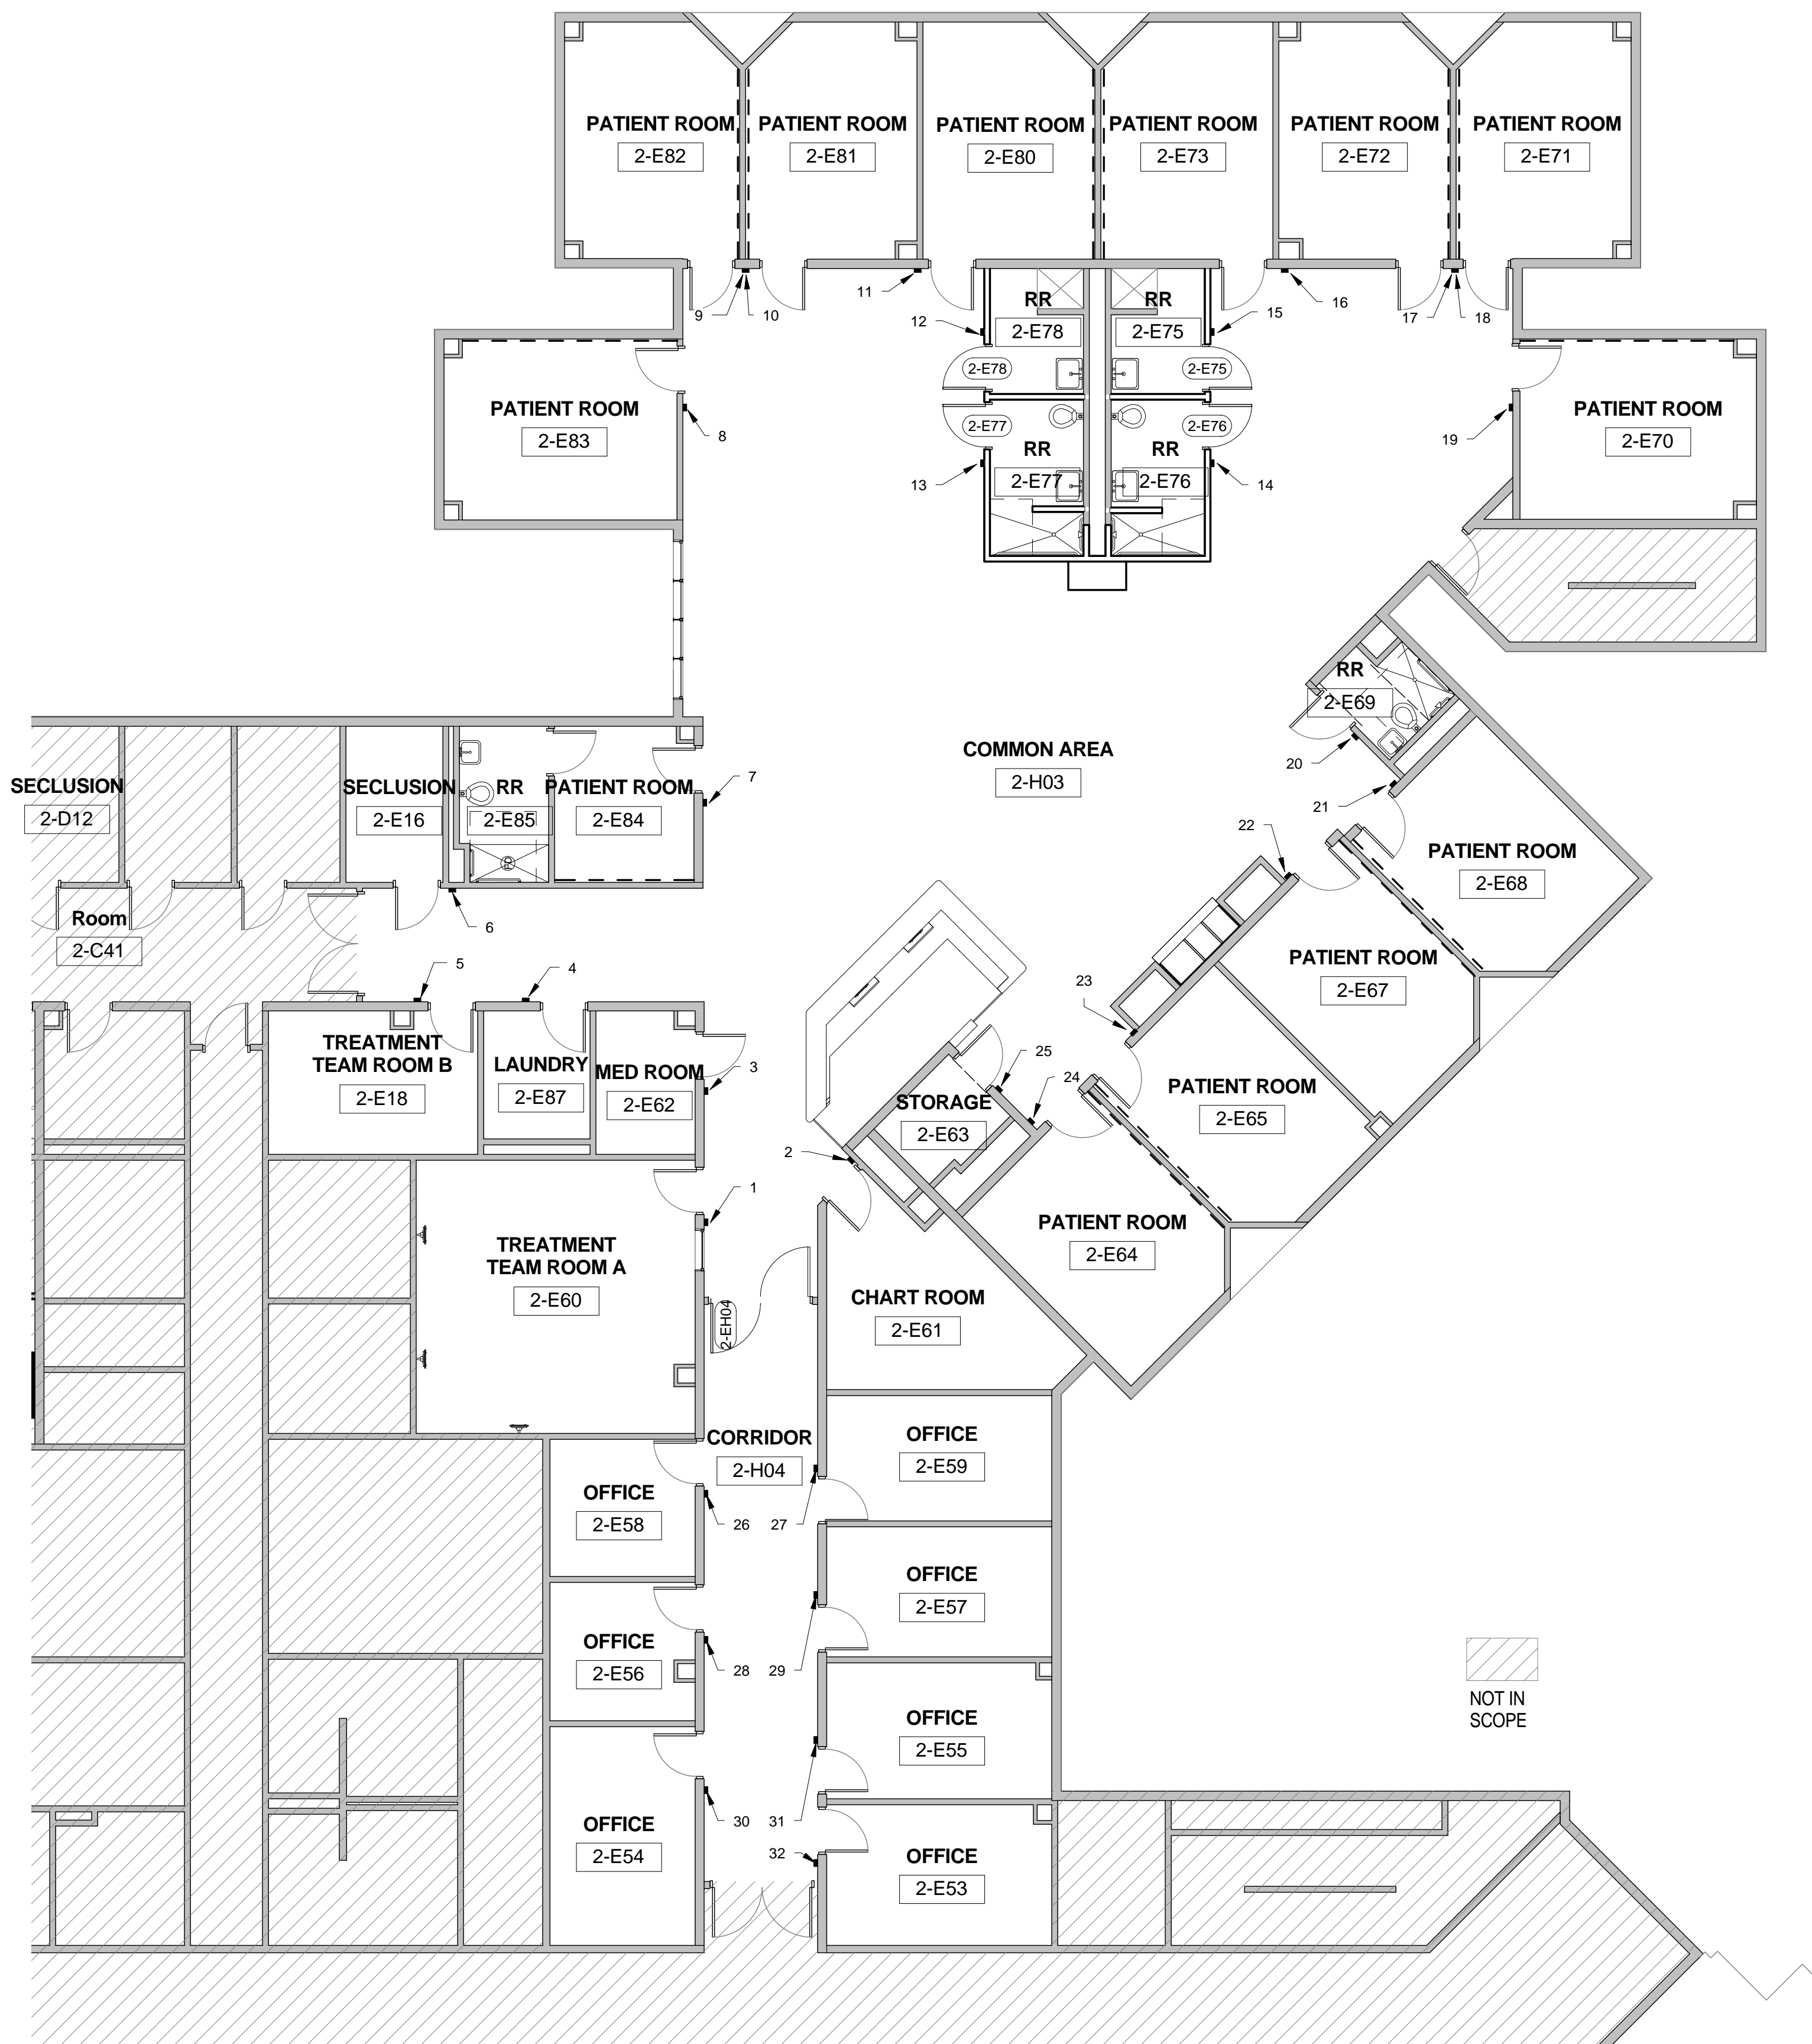

SGN #	SGN TYPE	LOCATION	DETAIL	MESSAGE	15	B	2-E75	RE: G4589-14 R1	LINE 1: 2-E75 LINE 2: ADA BRAILLE: 2-E75 LINE 3: N/A LINE 4: MALE IMAGE LINE 5: IMAGE LINE 6: IMAGE LINE 7: N/A LINE 8: MEN'S LINE 9: ADA BRAILLE: MEN'S LINE 10: PLEASE KNOCK BEFORE ENTERING LINE 11: POR FAVOR SONAR ANTES DE ENTRAR LINE 12: SLIDER PANEL LINE 13: N/A LINE 14: INSERT LINE 15: ADA BRAILLE: 2-E73 LINE 3: N/A LINE 4: N/A LINE 1: 2-E72 LINE 2: ADA BRAILLE: 2-E72 LINE 3: N/A LINE 4: N/A LINE 1: 2-E70 LINE 2: ADA BRAILLE: 2-E70 LINE 3: N/A LINE 4: N/A LINE 1: 2-E69 LINE 2: ADA BRAILLE: 2-E69 LINE 3: N/A LINE 4: MALE + FEMALE UNISEX IMAGE LINE 5: IMAGE LINE 6: IMAGE LINE 7: N/A LINE 8: BATHROOM LINE 9: ADA BRAILLE: BATHROOM LINE 10: PLEASE KNOCK BEFORE ENTERING LINE 11: POR FAVOR SONAR ANTES DE ENTRAR LINE 12: SLIDER PANEL LINE 13: N/A LINE 14: INSERT LINE 15: ADA BRAILLE: 2-E68 LINE 2: ADA BRAILLE: 2-E68 LINE 3: N/A LINE 4: N/A LINE 1: 2-E67 LINE 2: ADA BRAILLE: 2-E67 LINE 3: N/A LINE 4: N/A LINE 1: 2-E65 LINE 2: ADA BRAILLE: 2-E65 LINE 3: N/A LINE 4: N/A LINE 1: 2-E64 LINE 2: ADA BRAILLE: 2-E64 LINE 3: N/A LINE 4: N/A LINE 5: STORAGE LINE 6: ADA BRAILLE: (STORAGE) LINE 7: N/A LINE 1: 2-E58 LINE 2: ADA BRAILLE: 2-E58 LINE 3: N/A LINE 4: N/A LINE 5: INSERT LINE 6: INSERT LINE 1: 2-E59 LINE 2: ADA BRAILLE: 2-E59 LINE 3: N/A LINE 4: N/A LINE 5: INSERT LINE 1: 2-E56 LINE 2: ADA BRAILLE: 2-E56 LINE 3: N/A LINE 4: N/A LINE 5: INSERT LINE 1: 2-E57 LINE 2: ADA BRAILLE: 2-E57 LINE 3: N/A LINE 4: N/A LINE 5: INSERT LINE 1: 2-E54 LINE 2: ADA BRAILLE: 2-E54 LINE 3: N/A LINE 4: N/A LINE 5: INSERT LINE 1: 2-E55 LINE 2: ADA BRAILLE: 2-E55 LINE 3: N/A LINE 4: N/A LINE 5: INSERT
1	C	2-E60	RE: G4589-14 R1	LINE 1: 2-E60 LINE 2: ADA BRAILLE: 2-E60 LINE 3: N/A LINE 4: N/A LINE 5: TREATMENT TEAM LINE 6: ROOM A LINE 7: (ADA BRAILLE: TREATMENT TEAM ROOM A) LINE 8: N/A LINE 9: 2-E61 LINE 2: ADA BRAILLE: 2-E61 LINE 3: N/A LINE 4: N/A LINE 5: STAFF ROOM LINE 6: ADA BRAILLE: STAFF ROOM LINE 7: N/A LINE 1: 2-E61 LINE 2: ADA BRAILLE: 2-E62 LINE 3: N/A LINE 4: N/A LINE 5: MEDICATION LINE 6: ROOM LINE 7: ADA BRAILLE: MEDICATION ROOM LINE 8: N/A LINE 1: 2-E67 LINE 2: ADA BRAILLE: 2-E67 LINE 3: N/A LINE 4: N/A LINE 5: LAUNDRY LINE 6: ADA BRAILLE: LAUNDRY LINE 7: N/A LINE 1: 2-E18 LINE 2: ADA BRAILLE: 2-E18 LINE 3: N/A LINE 4: N/A LINE 5: TREATMENT TEAM ROOM B LINE 6: ADA BRAILLE: TREATMENT TEAM ROOM B) LINE 7: N/A LINE 1: 2-E85 LINE 2: ADA BRAILLE: 2-E85 LINE 3: N/A LINE 4: N/A LINE 5: SECLUSION LINE 6: ADA BRAILLE: SECLUSION LINE 7: N/A LINE 1: 2-E87 LINE 2: ADA BRAILLE: 2-E84 LINE 3: N/A LINE 4: N/A LINE 1: 2-E83 LINE 2: ADA BRAILLE: 2-E83 LINE 3: N/A LINE 4: N/A LINE 1: 2-E82 LINE 2: ADA BRAILLE: 2-E82 LINE 3: N/A LINE 4: N/A LINE 1: 2-E81 LINE 2: ADA BRAILLE: 2-E81 LINE 3: N/A LINE 4: N/A LINE 1: 2-E80 LINE 2: ADA BRAILLE: 2-E80 LINE 3: N/A LINE 4: N/A LINE 1: 2-E78 LINE 2: ADA BRAILLE: 2-E78 LINE 3: N/A LINE 4: FEMALE IMAGE LINE 5: IMAGE LINE 6: IMAGE LINE 7: N/A LINE 8: WOMEN'S LINE 9: ADA BRAILLE: WOMEN'S LINE 10: PLEASE KNOCK BEFORE ENTERING LINE 11: POR FAVOR SONAR ANTES DE ENTRAR LINE 12: SLIDER PANEL LINE 13: N/A LINE 14: INSERT LINE 1: 2-E77 LINE 2: ADA BRAILLE: 2-E77 LINE 3: N/A LINE 4: FEMALE + WHEELCHAIR IMAGE LINE 5: IMAGE LINE 6: IMAGE LINE 7: N/A LINE 8: ADA WOMEN'S LINE 9: ADA BRAILLE: ADA WOMEN'S LINE 10: PLEASE KNOCK BEFORE ENTERING LINE 11: POR FAVOR SONAR ANTES DE ENTRAR LINE 12: SLIDER PANEL LINE 13: N/A LINE 14: INSERT LINE 1: 2-E76 LINE 2: ADA BRAILLE: 2-E76 LINE 3: N/A LINE 4: MALE + WHEELCHAIR IMAGE LINE 5: IMAGE LINE 6: IMAGE LINE 7: N/A LINE 8: ADA MEN'S LINE 9: ADA BRAILLE: ADA MEN'S LINE 10: PLEASE KNOCK BEFORE ENTERING LINE 11: POR FAVOR SONAR ANTES DE ENTRAR LINE 12: SLIDER PANEL LINE 13: N/A LINE 14: INSERT					
2	C	2-E61	RE: G4589-14 R1						
3	C	2-E62	RE: G4589-14 R1						
4	C	2-E67	RE: G4589-14 R1						
5	C	2-E18	RE: G4589-14 R1						
6	C	2-E16	RE: G4589-14 R1						
7	D	2-E84	RE: G4589-14 R1						
8	D	2-E83	RE: G4589-14 R1						
9	D	2-E82	RE: G4589-14 R1						
10	D	2-E81	RE: G4589-14 R1						
11	D	2-E80	RE: G4589-14 R1						
12	B	2-E78	RE: G4586-14 R1						
13	B	2-E77	RE: G4586-14 R1						
14	B	2-E76	RE: G4586-14 R1						
16	D	2-E73	RE: G4589-14 R1						
17	D	2-E72	RE: G4589-14 R1						
18	D	2-E71	RE: G4589-14 R1						
19	D	2-E70	RE: G4589-14 R1						
20	B	2-E69	RE: G4586-14 R1						
21	D	2-E68	RE: G4589-14 R1						
22	D	2-E67	RE: G4589-14 R1						
23	D	2-E65	RE: G4589-14 R1						
24	D	2-E64	RE: G4589-14 R1						
25	B	2-E63	RE: G4586-14 R1						
26	C	2-E58	RE: G4589-14 R1						
27	C	2-E59	RE: G4589-14 R1						
28	C	2-E56	RE: G4589-14 R1						
29	C	2-E57	RE: G4589-14 R1						
30	C	2-E54	RE: G4589-14 R1						
31	C	2-E55	RE: G4589-14 R1						
32	C	2-E53	RE: G4589-14 R1						

NOTE: REFER TO ELEVATION FOR MOUNTING HEIGHTS. SIGNS 9, 10 AND 17, 18  
 MUST BE MOUNTED ONE ABOVE THE OTHER WITHIN ACCEPTABLE ADA MOUNTING HEIGHTS.  
 V.I.F. WALL SPACES FOR SIGN WIDTHS. NOTIFY ARCHITECTS OF SIGNS  
 NEEDING TO BE SHORTENED TO FIT AT DESIGNATED LOCATION.







### DEMOLITION - KEYED NOTES

- NOTE: REFER TO ENLARGED PLANS FOR ADDITIONAL KEYED NOTE LOCATIONS IF NOT VISIBLE ON THIS SHEET.
- 01 TYPICAL: REMOVE EXISTING MILLWORK AND/OR TRASH UNIT AND STORE FOR REINSTALLATION; COORDINATE EXACT REQUIREMENTS IN FIELD.
  - 02 REMOVE ALL EXISTING FLOORING, WALL FINISHES, FIXTURES AND ACCESSORIES; REFER TO MEP DRAWINGS FOR ADDITIONAL INFO PERTAINING TO FIXTURES; PREP EXISTING SUBSTRATES TO REMAIN FOR RECEIPT OF NEW FINISHES.
  - 03 REMOVE EXISTING DOOR AND FRAME; SALVAGE DOORS AND RETURN TO BUILDING STOCK; RE: RENOVATION PLAN.
  - 04 TYPICAL: REMOVE ALL WALL-MOUNTED ACCESSORIES (IE, BULLETIN BOARDS, SIGNAGE, ETC.) AND STORE FOR REINSTALLATION; COORDINATE EXACT REQUIREMENTS IN FIELD.
  - 05 REMOVE EXISTING VINYL OR TILE FLOORING AND WALL BASE; PREP EXISTING SUBSTRATE FOR RECEIPT OF NEW FINISHES; RE: FINISH PLANS; COORDINATE TEMPORARY REMOVAL OF ANY FURNITURE AND EQUIPMENT WITH OWNER.
  - 06 DEMOLISH EXISTING NURSE STATION.
  - 07 DEMOLISH EXISTING WALLS WHERE INDICATED DASHED; COORDINATE EXACT REQUIREMENTS IN FIELD.
  - 08 EXISTING CHASE WALL TO REMAIN; REMOVE FINISHES ONLY.
  - 09 REMOVE EXISTING NOURISHMENT STATION/DOORS; NOURISHMENT STATION TO REMAIN; PROTECT IN PLACE.
  - 10 EXISTING TELEPHONE BANK/MILLWORK TO REMAIN; PROTECT IN PLACE.
  - 11 COORDINATE WITH OWNER TEMPORARY REMOVAL OF EXISTING SIGNAGE, WALL-MOUNTED ACCESSORIES AND WALL-MOUNTED DEVICES TO PREPARE FOR APPLICATION OF NEW WALL FINISHES; TYPICAL THROUGHOUT.
  - 12 REMOVE EXISTING FLOORING ONLY.
  - 13 ALTERNATE NO. 3B-05; RE: SPECS.
  - 14 EXISTING FLOORING AND WALL BASE TO REMAIN.
  - 15 REMOVE EXISTING FLOORING AND WALL BASE; PREP EXISTING SUBSTRATE FOR RECEIPT OF NEW FINISHES; RE: FINISH PLANS; COORDINATE TEMPORARY REMOVAL OF ANY FURNITURE AND EQUIPMENT WITH OWNER.
  - 16 ALTERNATE NO. 3B-01; RE: SPECS.

### RENOVATION - KEYED NOTES

- NOTE: REFER TO ENLARGED PLANS FOR ADDITIONAL KEYED NOTE LOCATIONS IF NOT VISIBLE ON THIS SHEET.
- 01 INSTALL SCHEDULED FLOORING & BASE; RE: FINISH PLAN.
  - 02 APPLY SCHEDULED WALL FINISH THROUGHOUT; RE: FINISH PLAN.
  - 03 REINSTALL EXISTING MILLWORK, WALL-MOUNTED DEVICES, AND EQUIPMENT AS NEEDED; COORDINATE WITH OWNER IN FIELD.
  - 04 INSTALL NEW CEILING, WALL FINISHES, PLUMBING FIXTURES AND FLOORING FINISHES.
  - 05 RE-PAINT ALL EXISTING WALLS WITHIN THIS AREA WITH PT-1; EXISTING FLOORING IS ALSO TO BE REMOVED AS PART OF BASE SCOPE OF WORK; FLOORING REPLACEMENT AND WALL PAINTING SHALL BOTH OCCUR OVER THE COURSE OF ONE WEEKEND (FRIDAY THROUGH SUNDAY); COORDINATE REMOVAL AND REINSTALLATION OF ANY FURNITURE, FIXTURES, AND EQUIPMENT ITEMS IN FIELD WITH OWNER.
  - 06 IN LIEU OF TYPICAL WALL PAINT, APPLY CHALKBOARD PAINT TO EXISTING WALL OPPOSITE FROM PATIENT BEDS IN THE ROOM (CONFIRM IN FIELD); CHALKBOARD PAINT IS TO EXTEND FROM EXISTING DESK HEIGHT TO ALIGN WITH THE TOP OF THE EXISTING DOOR FRAME AND FOR THE FULL LENGTH OF THE WALL.
  - 07 ALTERNATE NO. 3B-01; RE: SPECS.
  - 08 ALTERNATE NO. 3B-02; RE: SPECS.
  - 09 REMOVE THE EXISTING NURSE STATION AND REPLACE WITH A NEW NURSE STATION TO MATCH THE CONFIGURATION AND FINISHES AS BUILT IN UNITS 1D AND 2B WITH EXCEPTIONS AS NOTED AND DEPICTED IN DETAILS WITHIN MODIFY EXISTING CORING WITHIN THE FLOOR SLAB AS NEEDED TO ACCOMMODATE THE NEW NURSE STATION CONFIGURATION; EXISTING CEILING IS TO REMAIN IN THIS AREA. NO FURF-DOWNS ARE TO BE INSTALLED ABOVE THE NEW NURSE STATION.
  - 10 ALTERNATE NO. 3B-03; RE: SPECS.
  - 11 RE: INTERIOR ELEVATIONS FOR EXISTING NOURISHMENT STATION MODIFICATIONS.
  - 12 ALTERNATE NO. 3B-05; RE: SPECS.

### GENERAL DEMOLITION NOTES:

1. THE DEMOLITION PLAN OUTLINES SOME OF THE SCOPE OF THE WORK INVOLVED FOR THE DEMOLITION PHASE OF THIS PROJECT. CONTRACTOR SHALL REVIEW ALL SHEETS FOR ADDITIONAL DEMO SCOPE.
2. CONTRACTOR SHALL VERIFY EXISTING SITE AND BUILDING CONDITIONS AND DIMENSIONS IN THE FIELD PRIOR TO COMMENCING DEMOLITION ACTIVITIES. CONTRACTOR SHALL NOT SCALE DRAWINGS. CONTRACTOR WILL NOTIFY ARCHITECT OF ANY DISCREPANCIES IN WRITING.
3. AFTER AWARD OF THE CONTRACT, CHANGE ORDER REQUESTS FOR ADDITIONAL MONEY WILL NOT BE APPROVED IF THE WORK COULD HAVE BEEN ANTICIPATED DURING A SITE VISIT BY THE CONTRACTOR.
4. CONTRACTOR WILL BE REQUIRED TO REPAIR, REPLACE, OR PATCH EXISTING BUILDINGS, DRIVEWAYS, SIDEWALKS, CANOPIES, AND/OR PARKING AREAS DISTURBED BY DEMOLITION.
5. CONTRACTOR WILL BE REQUIRED TO REGRADE AND HYDROMULCH AREAS AFFECTED BY DEMOLITION.
6. ALL FURNITURE WILL BE REMOVED OR RELOCATED BY THE OWNER AS NECESSARY PRIOR TO THE DEMOLITION WORK OF THIS PROJECT. CONTRACTOR SHALL COORDINATE WITH OWNER AS REQUIRED.
7. REMOVE EXISTING CONSTRUCTION TO THE EXTENT INDICATED ON THE DRAWINGS. SHOULD ANY DAMAGE OCCUR TO ANY EXISTING CONSTRUCTION TO REMAIN, THE CONTRACTOR SHALL REPAIR THE DAMAGE TO MATCH EXISTING/ADJACENT CONSTRUCTION.
8. CONTRACTOR IS TO VERIFY THE EXACT LOCATION OF ALL EXISTING UTILITIES PRIOR TO DEMOLITION ACTIVITIES.
9. CONTRACTOR SHALL REMOVE DEBRIS REGULARLY AS NECESSARY TO ELIMINATE INTERFERENCE WITH ROADS, STREET, WALKS, AND ALL OTHER ADJACENT FACILITIES.
10. CONTRACTOR IS RESPONSIBLE FOR CONSTRUCTION OF TEMPORARY DUST AND/OR SOUND PARTITIONS BETWEEN CONSTRUCTION AREA AND AREAS NOT IN SCOPE AS NECESSARY. DEMOLITION ACTIVITIES SHALL BE PERFORMED SO AS TO PRODUCE MINIMAL DISTURBANCE TO EXISTING FACILITY AND OCCUPANTS (I.E. MINIMIZE EXCESSIVE AND PROLONGED NOISE LEVELS AND DUST).
11. NOTIFY THE BUILDING OWNER OF ANY MATERIALS, FIXTURES, ETC. TO BE REMOVED THAT ARE DEEMED SALVAGEABLE. TURN OVER ANY REQUESTED ITEMS TO THE BUILDING OWNER IN GOOD CONDITION.
12. THE CONTRACTOR SHALL REMOVE ALL TRASH AND DEBRIS FROM THE SITE ON A DAILY BASIS.
13. MAINTAIN THE INTEGRITY OF ALL EXISTING RATED WALLS, FIRE SEAL, ANY PENETRATIONS WITH UL APPROVED ASSEMBLY.
14. WHEN UNANTICIPATED MECHANICAL, ELECTRICAL, OR STRUCTURAL ELEMENTS THAT CONFLICT WITH THE INTENDED FUNCTION OR DESIGN ARE ENCOUNTERED, DETERMINE THE NATURE AND EXTENT OF THE CONFLICT AND NOTIFY THE ARCHITECT IMMEDIATELY FOR RESOLUTION.
15. CONTRACTOR SHALL PROVIDE TRAFFIC HANDLING MEASURES AS NECESSARY TO PROTECT THE GENERAL PUBLIC AT ALL TIMES, AND AS REQUIRED BY GOVERNING AUTHORITIES.
16. DO NOT INTERRUPT EXISTING UTILITIES, EXCEPT WHEN AUTHORIZED IN WRITING BY AUTHORITIES HAVING JURISDICTION. PROVIDE TEMPORARY SERVICES DURING INTERRUPTIONS TO EXISTING UTILITIES, AS ACCEPTABLE TO GOVERNING AUTHORITIES.
17. WHEN UTILITY SERVICES ARE REQUIRED TO BE REMOVED, RELOCATED, OR ABANDONED, PROVIDE BYPASS CONNECTIONS TO MAINTAIN CONTINUITY OF SERVICE BEFORE PROCEEDING WITH DEMOLITION.
18. PRIOR TO COMMENCEMENT WITH ANY DEMOLITION WORK, CONTRACTOR SHALL IDENTIFY ALL ELECTRICAL CIRCUITS SERVING THE AREA INVOLVED WITH THIS DEMOLITION. THOSE CIRCUITS SHALL THEN BE LOCKED OUT AND TAGGED OUT IF THEY DO NOT SERVICE ANY OF THE REMAINING BUILDING. THOSE CIRCUITS WHICH ARE IDENTIFIED TO SERVICE BOTH THE AREA TO BE DEMOLISHED AND THE REMAINING BUILDING SHALL BE SPLIT SO AS TO KILL ALL ELECTRICAL POWER TO THE AREA TO BE DEMOLISHED WHILE MAINTAINING POWER TO THE REMAINDER OF THE BUILDING.
19. CONTRACTOR TO RELOCATE UTILITIES & EQUIPMENT AS REQUIRED TO ACCOMMODATE NEW PLUMBING REQUIREMENTS FOR NEW RENOVATION WORK.
20. REFER TO DEMOLITION PLUMBING PLANS FOR EXTENT OF CONCRETE SLAB TO BE REMOVED AND REPLACED FOR UNDER FLOOR PIPING INSTALLATION.
21. EXISTING WALLS OR PORTIONS OF WALLS TO BE REMOVED SHALL BE CUT FLUSH WHERE INTERSECTING WITH WALLS TO REMAIN. REMAINING WALLS TO BE PATCHED AND FINISHED SMOOTH.
22. NEW OPENINGS TO BE CUT IN EXISTING WALLS SHALL BE SAW-CUT AT LOCATIONS INDICATED TO THE HEIGHT AND WIDTH INDICATED. NEW UNITS SHALL BE INSTALLED TO SUPPORT EXISTING WALL CONSTRUCTION ABOVE AS INDICATED ON THE DRAWINGS, OR IF NOT INDICATED, AS REQUIRED FOR NEW WALL CONSTRUCTION PER STRUCTURAL DRAWINGS, IF PROVIDED.
23. WHERE EXISTING INTERIOR WALLS ARE REPLACED OR REMOVED, REMOVE MEP SYSTEMS BACK TO PANEL, OR MECHANICAL ROOM OR FARTHEST POSSIBLE POINT WITHOUT DISTURBING EXISTING CONSTRUCTION, REMOVE EXISTING MECHANICAL EQUIPMENT, RELOCATE POWER PER MEP DRAWINGS.
24. REFER TO MEP DRAWINGS FOR DEMOLITION OF MEP SYSTEMS, IDENTIFY WORK REQUIRED BY THIS CONTRACTOR WHICH MAY AFFECT DEMOLITION AND/OR REPAIRS OF ARCHITECTURAL ELEMENTS. COORDINATE WITH RELATED SUBS THE EXTENT OF ALL DEMOLITION WORK.
25. PATCH FLOORS, WALLS WHICH REMAIN AT LOCATIONS WHERE PIPES, CONDUITS, ETC. ARE REMOVED AS REQUIRED TO MATCH EXISTING CONDITIONS OR TO RECEIVE NEW FINISHES.
26. WHERE EXISTING FINISH FLOOR IS REMOVED, PREPARE SURFACE TO RECEIVE NEW FLOORING.
27. NOTIFY ARCHITECT & OWNER OF ANY POSSIBLE ASBESTOS CONTAINING MATERIALS DISCOVERED BEFORE PROCEEDING WITH WORK, PROTECT INTERIOR CONSTRUCTION TO REMAIN DURING DEMOLITION AND CONSTRUCTION.
28. CONTRACTOR TO OBTAIN ALL NECESSARY PERMITS BEFORE COMMENCING WORK.
29. CONTRACTOR TO PROVIDE ALL NECESSARY SHORING FOR PROTECTION OF EXISTING STRUCTURE AND FOUNDATION TO REMAIN.
30. ALL DASHED LINES ARE DEMOLITION LINES UNLESS NOTED OTHERWISE.
31. REMOVE ALL CARPET WAINSCOT FROM ALL LOCATIONS IN EACH UNIT.

### GENERAL NOTES



1. VERIFY DIMENSIONS AND EXISTING CONDITIONS BEFORE COMMENCING WORK. REPORT DISCREPANCIES TO THE ARCHITECT PRIOR TO PROCEEDING WITH AFFECTED WORK.
2. REFLECTING CEILING PLAN DIMENSIONS ARE PROCEEDING FROM FINISHED SURFACES UNLESS NOTED OTHERWISE. CEILING HEIGHTS ARE DIMENSIONED FROM FLOOR TO FINISHED CEILING HEIGHT.
3. DIMENSIONS NOTED AS "FIELD VERIFY" SHALL BE CHECKED AT THE SITE BY THE CONTRACTOR AND REVIEWED WITH THE ARCHITECT BEFORE INCORPORATING INTO THE WORK.
4. DO NOT SCALE DRAWING. WRITTEN DIMENSIONS TAKE PRECEDENCE. IF CLARIFICATION IS REQUIRED IN ORDER TO DETERMINE THE INTENT OF THE CONTRACT DOCUMENTS, CONTACT THE ARCHITECT.
5. NOTES OR DIMENSIONS LABELED "TYPICAL" SHALL APPLY TO SITUATIONS THAT ARE THE SAME OR SIMILAR.
6. ALL INTERIOR PARTITIONS SHALL BE KEYED AS REFERENCE SHEET A7.00 FOR PARTITION TYPES.
7. ALL DIMENSIONS ARE TO FACE OF FINISHED WALL UNLESS NOTED OTHERWISE.
8. ALL SPACES WITH FLOOR DRAINS TO HAVE FINISHED FLOORS SLOPED TO DRAIN NOT TO EXCEED ONE IN FIFTY.
9. ALL FLOOR FINISH CHANGES SHALL OCCUR AT THE CENTERLINE OF DOORS UNLESS NOTED OTHERWISE. ALL FLOOR FINISH CHANGES SHALL HAVE THRESHOLDS OR REDUCER STRIPS.
10. ALL DOORS IN INTERIOR GYP. BD STUD WALLS SHALL BE SET 4" OFF THE PERP. ADJ. WALL ON THE HINGE SIDE OF THE DOOR UNLESS NOTED OTHERWISE. THE CONTRACTOR SHALL CONTACT THE ARCHITECT IF ANY CONFLICT OCCURS.
11. PROVIDE VINYL REDUCERS AT ALL DISSIMILAR FLOOR MATERIALS UNLESS OTHERWISE NOTED.
12. UNLESS OTHERWISE NOTED, ALL ELECTRICAL AND MECHANICAL OPERABLE DEVICES SHALL BE MOUNTED WITH THE HIGHEST OPERABLE CONTROL AT 42" AFF.
13. ALL REQUIRED CLEARANCES, AS DESCRIBED IN THE TEXAS ACCESSIBILITY STANDARDS (TAS) OF THE ARCHITECTURAL BARRIERS ACT ARTICLE 910, TEXAS CIVIL STATUTES (2012) FOR COUNTERTOPS, ALL PLUMBING FIXTURES INCLUDING DRINKING FOUNTAINS, LAVATORIES, URINALS, AND TOILETS WILL BE STRICTLY ENFORCED.



**ARCHITECTURE**  
 PBK ARCHITECTS  
 11 Greenway Plaza, 22nd Floor  
 Houston, TX 77046  
 713-965-9569 P  
 713-961-4571 F  
 TX Firm F-3709  
 PBK.com

**MEP**  
 SHAH SMITH AND ASSOCIATES  
 2825 S Wilshire Dr #300  
 HOUSTON, TX 77042  
 (713) 790 - 7563

**HARRIS COUNTY PSYCHIATRIC  
 CENTER RENOVATION UNITS: 1C,  
 2E, 3B, 3C, 3D & 3E**

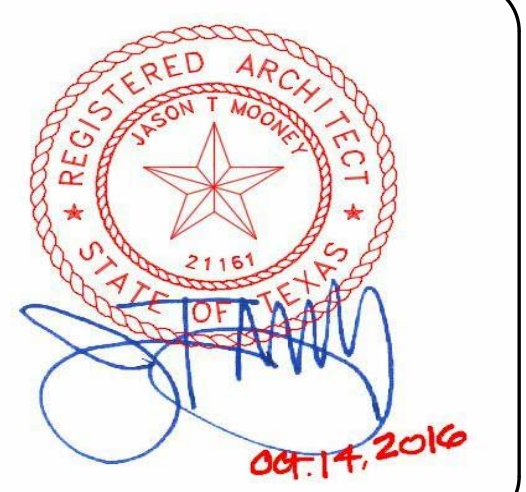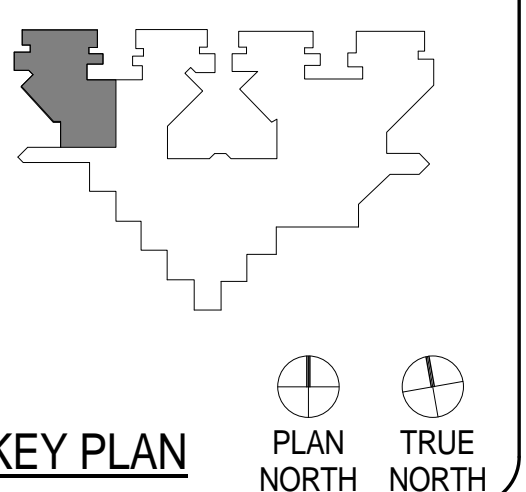


CLIENT UT HEALTH		
PROJECT NUMBER 16106		
DATE: OCTOBER 14, 2016		
DRAWN BY: VICTORIA GARCIA		
CHECKED BY: Checker		
REVISIONS		
No.	Description	Date

ISSUE FOR BID  
**THIRD FLOOR UNIT  
 3B**

**A2.08B**



**6** DEMOLITION FLOOR PLAN - UNIT 3B  
 1/8" = 1'-0"

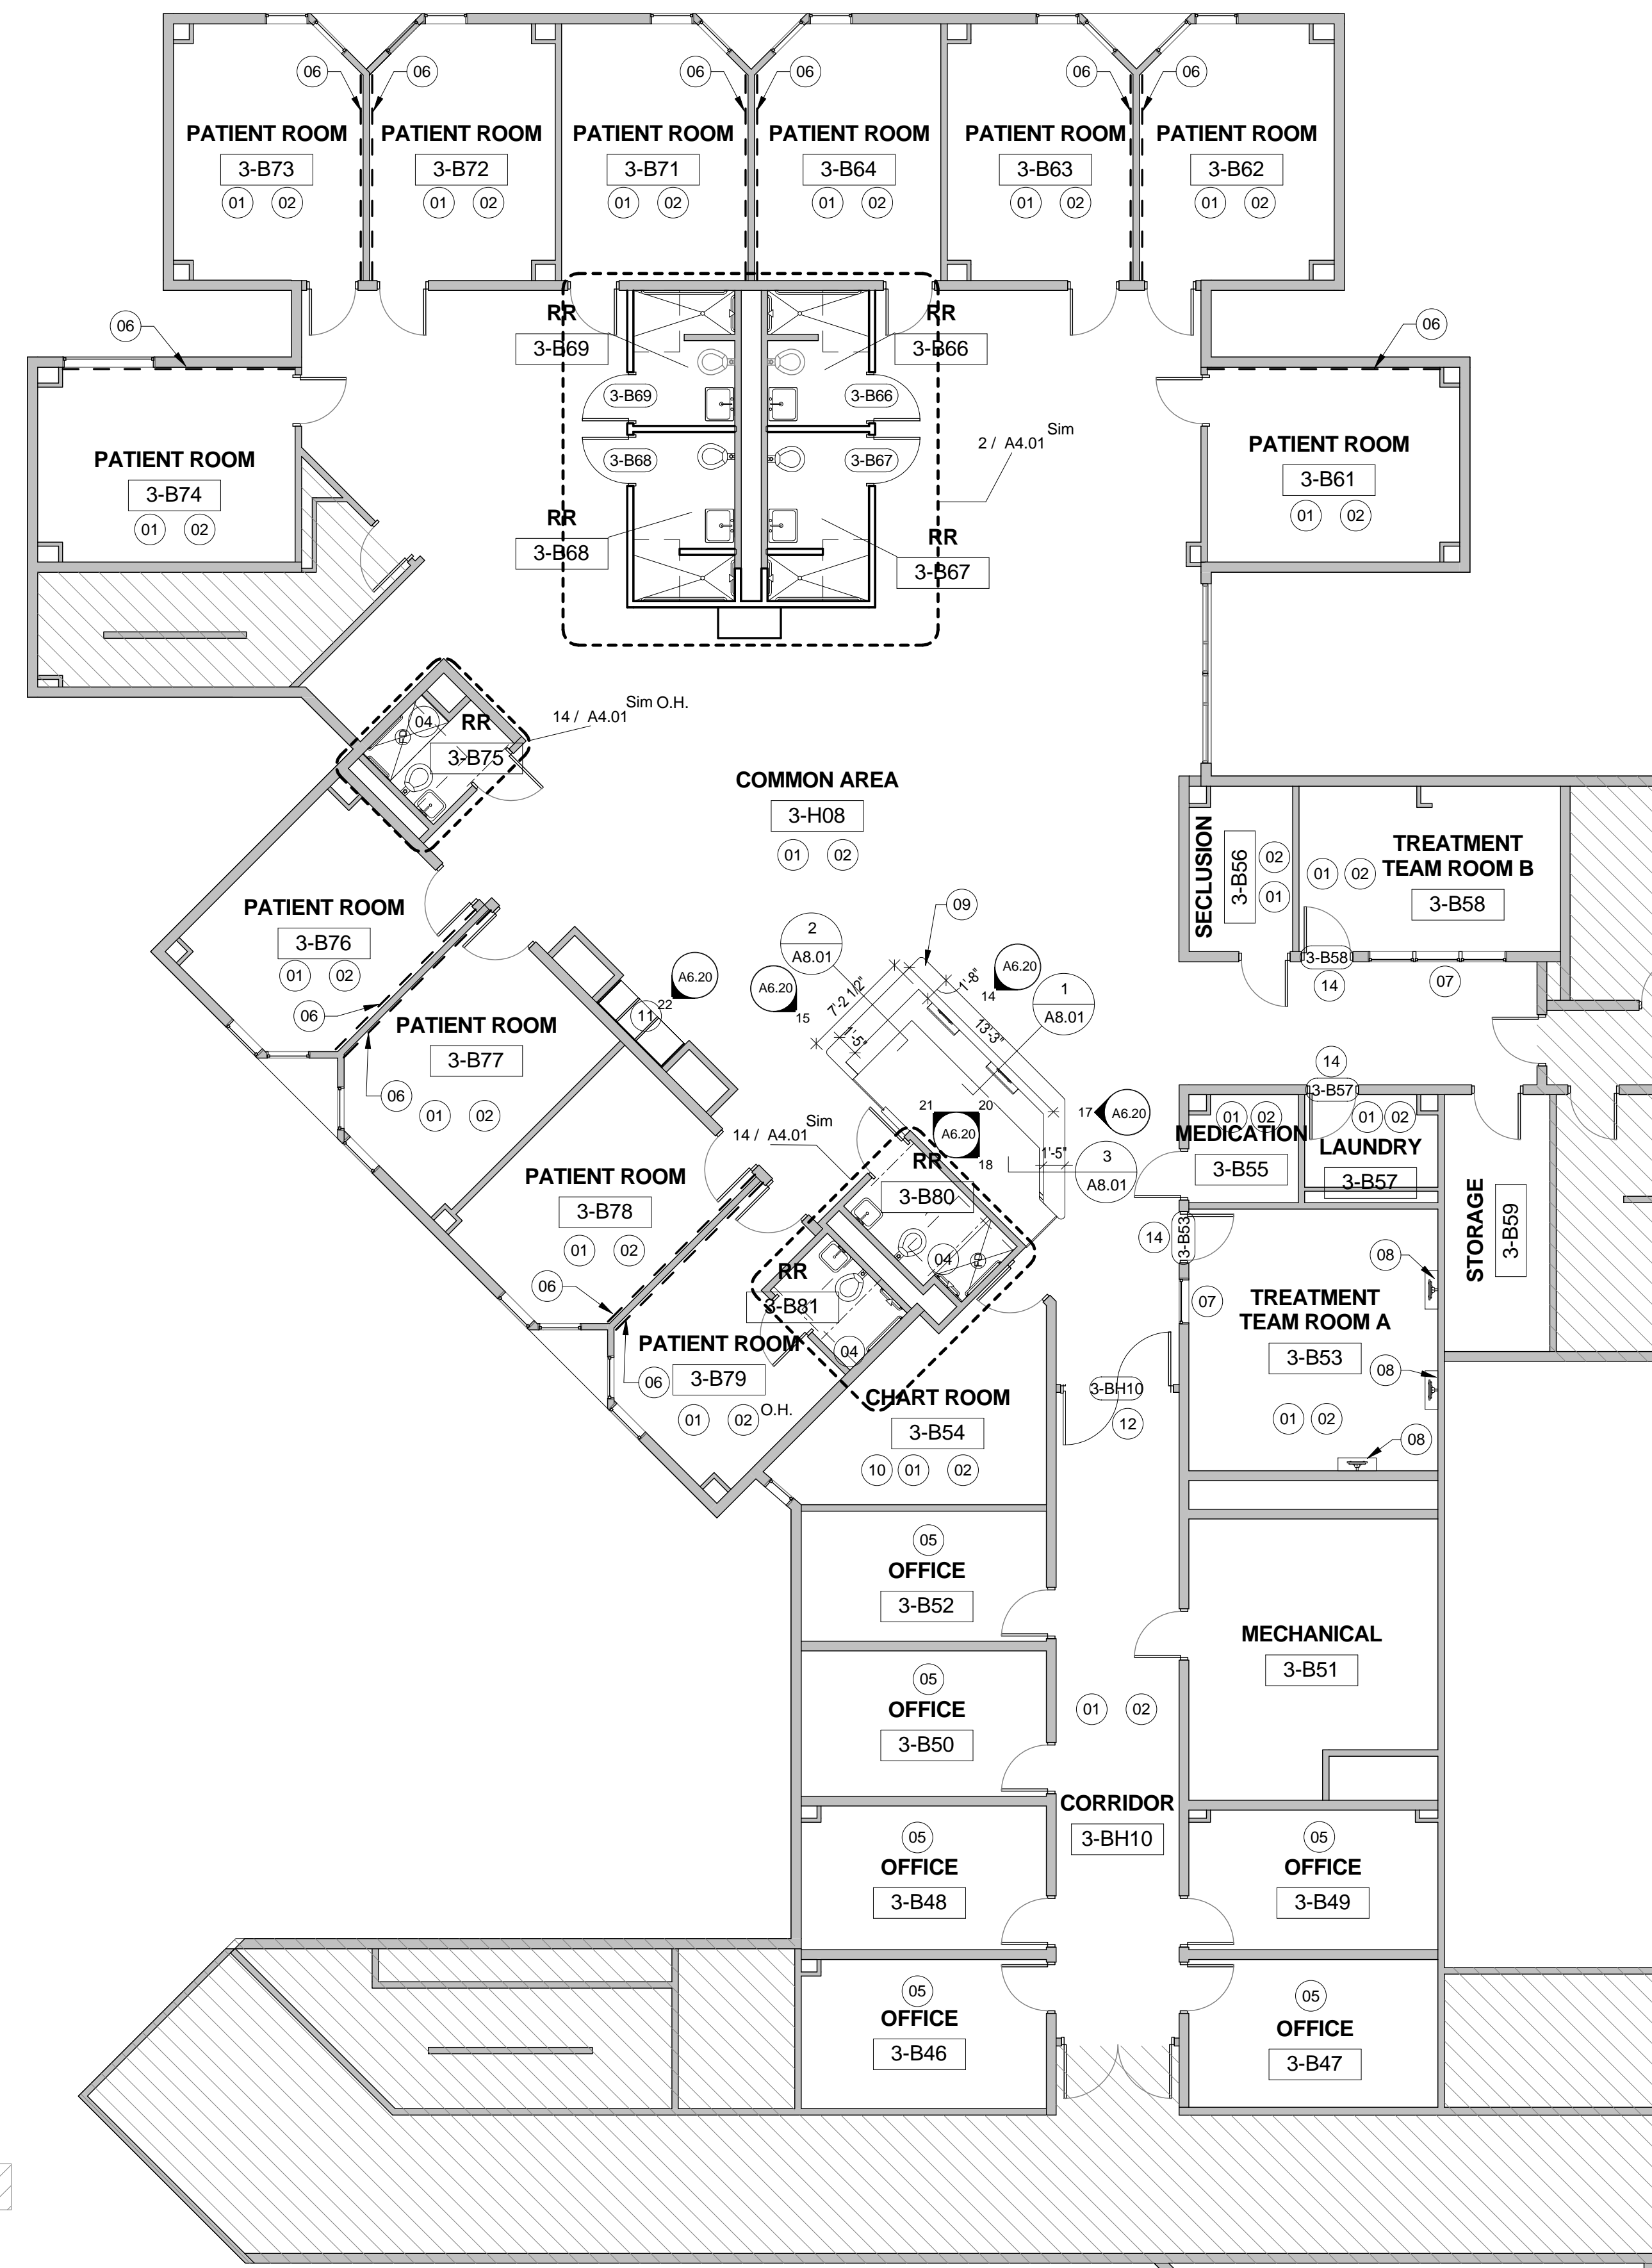


**3** RENOVATION PLAN - UNIT 3B  
 1/8" = 1'-0"



**HARRIS COUNTY PSYCHIATRIC  
CENTER RENOVATION UNITS: 1C,  
2E, 3B, 3C, 3D & 3E**



KEY PLAN PLAN NORTH TRUE NORTH

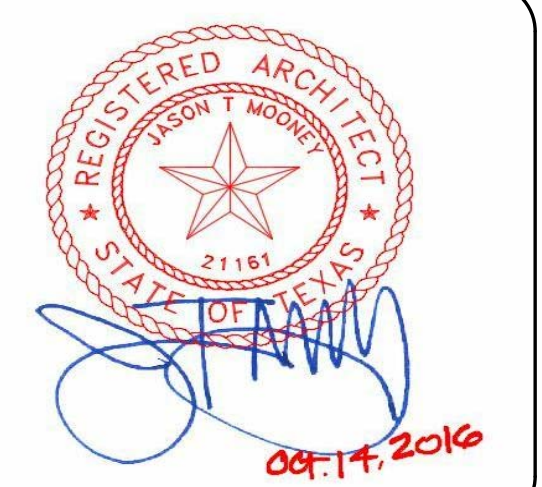


CLIENT  
UT HEALTH  
PROJECT NUMBER  
16106  
DATE: OCTOBER 14, 2016  
DRAWN BY: Author  
CHECKED BY: Checker

No.	Description	Date

ISSUE FOR BID  
**THIRD FLOOR UNIT  
3B - SIGNAGE PLAN**

**A2.09B**


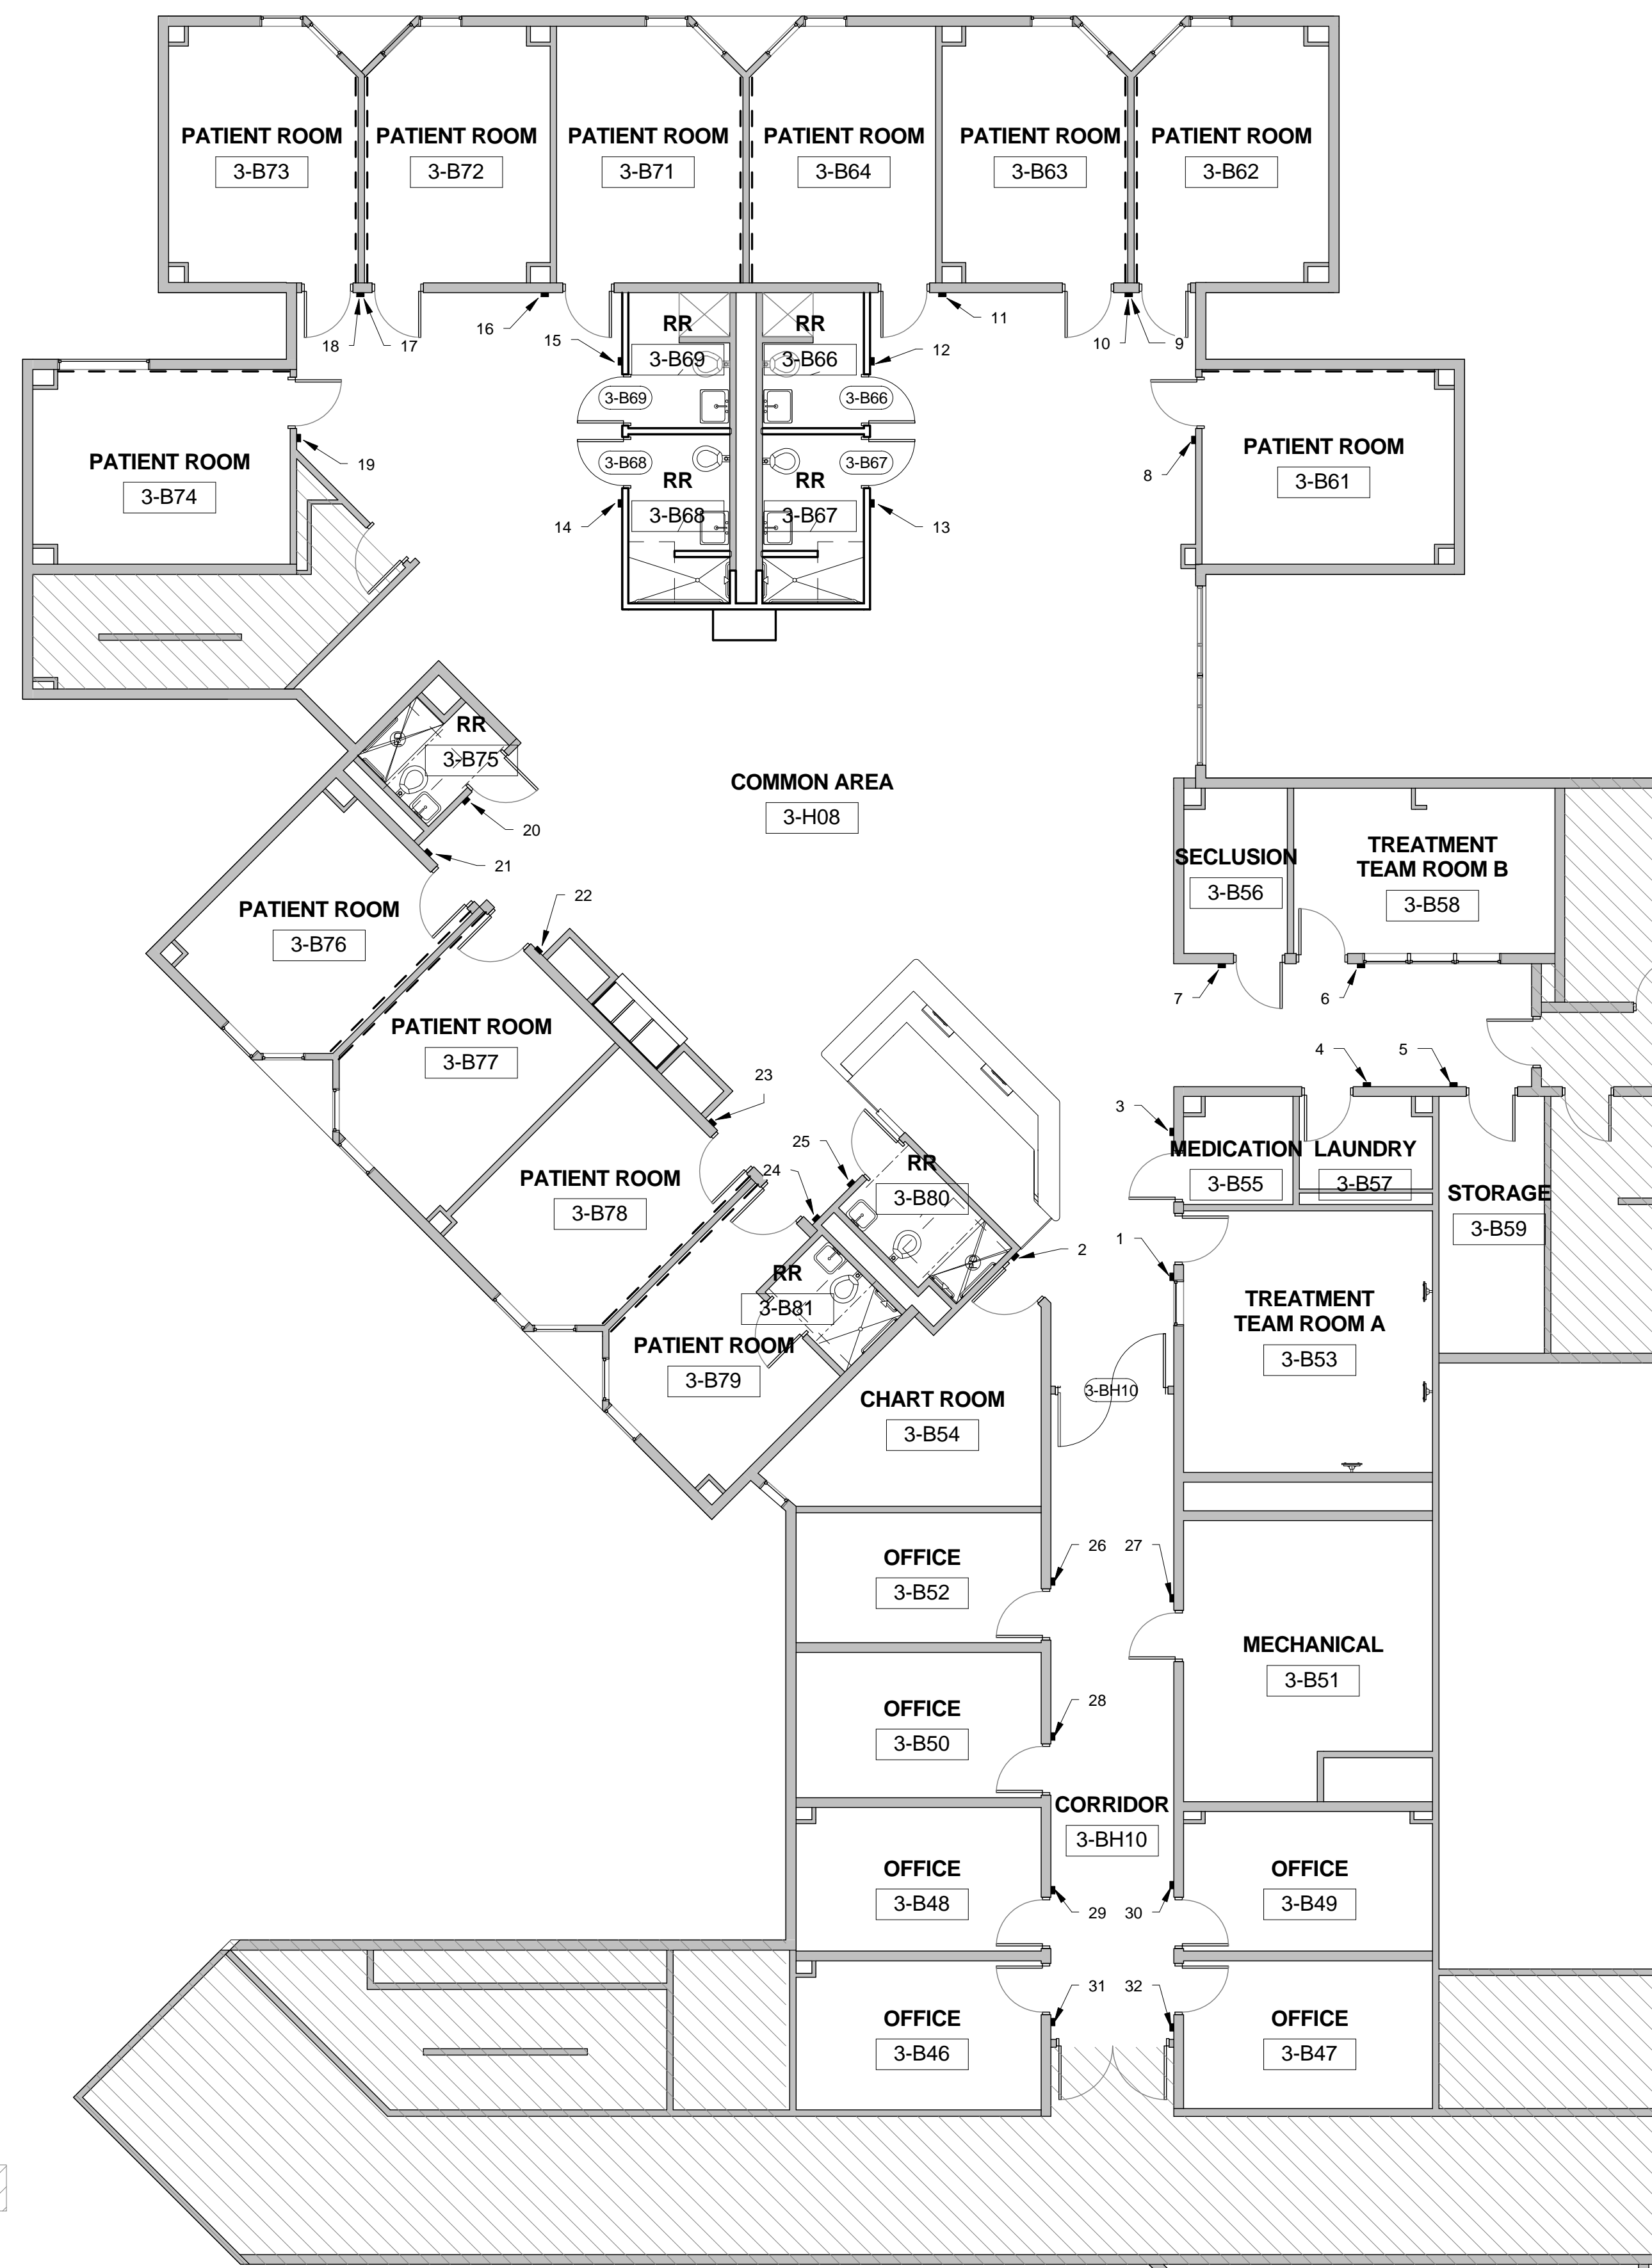


NOT IN SCOPE

SIGN #	SIGN TYPE	LOCATION	DETAIL	MESSAGE	REVISION
1	C	3-B53	RE: G4589-14 R1	LINE 1: 3-B53 LINE 2: (ADA BRAILLE: 3-B53) LINE 3: N/A LINE 4: N/A LINE 5: TREATMENT TEAM LINE 6: ROOM A LINE 7: (ADA BRAILLE: TREATMENT TEAM ROOM A) LINE 8: N/A LINE 9: 3-B54 LINE 10: (ADA BRAILLE: 3-B54) LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A LINE 32: N/A	19
2	C	3-B54	RE: G4589-14 R1	LINE 1: 3-B54 LINE 2: (ADA BRAILLE: 3-B54) LINE 3: N/A LINE 4: N/A LINE 5: TREATMENT TEAM LINE 6: ROOM A LINE 7: (ADA BRAILLE: TREATMENT TEAM ROOM A) LINE 8: N/A LINE 9: 3-B54 LINE 10: (ADA BRAILLE: 3-B54) LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A LINE 32: N/A	20
3	C	3-B55	RE: G4589-14 R1	LINE 1: 3-B55 LINE 2: (ADA BRAILLE: 3-B55) LINE 3: N/A LINE 4: N/A LINE 5: TREATMENT TEAM LINE 6: ROOM A LINE 7: (ADA BRAILLE: TREATMENT TEAM ROOM A) LINE 8: N/A LINE 9: 3-B54 LINE 10: (ADA BRAILLE: 3-B54) LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A LINE 32: N/A	21
4	C	3-B57	RE: G4589-14 R1	LINE 1: 3-B57 LINE 2: (ADA BRAILLE: 3-B57) LINE 3: N/A LINE 4: N/A LINE 5: TREATMENT TEAM LINE 6: ROOM A LINE 7: (ADA BRAILLE: TREATMENT TEAM ROOM A) LINE 8: N/A LINE 9: 3-B54 LINE 10: (ADA BRAILLE: 3-B54) LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A LINE 32: N/A	22
5	C	3-B59	RE: G4589-14 R1	LINE 1: 3-B59 LINE 2: (ADA BRAILLE: 3-B59) LINE 3: N/A LINE 4: N/A LINE 5: TREATMENT TEAM LINE 6: ROOM A LINE 7: (ADA BRAILLE: TREATMENT TEAM ROOM A) LINE 8: N/A LINE 9: 3-B54 LINE 10: (ADA BRAILLE: 3-B54) LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A LINE 32: N/A	23
6	C	3-B58	RE: G4589-14 R1	LINE 1: 3-B58 LINE 2: (ADA BRAILLE: 3-B58) LINE 3: N/A LINE 4: N/A LINE 5: TREATMENT TEAM LINE 6: ROOM B LINE 7: (ADA BRAILLE: TREATMENT TEAM ROOM B) LINE 8: N/A LINE 9: 3-B58 LINE 10: (ADA BRAILLE: 3-B58) LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A LINE 32: N/A	24
7	C	3-B56	RE: G4589-14 R1	LINE 1: 3-B56 LINE 2: (ADA BRAILLE: 3-B56) LINE 3: N/A LINE 4: N/A LINE 5: TREATMENT TEAM LINE 6: ROOM B LINE 7: (ADA BRAILLE: TREATMENT TEAM ROOM B) LINE 8: N/A LINE 9: 3-B58 LINE 10: (ADA BRAILLE: 3-B58) LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A LINE 32: N/A	25
8	D	3-B61	RE: G4589-14 R1	LINE 1: 3-B61 LINE 2: (ADA BRAILLE: 3-B61) LINE 3: N/A LINE 4: N/A LINE 5: TREATMENT TEAM LINE 6: ROOM B LINE 7: (ADA BRAILLE: TREATMENT TEAM ROOM B) LINE 8: N/A LINE 9: 3-B58 LINE 10: (ADA BRAILLE: 3-B58) LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A LINE 32: N/A	26
9	D	3-B62	RE: G4589-14 R1	LINE 1: 3-B62 LINE 2: (ADA BRAILLE: 3-B62) LINE 3: N/A LINE 4: N/A LINE 5: TREATMENT TEAM LINE 6: ROOM B LINE 7: (ADA BRAILLE: TREATMENT TEAM ROOM B) LINE 8: N/A LINE 9: 3-B58 LINE 10: (ADA BRAILLE: 3-B58) LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A LINE 32: N/A	27
10	D	3-B63	RE: G4589-14 R1	LINE 1: 3-B63 LINE 2: (ADA BRAILLE: 3-B63) LINE 3: N/A LINE 4: N/A LINE 5: TREATMENT TEAM LINE 6: ROOM B LINE 7: (ADA BRAILLE: TREATMENT TEAM ROOM B) LINE 8: N/A LINE 9: 3-B58 LINE 10: (ADA BRAILLE: 3-B58) LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A LINE 32: N/A	28
11	D	3-B64	RE: G4589-14 R1	LINE 1: 3-B64 LINE 2: (ADA BRAILLE: 3-B64) LINE 3: N/A LINE 4: N/A LINE 5: TREATMENT TEAM LINE 6: ROOM B LINE 7: (ADA BRAILLE: TREATMENT TEAM ROOM B) LINE 8: N/A LINE 9: 3-B58 LINE 10: (ADA BRAILLE: 3-B58) LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A LINE 32: N/A	29
12	B	3-B66	RE: G4586-14 R1	LINE 1: 3-B66 LINE 2: (ADA BRAILLE: 3-B66) LINE 3: N/A LINE 4: N/A LINE 5: TREATMENT TEAM LINE 6: ROOM B LINE 7: (ADA BRAILLE: TREATMENT TEAM ROOM B) LINE 8: N/A LINE 9: 3-B58 LINE 10: (ADA BRAILLE: 3-B58) LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A LINE 32: N/A	30
13	B	3-B67	RE: G4586-14 R1	LINE 1: 3-B67 LINE 2: (ADA BRAILLE: 3-B67) LINE 3: N/A LINE 4: N/A LINE 5: TREATMENT TEAM LINE 6: ROOM B LINE 7: (ADA BRAILLE: TREATMENT TEAM ROOM B) LINE 8: N/A LINE 9: 3-B58 LINE 10: (ADA BRAILLE: 3-B58) LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A LINE 32: N/A	31
14	B	3-B68	RE: G4586-14 R1	LINE 1: 3-B68 LINE 2: (ADA BRAILLE: 3-B68) LINE 3: N/A LINE 4: N/A LINE 5: TREATMENT TEAM LINE 6: ROOM B LINE 7: (ADA BRAILLE: TREATMENT TEAM ROOM B) LINE 8: N/A LINE 9: 3-B58 LINE 10: (ADA BRAILLE: 3-B58) LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A LINE 32: N/A	32
15	B	3-B69	RE: G4586-14 R1	LINE 1: 3-B69 LINE 2: (ADA BRAILLE: 3-B69) LINE 3: N/A LINE 4: N/A LINE 5: TREATMENT TEAM LINE 6: ROOM B LINE 7: (ADA BRAILLE: TREATMENT TEAM ROOM B) LINE 8: N/A LINE 9: 3-B58 LINE 10: (ADA BRAILLE: 3-B58) LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A LINE 32: N/A	
16	D	3-B71	RE: G4589-14 R1	LINE 1: 3-B71 LINE 2: (ADA BRAILLE: 3-B71) LINE 3: N/A LINE 4: N/A LINE 5: TREATMENT TEAM LINE 6: ROOM B LINE 7: (ADA BRAILLE: TREATMENT TEAM ROOM B) LINE 8: N/A LINE 9: 3-B58 LINE 10: (ADA BRAILLE: 3-B58) LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A LINE 32: N/A	
17	D	3-B72	RE: G4589-14 R1	LINE 1: 3-B72 LINE 2: (ADA BRAILLE: 3-B72) LINE 3: N/A LINE 4: N/A LINE 5: TREATMENT TEAM LINE 6: ROOM B LINE 7: (ADA BRAILLE: TREATMENT TEAM ROOM B) LINE 8: N/A LINE 9: 3-B58 LINE 10: (ADA BRAILLE: 3-B58) LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A LINE 32: N/A	
18	D	3-B73	RE: G4589-14 R1	LINE 1: 3-B73 LINE 2: (ADA BRAILLE: 3-B73) LINE 3: N/A LINE 4: N/A LINE 5: TREATMENT TEAM LINE 6: ROOM B LINE 7: (ADA BRAILLE: TREATMENT TEAM ROOM B) LINE 8: N/A LINE 9: 3-B58 LINE 10: (ADA BRAILLE: 3-B58) LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A LINE 32: N/A	

NOTE: REFER TO ELEVATION FOR MOUNTING HEIGHTS. SIGNS 9,10 AND 17,18 MUST BE MOUNTED ONE ABOVE THE OTHER WITHIN ACCEPTABLE ADA MOUNTING HEIGHTS.  
V.I.F. WALL SPACES FOR SIGN WIDTHS. NOTIFY ARCHITECTS OF SIGNS NEEDING TO BE SHORTENED TO FIT AT DESIGNATED LOCATION.



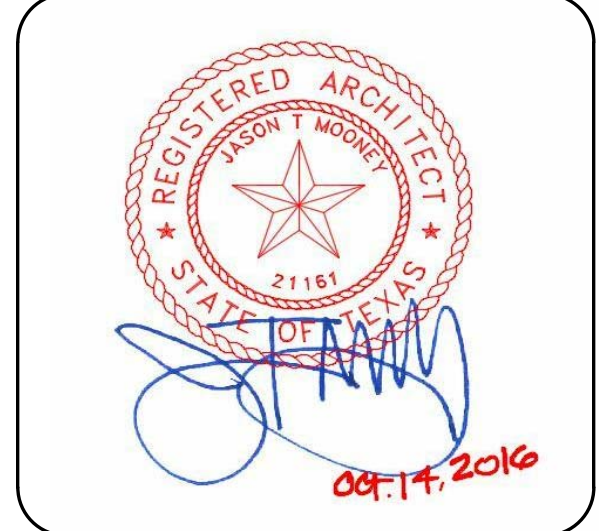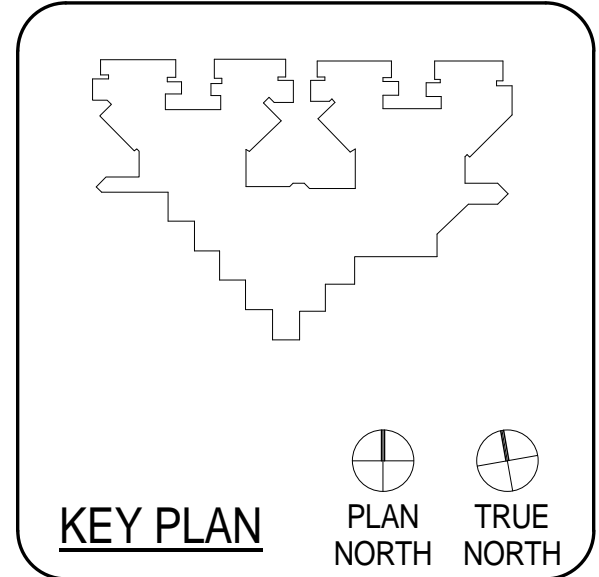

CLIENT		
UT HEALTH		
PROJECT NUMBER		
16106		
DATE: OCTOBER 14, 2016		
DRAWN BY: Author		
CHECKED BY: Checker		
REVISIONS		
No.	Description	Date
ISSUE FOR BID		


**SCHEDULES - THIRD FLOOR UNIT 3C**

**A2.10C**


DOOR SCHEDULE - UNIT 3C																
MARK	ELEV.	PAIR/SING LE	DOOR			MATL.	ELEV.	FRAME			DETAILS			H.W.	FIRE RATING	Comments
			SIZE W x H	W	H			SIZE W x H	W	H	MATL.	SILL	JAMB			
3-CH07	C	P	7'-4"	7'-4"	EXISTING	2	7'-0"	7'-0"	HM			3/A2.10C	2/A2.10C	EXISTING	N/A	SALVAGE EXISTING HARDWARE AND REINSTALL; RE-USE EXISTING GLASS LITE; EXISTING FRAME W/ NEW PAINT FINISH, RE: ALTERNATE NO. 3C-05
3-C10	B	S	3'-4"	7'-4"	SC WD	1	7'-0"	3'-0"	HM			EXISTING	EXISTING	EXISTING	N/A	ADD GLASS LITE TO EXISTING DOOR
3-C36	B	S	3'-4"	7'-4"	SC WD	1	7'-0"	3'-0"	HM			EXISTING	EXISTING	EXISTING	N/A	ADD GLASS LITE TO EXISTING DOOR
3-C29	A	S	3'-4"	7'-4"	SC WD	1	7'-0"	3'-0"	HM			3/A2.10C	2/A2.10C	SEE BELOW	N/A	
3-C27	A	S	3'-4"	7'-4"	SC WD	1	7'-0"	3'-0"	HM			3/A2.10C	2/A2.10C	SEE BELOW	N/A	
3-C28	A	S	3'-4"	7'-4"	SC WD	1	7'-0"	3'-0"	HM			3/A2.10C	2/A2.10C	SEE BELOW	N/A	
3-C26	A	S	3'-4"	7'-4"	SC WD	1	7'-0"	3'-0"	HM			3/A2.10C	2/A2.10C	SEE BELOW	N/A	
3-C39	B	S	3'-4"	7'-4"	SC WD	1	7'-0"	3'-0"	HM			EXISTING	EXISTING	EXISTING	N/A	ADD GLASS LITE TO EXISTING DOOR

DOOR HARDWARE IS TO "MATCH EXISTING", BUT SHOULD CONSIST OF THE FOLLOWING COMPONENTS:


- (1) EA. SELECT HINGES SL57 FULL-SURFACE GEARED CONTINUOUS HINGES
- (1) EA. "PUSH/PULL SET TO MATCH EXISTING; INSTALL PUSH PLATE ON INTERIOR (RESTROOM SIDE) OF DOOR, PULL ON EXTERIOR (COMMON AREA SIDE) OF DOOR, AND PROVIDE (1) LOCKSET FOR STAFF USE ON EXTERIOR (COMMON AREA SIDE) OF DOOR TO MATCH EXISTING
- (1) EA. IVES WIS407CCV (WALL BUMPER)/FS436 (FLOOR DOME) DOOR STOP
- (3) EA. IVES SR64 DOOR SILENCERS
- NO CLOSERS

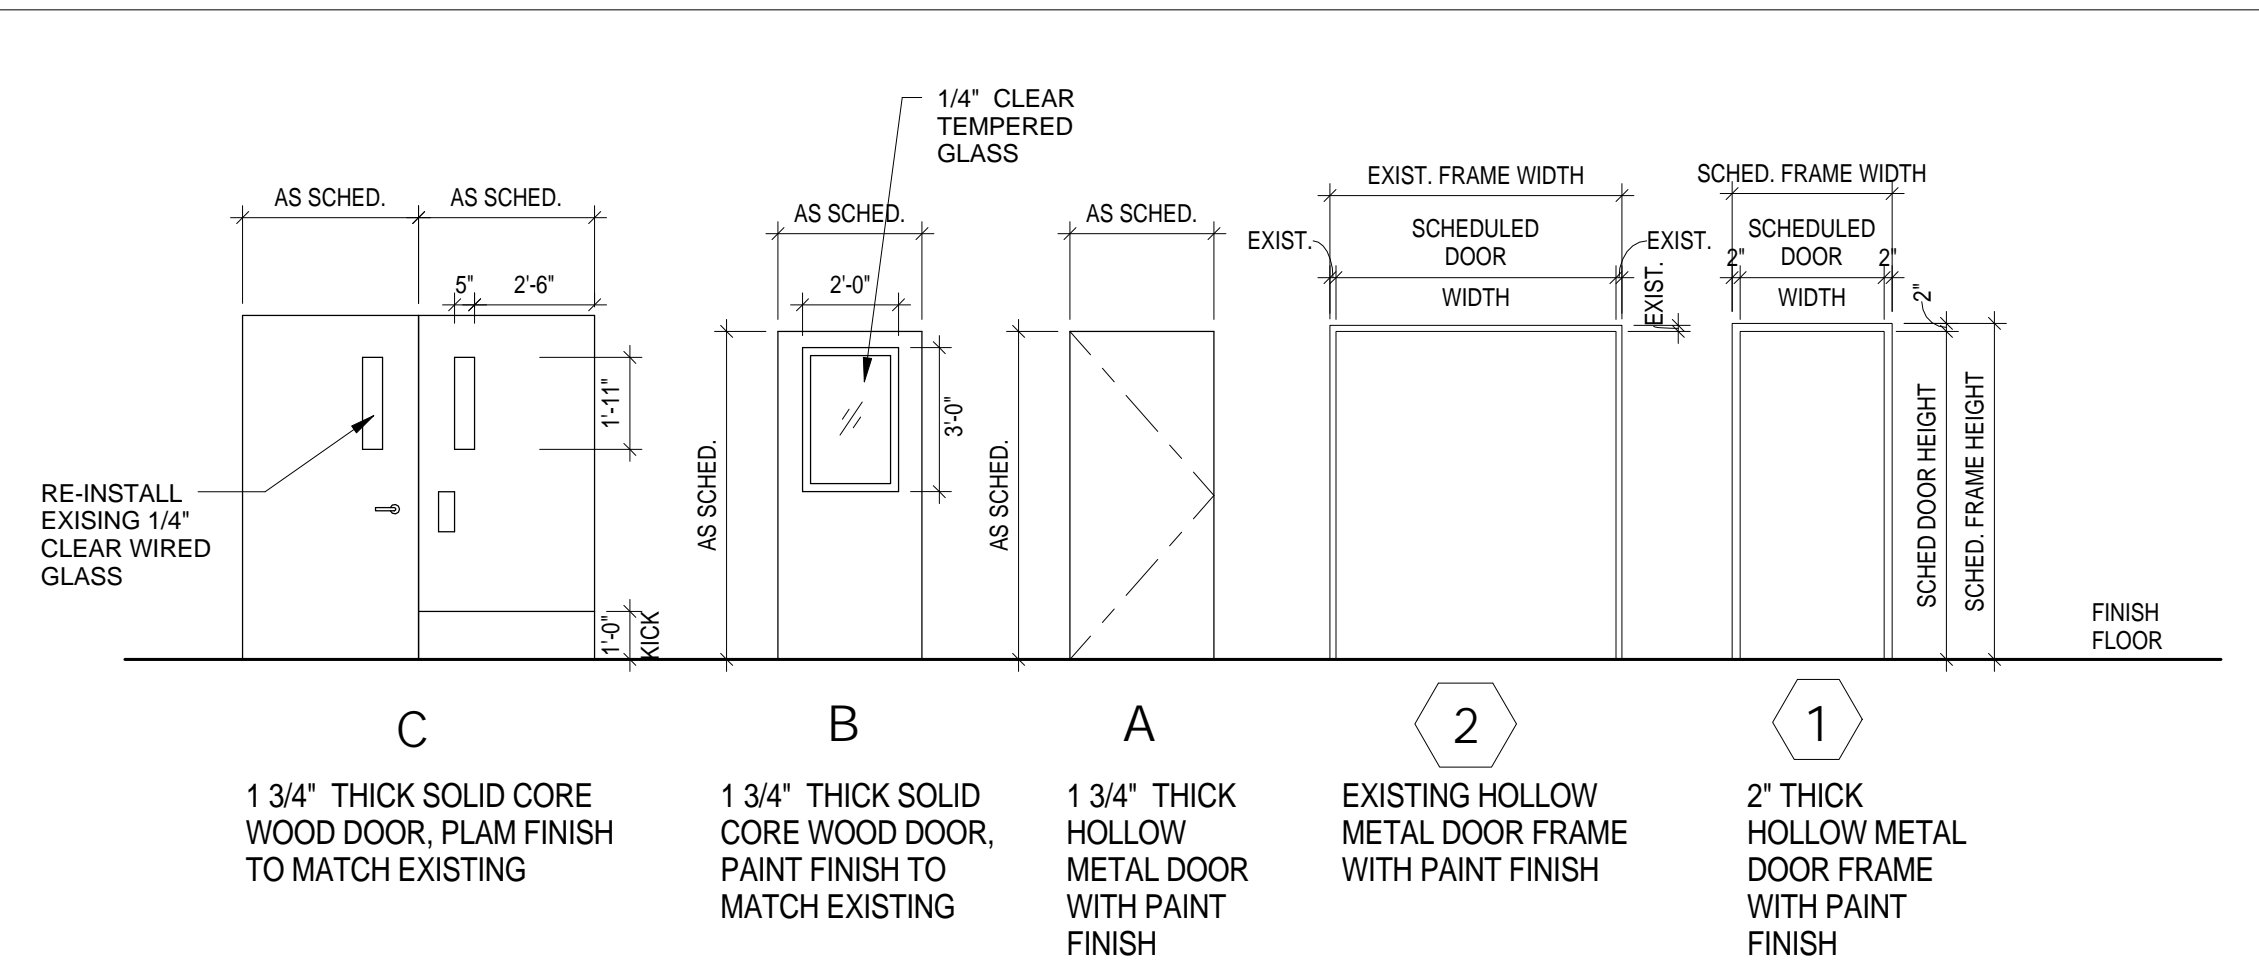

**1 DOOR TYPE & FRAME 3C**  
1/4" = 1'-0"

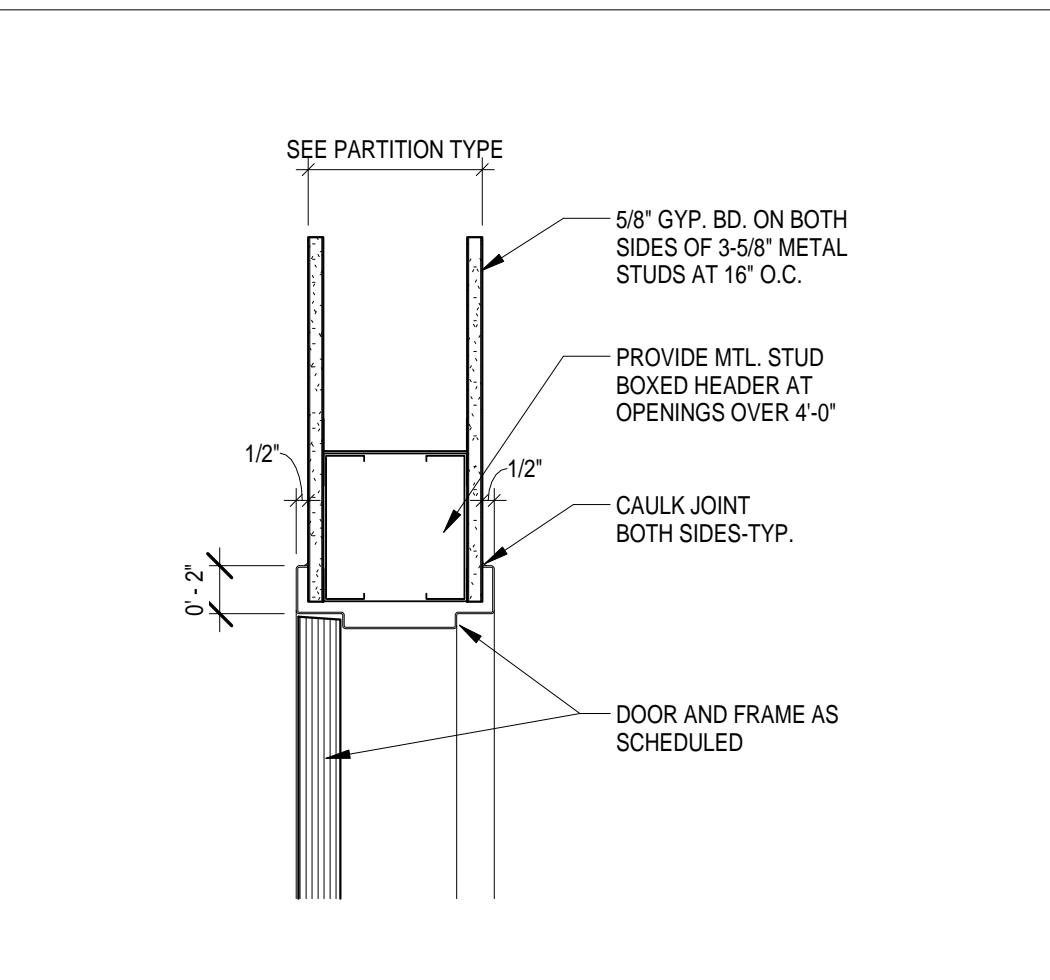

**2 INT-STUD-DOOR-HM-HEAD-DTL**  
1/12" = 1'-0"

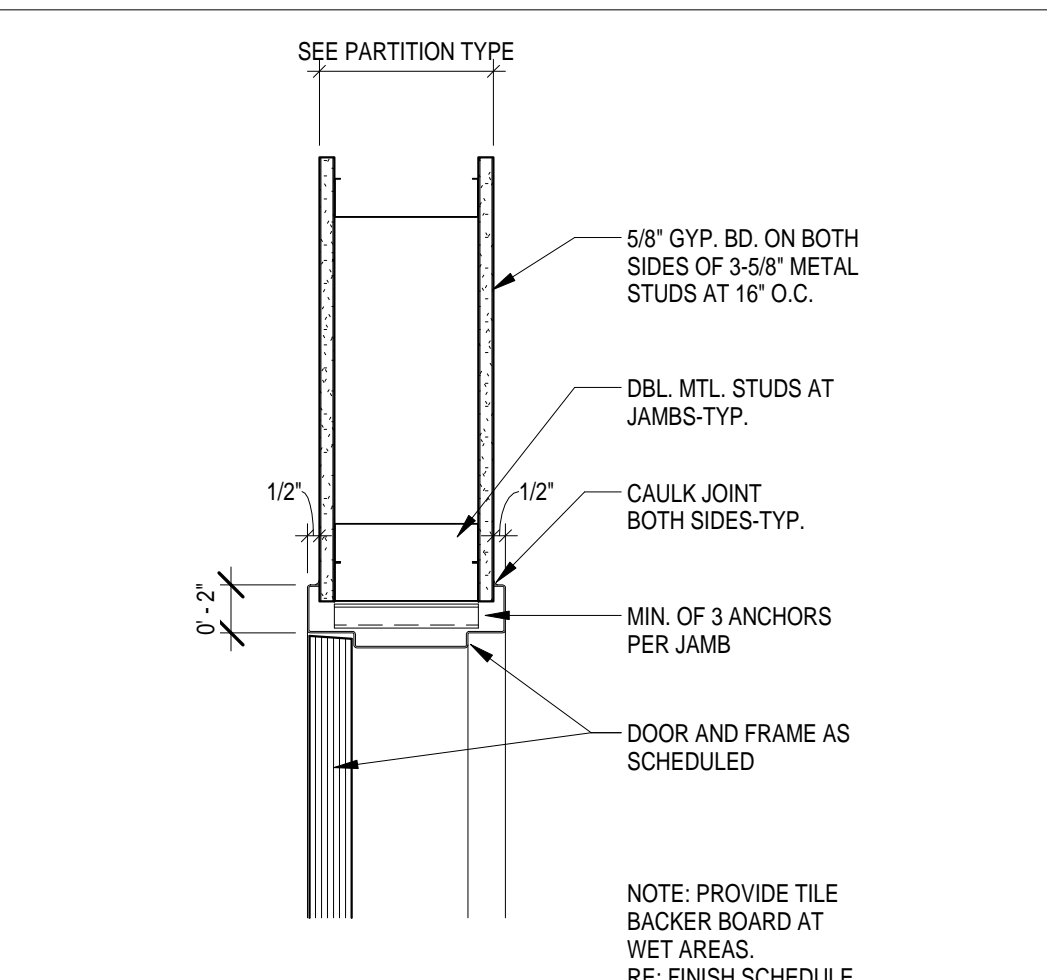

**3 INT-STUD-DOOR-HM-JAMB-DTL**  
1/12" = 1'-0"



**DEMOLITION - KEYED NOTES**

- NOTE: REFER TO ENLARGED PLANS FOR ADDITIONAL KEYED NOTE LOCATIONS IF NOT VISIBLE ON THIS SHEET.
- 01 TYPICAL: REMOVE EXISTING MILLWORK AND/OR TRASH UNIT AND STORE FOR REINSTALLATION; COORDINATE EXACT REQUIREMENTS IN FIELD.
  - 02 REMOVE ALL EXISTING FLOORING, WALL FINISHES, FIXTURES AND ACCESSORIES; REFER TO MEP DRAWINGS FOR ADDITIONAL INFO PERTAINING TO FIXTURES; PREP EXISTING SUBSTRATES TO REMAIN FOR RECEIPT OF NEW FINISHES.
  - 03 REMOVE EXISTING DOOR AND FRAME; SALVAGE DOORS AND RETURN TO BUILDING STOCK; RE: RENOVATION PLAN.
  - 04 TYPICAL: REMOVE ALL WALL-MOUNTED ACCESSORIES (IE. BULLETIN BOARDS, SIGNAGE, ETC.) AND STORE FOR REINSTALLATION; COORDINATE EXACT REQUIREMENTS IN FIELD.
  - 05 REMOVE EXISTING VINYL OR TILE FLOORING AND WALL BASE; PREP EXISTING SUBSTRATE FOR RECEIPT OF NEW FINISHES; RE: FINISH PLANS; COORDINATE TEMPORARY REMOVAL OF ANY FURNITURE AND EQUIPMENT WITH OWNER.
  - 06 DEMOLISH EXISTING NURSE STATION.
  - 07 DEMOLISH EXISTING WALLS WHERE INDICATED DASHED; COORDINATE EXACT REQUIREMENTS IN FIELD.
  - 08 EXISTING CHASE WALL TO REMAIN; REMOVE FINISHES ONLY.
  - 09 REMOVE EXISTING NOURISHMENT STATION/DOORS; NOURISHMENT STATION TO REMAIN; PROTECT IN PLACE.
  - 10 EXISTING TELEPHONE BANK/MILLWORK TO REMAIN; PROTECT IN PLACE.
  - 11 COORDINATE WITH OWNER TEMPORARY REMOVAL OF EXISTING SIGNAGE, WALL-MOUNTED ACCESSORIES AND WALL-MOUNTED DEVICES TO PREPARE FOR APPLICATION OF NEW WALL FINISHES, TYPICAL THROUGHOUT.
  - 12 REMOVE EXISTING FLOORING ONLY.
  - 13 ALTERNATE NO. 3C-05; RE: SPECS.
  - 14 EXISTING FLOORING AND WALL BASE TO REMAIN.
  - 15 REMOVE EXISTING FLOORING AND WALL BASE; PREP EXISTING SUBSTRATE FOR RECEIPT OF NEW FINISHES; RE: FINISH PLANS; COORDINATE TEMPORARY REMOVAL OF ANY FURNITURE AND EQUIPMENT WITH OWNER.
  - 16 ALTERNATE NO. 3C-01; RE: SPECS.

**RENOVATION - KEYED NOTES**

- NOTE: REFER TO ENLARGED PLANS FOR ADDITIONAL KEYED NOTE LOCATIONS IF NOT VISIBLE ON THIS SHEET.
- 01 INSTALL SCHEDULED FLOORING & BASE; RE: FINISH PLAN.
  - 02 APPLY SCHEDULED WALL FINISH THROUGHOUT; RE: FINISH PLAN.
  - 03 REINSTALL EXISTING MILLWORK, WALL-MOUNTED DEVICES, AND EQUIPMENT AS NEEDED; COORDINATE WITH OWNER IN FIELD.
  - 04 INSTALL NEW CEILING, WALL FINISHES, PLUMBING FIXTURES AND FLOORING FINISHES.
  - 05 RE-Paint ALL EXISTING WALLS WITHIN THIS AREA WITH PT-1; EXISTING FLOORING IS ALSO TO BE REMOVED AS PART OF BASE SCOPE OF WORK - FLOORING REPLACEMENT AND WALL PAINTING SHALL BOTH OCCUR OVER THE COURSE OF ONE WEEKEND (FRIDAY THROUGH SUNDAY); COORDINATE REMOVAL AND REINSTALLATION OF ANY FURNITURE, FIXTURES, AND EQUIPMENT ITEMS WITH OWNER.
  - 06 IN LIEU OF TYPICAL WALL PAINT, APPLY CHALKBOARD PAINT TO EXISTING WALL OPPOSITE FROM PATIENT BEDS IN THE ROOM (CONFIRM IN FIELD); CHALKBOARD PAINT IS TO EXTEND FROM EXISTING DESK HEIGHT TO ALIGN WITH THE TOP OF THE EXISTING DOOR FRAME AND FOR THE FULL LENGTH OF THE WALL.
  - 07 ALTERNATE NO. 3C-01; RE: SPECS.
  - 08 ALTERNATE NO. 3C-02; RE: SPECS.
  - 09 REMOVE THE EXISTING NURSE STATION AND REPLACE WITH A NEW NURSE STATION TO MATCH THE CONFIGURATION AND FINISHES AS BUILT IN UNITS 1D AND 2B WITH EXCEPTIONS AS NOTED AND SPECIFIED IN DETAILS WITHIN MODIFY EXISTING CORING WITHIN THE FLOOR SLAB AS NEEDED TO ACCOMMODATE THE NEW NURSE STATION CONFIGURATION; EXISTING CEILING IS TO REMAIN IN THIS AREA, NO FURR-DOWNS ARE TO BE INSTALLED ABOVE THE NEW NURSE STATION.
  - 10 ALTERNATE NO. 3C-03; RE: SPECS.
  - 11 RE: INTERIOR ELEVATIONS FOR EXISTING NOURISHMENT STATION MODIFICATIONS.
  - 12 ALTERNATE NO. 3C-06; RE: SPECS.

**GENERAL DEMOLITION NOTES:**

1. THE DEMOLITION PLAN OUTLINES SOME OF THE SCOPE OF THE WORK INVOLVED FOR THE DEMOLITION PHASE OF THIS PROJECT. CONTRACTOR SHALL REVIEW ALL SHEETS FOR ADDITIONAL DEMO SCOPE.
2. CONTRACTOR SHALL VERIFY EXISTING SITE AND BUILDING CONDITIONS AND DIMENSIONS IN THE FIELD PRIOR TO COMMENCING DEMOLITION ACTIVITIES. CONTRACTOR SHALL NOT SCALE DRAWINGS. CONTRACTOR WILL NOTIFY ARCHITECT OF ANY DISCREPANCIES IN WRITING.
3. AFTER AWARD OF THE CONTRACT, CHANGE ORDER REQUESTS FOR ADDITIONAL MONEY WILL NOT BE APPROVED IF THE WORK COULD HAVE BEEN ANTICIPATED DURING A SITE VISIT BY THE CONTRACTOR.
4. CONTRACTOR WILL BE REQUIRED TO REPAIR, REPLACE, OR PATCH EXISTING BUILDINGS, DRIVEWAYS, SIDEWALKS, CANOPIES, AND/OR PARKING AREAS DISTURBED BY DEMOLITION.
5. CONTRACTOR WILL BE REQUIRED TO REGRADE AND HYDROLOGICAL AREAS AFFECTED BY DEMOLITION.
6. ALL FURNITURE WILL BE REMOVED OR RELOCATED BY THE OWNER AS NECESSARY PRIOR TO THE DEMOLITION WORK OF THIS PROJECT. CONTRACTOR SHALL COORDINATE WITH OWNER AS REQUIRED.
7. REMOVE EXISTING CONSTRUCTION TO THE EXTENT INDICATED ON THE DRAWINGS. SHOULD ANY DAMAGE OCCUR TO ANY EXISTING CONSTRUCTION TO REMAIN, THE CONTRACTOR SHALL REPAIR THE DAMAGE TO MATCH EXISTING ADJACENT CONSTRUCTION.
8. CONTRACTOR IS TO VERIFY THE EXACT LOCATION OF ALL EXISTING UTILITIES PRIOR TO DEMOLITION ACTIVITIES.
9. CONTRACTOR SHALL REMOVE DEBRIS REGULARLY AS NECESSARY TO ELIMINATE INTERFERENCE WITH ROADS, STREET, WALKS, AND ALL OTHER ADJACENT FACILITIES.
10. CONTRACTOR IS RESPONSIBLE FOR CONSTRUCTION OF TEMPORARY DUST AND/OR SOUND PARTITIONS BETWEEN CONSTRUCTION AREA AND AREAS NOT IN SCOPE AS NECESSARY. DEMOLITION ACTIVITIES SHALL BE PERFORMED SO AS TO PRODUCE MINIMAL DISTURBANCE TO EXISTING FACILITY AND OCCUPANTS (IE. MINIMIZE EXCESSIVE AND PROLONGED NOISE LEVELS AND DUST).
11. NOTIFY THE BUILDING OWNER OF ANY MATERIALS, FIXTURES, ETC. TO BE REMOVED THAT ARE DEEMED SALVAGEABLE. TURN OVER ANY REQUESTED ITEMS TO THE BUILDING OWNER IN GOOD CONDITION.
12. THE CONTRACTOR SHALL REMOVE ALL TRASH AND DEBRIS FROM THE SITE ON A DAILY BASIS.
13. MAINTAIN THE INTEGRITY OF ALL EXISTING RATED WALLS, FIRE SEAL ANY PENETRATIONS WITH U.L. APPROVED ASSEMBLY.
14. WHEN UNANTICIPATED MECHANICAL, ELECTRICAL, OR STRUCTURAL ELEMENTS THAT CONFLICT WITH THE INTENDED FUNCTION OR DESIGN ARE ENCOUNTERED, DETERMINE THE NATURE AND EXTENT OF THE CONFLICT AND NOTIFY THE ARCHITECT IMMEDIATELY FOR RESOLUTION.
15. CONTRACTOR SHALL PROVIDE TRAFFIC HANDLING MEASURES AS NECESSARY TO PROTECT THE GENERAL PUBLIC AT ALL TIMES, AND AS REQUIRED BY GOVERNING AUTHORITIES.
16. DO NOT INTERRUPT EXISTING UTILITIES, EXCEPT WHEN AUTHORIZED IN WRITING BY AUTHORITIES HAVING JURISDICTION. PROVIDE TEMPORARY SERVICES DURING INTERRUPTIONS TO EXISTING UTILITIES, AS ACCEPTABLE TO GOVERNING AUTHORITIES.
17. WHEN UTILITY SERVICES ARE REQUIRED TO BE REMOVED, RELOCATED, OR ABANDONED, PROVIDE BYPASS CONNECTIONS TO MAINTAIN CONTINUITY OF SERVICE BEFORE PROCEEDING WITH DEMOLITION.
18. PRIOR TO COMMENCEMENT WITH ANY DEMOLITION WORK, CONTRACTOR SHALL IDENTIFY ALL ELECTRICAL CIRCUITS SERVICING THE AREA INVOLVED WITH THIS DEMOLITION. THOSE CIRCUITS SHALL THEN BE LOCKED OUT AND TAGGED OUT IF THEY DO NOT SERVICE ANY OF THE REMAINING BUILDING. THOSE CIRCUITS WHICH ARE IDENTIFIED TO SERVICE BOTH THE AREA TO BE DEMOLISHED AND THE REMAINING BUILDING SHALL BE SPLIT SO AS TO KILL ALL ELECTRICAL POWER TO THE AREA TO BE DEMOLISHED WHILE MAINTAINING POWER TO THE REMAINDER OF THE BUILDING.
19. CONTRACTOR TO RELOCATE UTILITIES & EQUIPMENT AS REQUIRED TO ACCOMMODATE NEW PLUMBING REQUIREMENTS FOR NEW RENOVATION WORK.
20. REFER TO DEMOLITION PLUMBING PLANS FOR EXTENT OF CONCRETE SLAB TO BE REMOVED AND REPLACED FOR UNDER FLOOR PIPING INSTALLATION.
21. EXISTING WALLS (OR PORTIONS OF WALLS) TO BE REMOVED SHALL BE CUT FLUSH WHERE INTERSECTING WITH WALLS TO REMAIN. REMAINING WALLS TO BE PATCHED AND FINISHED SMOOTH.
22. NEW OPENING TO BE CUT IN EXISTING WALLS SHALL BE SAW-CUT AT LOCATIONS INDICATED TO THE HEIGHT AND WIDTH INDICATED. NEW UNITS SHALL BE INSTALLED TO SUPPORT EXISTING WALL CONSTRUCTION ABOVE AS INDICATED ON THE DRAWINGS, OR IF NOT INDICATED, NEW WALL CONSTRUCTION PER STRUCTURAL DRAWINGS, IF PROVIDED.
23. WHERE EXISTING INTERIOR WALLS ARE REPLACED OR REMOVED, REMOVE MEP SYSTEMS BACK TO PANEL OR MECHANICAL ROOM OR FARTHEST POSSIBLE POINT WITHOUT DISTURBING EXISTING CONSTRUCTION; REMOVE EXISTING MECHANICAL EQUIPMENT; RELOCATE POWER PER MEP DRAWINGS.
24. REFER TO MEP DRAWINGS FOR DEMOLITION OF MEP SYSTEMS. IDENTIFY WORK REQUIRED BY THIS CONTRACTOR WHICH MAY AFFECT DEMOLITION AND/OR REPAIRS OF ARCHITECTURAL ELEMENTS. COORDINATE WITH RELATED SUBS THE EXTENT OF ALL DEMOLITION WORK.
25. PATCH FLOORS, WALLS, CEILINGS WHICH REMAIN AT LOCATIONS WHERE PIPES, CONDUITS, ETC. ARE REMOVED AS REQUIRED TO MATCH EXISTING CONDITIONS OR TO RECEIVE NEW FINISHES.
26. WHERE EXISTING FINISH FLOORS IS REMOVED, PREPARE SURFACE TO RECEIVE NEW FLOORING.
27. NOTIFY ARCHITECT & OWNER OF ANY POSSIBLE ASBESTOS CONTAINING MATERIALS DISCOVERED BEFORE PROCEEDING WITH WORK; PROTECT INTERIOR CONSTRUCTION TO REMAIN DURING DEMOLITION AND CONSTRUCTION.
28. CONTRACTOR TO OBTAIN ALL NECESSARY PERMITS BEFORE COMMENCING WORK.
29. CONTRACTOR TO PROVIDE ALL NECESSARY SHORING FOR PROTECTION OF EXISTING STRUCTURE AND FOUNDATION TO REMAIN.
30. ALL DASHED LINES ARE DEMOLITION LINES UNLESS NOTED OTHERWISE.
31. REMOVE ALL CARPET WAINSCOT FROM ALL LOCATIONS IN EACH UNIT.

**GENERAL NOTES**



1. VERIFY DIMENSIONS AND EXISTING CONDITIONS BEFORE COMMENCING WORK. REPORT DISCREPANCIES TO THE ARCHITECT PRIOR TO PROCEEDING WITH AFFECTED WORK.
2. REFLECTING CEILING PLAN DIMENSIONS ARE REFERENCED FROM FINISHED SURFACES UNLESS NOTED OTHERWISE. CEILING HEIGHTS ARE DIMENSIONED FROM FLOOR TO FINISHED CEILING HEIGHT.
3. DIMENSIONS NOTED AS "FIELD VERIFY" SHALL BE CHECKED AT THE SITE BY THE CONTRACTOR AND REVIEWED WITH THE ARCHITECT BEFORE INCORPORATING INTO THE WORK.
4. DO NOT SCALE DRAWING. WRITTEN DIMENSIONS TAKE PRECEDENCE. IF CLARIFICATION IS REQUIRED IN ORDER TO DETERMINE THE INTENT OF THE CONTRACT DOCUMENTS, CONTACT THE ARCHITECT.
5. NOTES OR DIMENSIONS LABELED "TYPICAL" SHALL APPLY TO SITUATIONS THAT ARE THE SAME OR SIMILAR.
6. ALL INTERIOR PARTITIONS SHALL BE KEYED AS REFERENCE SHEET A7.00 FOR PARTITION TYPES.
7. ALL DIMENSIONS ARE TO FACE OF FINISHED WALL UNLESS NOTED OTHERWISE.
8. ALL SPACES WITH FLOOR DRAINS TO HAVE FINISHED FLOORS SLOPED TO DRAIN NOT TO EXCEED ONE IN FIFTY.
9. ALL FLOORS FINISH CHANGES SHALL OCCUR AT THE CENTERLINE OF DOORS UNLESS NOTED OTHERWISE. ALL FLOOR FINISH CHANGES SHALL HAVE THRESHOLDS OR REDUCER STRIPS.
10. ALL DOORS IN INTERIOR GYP. BD STUD WALLS SHALL BE SET 4" OFF THE PERP. ADJ. WALL ON THE HINGE SIDE OF THE DOOR UNLESS NOTED OTHERWISE. THE CONTRACTOR SHALL CONTACT THE ARCHITECT IF ANY CONFLICT OCCURS.
11. PROVIDE VINYL REDUCER AT ALL DISSIMILAR FLOOR MATERIALS UNLESS OTHERWISE NOTED.
12. UNLESS OTHERWISE NOTED, ALL ELECTRICAL AND MECHANICAL OPERABLE DEVICES SHALL BE MOUNTED WITH THE HIGHEST OPERABLE CONTROL AT 42" AFF.
13. ALL REQUIRED CLEARANCES, AS DESCRIBED IN THE TEXAS ACCESSIBILITY STANDARDS (TAS) OF THE ARCHITECTURAL BARRIERS ACT ARTICLE 9102, TEXAS CIVIL STATUTES (2013) FOR COUNTERTOPS, ALL PLUMBING FIXTURES INCLUDING DRINKING FOUNTAINS, LAVATORIES, URINALS, AND TOILETS WILL BE STRICTLY ENFORCED.



**ARCHITECTURE**  
 PBK ARCHITECTS  
 11 Greenway Plaza, 22nd Floor  
 Houston, TX 77046  
 713-965-9569 P  
 713-961-4571 F  
 TX Firm # F-1709  
 PBK.com

**MEP**  
 SHAH SMITH AND ASSOCIATES  
 2625 Westline Dr #300  
 HOUSTON, TX 77042  
 (713) 790 - 7563


**HARRIS COUNTY PSYCHIATRIC CENTER RENOVATION UNITS: 1C, 2E, 3B, 3C, 3D & 3E**

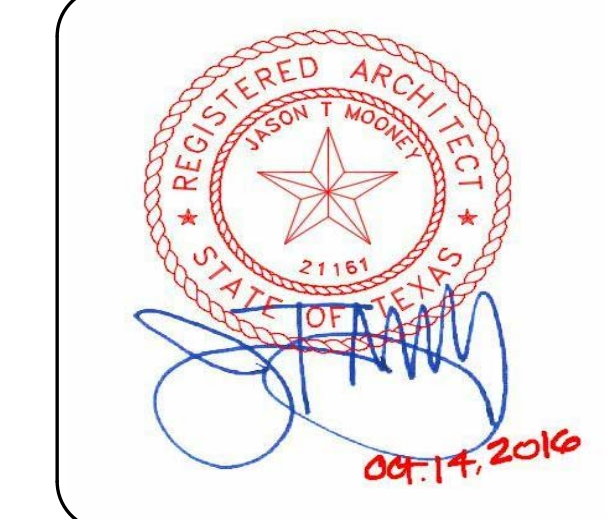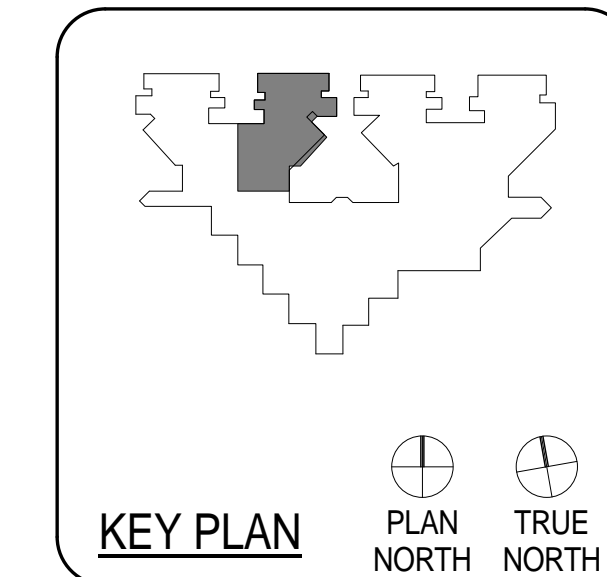


CLIENT UT HEALTH		
PROJECT NUMBER 16106		
DATE: OCTOBER 14, 2016		
DRAWN BY: VICTORIA GARCIA		
CHECKED BY: Checker		
REVISIONS		
No.	Description	Date

ISSUE FOR BID  
**THIRD FLOOR UNIT 3C**

**A2.11C**

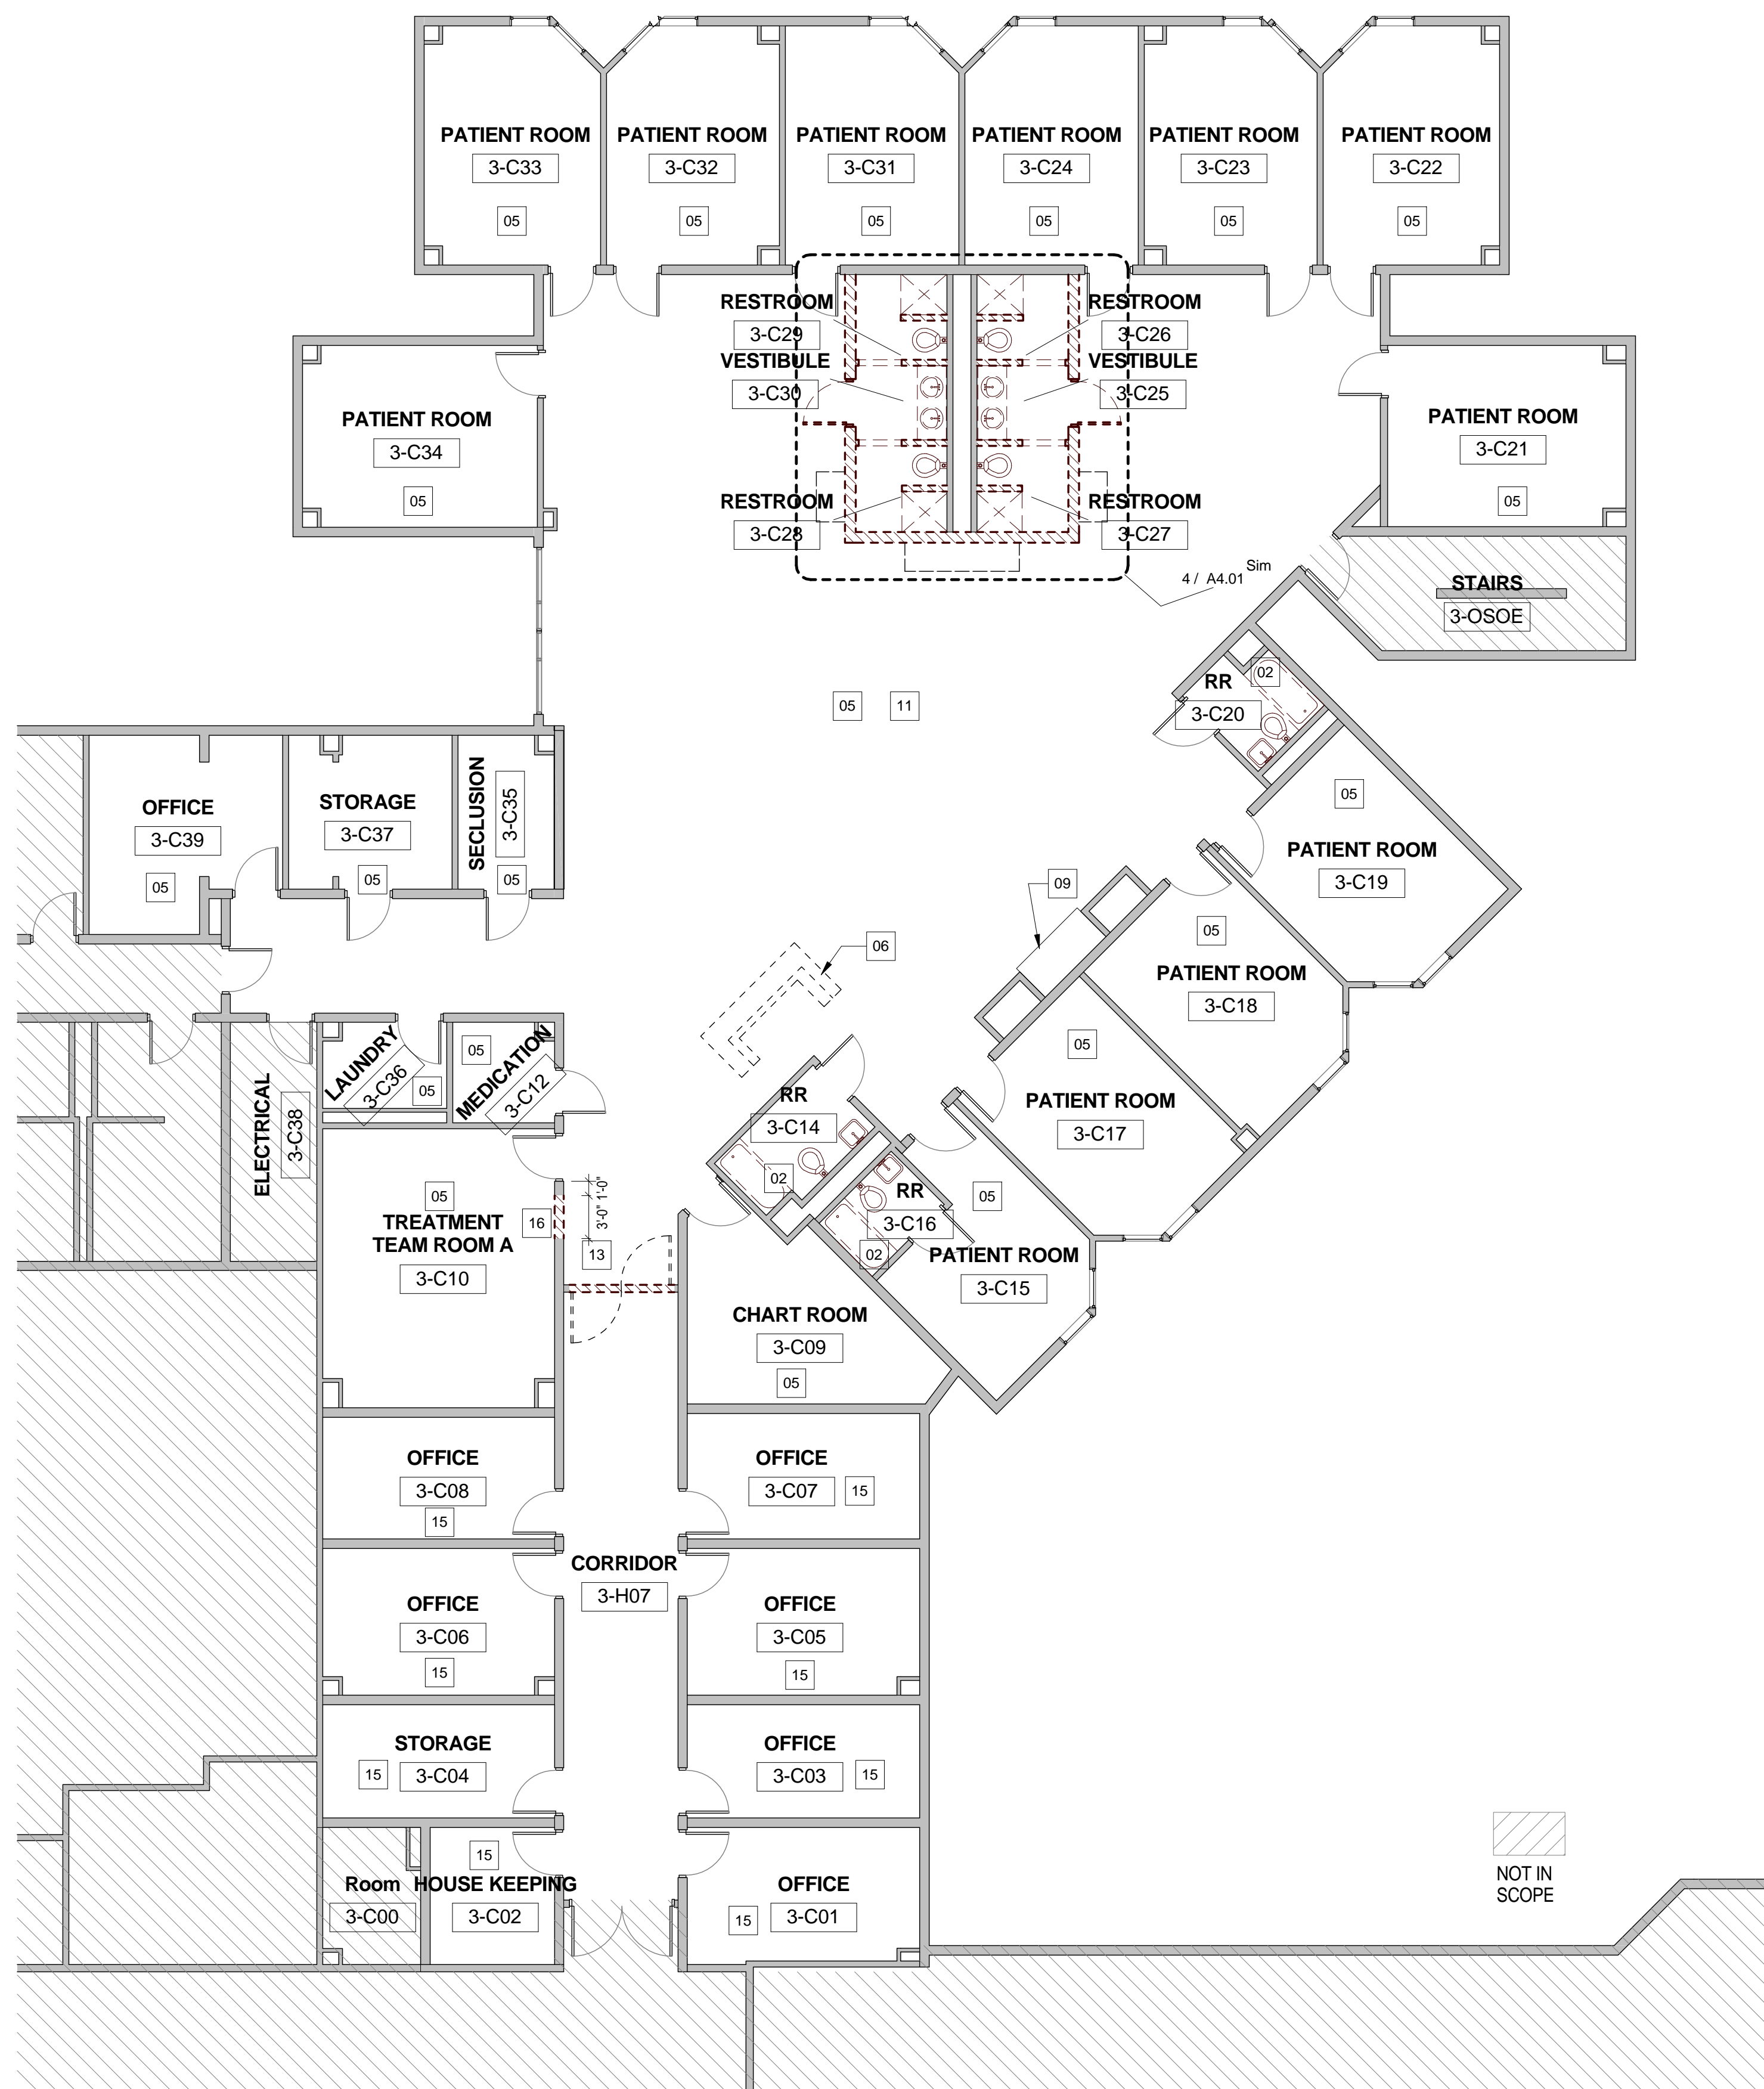

**6** DEMOLITION FLOOR PLAN - UNIT 3C  
 1/8" = 1'-0"

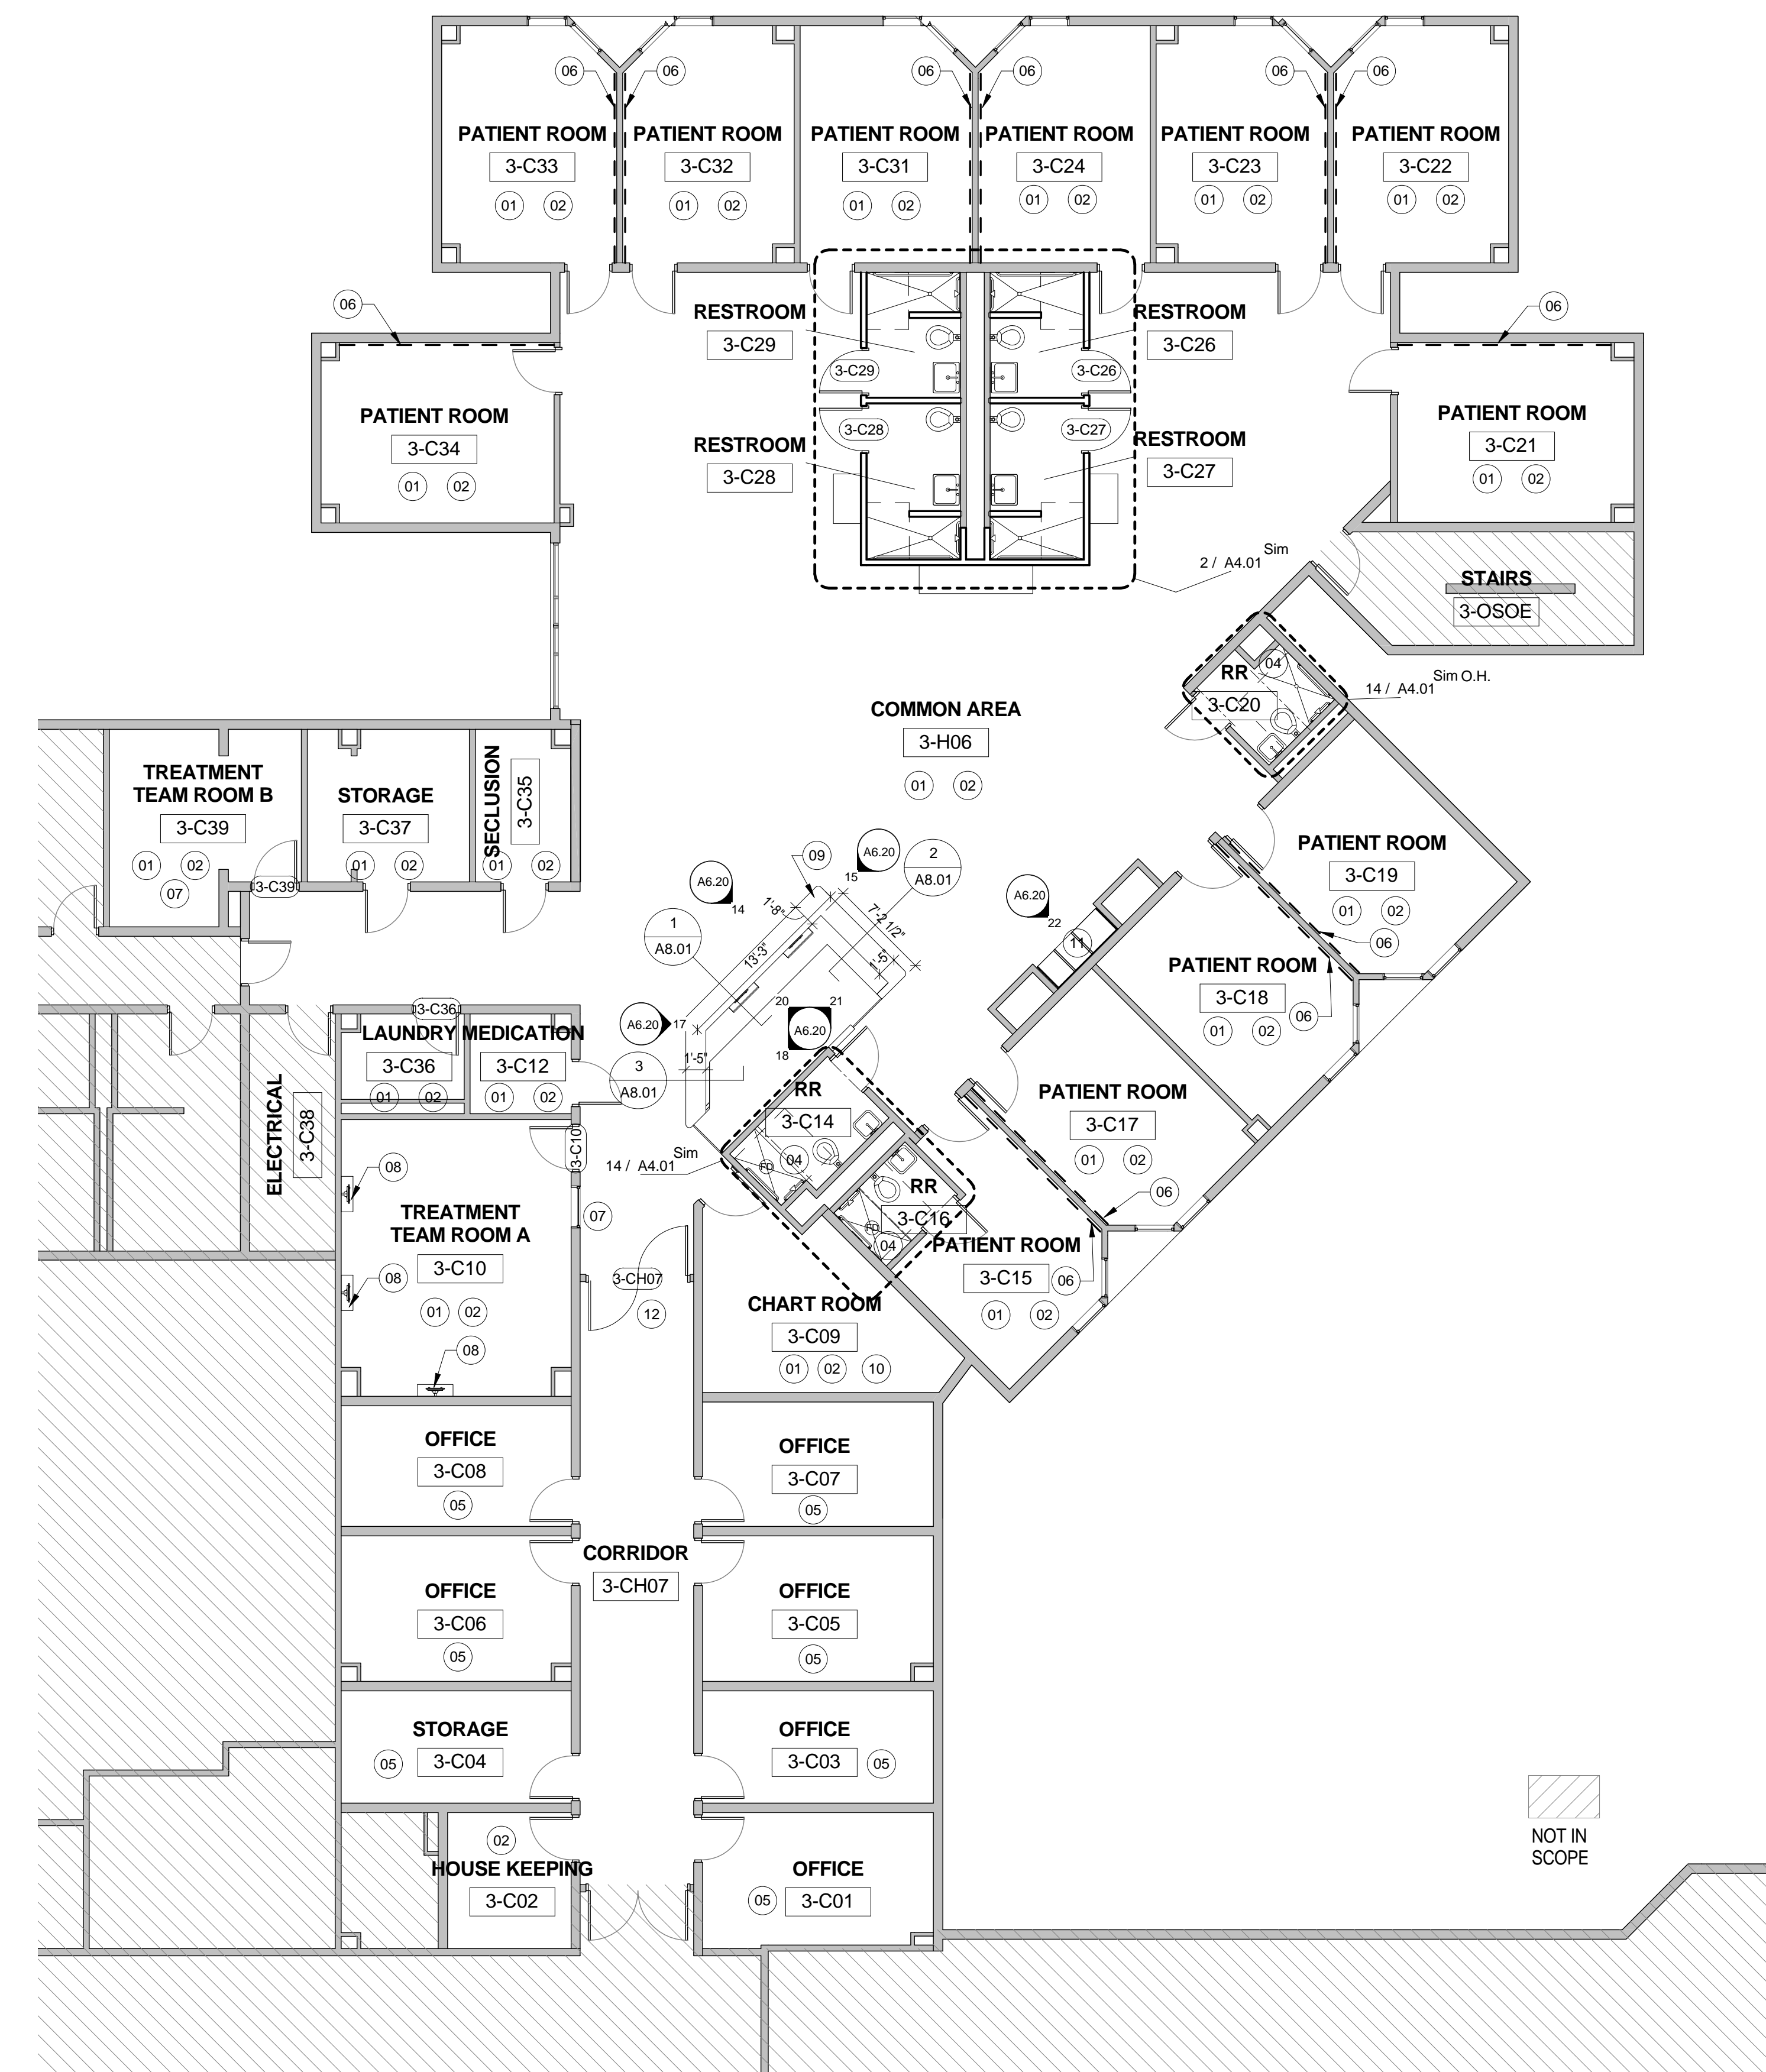


**3** RENOVATION PLAN - UNIT 3C  
 1/8" = 1'-0"







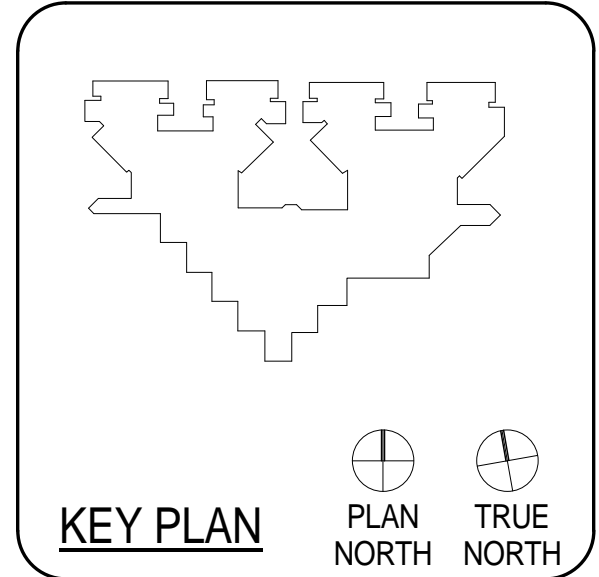

CLIENT		
UT HEALTH		
PROJECT NUMBER		
16106		
DATE: OCTOBER 14, 2016		
DRAWN BY: VG/BG		
CHECKED BY: JM/CS		
REVISIONS		
No.	Description	Date

ISSUE FOR BID  
**SCHEDULES - THIRD  
FLOOR UNIT 3D**

**A2.13D**

MARK	ELEV.	PAIR/SING LE	DOOR			MATL.	ELEV.	FRAME			MATL.	DETAILS			H.W.	FIRE RATING	Comments
			SIZE W x H					SIZE W x H				SILL	JAMB	HEAD			
			W	H				W	H								
3-D18	B	S	3' - 4"	7' - 4"	SC WD	1	7' - 0"	3' - 0"	HM		EXISTING	EXISTING	EXISTING	N/A		ADD GLASS LITE TO EXISTING DOOR	
3-D09	B	S	3' - 4"	7' - 4"	SC WD	1	7' - 0"	3' - 0"	HM		EXISTING	EXISTING	EXISTING	N/A		ADD GLASS LITE TO EXISTING DOOR	
3-D11A	B	S	3' - 4"	7' - 4"	SC WD	1	7' - 0"	3' - 0"	HM		EXISTING	EXISTING	EXISTING	N/A		ADD GLASS LITE TO EXISTING DOOR	
3-D11B	B	S	3' - 4"	7' - 4"	SC WD	1	7' - 0"	3' - 0"	HM		EXISTING	EXISTING	EXISTING	N/A		ADD GLASS LITE TO EXISTING DOOR	
3-DH05	C	P	7' - 4"	7' - 4"	EXISTING	2	7' - 0"	7' - 0"	HM		2/A2.13D	3/A2.13D	EXISTING	N/A		SALVAGE EXISTING HARDWARE AND REINSTALL; RE-USE EXISTING GLASS LITE; EXISTING FRAME W/ NEW PAINT FINISH, RE: ALTERNATE NO. 3D-05	
3-D24	A	S	3' - 4"	7' - 4"	SC WD	1	7' - 0"	3' - 0"	HM		2/A2.13D	3/A2.13D	1	N/A			
3-D23	A	S	3' - 4"	7' - 4"	SC WD	1	7' - 0"	3' - 0"	HM		2/A2.13D	3/A2.13D	1	N/A			
3-D34	A	S	3' - 0"	7' - 4"	SC WD	1	7' - 0"	2' - 8"	HM		EXISTING	EXISTING	1	N/A		SALVAGE EXISTING DOOR, FRAME AND HARDWARE OF EXISTING DOOR TO RE-INSTALL; NEW PAINT FINISH ON EXISTING FRAME	
3-D34B	A	S	3' - 0"	7' - 4"	SC WD	1	7' - 0"	2' - 8"	HM		2/A2.13D	3/A2.13D	2	N/A			

**HARDWARE SET 1**




DOOR HARDWARE IS TO "MATCH EXISTING", BUT SHOULD CONSIST OF THE FOLLOWING COMPONENTS:

- A. (1) EA. SELECT HINGES SL57 FULL-SURFACE GEARED CONTINUOUS HINGES
- B. (1) EA. "PUSH/PULL SET TO MATCH EXISTING; INSTALL PUSH PLATE ON INTERIOR (RESTROOM SIDE) OF DOOR, PULL ON EXTERIOR (COMMON AREA SIDE) OF DOOR, AND PROVIDE (1) LOCKSET FOR STAFF USE ON EXTERIOR (COMMON AREA SIDE) OF DOOR TO MATCH EXISTING
- C. (1) EA. IVES WS407CCV (WALL BUMPER)FS436 (FLOOR DOME) DOOR STOP
- D. (3) EA. IVES SR64 DOOR SILENCERS
- E. NO CLOSERS

**HARDWARE SET 2**

DOOR HARDWARE IS TO "MATCH EXISTING", BUT SHOULD CONSIST OF THE FOLLOWING COMPONENTS:

- A. (1) EA. SELECT HINGES SL57 FULL-SURFACE GEARED CONTINUOUS HINGES
- B. (1) EA. STORAGE FUNCTION LOCK SET IN HARDWARE TO MATCH EXISTING; COORDINATE WITH OWNER.
- C. (1) EA. IVES WS407CCV (WALL BUMPER)FS436 (FLOOR DOME) DOOR STOP
- D. (3) EA. IVES SR64 DOOR SILENCERS
- E. NO CLOSERS

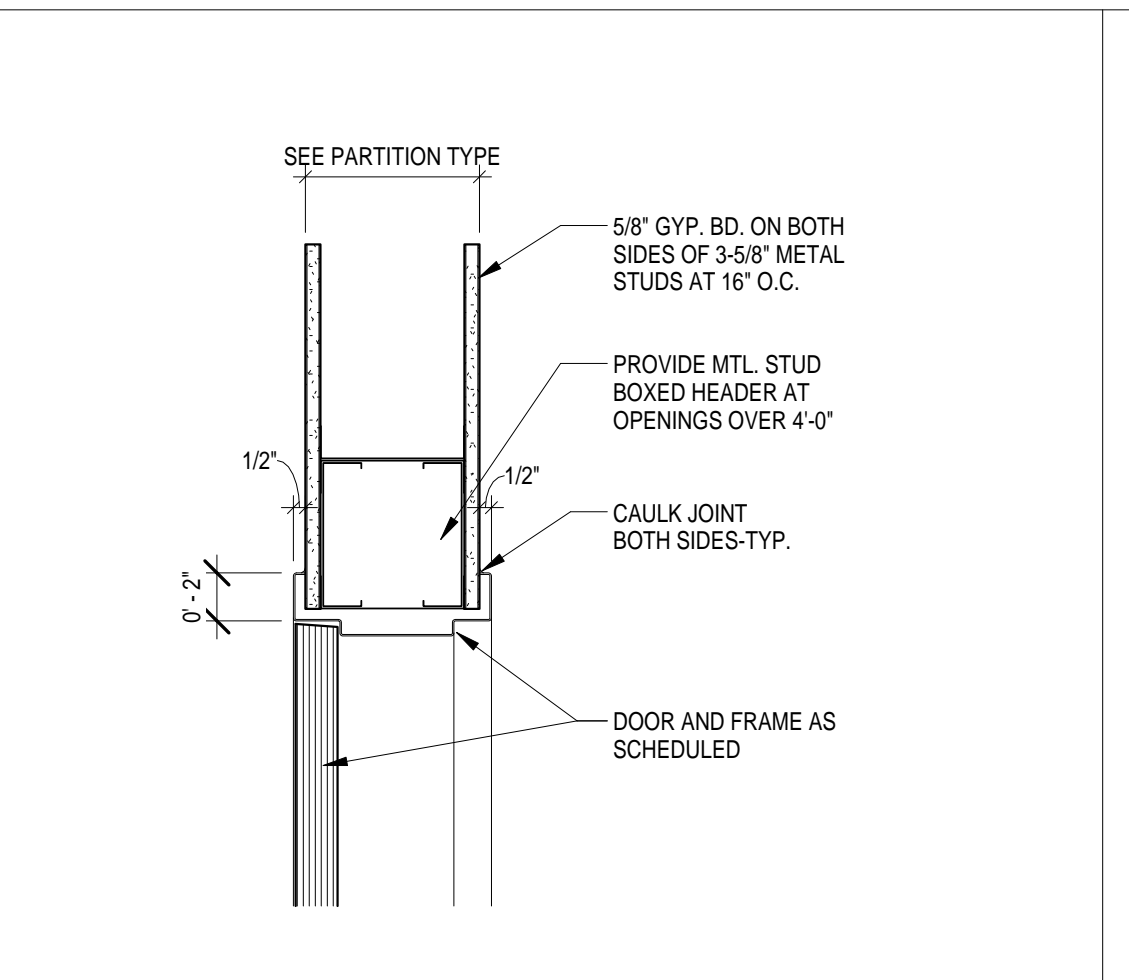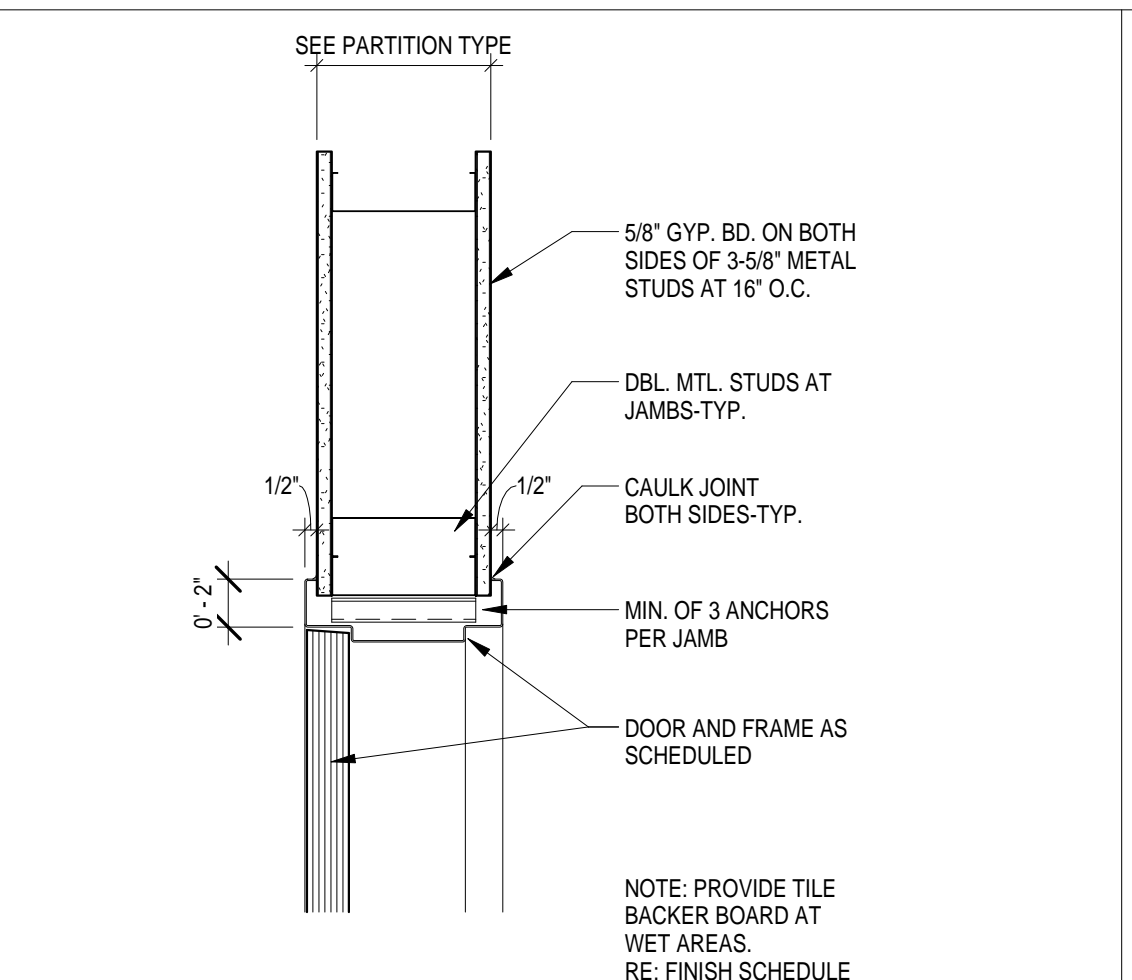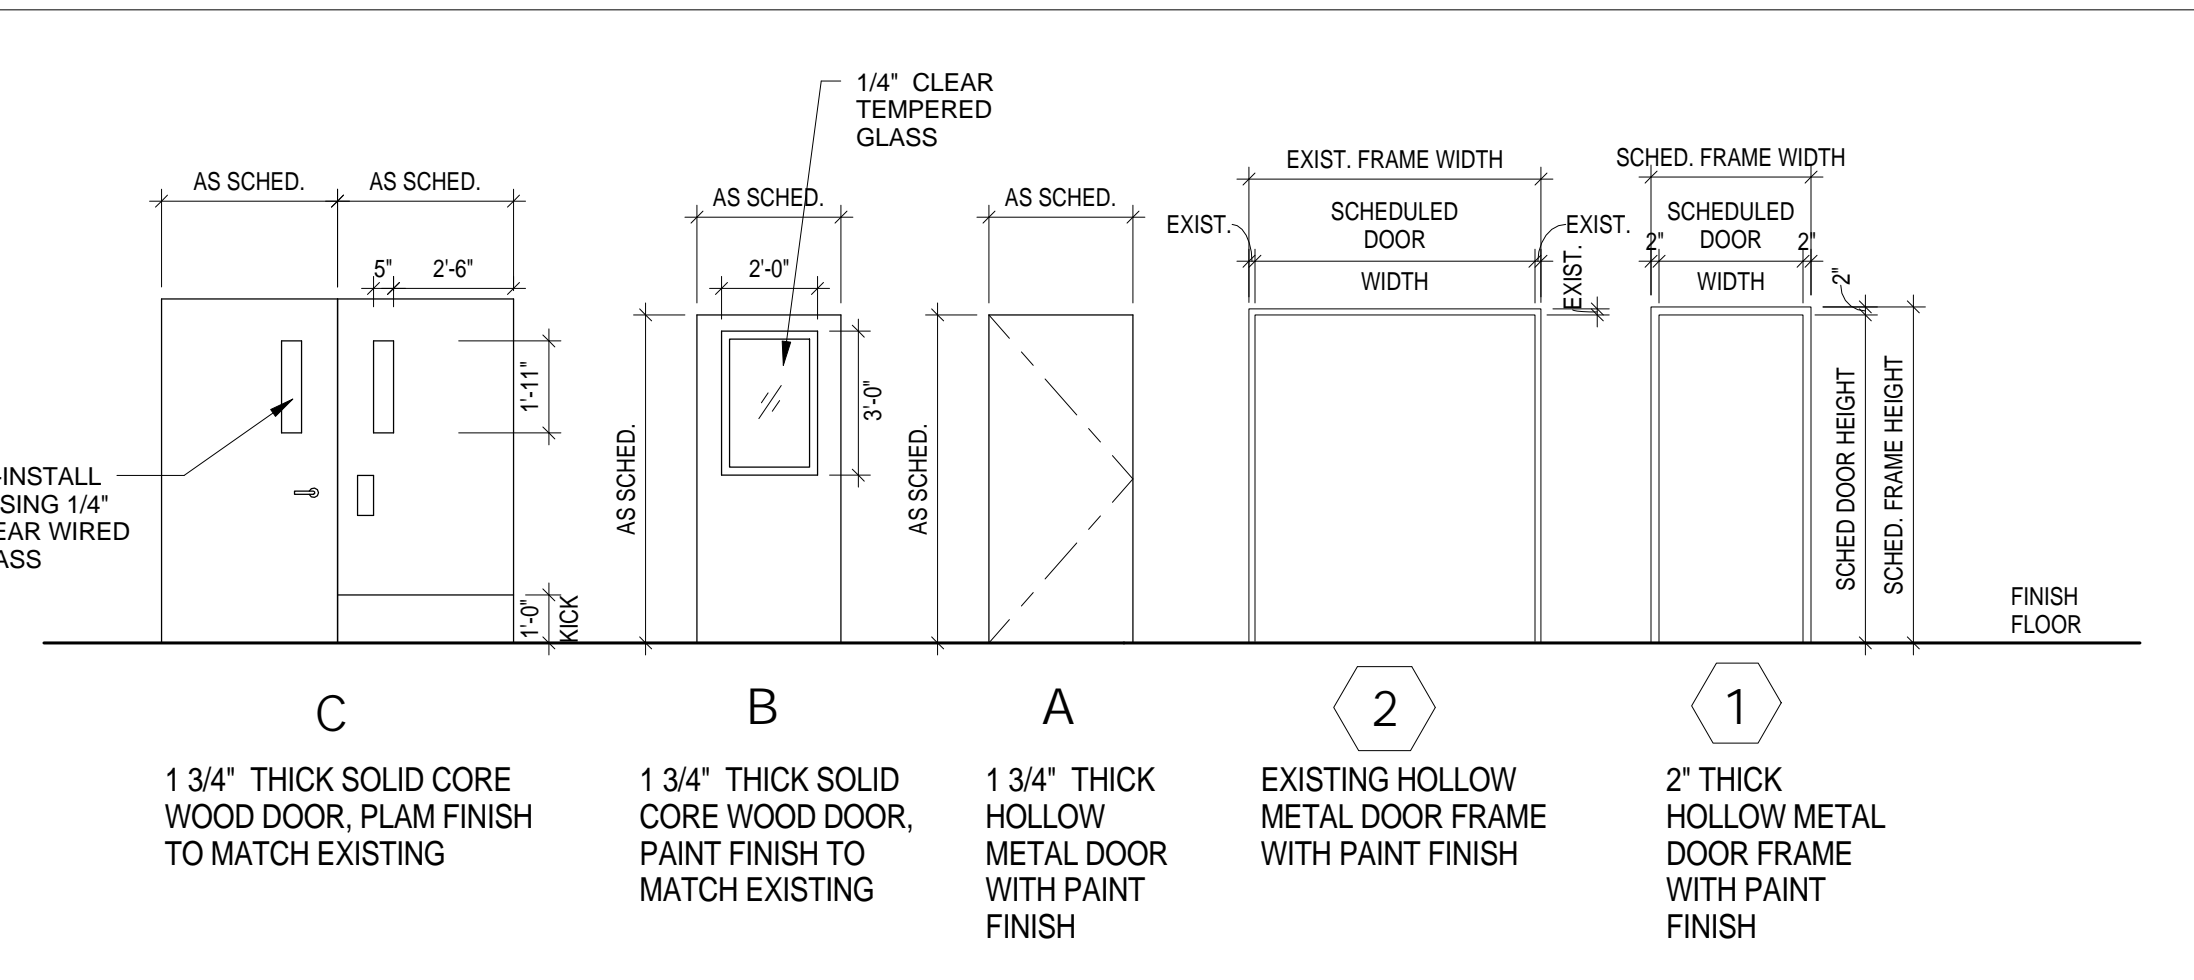



**DEMOLITION - KEYED NOTES**

- NOTE: REFER TO ENLARGED PLANS FOR ADDITIONAL KEYED NOTE LOCATIONS IF NOT VISIBLE ON THIS SHEET.
- 01 TYPICAL: REMOVE EXISTING MILLWORK AND/OR TRASH UNIT AND STORE FOR REINSTALLATION; COORDINATE EXACT REQUIREMENTS IN FIELD.
  - 02 REMOVE ALL EXISTING FLOORING, WALL FINISHES, FIXTURES AND ACCESSORIES; REFER TO MEP DRAWINGS FOR ADDITIONAL INFO PERTAINING TO FIXTURES; PREP EXISTING SUBSTRATES TO REMAIN FOR RECEIPT OF NEW FINISHES
  - 03 REMOVE EXISTING DOOR AND FRAME; SALVAGE DOORS AND RETURN TO BUILDING STOCK; RE: RENOVATION PLAN
  - 04 TYPICAL: REMOVE ALL WALL-MOUNTED ACCESSORIES (IE, BULLETIN BOARDS, SIGNAGE, ETC.) AND STORE FOR REINSTALLATION; COORDINATE EXACT REQUIREMENTS IN FIELD
  - 05 REMOVE EXISTING VINYL OR TILE FLOORING AND WALL BASE; PREP EXISTING SUBSTRATE FOR RECEIPT OF NEW FINISHES; RE: FINISH PLANS; COORDINATE TEMPORARY REMOVAL OF ANY FURNITURE AND EQUIPMENT WITH OWNER
  - 06 DEMOLISH EXISTING NURSE STATION
  - 07 DEMOLISH EXISTING WALLS WHERE INDICATED DASHED; COORDINATE EXACT REQUIREMENTS IN FIELD
  - 08 EXISTING CHASE WALL TO REMAIN; REMOVE FINISHES ONLY
  - 09 REMOVE EXISTING NOURISHMENT STATION/DOORS; NOURISHMENT STATION TO REMAIN; PROTECT IN PLACE
  - 10 EXISTING TELEPHONE BANK/MILLWORK TO REMAIN; PROTECT IN PLACE
  - 11 COORDINATE WITH OWNER TEMPORARY REMOVAL OF EXISTING SIGNAGE, WALL-MOUNTED ACCESSORIES AND WALL-MOUNTED DEVICES TO PREPARE FOR APPLICATION OF NEW WALL FINISHES, TYPICAL THROUGHOUT
  - 12 REMOVE EXISTING FLOORING ONLY
  - 13 ALTERNATE NO.3D-05; RE: SPECS
  - 14 EXISTING FLOORING AND WALL BASE TO REMAIN
  - 15 REMOVE EXISTING FLOORING AND WALL BASE; PREP EXISTING SUBSTRATE FOR RECEIPT OF NEW FINISHES; RE: FINISH PLANS; COORDINATE TEMPORARY REMOVAL OF ANY FURNITURE AND EQUIPMENT WITH OWNER
  - 16 ALTERNATE NO.3D-01; RE: SPECS

**RENOVATION - KEYED NOTES**

- NOTE: REFER TO ENLARGED PLANS FOR ADDITIONAL KEYED NOTE LOCATIONS IF NOT VISIBLE ON THIS SHEET.
- 01 INSTALL SCHEDULED FLOORING & BASE; RE: FINISH PLAN
  - 02 APPLY SCHEDULED WALL FINISH THROUGHOUT; RE: FINISH PLAN
  - 03 REINSTALL EXISTING MILLWORK, WALL-MOUNTED DEVICES, AND EQUIPMENT AS NEEDED; COORDINATE WITH OWNER IN FIELD
  - 04 INSTALL NEW CEILING, WALL FINISHES, PLUMBING FIXTURES AND FLOORING FINISHES
  - 05 RE-PAIN ALL EXISTING WALLS WITHIN THIS AREA WITH PT-1; EXISTING FLOORING IS ALSO TO BE REMOVED AS PART OF BASE SCOPE OF WORK - FLOORING REPLACEMENT AND WALL PAINTING SHALL BOTH OCCUR OVER THE COURSE OF ONE WEEKEND (FRIDAY THROUGH SUNDAY) COORDINATE REMOVAL AND REINSTALLATION OF ANY FURNITURE, FIXTURES, AND EQUIPMENT ITEMS IN FIELD WITH OWNER
  - 06 IN LIEU OF TYPICAL WALL PAINT, APPLY CHALKBOARD PAINT TO EXISTING WALL OPPOSITE FROM PATIENT BEDS IN THE ROOM (CONFIRM IN FIELD); CHALKBOARD PAINT IS TO EXTEND FROM EXISTING DESK HEIGHT TO ALIGN WITH THE TOP OF THE EXISTING DOOR FRAME AND FOR THE FULL LENGTH OF THE WALL
  - 07 ALTERNATE NO.3D-01; RE: SPECS
  - 08 ALTERNATE NO.3D-02; RE: SPECS
  - 09 REMOVE THE EXISTING NURSE STATION AND REPLACE WITH A NEW NURSE STATION TO MATCH THE CONFIGURATION AND FINISHES AS BUILT IN UNITS 1D AND 2B WITH EXCEPTIONS AS NOTED AND DEPICTED IN DETAILS WITHIN; MODIFY EXISTING CORING WITHIN THE FLOOR SLAB AS NEEDED TO ACCOMMODATE THE NEW NURSE STATION CONFIGURATION; EXISTING CEILING IS TO REMAIN IN THIS AREA, NO FURR-DOWNS ARE TO BE INSTALLED ABOVE THE NEW NURSE STATION
  - 10 ALTERNATE NO.3D-03; RE: SPECS
  - 11 RE: INTERIOR ELEVATIONS FOR EXISTING NOURISHMENT STATION MODIFICATIONS
  - 12 ALTERNATE NO.3D-05; RE: SPECS

**GENERAL DEMOLITION NOTES:**

- 1. THE DEMOLITION PLAN OUTLINES SOME OF THE SCOPE OF THE WORK INVOLVED FOR THE DEMOLITION PHASE OF THIS PROJECT. CONTRACTOR SHALL REVIEW ALL SHEETS FOR ADDITIONAL DEMO SCOPE.
- 2. CONTRACTOR SHALL VERIFY EXISTING SITE AND BUILDING CONDITIONS AND DIMENSIONS IN THE FIELD PRIOR TO COMMENCING DEMOLITION ACTIVITIES. CONTRACTOR SHALL NOT SCALE DRAWINGS. CONTRACTOR WILL NOTIFY ARCHITECT OF ANY DISCREPANCIES IN WRITING.
- 3. AFTER AWARD OF THE CONTRACT, CHANGE ORDER REQUESTS FOR ADDITIONAL MONEY WILL NOT BE APPROVED IF THE WORK COULD HAVE BEEN ANTICIPATED DURING A SITE VISIT BY THE CONTRACTOR.
- 4. CONTRACTOR WILL BE REQUIRED TO REPAIR, REPLACE, OR PATCH EXISTING BUILDINGS, DRIVEWAYS, SIDEWALKS, CANOPIES, AND/OR PARKING AREAS DISTURBED BY DEMOLITION.
- 5. CONTRACTOR WILL BE REQUIRED TO REGRADE AND HYDROMULCH AREAS AFFECTED BY DEMOLITION.
- 6. ALL FURNITURE WILL BE REMOVED OR RELOCATED BY THE OWNER AS NECESSARY PRIOR TO THE DEMOLITION WORK OF THIS PROJECT. CONTRACTOR SHALL COORDINATE WITH OWNER AS REQUIRED.
- 7. REMOVE EXISTING CONSTRUCTION TO THE EXTENT INDICATED ON THE DRAWINGS. SHOULD ANY DAMAGE OCCUR TO ANY EXISTING CONSTRUCTION TO REMAIN, THE CONTRACTOR SHALL REPAIR THE DAMAGE TO MATCH EXISTING ADJACENT CONSTRUCTION.
- 8. CONTRACTOR IS TO VERIFY THE EXACT LOCATION OF ALL EXISTING UTILITIES PRIOR TO DEMOLITION ACTIVITIES.
- 9. CONTRACTOR SHALL REMOVE DEBRIS REGULARLY AS NECESSARY TO ELIMINATE INTERFERENCE WITH ROADS, STREET, WALKS, AND ALL OTHER ADJACENT FACILITIES.
- 10. CONTRACTOR IS RESPONSIBLE FOR CONSTRUCTION OF TEMPORARY DUST AND/OR SOUND PARTITIONS BETWEEN CONSTRUCTION AREA AND AREAS NOT IN SCOPE AS NECESSARY. DEMOLITION ACTIVITIES SHALL BE PERFORMED SO AS TO PRODUCE MINIMAL DISTURBANCE TO EXISTING FACILITY AND OCCUPANTS (IE, MINIMIZE EXCESSIVE NOISE LEVELS AND DUST).
- 11. NOTIFY THE BUILDING OWNER OF ANY MATERIALS, FIXTURES, ETC. TO BE REMOVED THAT ARE DEEMED SALVAGEABLE. TURN OVER ANY REQUESTED ITEMS TO THE BUILDING OWNER IN GOOD CONDITION.
- 12. THE CONTRACTOR SHALL REMOVE ALL TRASH AND DEBRIS FROM THE SITE ON A DAILY BASIS.
- 13. MAINTAIN THE INTEGRITY OF ALL EXISTING RATED WALLS, FIRE SEAL ANY PENETRATIONS WITH U.L. APPROVED ASSEMBLY.
- 14. WHEN UNANTICIPATED MECHANICAL, ELECTRICAL, OR STRUCTURAL ELEMENTS THAT CONFLICT WITH THE INTENDED FUNCTION OR DESIGN ARE ENCOUNTERED, DETERMINE THE NATURE AND EXTENT OF THE CONFLICT AND NOTIFY THE ARCHITECT IMMEDIATELY FOR RESOLUTION.
- 15. CONTRACTOR SHALL PROVIDE TRAFFIC HANDLING MEASURES AS NECESSARY TO PROTECT THE GENERAL PUBLIC AT ALL TIMES, AND AS REQUIRED BY GOVERNING AUTHORITIES.
- 16. DO NOT INTERRUPT EXISTING UTILITIES, EXCEPT WHEN AUTHORIZED IN WRITING BY AUTHORITIES HAVING JURISDICTION. PROVIDE TEMPORARY SERVICES DURING INTERRUPTIONS TO EXISTING UTILITIES, AS ACCEPTABLE TO GOVERNING AUTHORITIES.
- 17. WHEN UTILITY SERVICES ARE REQUIRED TO BE REMOVED, RELOCATED, OR ABANDONED, PROVIDE BYPASS CONNECTIONS TO MAINTAIN CONTINUITY OF SERVICE BEFORE PROCEEDING WITH DEMOLITION.
- 18. PRIOR TO COMMENCEMENT WITH ANY DEMOLITION WORK, CONTRACTOR SHALL IDENTIFY ALL ELECTRICAL CIRCUITS SERVICING THE AREA INVOLVED WITH THIS DEMOLITION. THOSE CIRCUITS SHALL THEN BE LOCKED OUT AND TAGGED OUT IF THEY DO NOT SERVICE ANY OF THE REMAINING BUILDING. THOSE CIRCUITS WHICH ARE IDENTIFIED TO SERVICE BOTH THE AREA TO BE DEMOLISHED AND THE REMAINING BUILDING SHALL BE SPLIT SO AS TO KILL ALL ELECTRICAL POWER TO THE AREA TO BE DEMOLISHED WHILE MAINTAINING POWER TO THE REMAINDER OF THE BUILDING.
- 19. CONTRACTOR TO RELOCATE UTILITIES & EQUIPMENT AS REQUIRED TO ACCOMMODATE NEW PLUMBING REQUIREMENTS FOR NEW RENOVATION WORK.
- 20. REFER TO DEMOLITION PLUMBING PLANS FOR EXTENT OF CONCRETE SLAB TO BE REMOVED AND REPLACED FOR UNDER FLOOR PIPING INSTALLATION.
- 21. EXISTING WALLS (OR PORTIONS OF WALLS) TO BE REMOVED SHALL BE CUT FLUSH WHERE INTERSECTING WITH WALLS TO REMAIN. REMAINING WALLS TO BE PATCHED AND FINISHED SMOOTH.
- 22. NEW OPENING TO BE CUT IN EXISTING WALLS SHALL BE SAW-CUT AT LOCATIONS INDICATED TO THE HEIGHT AND WIDTH INDICATED. NEW UNTELS SHALL BE INSTALLED TO SUPPORT EXISTING WALL CONSTRUCTION ABOVE AS INDICATED ON THE DRAWING OR IF NOT INDICATED, AS REQUIRED FOR NEW WALL CONSTRUCTION PER STRUCTURAL DRAWINGS, IF PROVIDED.
- 23. WHERE EXISTING INTERIOR WALLS ARE REPLACED OR REMOVED, REMOVE MEP SYSTEMS BACK TO PANEL OR MECHANICAL ROOM OR FARTHEST POSSIBLE POINT WITHOUT DISTURBING EXISTING CONSTRUCTION. REMOVE EXISTING MECHANICAL EQUIPMENT, RELOCATE POWER PER MEP DRAWINGS.
- 24. REFER TO MEP DRAWINGS FOR DEMOLITION OF MEP SYSTEMS. IDENTIFY WORK REQUIRED BY THIS CONTRACTOR WHICH MAY AFFECT DEMOLITION AND/OR REPAIRS OF ARCHITECTURAL ELEMENTS. COORDINATE WITH RELATED SUBS THE EXTENT OF ALL DEMOLITION WORK.
- 25. PATCH FLOORS, WALLS & CEILINGS WHICH REMAIN AT LOCATIONS WHERE PIPES, CONDUITS, ETC. ARE REMOVED AS REQUIRED TO MATCH EXISTING CONDITIONS OR TO RECEIVE NEW FINISHES.
- 26. WHERE EXISTING FINISH FLOOR IS REMOVED, PREPARE SURFACE TO RECEIVE NEW FLOORING.
- 27. NOTIFY ARCHITECT & OWNER OF ANY POSSIBLE ASBESTOS CONTAINING MATERIALS DISCOVERED BEFORE PROCEEDING WITH WORK. PROTECT INTERIOR CONSTRUCTION TO REMAIN DURING DEMOLITION AND CONSTRUCTION.
- 28. CONTRACTOR TO OBTAIN ALL NECESSARY PERMITS BEFORE COMMENCING WORK.
- 29. CONTRACTOR TO PROVIDE ALL NECESSARY SHORING FOR PROTECTION OF EXISTING STRUCTURE AND FOUNDATION TO REMAIN.
- 30. ALL DASHED LINES ARE DEMOLITION LINES UNLESS NOTED OTHERWISE.
- 31. REMOVE ALL CARPET WAINSCOT FROM ALL LOCATIONS IN EACH UNIT.

**GENERAL NOTES**



- 1. VERIFY DIMENSIONS AND EXISTING CONDITIONS BEFORE COMMENCING WORK. REPORT DISCREPANCIES TO THE ARCHITECT PRIOR TO PROCEEDING WITH AFFECTED WORK.
- 2. REFLECTING CEILING PLAN DIMENSIONS ARE REFERENCED FROM FINISHED SURFACES UNLESS NOTED OTHERWISE. CEILING HEIGHTS ARE DIMENSIONED FROM FLOOR TO FINISHED CEILING HEIGHT.
- 3. DIMENSIONS NOTED AS "FIELD VERIFY" SHALL BE CHECKED AT THE SITE BY THE CONTRACTOR AND REVIEWED WITH THE ARCHITECT BEFORE INCORPORATING INTO THE WORK.
- 4. DO NOT SCALE DRAWING. WRITTEN DIMENSIONS TAKE PRECEDENCE. IF CLARIFICATION IS REQUIRED IN ORDER TO DETERMINE THE INTENT OF THE CONTRACT DOCUMENTS, CONTACT THE ARCHITECT.
- 5. NOTES OR DIMENSIONS LABELED "TYPICAL" SHALL APPLY TO SITUATIONS THAT ARE THE SAME OR SIMILAR.
- 6. ALL INTERIOR PARTITIONS SHALL BE KEYED AS REFERENCE SHEET A7.00 FOR PARTITION TYPES.
- 7. ALL DIMENSIONS ARE TO FACE OF FINISHED WALL UNLESS NOTED OTHERWISE.
- 8. ALL SPACES WITH FLOOR DRAINS TO HAVE FINISHED FLOORS SLOPED TO DRAIN NOT TO EXCEED ONE IN FIFTY.
- 9. ALL FLOOR FINISH CHANGES SHALL OCCUR AT THE CENTERLINE OF DOORS UNLESS NOTED OTHERWISE. ALL FLOOR FINISH CHANGES SHALL HAVE THRESHOLDS OR REDUCER STRIPS.
- 10. ALL DOORS IN INTERIOR GYP. BD STUD WALLS SHALL BE SET 4" OFF THE PERP. ADJ. WALL ON THE HINGE SIDE OF THE DOOR UNLESS NOTED OTHERWISE. THE CONTRACTOR SHALL CONTACT THE ARCHITECT IF ANY CONFLICT OCCURS.
- 11. PROVIDE VINYL REDUCER AT ALL DISSIMILAR FLOOR MATERIALS UNLESS OTHERWISE NOTED.
- 12. UNLESS OTHERWISE NOTED, ALL ELECTRICAL AND MECHANICAL OPERABLE DEVICES SHALL BE MOUNTED WITH THE HIGHEST OPERABLE CONTROL AT 42" AFF.
- 13. ALL REQUIRED CLEARANCES, AS DESCRIBED IN THE TEXAS ACCESSIBILITY STANDARDS (TAS) OF THE ARCHITECTURAL BARRIERS ACT ARTICLE 9102, TEXAS CIVIL STATUTES (2012) FOR COUNTERTOPS, ALL PLUMBING FIXTURES INCLUDING DRINKING FOUNTAINS, LAVATORIES, URINALS, AND TOILETS WILL BE STRICTLY ENFORCED.



**ARCHITECTURE**  
 PBK ARCHITECTS  
 11 Greenway Plaza, 22nd Floor  
 Houston, TX 77046  
 713-965-9066 P  
 713-961-4571 F  
 TX Firm # F-3709  
 PBK.com

**MEP**  
 SHAH SMITH AND ASSOCIATES  
 2825 S. Wilshire Dr. #300  
 HOUSTON, TX 77042  
 (713) 790-7563



**HARRIS COUNTY PSYCHIATRIC  
 CENTER RENOVATION UNITS: 1C,  
 2E, 3B, 3C, 3D & 3E**

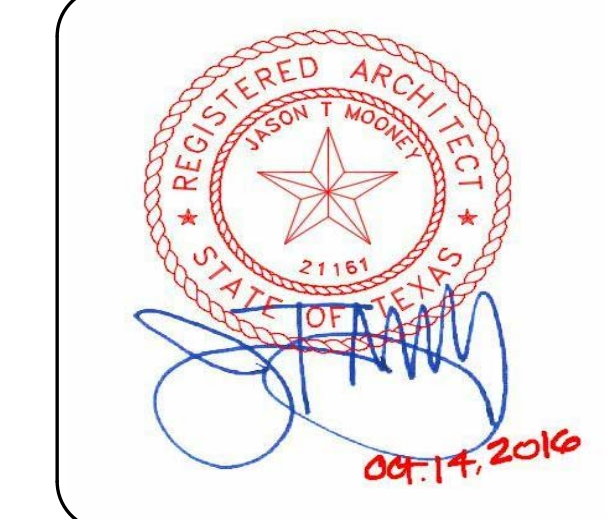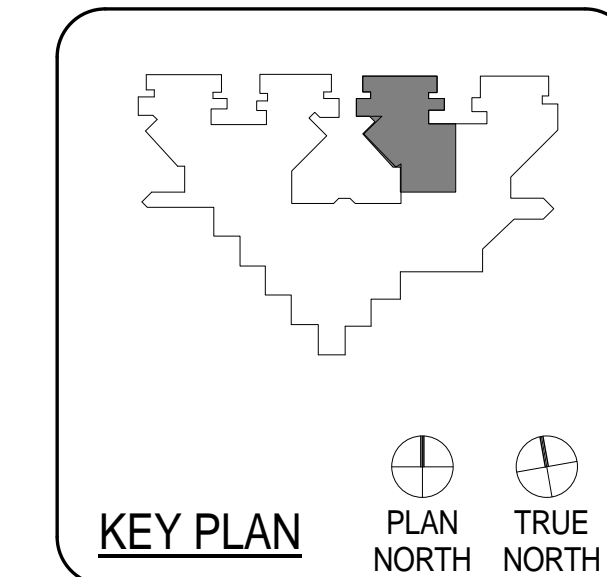

CLIENT		
UT HEALTH		
PROJECT NUMBER		
16106		
DATE:	OCTOBER 14, 2016	
DRAWN BY:	VICTORIA GARCIA	
CHECKED BY:	Checker	
REVISIONS		
No.	Description	Date

ISSUE FOR BID  
**THIRD FLOOR UNIT  
 3D**

**A2.14D**

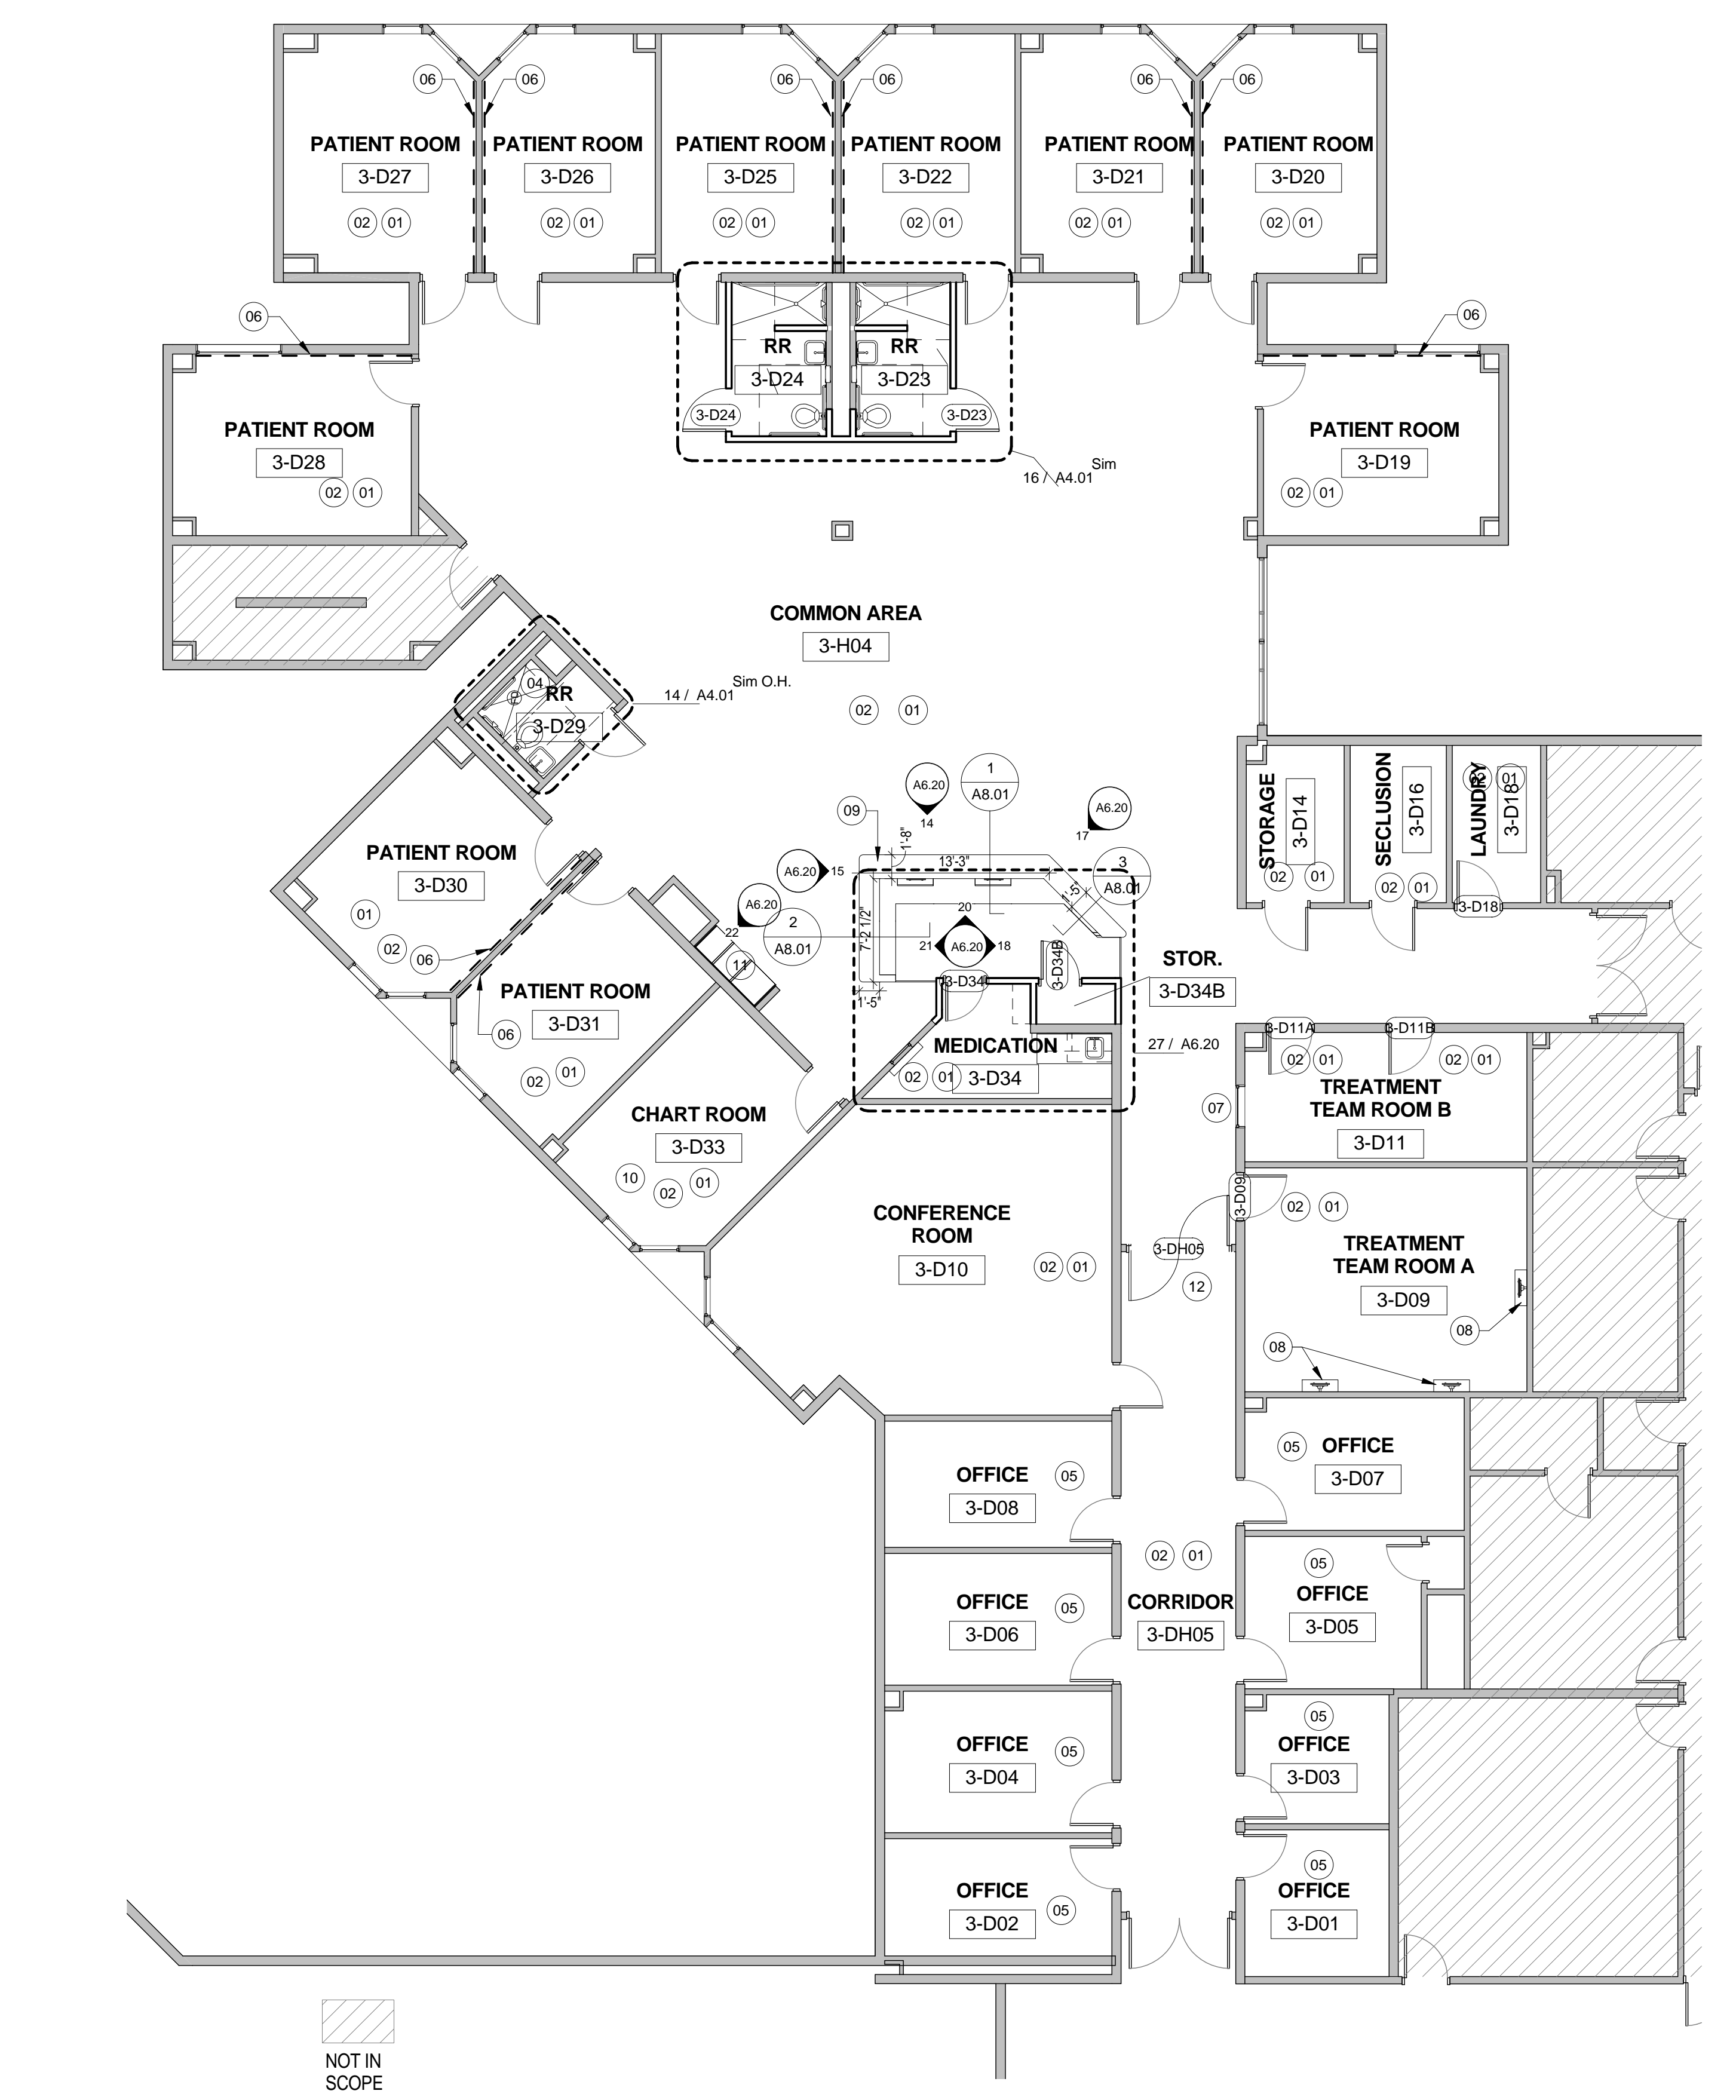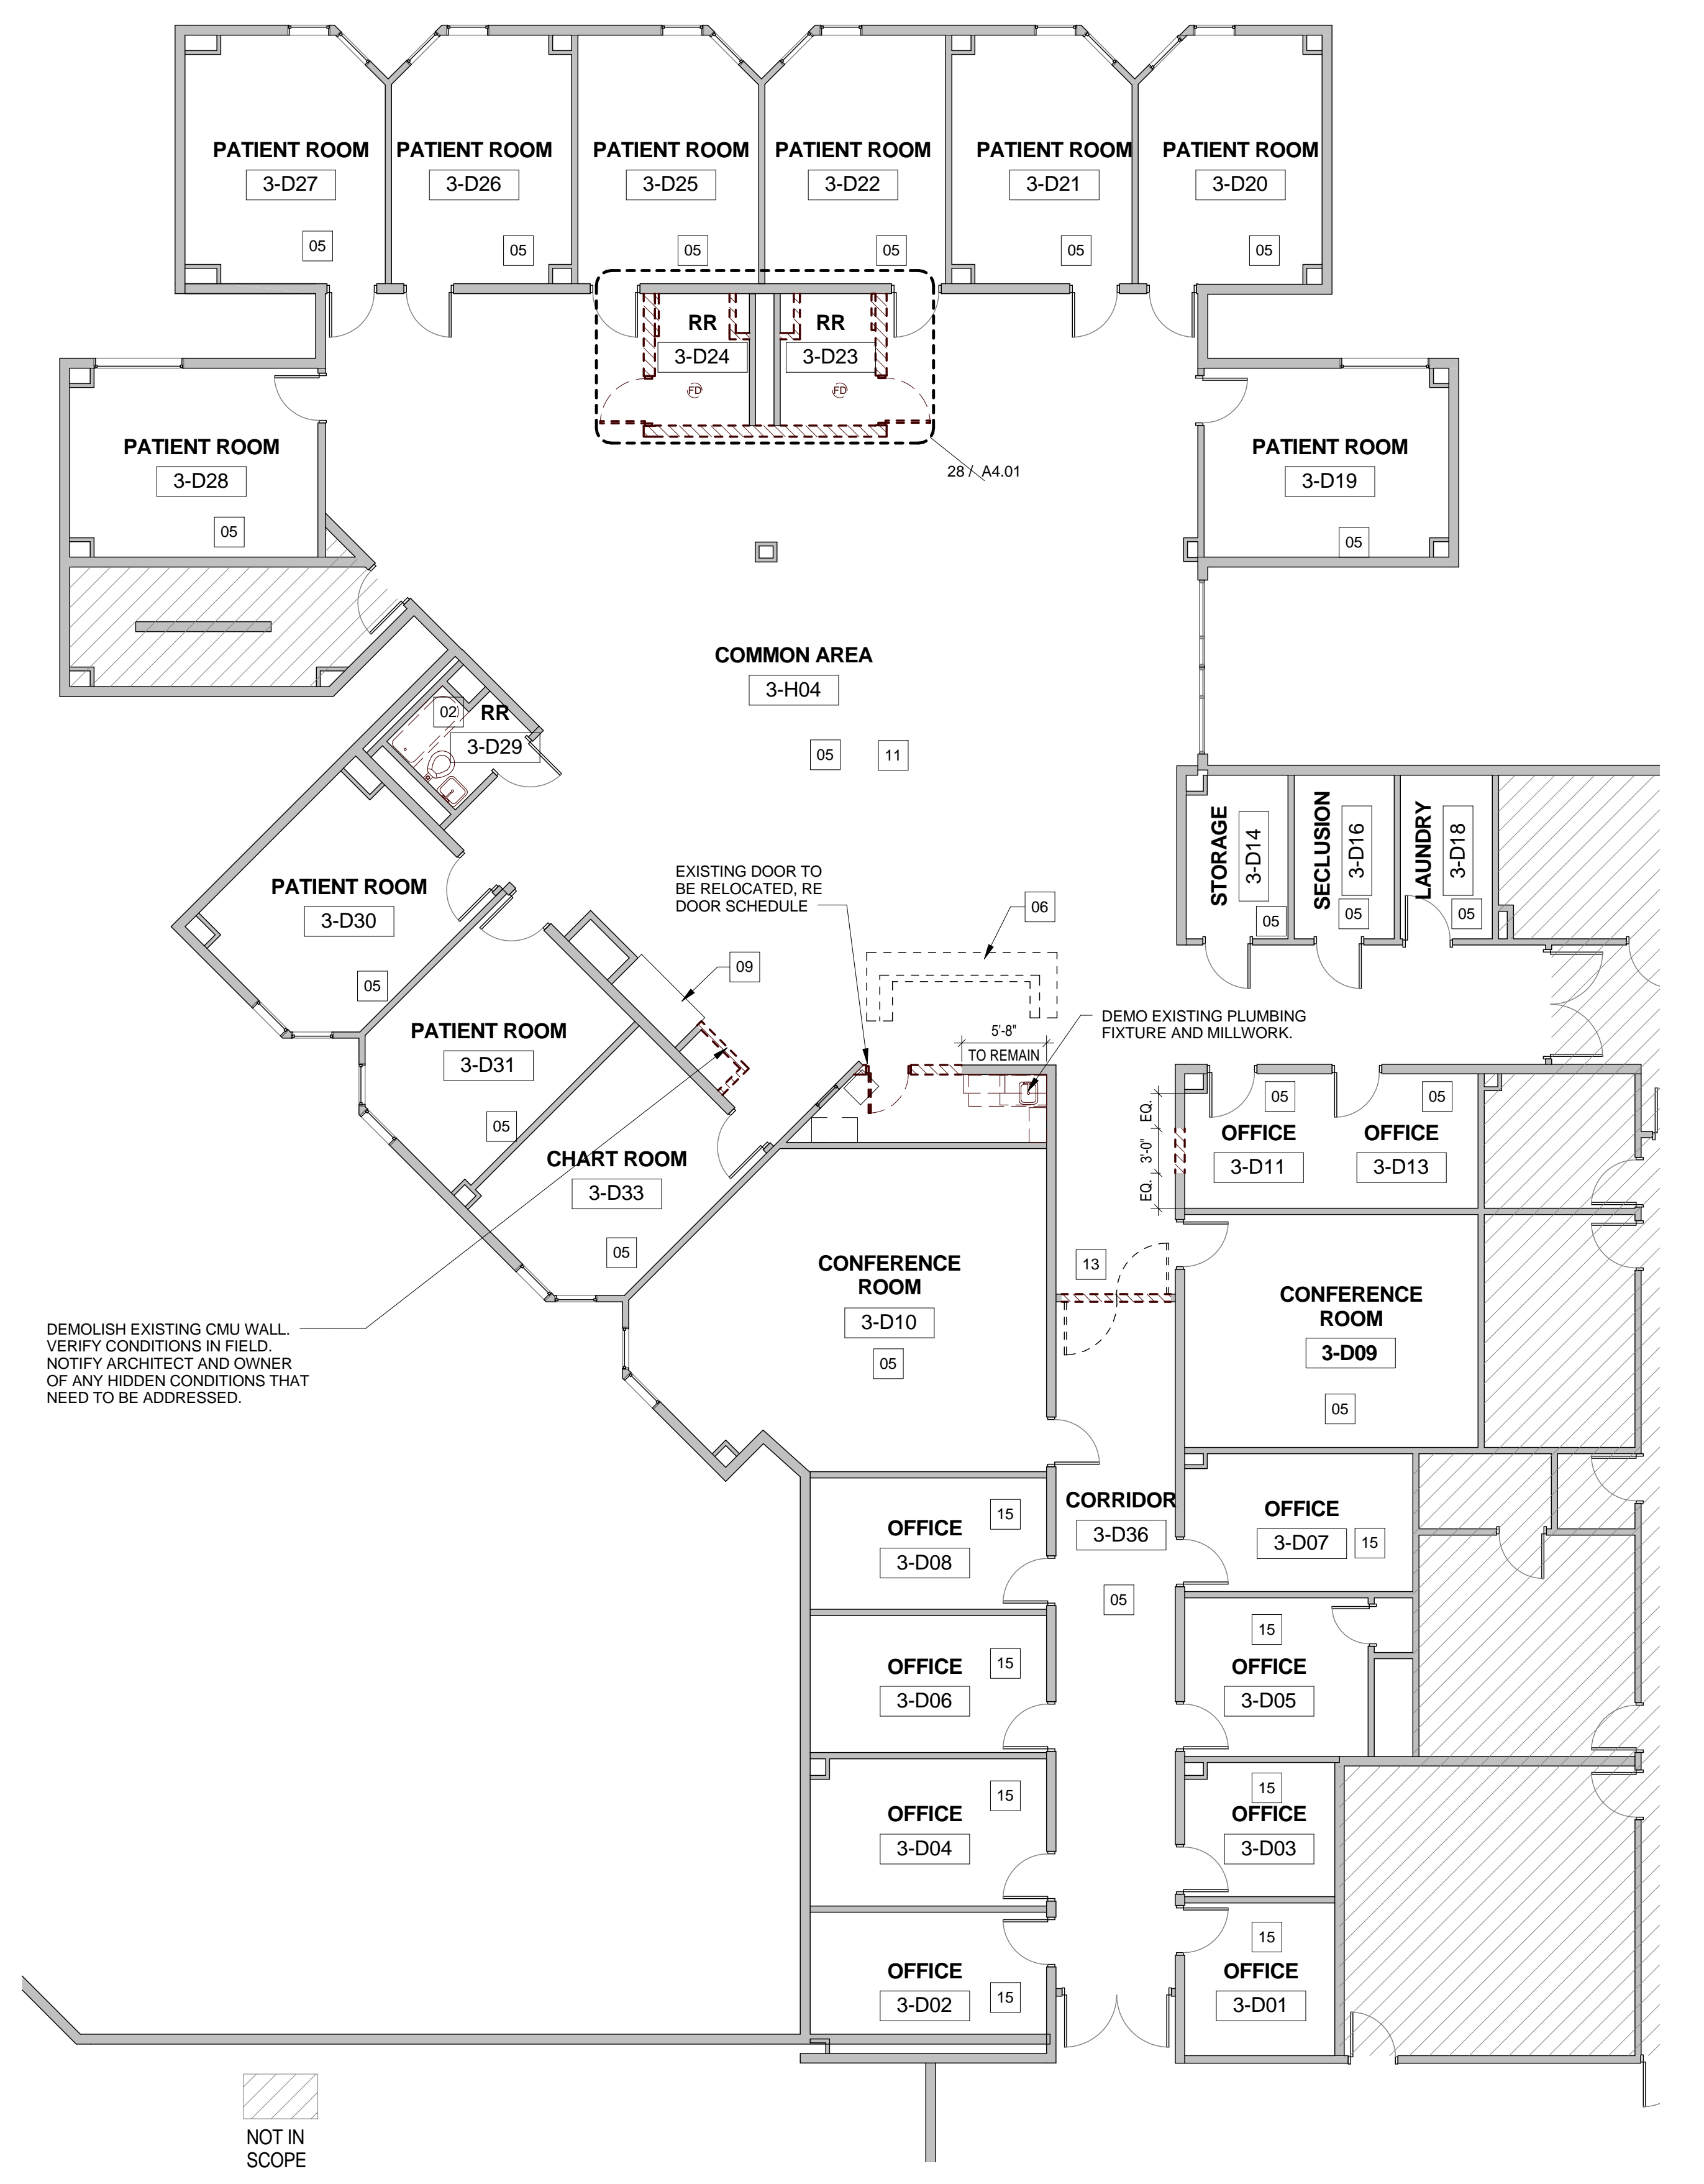

C:\Users\vgarcia\Documents\16106-HCPC\_A16\_Central\_Vgarcia.rvt  
 10/14/2016 3:08:40 PM

**6** DEMOLITION FLOOR PLAN - UNIT 3D  
 1/8" = 1'-0"

**3** RENOVATION PLAN - UNIT 3D  
 1/8" = 1'-0"



No.	Description	Date

ISSUE FOR BID


**THIRD FLOOR UNIT  
3D - SIGNAGE PLAN**

**A2.15D**

SIGN #	SIGN TYPE	LOCATION	DETAIL	MESSAGE	17	D	3-D28	RE: G4589-14 R1
1	C	3-D10	RE: G4589-14 R1	LINE 1: 3-D10 LINE 2: (ADA BRAILLE: 3-D10) LINE 3: N/A LINE 4: N/A LINE 5: CONFERENCE LINE 6: ROOM LINE 7: (ADA BRAILLE: CONFERENCE ROOM) LINE 8: N/A LINE 9: N/A LINE 10: N/A LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A	17	D	3-D28	RE: G4589-14 R1
2	C	3-D09	RE: G4589-14 R1	LINE 1: 3-D09 LINE 2: (ADA BRAILLE: 3-D09) LINE 3: N/A LINE 4: N/A LINE 5: TREATMENT TEAM LINE 6: ROOM A LINE 7: (ADA BRAILLE: TREATMENT TEAM ROOM A) LINE 8: N/A LINE 9: N/A LINE 10: N/A LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A	18	B	3-D29	RE: G4586-14 R1
3	A	3-D11	RE: G4586-14 R1	LINE 1: 3-D11 LINE 2: (ADA BRAILLE: 3-D11) LINE 3: N/A LINE 4: N/A LINE 5: TREATMENT TEAM LINE 6: ROOM B LINE 7: (ADA BRAILLE: 3-D11) LINE 8: N/A LINE 9: N/A LINE 10: N/A LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A	19	D	3-D30	RE: G4589-14 R1
NOT USED	A	3-D03	RE: G4586-14 R1	LINE 1: 3-D03 LINE 2: (ADA BRAILLE: 3-D03) LINE 3: N/A LINE 4: N/A LINE 5: TREATMENT TEAM LINE 6: ROOM B LINE 7: (ADA BRAILLE: 3-D03) LINE 8: N/A LINE 9: N/A LINE 10: N/A LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A	20	D	3-D31	RE: G4589-14 R1
5	C	3-D18	RE: G4589-14 R1	LINE 1: 3-D18 LINE 2: (ADA BRAILLE: 3-D18) LINE 3: N/A LINE 4: N/A LINE 5: LAUNDRY LINE 6: (ADA BRAILLE: LAUNDRY) LINE 7: N/A LINE 8: N/A LINE 9: N/A LINE 10: N/A LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A	21	C	3-D33	RE: G4589-14 R1
6	C	3-D16	RE: G4589-14 R1	LINE 1: 3-D16 LINE 2: (ADA BRAILLE: 3-D16) LINE 3: N/A LINE 4: N/A LINE 5: SECLUSION LINE 6: (ADA BRAILLE: SECLUSION) LINE 7: N/A LINE 8: N/A LINE 9: N/A LINE 10: N/A LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A	22	C	3-D34	RE: G4589-14 R1
7	C	3-D04	RE: G4589-14 R1	LINE 1: 3-D04 LINE 2: (ADA BRAILLE: 3-D04) LINE 3: N/A LINE 4: N/A LINE 5: STORAGE LINE 6: (ADA BRAILLE: STORAGE) LINE 7: N/A LINE 8: N/A LINE 9: N/A LINE 10: N/A LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A	23	C	3-D08	RE: G4589-14 R1
8	D	3-D19	RE: G4589-14 R1	LINE 1: 3-D19 LINE 2: (ADA BRAILLE: 3-D19) LINE 3: N/A LINE 4: N/A LINE 5: INSERT LINE 6: (ADA BRAILLE: 3-D19) LINE 7: N/A LINE 8: N/A LINE 9: N/A LINE 10: N/A LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A	24	C	3-D07	RE: G4589-14 R1
9	D	3-D20	RE: G4589-14 R1	LINE 1: 3-D20 LINE 2: (ADA BRAILLE: 3-D20) LINE 3: N/A LINE 4: N/A LINE 5: INSERT LINE 6: (ADA BRAILLE: 3-D20) LINE 7: N/A LINE 8: N/A LINE 9: N/A LINE 10: N/A LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A	25	C	3-D06	RE: G4589-14 R1
10	D	3-D01	RE: G4589-14 R1	LINE 1: 3-D01 LINE 2: (ADA BRAILLE: 3-D01) LINE 3: N/A LINE 4: N/A LINE 5: INSERT LINE 6: (ADA BRAILLE: 3-D01) LINE 7: N/A LINE 8: N/A LINE 9: N/A LINE 10: N/A LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A	26	C	3-D05	RE: G4589-14 R1
11	D	3-D22	RE: G4589-14 R1	LINE 1: 3-D22 LINE 2: (ADA BRAILLE: 3-D22) LINE 3: N/A LINE 4: N/A LINE 5: INSERT LINE 6: (ADA BRAILLE: 3-D22) LINE 7: N/A LINE 8: N/A LINE 9: N/A LINE 10: N/A LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A	27	C	3-D04	RE: G4589-14 R1
12	B	3-D23	RE: G4586-14 R1	LINE 1: 3-D23 LINE 2: (ADA BRAILLE: 3-D23) LINE 3: N/A LINE 4: N/A LINE 5: INSERT LINE 6: (ADA BRAILLE: 3-D23) LINE 7: N/A LINE 8: N/A LINE 9: N/A LINE 10: N/A LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A	28	C	3-D03	RE: G4589-14 R1
13	B	3-D24	RE: G4586-14 R1	LINE 1: 3-D24 LINE 2: (ADA BRAILLE: 3-D24) LINE 3: N/A LINE 4: N/A LINE 5: INSERT LINE 6: (ADA BRAILLE: 3-D24) LINE 7: N/A LINE 8: N/A LINE 9: N/A LINE 10: N/A LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A	29	C	3-D02	RE: G4589-14 R1
14	D	3-D25	RE: G4589-14 R1	LINE 1: 3-D25 LINE 2: (ADA BRAILLE: 3-D25) LINE 3: N/A LINE 4: N/A LINE 5: INSERT LINE 6: (ADA BRAILLE: 3-D25) LINE 7: N/A LINE 8: N/A LINE 9: N/A LINE 10: N/A LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A	30	C	3-D01	RE: G4589-14 R1
15	D	3-D26	RE: G4589-14 R1	LINE 1: 3-D26 LINE 2: (ADA BRAILLE: 3-D26) LINE 3: N/A LINE 4: N/A LINE 5: INSERT LINE 6: (ADA BRAILLE: 3-D26) LINE 7: N/A LINE 8: N/A LINE 9: N/A LINE 10: N/A LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A	31	C	3-D34B	RE: G4589-14 R1
16	D	3-D27	RE: G4589-14 R1	LINE 1: 3-D27 LINE 2: (ADA BRAILLE: 3-D27) LINE 3: N/A LINE 4: N/A LINE 5: INSERT LINE 6: (ADA BRAILLE: 3-D27) LINE 7: N/A LINE 8: N/A LINE 9: N/A LINE 10: N/A LINE 11: N/A LINE 12: N/A LINE 13: N/A LINE 14: N/A LINE 15: N/A LINE 16: N/A LINE 17: N/A LINE 18: N/A LINE 19: N/A LINE 20: N/A LINE 21: N/A LINE 22: N/A LINE 23: N/A LINE 24: N/A LINE 25: N/A LINE 26: N/A LINE 27: N/A LINE 28: N/A LINE 29: N/A LINE 30: N/A LINE 31: N/A	31	C	3-D34B	RE: G4589-14 R1

NOTE: REFER TO ELEVATION FOR MOUNTING HEIGHTS. SIGNS 5, 10 AND 15, 16 MUST BE MOUNTED ONE ABOVE THE OTHER WITHIN ACCEPTABLE ADA MOUNTING HEIGHTS.


V.I. WALL SPACES FOR SIGN WIDTH. NOTIFY ARCHITECTS OF SIGNS NEEDING TO BE SHORTENED TO FIT AT DESIGNATED LOCATION.

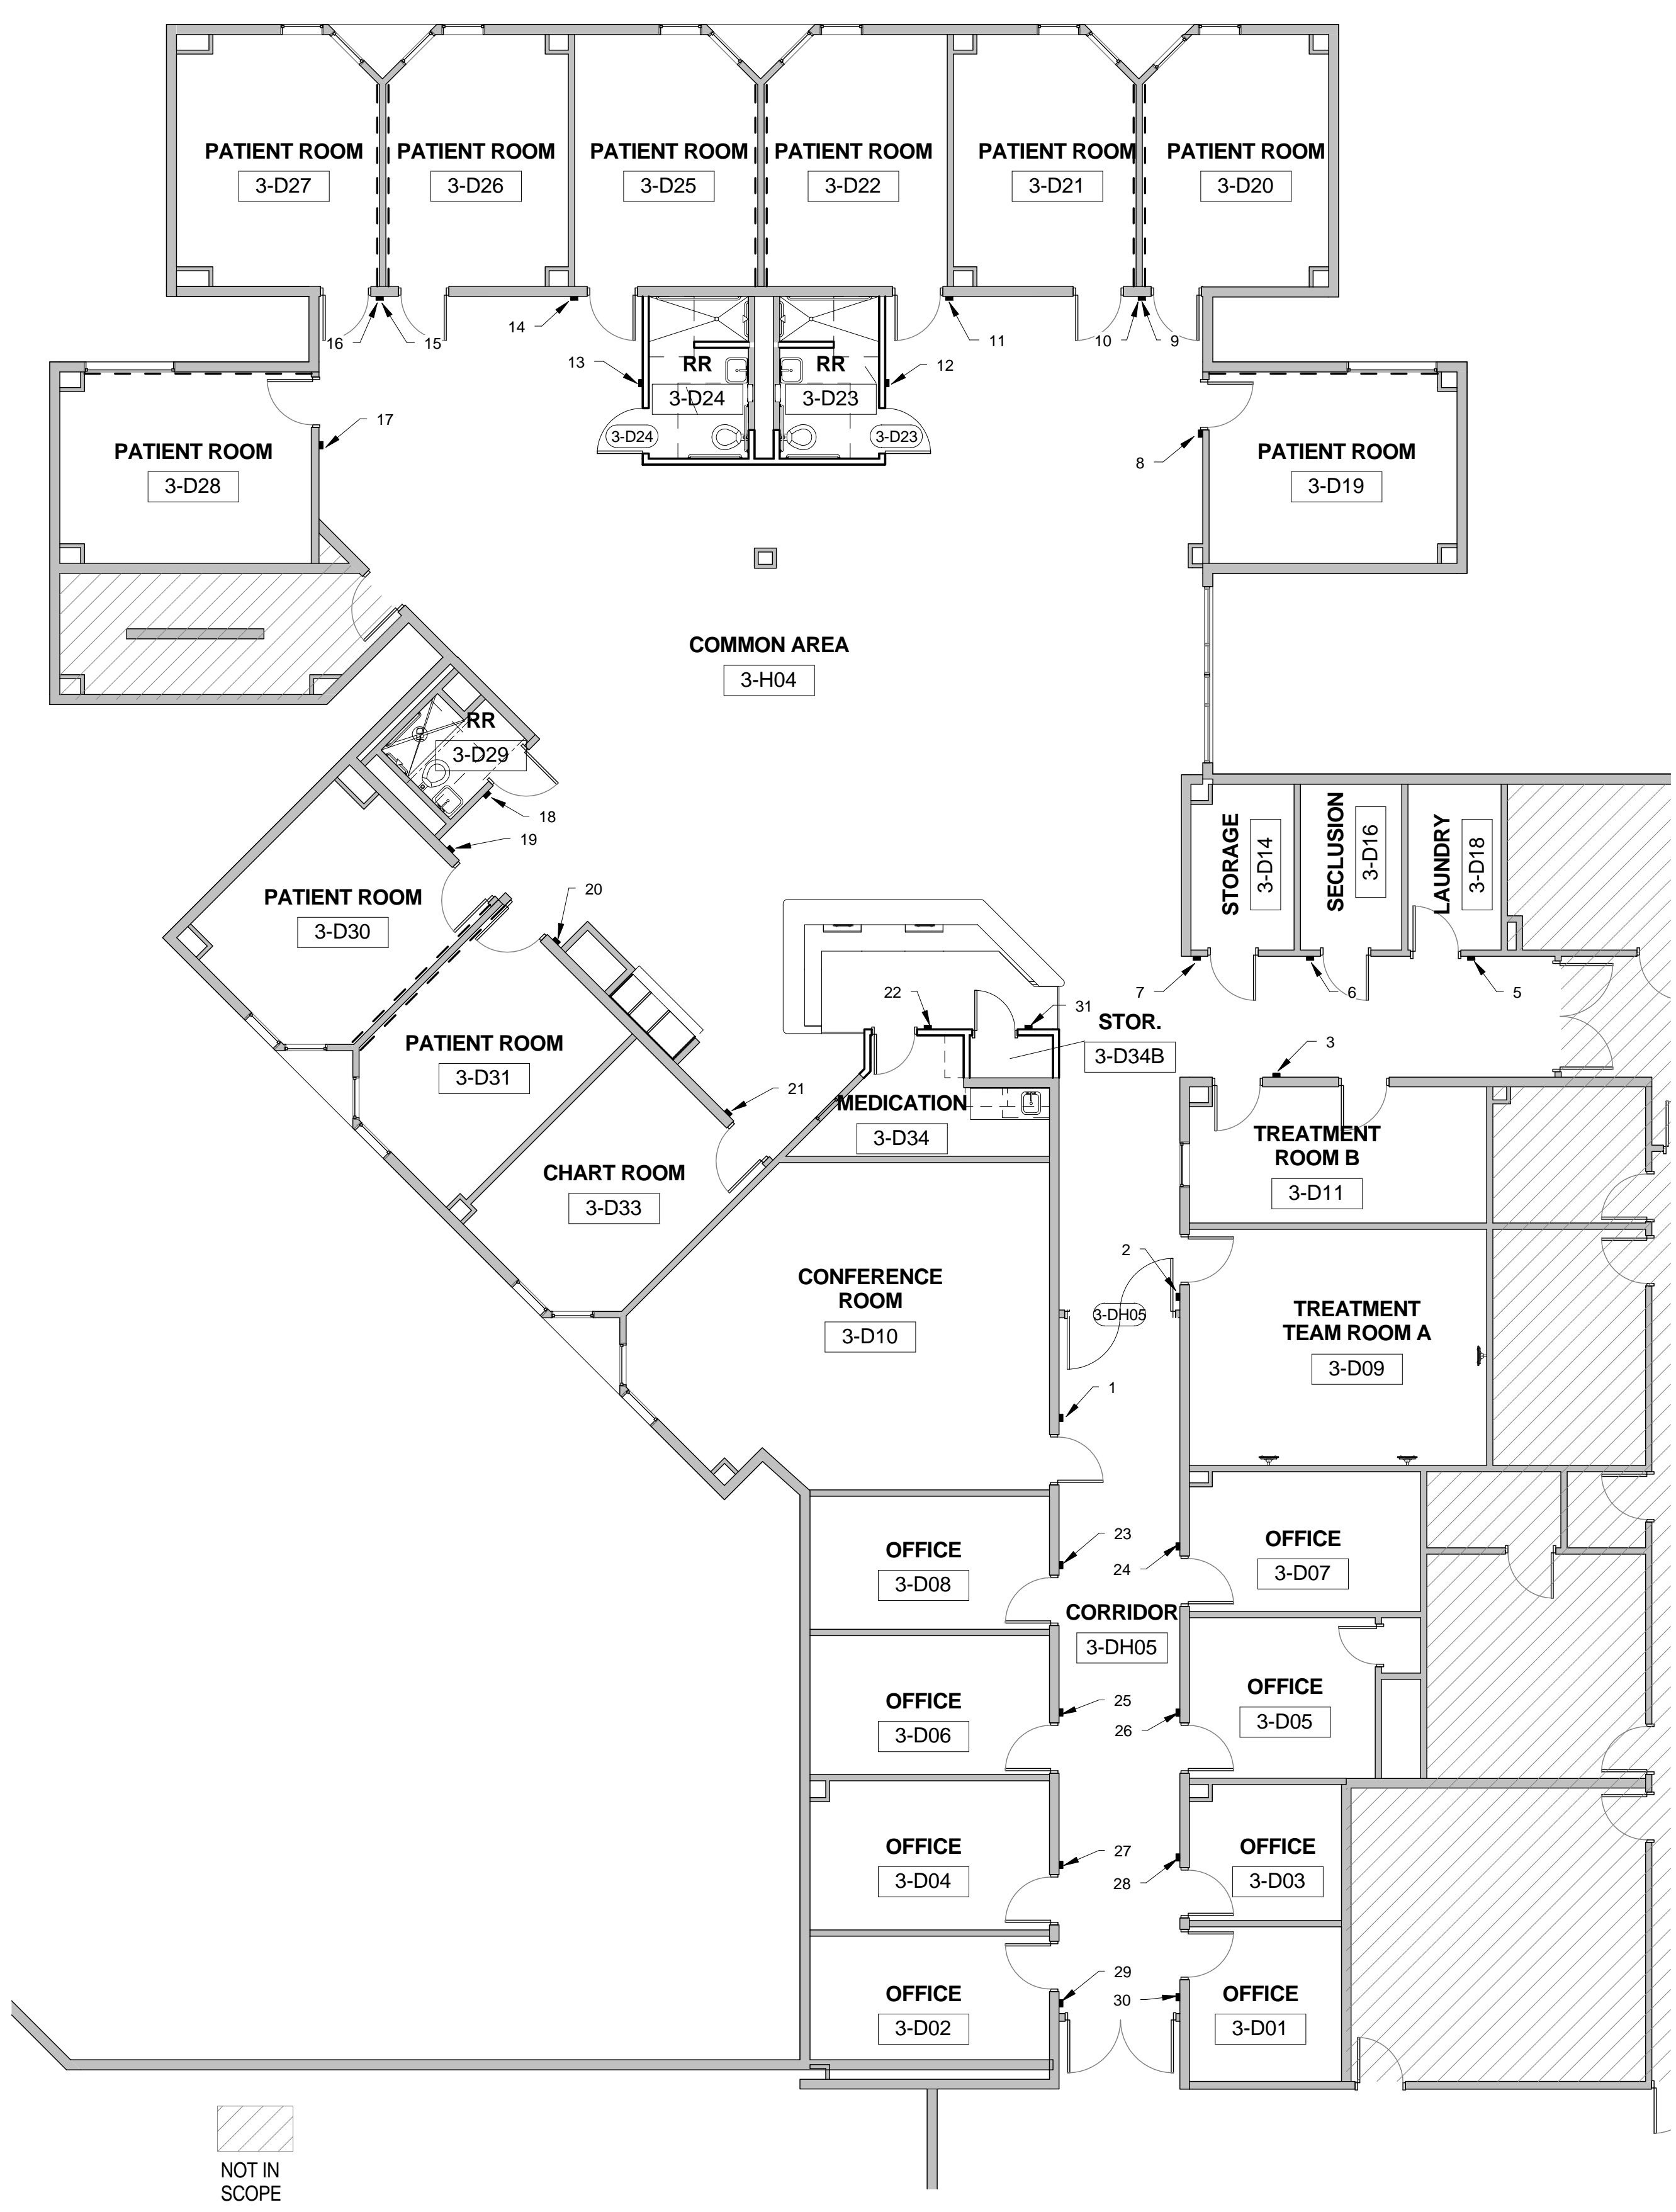

NOT IN SCOPE

C:\Users\lgarcia\Documents\16106-HCPC-A16-Central\_Lygarcia.rvt  
10/14/2016 3:08:54 PM



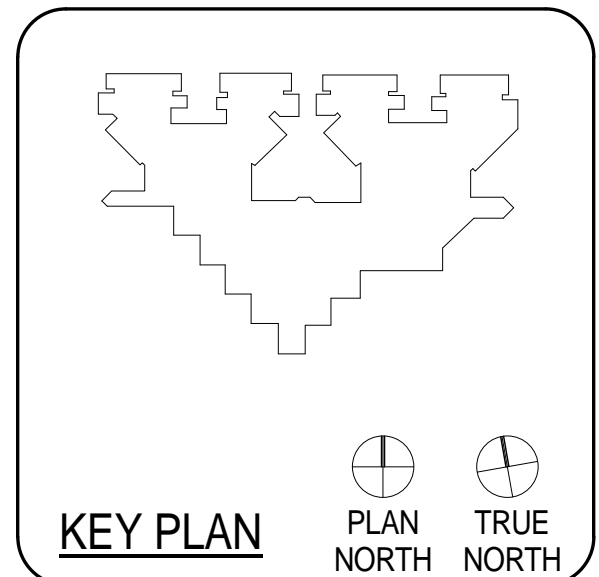

CLIENT	UT HEALTH
PROJECT NUMBER	16106
DATE:	OCTOBER 14, 2016
DRAWN BY:	VG/BG
CHECKED BY:	JM/CS

No.	Description	Date


ISSUE FOR BID

**SCHEDULES - THIRD FLOOR UNIT 3E**


**A2.16E**

MARK	ELEV.	PAIR/SING LE	DOOR			MATL.	ELEV.	FRAME			DETAILS			H.W.	FIRE RATING	Comments
			SIZE W x H		MATL.			SIZE W x H		SILL	JAMB	HEAD				
			W	H				W	H							
3-E49	B	S	3' - 4"	7' - 4"	SC WD	1	7' - 0"	3' - 0"	HM		EXISTING	EXISTING	EXISTING	N/A	ADD GLASS LITE TO EXISTING DOOR	
3-E56	B	S	3' - 4"	7' - 4"	SC WD	1	7' - 0"	3' - 0"	HM		EXISTING	EXISTING	EXISTING	N/A	ADD GLASS LITE TO EXISTING DOOR	
3-E71	A	S	3' - 4"	7' - 4"	SC WD	1	7' - 0"	3' - 0"	HM		2/A2.16E	3/A2.16E	SEE BELOW	N/A		
3-E72	A	S	3' - 4"	7' - 4"	SC WD	1	7' - 0"	3' - 0"	HM		2/A2.16E	3/A2.16E	SEE BELOW	N/A		
3-E73	A	S	3' - 4"	7' - 4"	SC WD	1	7' - 0"	3' - 0"	HM		2/A2.16E	3/A2.16E	SEE BELOW	N/A		
3-E74	A	S	3' - 4"	7' - 4"	SC WD	1	7' - 0"	3' - 0"	HM		2/A2.16E	3/A2.16E	SEE BELOW	N/A		
3-E83	B	S	3' - 4"	7' - 4"	SC WD	1	7' - 0"	3' - 0"	HM		EXISTING	EXISTING	EXISTING	N/A	ADD GLASS LITE TO EXISTING DOOR	
3-EH02	C	P	7' - 4"	7' - 4"	EXISTING	2	7' - 0"	7' - 0"	HM		2/A2.16E	3/A2.16E	EXISTING	N/A	SALVAGE EXISTING HARDWARE AND REINSTALL; RE-USE EXISTING GLASS LITE; EXISTING FRAME W/ NEW PAINT FINISH, RE: ALTERNATE NO. 3E-05	


- DOOR HARDWARE IS TO "MATCH EXISTING", BUT SHOULD CONSIST OF THE FOLLOWING COMPONENTS:
- A. (1) EA. SELECT HINGES SL57 FULL-SURFACE GEARED CONTINUOUS HINGES
  - B. (1) EA. "PUSH/PULL SET TO MATCH EXISTING; INSTALL PUSH PLATE ON INTERIOR (RESTROOM SIDE) OF DOOR, PULL ON EXTERIOR (COMMON AREA SIDE) OF DOOR, AND PROVIDE (1) LOCKSET FOR STAFF USE ON EXTERIOR (COMMON AREA SIDE) OF DOOR TO MATCH EXISTING
  - C. (1) EA. IVES WIS407CCV (WALL BUMPER)/FS436 (FLOOR DOME) DOOR STOP
  - D. (3) EA. IVES SR64 DOOR SILENCERS
  - E. NO CLOSERS

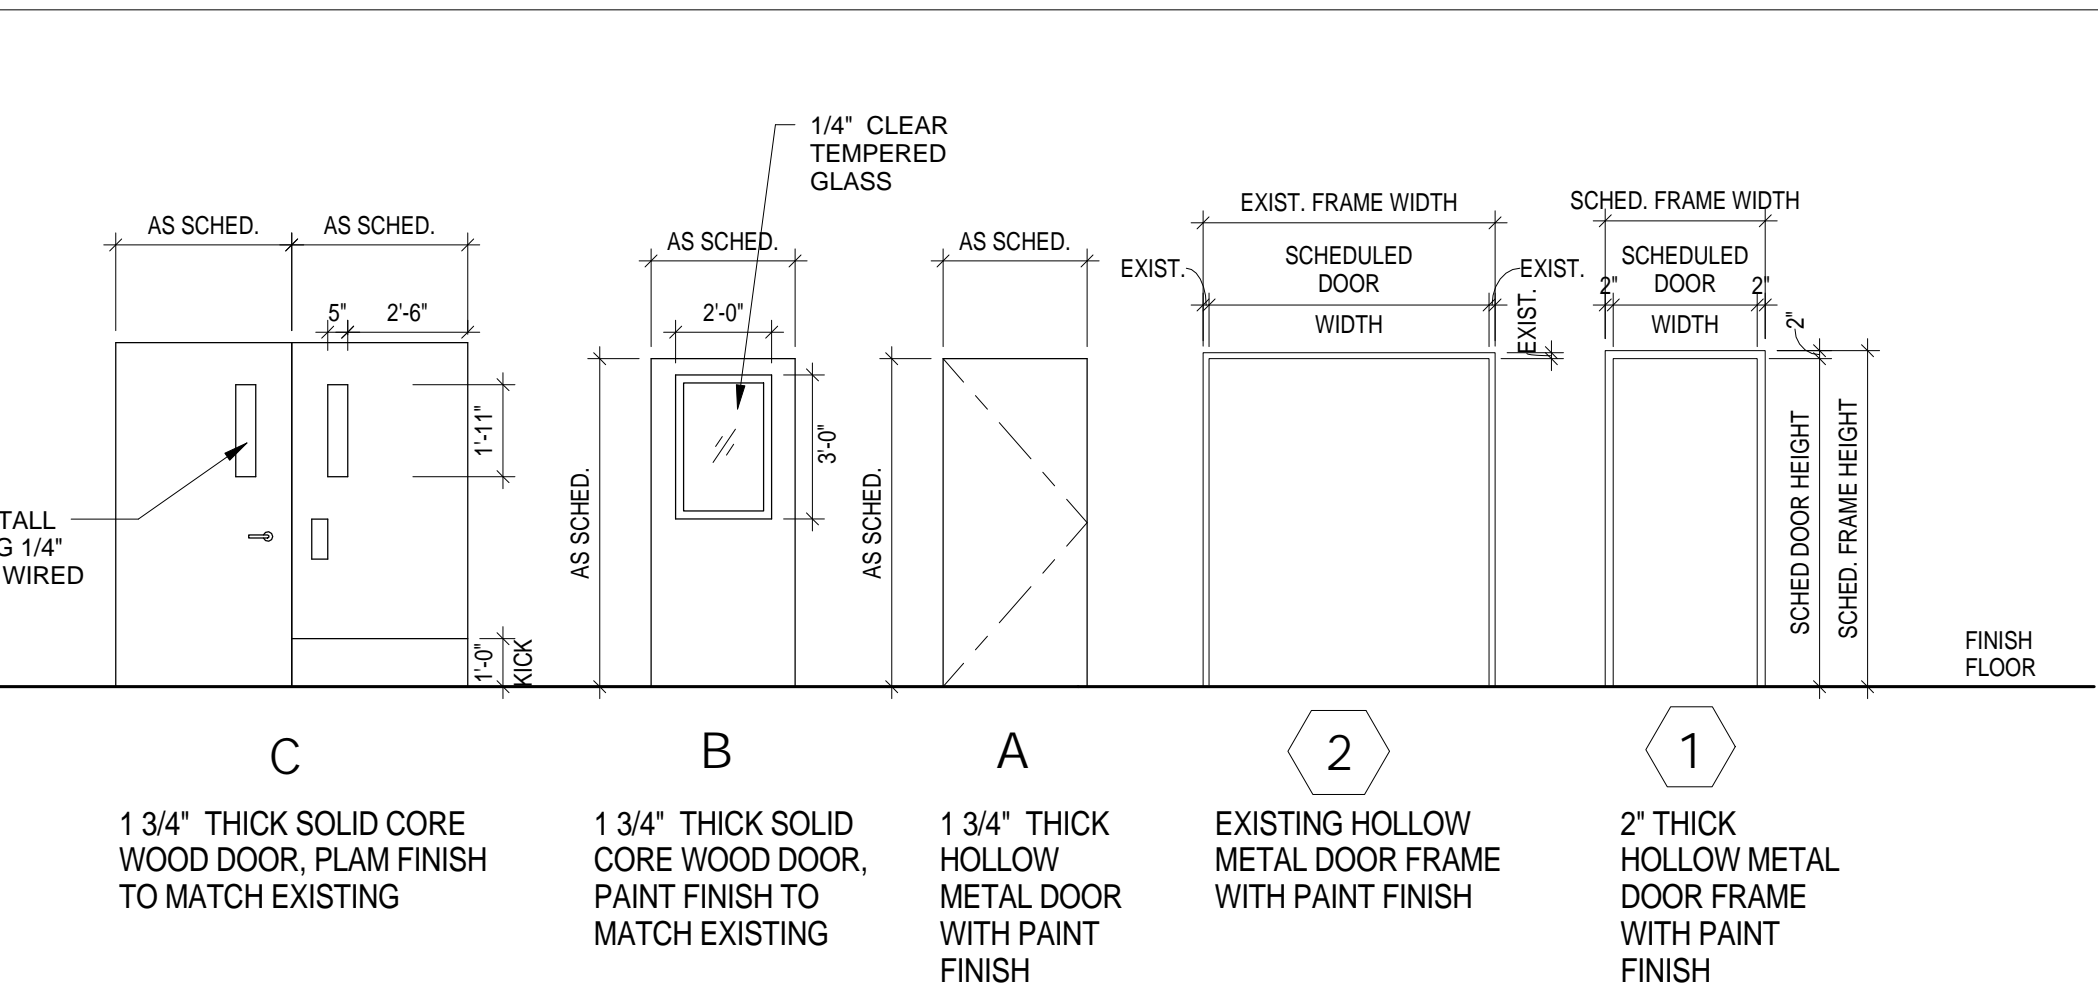

**1 DOOR TYPE & FRAME 3E**  
1/4" = 1'-0"

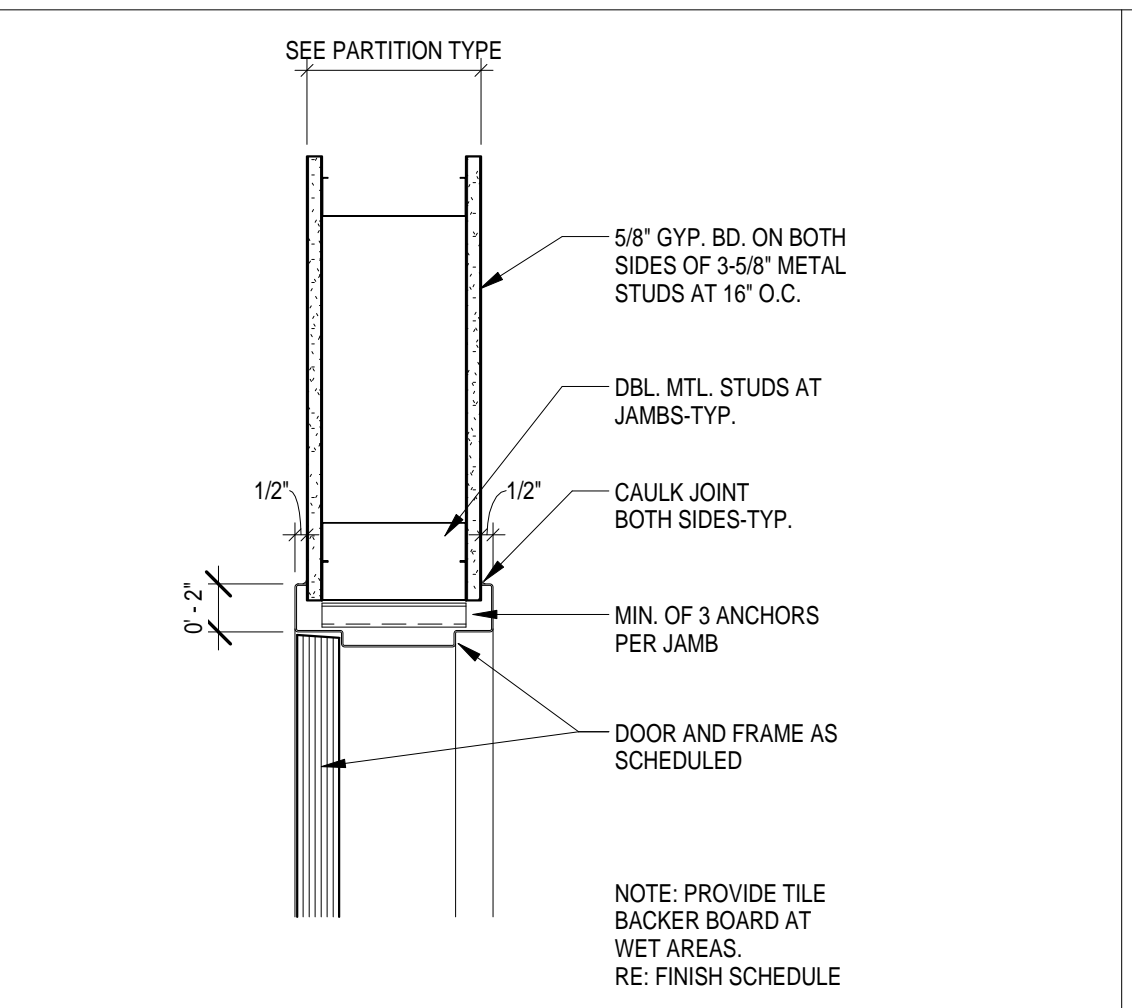

**2 INT-STUD-DOOR-HM-JAMB-DTL**  
1 1/2" = 1'-0"

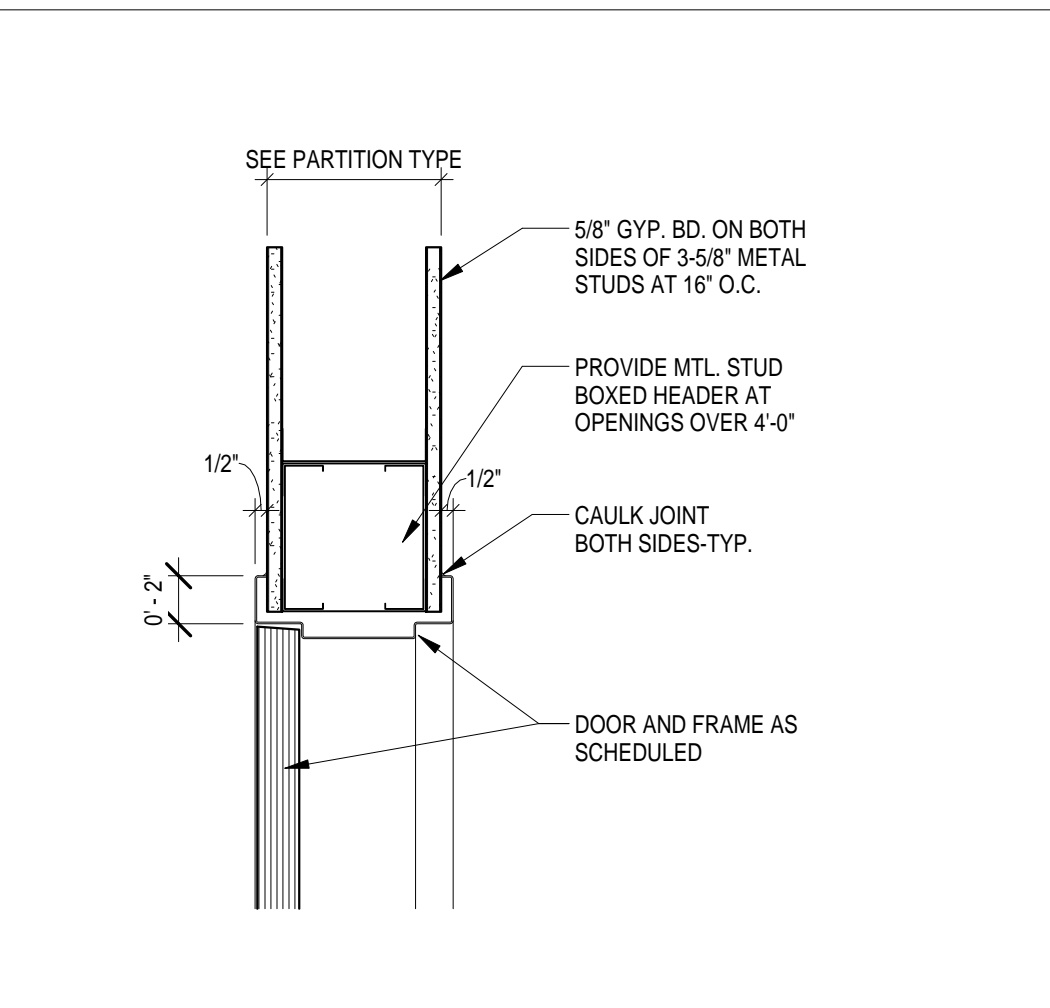

**3 INT-STUD-DOOR-HM-HEAD-DTL**  
1 1/2" = 1'-0"



**DEMOLITION - KEYED NOTES**

- NOTE: REFER TO ENLARGED PLANS FOR ADDITIONAL KEYED NOTE LOCATIONS IF NOT VISIBLE ON THIS SHEET.
- 01 TYPICAL: REMOVE EXISTING MILLWORK AND/OR TRASH UNIT AND STORE FOR REINSTALLATION. COORDINATE EXACT REQUIREMENTS IN FIELD.
  - 02 REMOVE ALL EXISTING FLOORING, WALL FINISHES, FIXTURES AND ACCESSORIES; REFER TO MEP DRAWINGS FOR ADDITIONAL INFO PERTAINING TO FIXTURES; PREP EXISTING SUBSTRATES TO REMAIN FOR RECEIPT OF NEW FINISHES
  - 03 REMOVE EXISTING DOOR AND FRAME, SALVAGE DOORS AND RETURN TO BUILDING STOCK, RE: RENOVATION PLAN
  - 04 TYPICAL: REMOVE ALL WALL-MOUNTED ACCESSORIES (IE, BULLETIN BOARDS, SIGNAGE, ETC.) AND STORE FOR REINSTALLATION. COORDINATE EXACT REQUIREMENTS IN FIELD
  - 05 REMOVE EXISTING VINYL OR TILE FLOORING AND WALL BASE; PREP EXISTING SUBSTRATE FOR RECEIPT OF NEW FINISHES; RE: FINISH PLANS. COORDINATE TEMPORARY REMOVAL OF ANY FURNITURE AND EQUIPMENT WITH OWNER
  - 06 DEMOLISH EXISTING NURSE STATION
  - 07 DEMOLISH EXISTING WALLS WHERE INDICATED DASHED, COORDINATE EXACT REQUIREMENTS IN FIELD
  - 08 EXISTING CHASE WALL TO REMAIN; REMOVE FINISHES ONLY
  - 09 REMOVE EXISTING NOURISHMENT STATION/DOORS; NOURISHMENT STATION TO REMAIN; PROTECT IN PLACE
  - 10 EXISTING TELEPHONE BANK/MILLWORK TO REMAIN; PROTECT IN PLACE
  - 11 COORDINATE WITH OWNER TEMPORARY REMOVAL OF EXISTING SIGNAGE, WALL-MOUNTED ACCESSORIES AND WALL-MOUNTED DEVICES TO PREPARE FOR APPLICATION OF NEW WALL FINISHES, TYPICAL THROUGHOUT
  - 12 REMOVE EXISTING FLOORING ONLY
  - 13 ALTERNATE NO. 3E-05; RE: SPECS
  - 14 EXISTING FLOORING AND WALL BASE TO REMAIN
  - 15 REMOVE EXISTING FLOORING AND WALL BASE; PREP EXISTING SUBSTRATE FOR RECEIPT OF NEW FINISHES; RE: FINISH PLANS. COORDINATE TEMPORARY REMOVAL OF ANY FURNITURE AND EQUIPMENT WITH OWNER
  - 16 ALTERNATE NO. 3E-01; RE: SPECS

**RENOVATION - KEYED NOTES**

- NOTE: REFER TO ENLARGED PLANS FOR ADDITIONAL KEYED NOTE LOCATIONS IF NOT VISIBLE ON THIS SHEET.
- 01 INSTALL SCHEDULED FLOORING & BASE; RE: FINISH PLAN
  - 02 APPLY SCHEDULED WALL FINISH THROUGHOUT; RE: FINISH PLAN
  - 03 REINSTALL EXISTING MILLWORK, WALL-MOUNTED DEVICES, AND EQUIPMENT AS NEEDED; COORDINATE WITH OWNER IN FIELD
  - 04 INSTALL NEW CEILING, WALL FINISHES, PLUMBING FIXTURES AND FLOORING FINISHES
  - 05 RE-PANT ALL EXISTING WALLS WITHIN THIS AREA WITH PT-1; EXISTING FLOORING IS ALSO TO BE REMOVED AS PART OF BASE SCOPE OF WORK - FLOORING REPLACEMENT AND WALL PAINTING SHALL BOTH OCCUR OVER THE COURSE OF ONE WEEKEND (FRIDAY THROUGH SUNDAY); COORDINATE REMOVAL AND REINSTALLATION OF ANY FURNITURE, FIXTURES, AND EQUIPMENT ITEMS IN FIELD WITH OWNER
  - 06 IN LIEU OF TYPICAL WALL PAINT, APPLY CHALKBOARD PAINT TO EXISTING WALL OPPOSITE FROM PATIENT BEDS IN THE ROOM (CONFIRM IN FIELD); CHALKBOARD PAINT IS TO EXTEND FROM EXISTING DESK HEIGHT TO ALIGN WITH THE TOP OF THE EXISTING DOOR FRAME AND FOR THE FULL LENGTH OF THE WALL
  - 07 ALTERNATE NO. 3E-01; RE: SPECS
  - 08 ALTERNATE NO. 3E-02; RE: SPECS
  - 09 REMOVE THE EXISTING NURSE STATION AND REPLACE WITH A NEW NURSE STATION TO MATCH THE CONFIGURATION AND FINISHES AS BUILT IN UNITS 1D AND 2B WITH EXCEPTIONS AS NOTED AND DEPICTED IN DETAILS WITHIN; MODIFY EXISTING CORING WITHIN THE FLOOR SLAB AS NEEDED TO ACCOMMODATE THE NEW NURSE STATION CONFIGURATION; EXISTING CEILING IS TO REMAIN IN THIS AREA, NO FURR-DOWNS ARE TO BE INSTALLED ABOVE THE NEW NURSE STATION
  - 10 ALTERNATE NO. 3E-03; RE: SPECS
  - 11 RE: INTERIOR ELEVATIONS FOR EXISTING NOURISHMENT STATION MODIFICATIONS
  - 12 ALTERNATE NO. 3E-05; RE: SPECS

**GENERAL DEMOLITION NOTES:**

1. THE DEMOLITION PLAN OUTLINES SOME OF THE SCOPE OF THE WORK INVOLVED FOR THE DEMOLITION PHASE OF THIS PROJECT. CONTRACTOR SHALL REVIEW ALL SHEETS FOR ADDITIONAL DEMO SCOPE.
2. CONTRACTOR SHALL VERIFY EXISTING SITE AND BUILDING CONDITIONS AND DIMENSIONS IN THE FIELD PRIOR TO COMMENCING DEMOLITION ACTIVITIES. CONTRACTOR SHALL NOT SCALE DRAWINGS.
3. CONTRACTOR WILL NOTIFY ARCHITECT OF ANY DISCREPANCIES IN WRITING.
4. AFTER AWARD OF THE CONTRACT, CHANGE ORDER REQUESTS FOR ADDITIONAL MONEY WILL NOT BE APPROVED IF THE WORK COULD HAVE BEEN ANTICIPATED DURING A SITE VISIT BY THE CONTRACTOR.
5. CONTRACTOR WILL BE REQUIRED TO REPAIR, REPLACE OR PATCH EXISTING BUILDINGS, DRIVEWAYS, SIDEWALKS, CANOPIES, AND/OR PARKING AREAS DISTURBED BY DEMOLITION.
6. ALL FURNITURE WILL BE REMOVED OR RELOCATED BY THE OWNER AS NECESSARY PRIOR TO THE DEMOLITION WORK OF THIS PROJECT. CONTRACTOR SHALL COORDINATE WITH OWNER AS REQUIRED.
7. REMOVE EXISTING CONSTRUCTION TO THE EXTENT INDICATED ON THE DRAWINGS. SHOULD ANY DAMAGE OCCUR TO ANY EXISTING CONSTRUCTION TO REMAIN, THE CONTRACTOR SHALL REPAIR THE DAMAGE TO MATCH EXISTING ADJACENT CONSTRUCTION.
8. CONTRACTOR IS TO VERIFY THE EXACT LOCATION OF ALL EXISTING UTILITIES PRIOR TO DEMOLITION ACTIVITIES.
9. CONTRACTOR SHALL REMOVE DEBRIS REGULARLY AS NECESSARY TO ELIMINATE INTERFERENCE WITH ROADS, STREET, WALKS, AND ALL OTHER ADJACENT FACILITIES.
10. CONTRACTOR IS RESPONSIBLE FOR CONSTRUCTION OF TEMPORARY DUST AND/OR SOUND PARTITIONS BETWEEN CONSTRUCTION AREA AND AREAS NOT IN SCOPE AS NECESSARY. DEMOLITION ACTIVITIES SHALL BE PERFORMED SO AS TO PRODUCE MINIMAL DISTURBANCE TO EXISTING FACILITY AND OCCUPANTS (IE, MINIMIZE EXCESSIVE AND PROLONGED NOISE LEVELS AND DUST).
11. NOTIFY THE BUILDING OWNER OF ANY MATERIALS, FIXTURES, ETC. TO BE REMOVED THAT ARE DEEMED SALVAGEABLE. TURN OVER ANY REQUESTED ITEMS TO THE BUILDING OWNER IN GOOD CONDITION.
12. THE CONTRACTOR SHALL REMOVE ALL TRASH AND DEBRIS FROM THE SITE ON A DAILY BASIS.
13. MAINTAIN THE INTEGRITY OF ALL EXISTING RATED WALLS, FIRE SEAL ANY PENETRATIONS WITH U.L. APPROVED ASSEMBLY.
14. WHEN UNANTICIPATED MECHANICAL, ELECTRICAL, OR STRUCTURAL ELEMENTS THAT CONFLICT WITH THE INTENDED FUNCTION OR DESIGN ARE ENCOUNTERED, DETERMINE THE NATURE AND EXTENT OF THE CONFLICT AND NOTIFY THE ARCHITECT IMMEDIATELY FOR RESOLUTION.
15. CONTRACTOR SHALL PROVIDE TRAFFIC HANDLING MEASURES AS NECESSARY TO PROTECT THE GENERAL PUBLIC AT ALL TIMES, AND AS REQUIRED BY GOVERNING AUTHORITIES.
16. DO NOT INTERRUPT EXISTING UTILITIES, EXCEPT WHEN AUTHORIZED IN WRITING BY AUTHORITIES HAVING JURISDICTION. PROVIDE TEMPORARY SERVICES DURING INTERRUPTIONS TO EXISTING UTILITIES, AS ACCEPTABLE TO GOVERNING AUTHORITIES.
17. WHEN UTILITY SERVICES ARE REQUIRED TO BE REMOVED, RELOCATED, OR ABANDONED, PROVIDE BYPASS CONNECTIONS TO MAINTAIN CONTINUITY OF SERVICE BEFORE PROCEEDING WITH DEMOLITION.
18. PRIOR TO COMMENCEMENT WITH ANY DEMOLITION WORK, CONTRACTOR SHALL IDENTIFY ALL ELECTRICAL CIRCUITS SERVING THE AREA INVOLVED WITH THIS DEMOLITION. THOSE CIRCUITS SHALL THEN BE LOCKED OUT AND TAGGED OUT IF THEY DO NOT SERVICE ANY OF THE REMAINING BUILDING. THOSE CIRCUITS WHICH ARE IDENTIFIED TO SERVICE BOTH THE AREA TO BE DEMOLISHED AND THE REMAINING BUILDING SHALL BE SPLIT SO AS TO KILL ALL ELECTRICAL POWER TO THE AREA TO BE DEMOLISHED WHILE MAINTAINING POWER TO THE REMAINDER OF THE BUILDING.
19. CONTRACTOR TO RE-LOCATE UTILITIES & EQUIPMENT AS REQUIRED TO ACCOMMODATE NEW PLUMBING REQUIREMENTS FOR NEW RENOVATION WORK.
20. REFER TO DEMOLITION PLUMBING PLANS FOR EXTENT OF CONCRETE SLAB TO BE REMOVED AND REPLACED FOR UNDER FLOOR PIPING INSTALLATION.
21. EXISTING WALLS OR PORTIONS OF WALLS TO BE REMOVED SHALL BE CUT FLUSH WHERE INTERSECTING WITH WALLS TO REMAIN. REMAINING WALLS TO BE PATCHED AND FINISHED SMOOTH.
22. NEW OPENING TO BE CUT IN EXISTING WALLS SHALL BE SAW-CUT AT LOCATIONS INDICATED TO THE HEIGHT AND WIDTH INDICATED. NEW LINTELS SHALL BE INSTALLED TO SUPPORT EXISTING WALL CONSTRUCTION ABOVE AS INDICATED ON THE DRAWINGS, OR IF NOT INDICATED, AS REQUIRED FOR NEW WALL CONSTRUCTION PER STRUCTURAL DRAWINGS, IF PROVIDED.
23. WHERE EXISTING INTERIOR WALLS ARE REPLACED OR REMOVED, REMOVE MEP SYSTEMS BACK TO PANEL OR MECHANICAL ROOM OR FARTHEST POSSIBLE POINT WITHOUT DISTURBING EXISTING CONSTRUCTION. REMOVE EXISTING MECHANICAL EQUIPMENT. RELOCATE POWER PER MEP DRAWINGS.
24. REFER TO MEP DRAWINGS FOR DEMOLITION OF MEPT SYSTEMS. IDENTIFY WORK REQUIRED BY THIS CONTRACTOR WHICH MAY AFFECT DEMOLITION AND/OR REPAIRS OF ARCHITECTURAL ELEMENTS. COORDINATE WITH RELATED SUBS THE EXTENT OF ALL DEMOLITION WORK.
25. PATCH FLOORS, WALLS/CEILINGS WHICH REMAIN AT LOCATIONS WHERE PIPES, CONDUITS, ETC. ARE REMOVED AS REQUIRED TO MATCH EXISTING CONDITIONS OR TO RECEIVE NEW FINISHES.
26. WHERE EXISTING FINISH FLOOR IS REMOVED, PREPARE SURFACE TO RECEIVE NEW FLOORING.
27. NOTIFY ARCHITECT & OWNER OF ANY POSSIBLE ASBESTOS CONTAINING MATERIALS DISCOVERED BEFORE PROCEEDING WITH WORK. PROTECT INTERIOR CONSTRUCTION TO REMAIN DURING DEMOLITION AND CONSTRUCTION.
28. CONTRACTOR TO OBTAIN ALL NECESSARY PERMITS BEFORE COMMENCING WORK.
29. CONTRACTOR TO PROVIDE ALL NECESSARY SHORING FOR PROTECTION OF EXISTING STRUCTURE AND FOUNDATION TO REMAIN.
30. ALL DASHED LINES ARE DEMOLITION LINES UNLESS NOTED OTHERWISE.
31. REMOVE ALL CARPET/WAINSCOT FROM ALL LOCATIONS IN EACH UNIT.

**GENERAL NOTES**



1. VERIFY DIMENSIONS AND EXISTING CONDITIONS BEFORE COMMENCING WORK. REPORT DISCREPANCIES TO THE ARCHITECT PRIOR TO PROCEEDING WITH AFFECTED WORK.
2. REFLECTING CEILING PLAN DIMENSIONS ARE REFERENCED FROM FINISHED SURFACES UNLESS NOTED OTHERWISE. CEILING HEIGHTS ARE DIMENSIONED FROM FLOOR TO FINISHED CEILING HEIGHT.
3. DIMENSIONS NOTED AS "FIELD VERIFY" SHALL BE CHECKED AT THE SITE BY THE CONTRACTOR AND REVIEWED WITH THE ARCHITECT BEFORE INCORPORATING INTO THE WORK.
4. DO NOT SCALE DRAWING. WRITTEN DIMENSIONS TAKE PRECEDENCE. IF CLARIFICATION IS REQUIRED IN ORDER TO DETERMINE THE INTENT OF THE CONTRACT DOCUMENTS, CONTACT THE ARCHITECT.
5. NOTES OR DIMENSIONS LABELED "TYPICAL" SHALL APPLY TO SITUATIONS THAT ARE THE SAME OR SIMILAR.
6. ALL INTERIOR PARTITIONS SHALL BE KEYED AS REFERENCE SHEET A7.00 FOR PARTITION TYPES
7. ALL DIMENSIONS ARE TO FACE OF FINISHED WALL UNLESS NOTED OTHERWISE.
8. ALL SPACES WITH FLOOR DRAINS TO HAVE FINISHED FLOORS SLOPED TO DRAIN NOT TO EXCEED ONE IN FIFTY.
9. ALL FLOORS FINISH CHANGES SHALL OCCUR AT THE CENTERLINE OF DOORS UNLESS NOTED OTHERWISE. ALL FLOOR FINISH CHANGES SHALL HAVE THRESHOLDS OR REDUCER STRIPS.
10. ALL DOORS IN INTERIOR GYP. BD STUD WALLS SHALL BE SET 4" OFF THE PERP. ADJ. WALL ON THE HINGE SIDE OF THE DOOR UNLESS NOTED OTHERWISE. THE CONTRACTOR SHALL CONTACT THE ARCHITECT IF ANY CONFLICT OCCURS.
11. PROVIDE VINYL REDUCER AT ALL DISSIMILAR FLOOR MATERIALS UNLESS OTHERWISE NOTED.
12. UNLESS OTHERWISE NOTED, ALL ELECTRICAL AND MECHANICAL OPERABLE DEVICES SHALL BE MOUNTED WITH THE HIGHEST OPERABLE CONTROL AT 42" AFF.
13. ALL REQUIRED CLEARANCES, AS DESCRIBED IN THE TEXAS ACCESSIBILITY STANDARDS (TAS) OF THE ARCHITECTURAL BARRIERS ACT ARTICLE 9102, TEXAS CIVIL STATUTES (2012) FOR COMMON AREAS, ALL PLUMBING FIXTURES INCLUDING DRINKING FOUNTAINS, LAVATORIES, URINALS, AND TOILETS WILL BE STRICTLY ENFORCED.



**ARCHITECTURE**  
 PBK ARCHITECTS  
 11 Greenway Plaza, 22nd Floor  
 Houston, TX 77046  
 713-965-9569 P  
 713-961-4571 F  
 TX Firm # F-1709  
 PBK.com

**MEP**  
 SHAH SMITH AND ASSOCIATES  
 2825 S Willett Dr #300  
 HOUSTON, TX 77042  
 (713) 790-7563



**HARRIS COUNTY PSYCHIATRIC  
 CENTER RENOVATION UNITS: 1C,  
 2E, 3B, 3C, 3D & 3E**

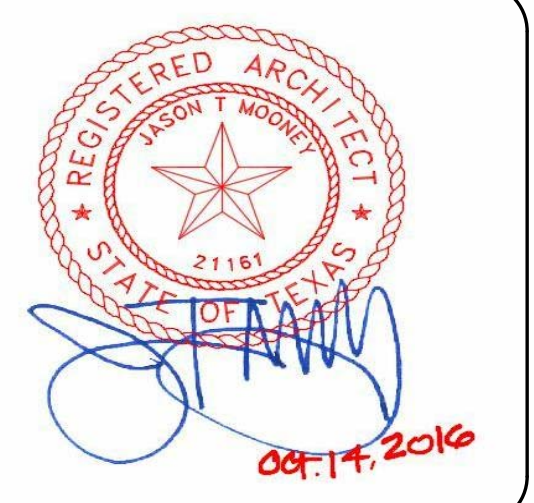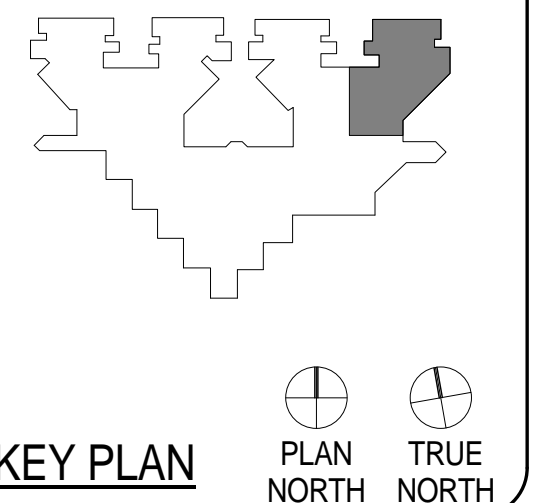

CLIENT	UT HEALTH	
PROJECT NUMBER	16106	
DATE:	OCTOBER 14, 2016	
DRAWN BY:	VICTORIA GARCIA	
CHECKED BY:	Checker	
REVISIONS		
No.	Description	Date

ISSUE FOR BID  
**THIRD FLOOR UNIT  
 3E**

**A2.17E**

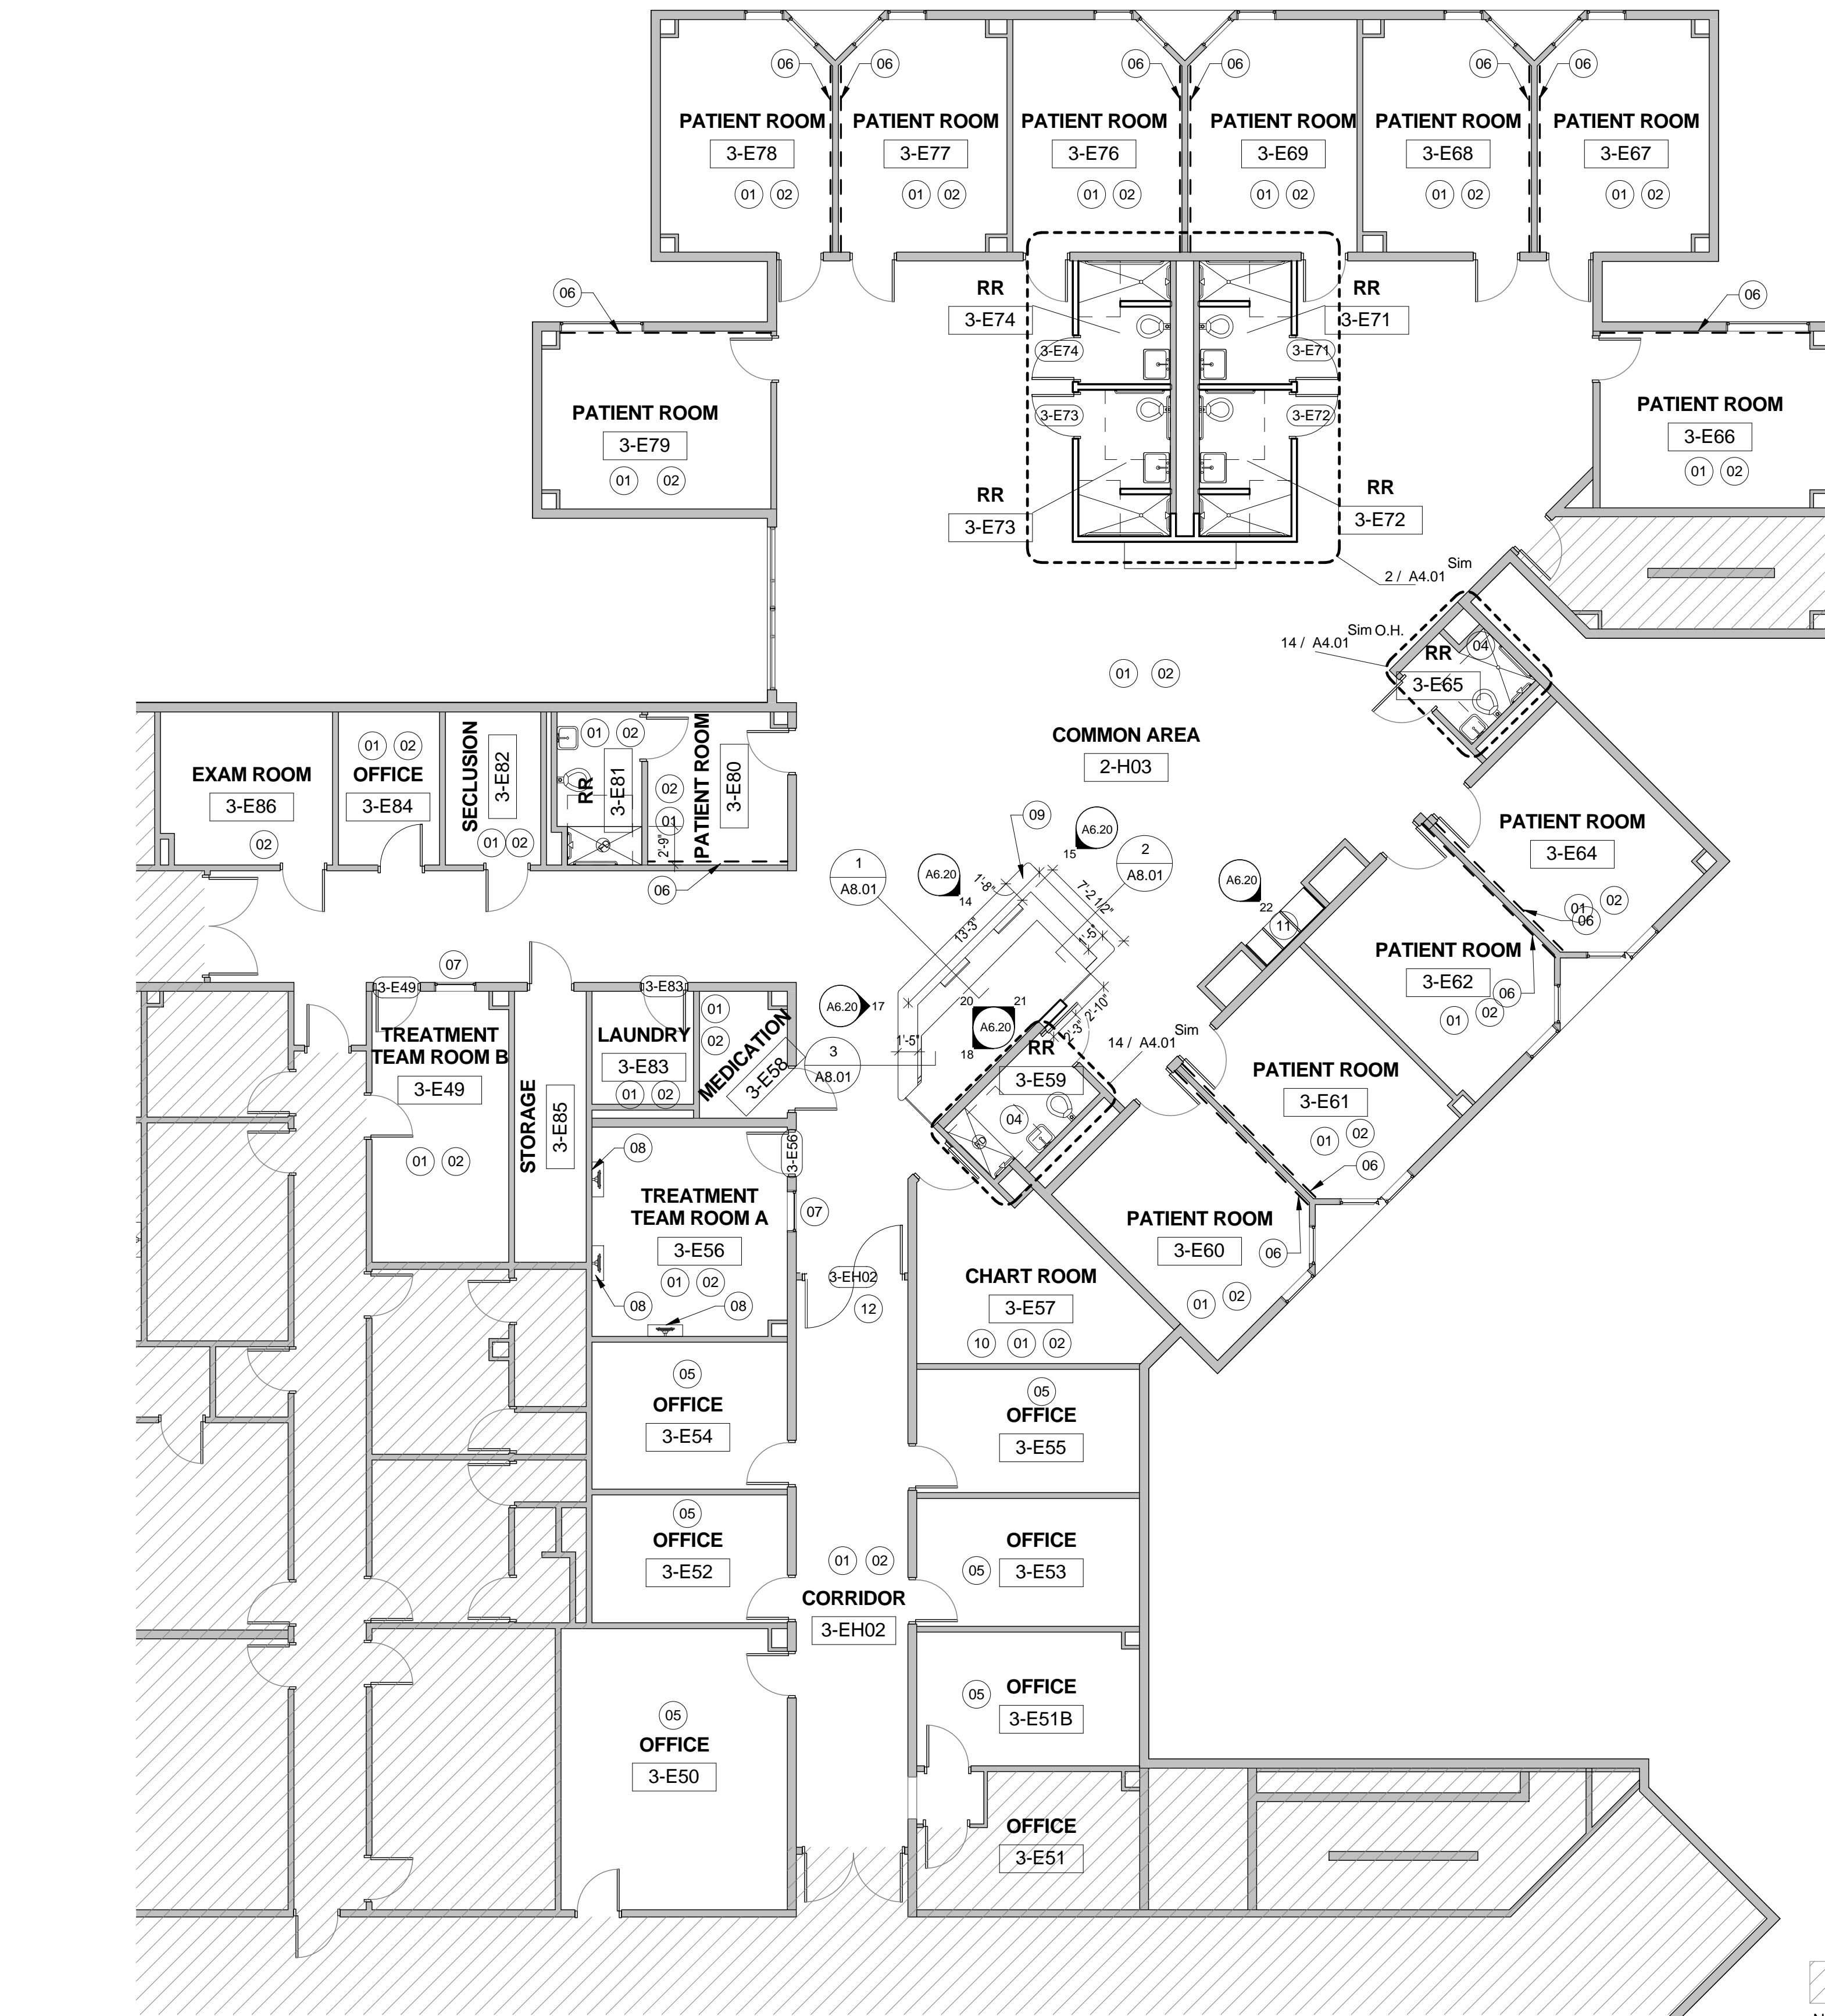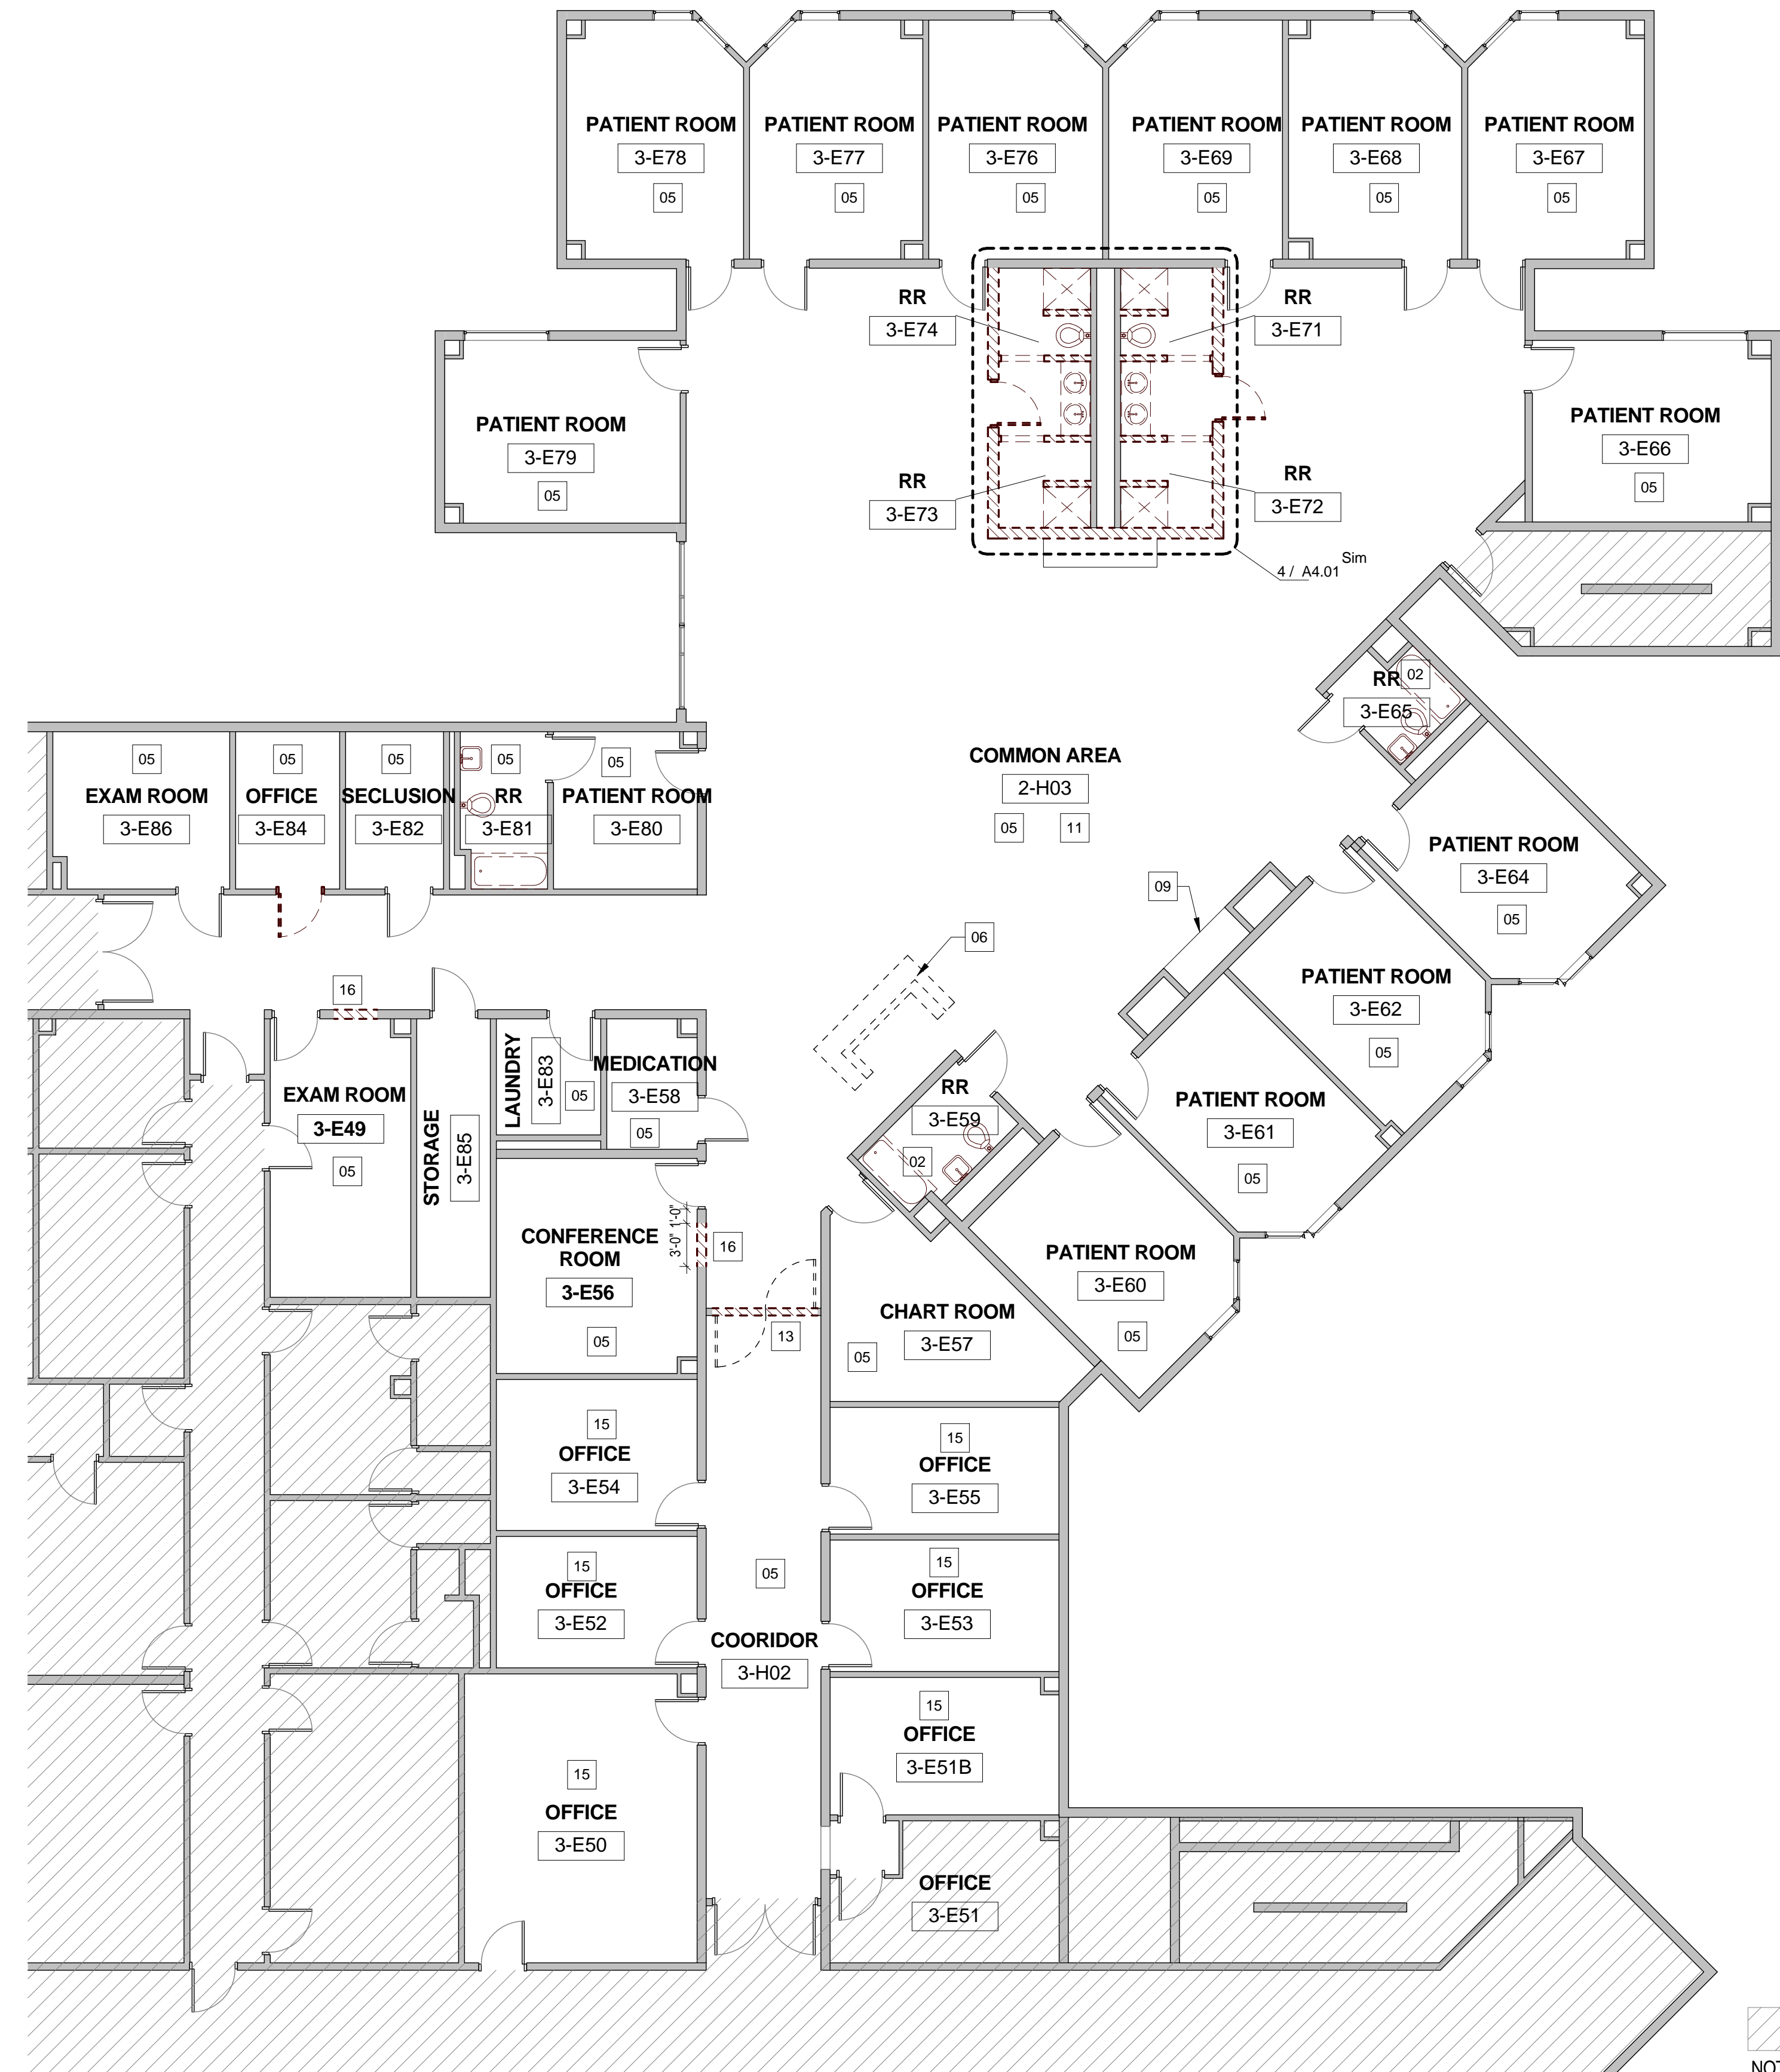



**6** DEMOLITION FLOOR PLAN - UNIT 3E  
 1/8" = 1'-0"

**3** RENOVATION PLAN - UNIT 3E  
 1/8" = 1'-0"







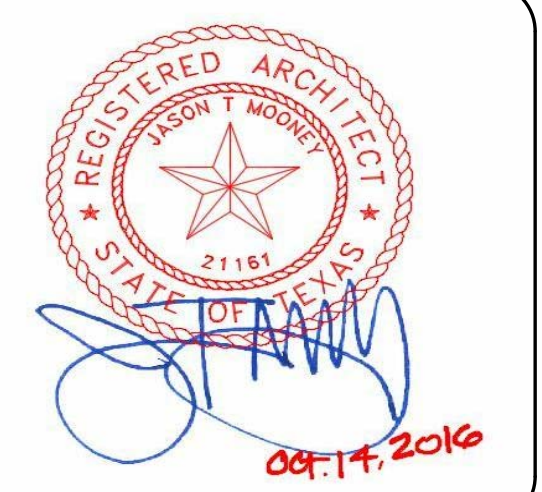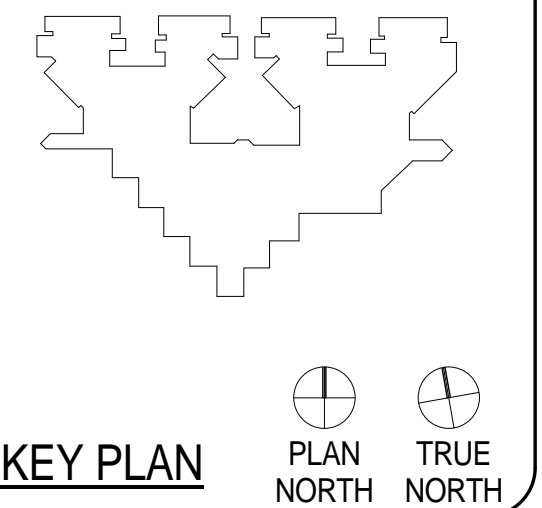

CLIENT	UT HEALTH	
PROJECT NUMBER	16106	
DATE:	OCTOBER 14, 2016	
DRAWN BY:	Author	
CHECKED BY:	Checker	
REVISIONS		
No.	Description	Date

ISSUE FOR BID  
**FIRST FLOOR FINISH  
PLAN - UNIT 1C**

**A2.19C**

**GENERAL FINISH PLAN NOTES**

- REFER TO INTERIOR ELEVATIONS, AS REFERENCED ON ARCHITECTURAL PLANS, FOR ADDITIONAL INFORMATION.
- SUBMIT SAMPLES OF ALL SCHEDULED FINISHES FOR APPROVAL, PRIOR TO ORDERING.
- ALL INSTALLATION PROCEDURES SHALL BE IN ACCORDANCE WITH EACH MANUFACTURER'S INSTRUCTIONS.
- AFTER PROJECT COMPLETION, ALL FINISHES AND SURFACES TO BE THOROUGHLY CLEANED.
- ALL INTERIOR FINISHES FOR WALLS, CEILINGS AND FLOORS COMPLY WITH IBC 2012 SECTION 803 & 804:  
\* FLOORING - VINYL FLOORING - FLOORING RADIANT PANEL TEST (ASTM-E-648) PASSES CLASS 1  
\* WALL BASE - CLASS C  
\* ACOUSTICAL CEILING - CLASS A
- ALL PAINT FINISHES PT-1 ON WALLS, UNLESS NOTED OTHERWISE.
- ALL NEW OR REPLACEMENT SUSPENDED CEILING TO BE 24x24 ACT, UNLESS NOTED OTHERWISE.

**FINISH PLAN LEGEND**

ROOM FINISH TAG

ACT	CEILING FINISH
W/C	WALL FINISH
RB	WALL BASE FINISH
VCT	FLOOR FINISH

MILLWORK FINISH TAG

SS-1	COUNTERTOPS, BENCHES / HORIZONTAL SURFACE FINISH
PL-2	MILLWORK IN AND OUT SIDE/ VERTICAL SURFACE FINISH

P1 DENOTES ACCENT WALL PAINT

• DENOTES MULTIPLE FINISHES. REFER TO ENLARGED PLANS AND/OR ELEVATIONS FOR INFORMATION.

1 KEYNOTE

CG PAWLING PRO-TEK MODEL CG-10 CORNER GUARD

SH SILL HEIGHT

**FINISH SECTIONS - CEILINGS**

GWB	GYPSUM BOARD CEILING WITH CL-3 FINISH (ALL PATIENT ROOMS & RESTROOMS)
ACT	24X24 ACOUSTICAL CEILING SAND MICRO TILES (ALL PUBLIC AREAS AND SUPPORT/STAFF AREAS; REPLACE THROUGHOUT; ALL OTHER EXISTING ACT GRID TO BE PAINTED WHITE)
CL-3	SHERWIN WILLIAMS 'EAGLET BEIGE' #7573, EGG SHELL FINISH

**FINISH SECTIONS - WALLS**

PT-1	SHERWIN WILLIAMS - SEMI-GLOSS LATEX ENAMEL 'EAGLET BEIGE' # 7573
PT-3	SHERWIN WILLIAMS - SEMI-GLOSS LATEX ENAMEL 'RAIN' # 6219
PTP-4	(WALL MAIN) AMERICAN OLEAN 10"X14" 'DURANGO CREAM' # SC85 BRICK JOINT, VERTICALLY INSTALLED (RESTROOMS)
PTP-5	(WALL - ACCENT STRIP) AMERICAN OLEAN - GLASS & NATURAL STONE 3" X RANDOM MOSAIC 'COLOR APPEAL: PACIFIC COAST BLEND' #C136 (RESTROOMS)
GBL-1	(PARTIAL WALL SHOWERS) GLASS BLOCKS 12x12x4 PITTSBURGH CORNING - 'DECORA LX PATTERN'

**FINISH SECTIONS - FLOORING**

LVT-1	KARNDLEAN 36" X 6" - 'OPUS: PALLEO' # WP312
LVT-2	KARNDLEAN 36" X 4" - 'OPUS: GOLDEN TEAK' # WP513
PTP-1	BPI VINTAGEWOOD 6" X 36" PLANKS - 'DUNE' # 62-700 (RESTROOM MAIN FLOOR)
PTP-2	AMERICAN OLEAN 2X2 MOSAIC - 'SALCEDO: DURANGO CREAM' # SC85 (INSIDE SHOWER)

\*PATTERNS INDICATE DIRECTIONAL FLOOR PATTERN

**FINISH SECTIONS - WALL BASE**

RB-1	4" RUBBER WALL BASE TO BE STANDARD - FLEXCO - COVE 'CAPPUCCINO' # 65
WB	WALL BASE. COVE TYPE TO MATCH FLOOR TILE TYPE AND SIZE (ALL RESTROOMS)

**FINISHES - DOOR & WINDOW FRAMES**


PT-8	PAINT- INTERIOR DOOR FRAMES - SHERWIN WILLIAMS PROMAR 200 INTERIOR ALKYD 'DORMER BROWN'
------	---

**GROUT**

G-1	(BATHROOM WALL) LATICRETE 'ANTIQUE WHITE' #23
G-2	(BATHROOM FLOOR) LATICRETE 'BUTTERCREAM' #81

**FINISH SECTIONS - MILLWORK**



PL-1	WILSONART 'DESERT ZEPHYR' #4841-60
PL-2	WILSONART #6257 (419) SATIN BRUSHED NATURAL ALUMINUM
PL-3	WILSONART #7951K-18 'ASIAN SUN'
CO-1	CORIAN 'COTTAGE LINE'

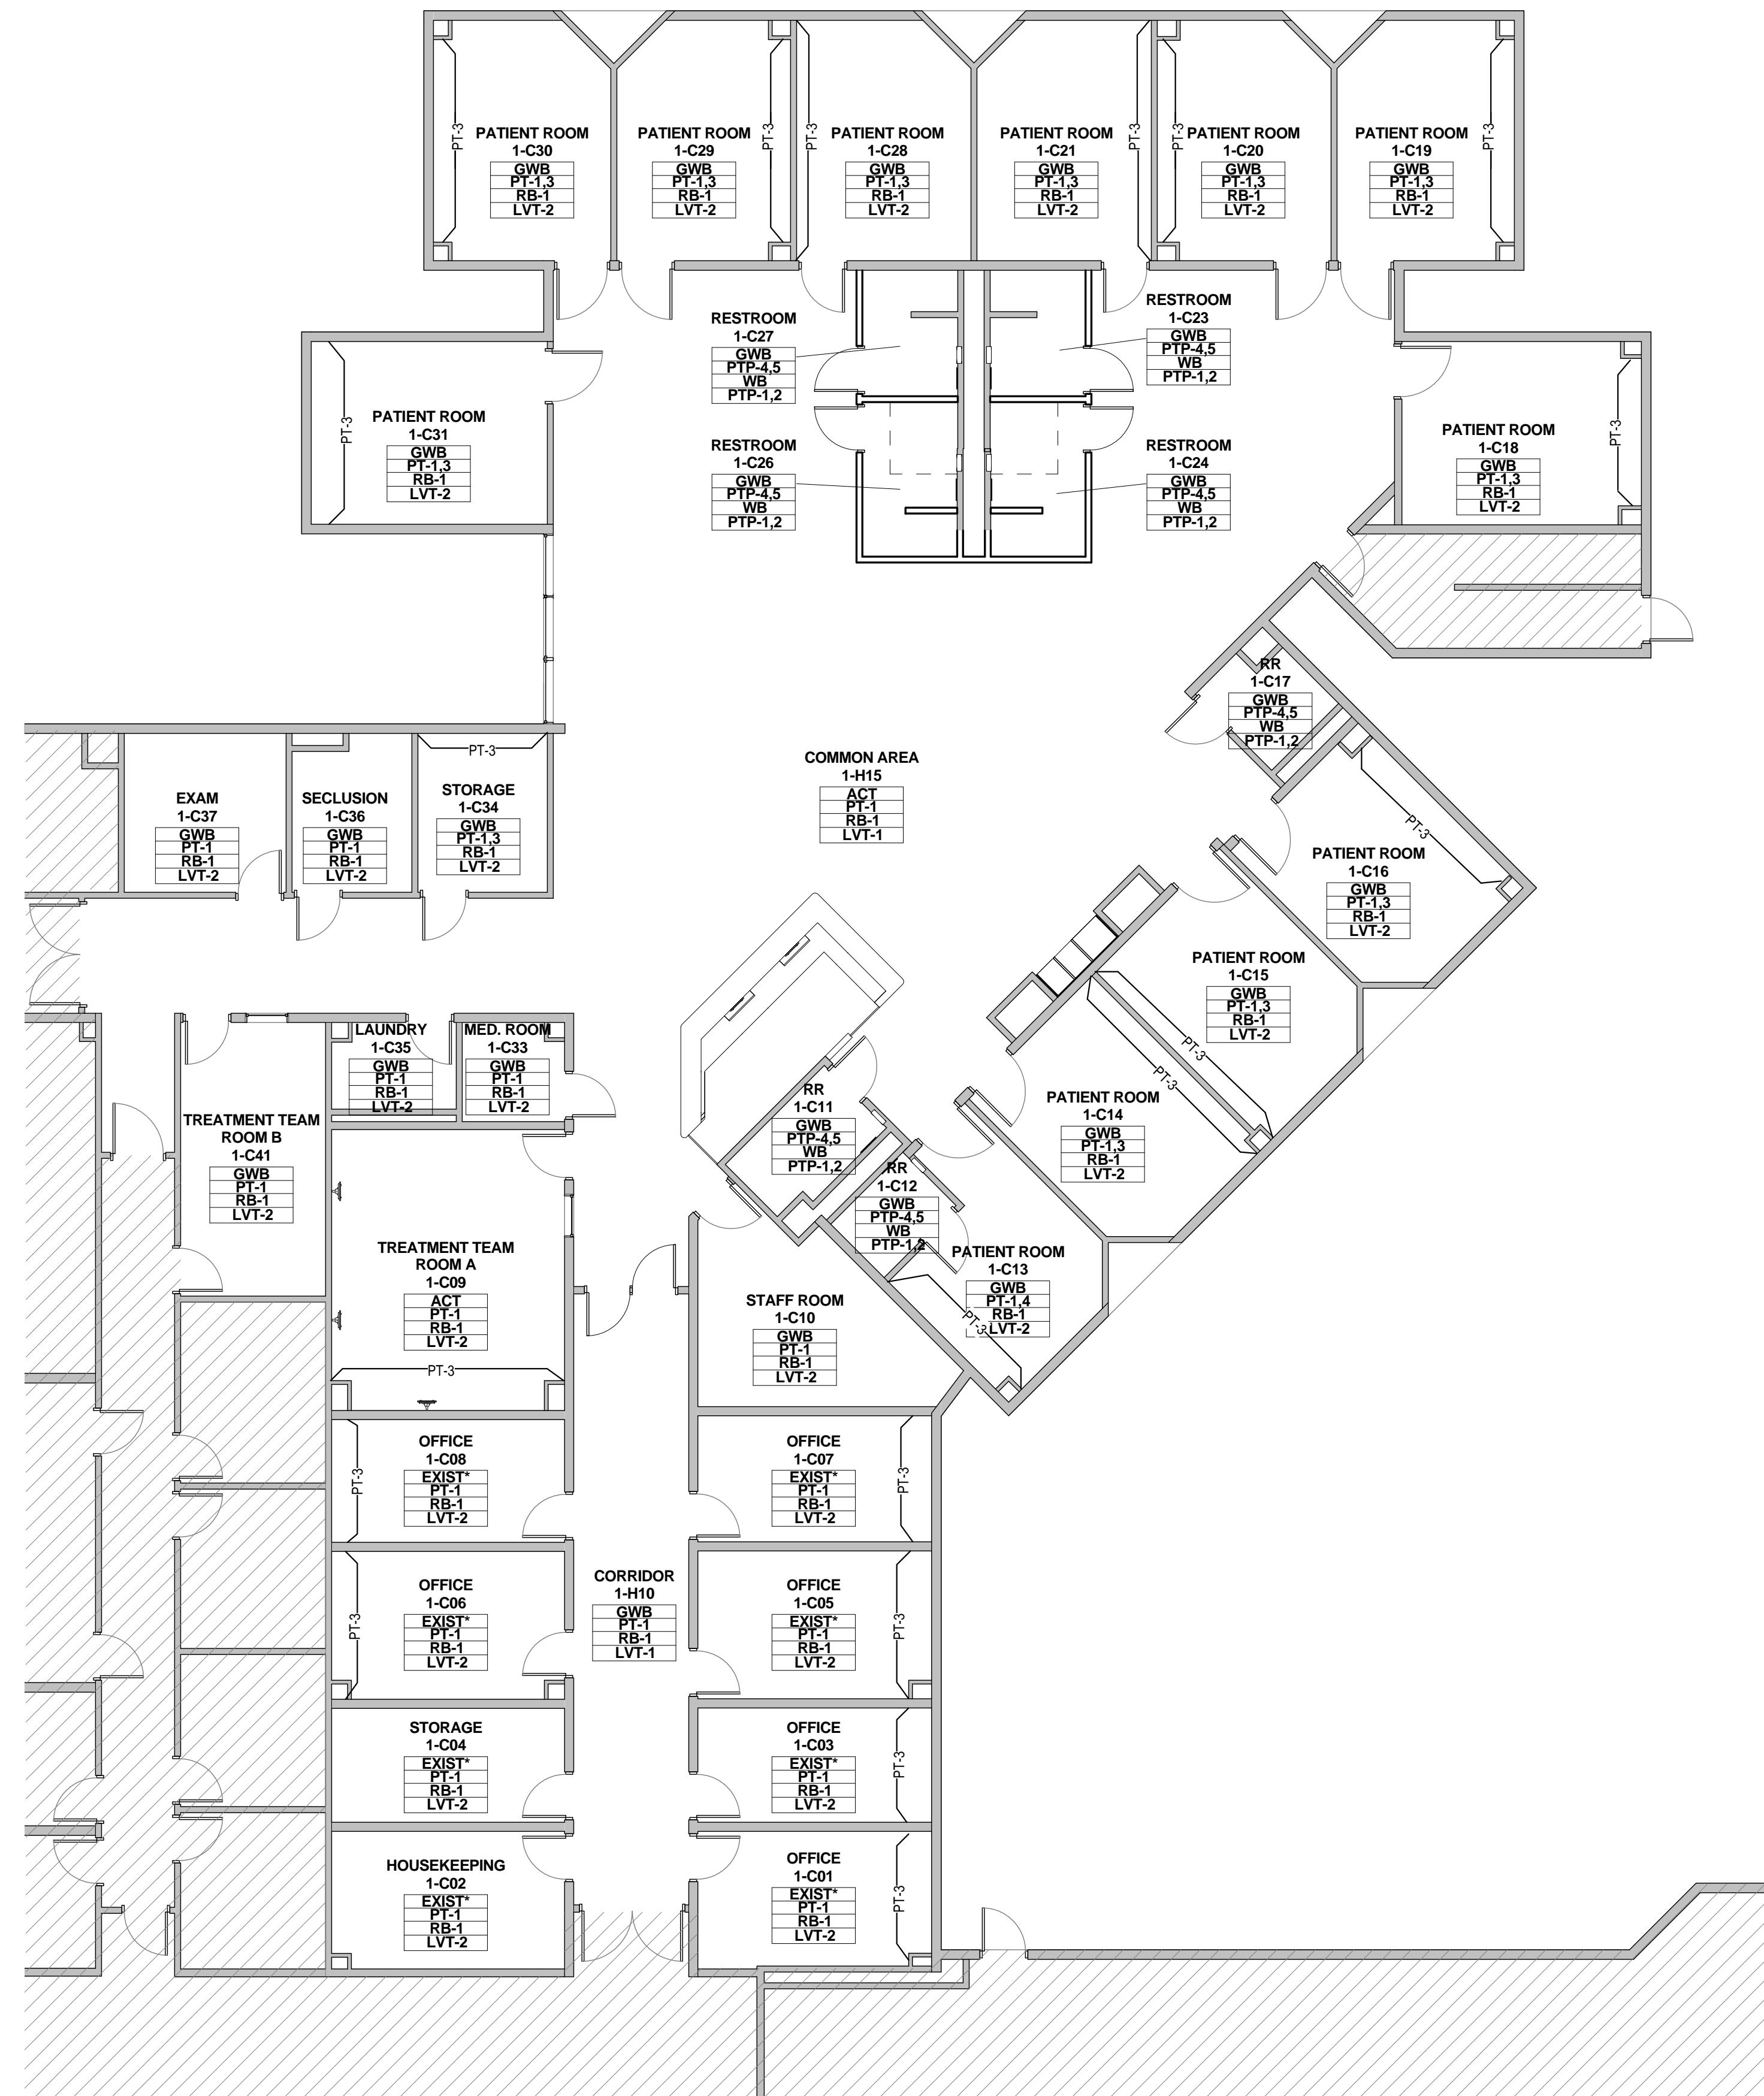

NOTE:  
\*PAINT EXISTING GYP BD WITH NEW PAINT COAT PT-1

\\pbk02\projects\_hou\16106\Drawings\BIM\REV\T\MODEL\_CENTRAL\ARCH\16106-HCPC-A16\_Central.rvt 10/13/2016 2:28:06 PM



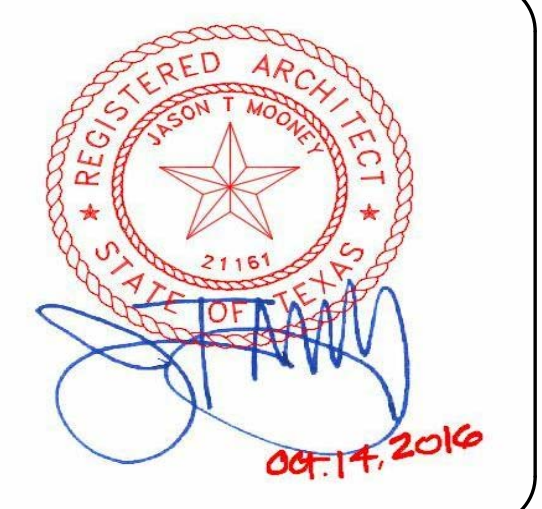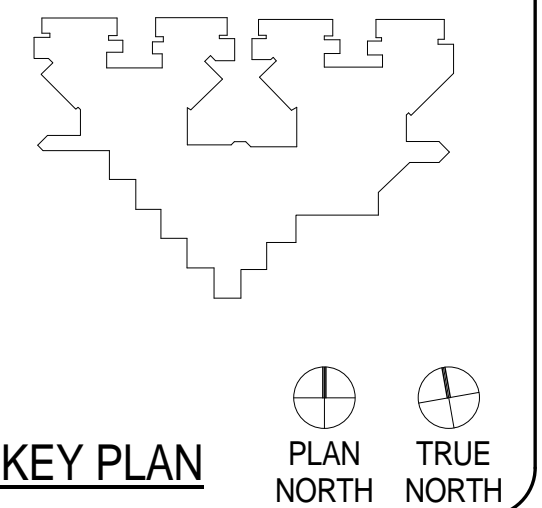

CLIENT	UT HEALTH	
PROJECT NUMBER	16106	
DATE:	OCTOBER 14, 2016	
DRAWN BY:	VG/BG	
CHECKED BY:	JM/CS	
REVISIONS		
No.	Description	Date

ISSUE FOR BID  
**SECOND FLOOR  
FINISH PLAN - UNIT  
2E**

**A2.20E**

### GENERAL FINISH PLAN NOTES

- REFER TO INTERIOR ELEVATIONS, AS REFERENCED ON ARCHITECTURAL PLANS, FOR ADDITIONAL INFORMATION.
- SUBMIT SAMPLES OF ALL SCHEDULED FINISHES FOR APPROVAL, PRIOR TO ORDERING.
- ALL INSTALLATION PROCEDURES SHALL BE IN ACCORDANCE WITH EACH MANUFACTURER'S INSTRUCTIONS.
- AFTER PROJECT COMPLETION, ALL FINISHES AND SURFACES TO BE THOROUGHLY CLEANED.
- ALL INTERIOR FINISHES FOR WALLS, CEILINGS AND FLOORS COMPLY WITH IBC 2012 SECTION 803 & 804.  
\* FLOORING - VINYL FLOORING - FLOORING RADIANT PANEL TEST (ASTM-E-648)  
  PASSES CLASS 1  
  \* WALL BASE - CLASS C  
  \* ACOUSTICAL CEILING - CLASS A
- ALL PAINT FINISHES PT-1 ON WALLS, UNLESS NOTED OTHERWISE.
- ALL NEW OR REPLACEMENT SUSPENDED CEILING TO BE 24x24 ACT, UNLESS NOTED OTHERWISE.

### FINISH PLAN LEGEND

- ROOM FINISH TAG**
- ACT - CEILING FINISH
  - WB - WALL FINISH
  - RB - WALL BASE FINISH
  - LVT - FLOOR FINISH
- MILLWORK FINISH TAG**
- SS-1 - COUNTERTOPS, BENCHES / HORIZONTAL SURFACE FINISH
  - PL-2 - MILLWORK IN AND OUT SIDE / VERTICAL SURFACE FINISH
- P1 - DENOTES ACCENT WALL PAINT
- - DENOTES MULTIPLE FINISHES. REFER TO ENLARGED PLANS AND/OR ELEVATIONS FOR INFORMATION.
- 1 - KEYNOTE
- CG - PAWLING PRO-TEK MODEL CG-10 CORNER GUARD
- SH - SILL HEIGHT

### FINISH SECTIONS - CEILINGS

- GWB - GYPSUM BOARD CEILING WITH CL-3 FINISH (ALL PATIENT ROOMS & RESTROOMS)
- ACT - 24X24 ACOUSTICAL CEILING SAND MICRO TILES (ALL PUBLIC AREAS AND SUPPORT/STAFF AREAS; REPLACE THROUGHOUT; ALL OTHER EXISTING ACT GRID TO BE PAINTED WHITE)
- CL-3 - SHERWIN WILLIAMS 'EAGLET BEIGE' #7573, EGGSHELL FINISH

### FINISH SECTIONS - WALLS

- PT-1 - SHERWIN WILLIAMS - SEMI-GLOSS LATEX ENAMEL 'EAGLET BEIGE' # 7573
- PT-3 - SHERWIN WILLIAMS - SEMI-GLOSS LATEX ENAMEL 'RAIN' # 6219 (WALL MAIN) AMERICAN OLEAN 10'X14" 'DURANGO CREAM' # SC85 BRICK JOINT, VERTICALLY INSTALLED (RESTROOMS)
- PTP-4 - (WALL: ACCENT STRIP) AMERICAN OLEAN - GLASS & NATURAL STONE 3 X RANDOM MOSAIC 'COLOR APPEAL: PACIFIC COAST BLEND' #C136 (RESTROOMS)
- PTP-5 - (WALL: ACCENT STRIP) AMERICAN OLEAN - GLASS & NATURAL STONE 3 X RANDOM MOSAIC 'COLOR APPEAL: PACIFIC COAST BLEND' #C136 (RESTROOMS)
- GBL-1 - (PARTIAL WALL SHOWERS) GLASS BLOCKS 12x12x4 PITTSBURGH CORNING - 'DECORA LX PATTERN'

### FINISH SECTIONS - FLOORING

- LVT-1 - KARNDIAN 36" X 6" - 'OPUS: PALLEO' # WP312
  - LVT-2 - KARNDIAN 36" X 4" - 'OPUS: GOLDEN TEAK' # WP513
  - PTP-1 - BPI VINTAGEWOOD 6" X 36" PLANKS - 'DUNE' # 62-700 (RESTROOM MAIN FLOOR)
  - PTP-2 - AMERICAN OLEAN 2X2 MOSAIC - 'SALCEDO: DURANGO CREAM' # SC85 (INSIDE SHOWER)
- \*PATTERNS INDICATE DIRECTIONAL FLOOR PATTERN

### FINISH SECTIONS - WALL BASE

- RB-1 - 4" RUBBER WALL BASE TO BE STANDARD - FLEXCO - COVE 'CAPPUCCINO' # 65
- WB - WALL BASE: COVE TYPE TO MATCH FLOOR TILE TYPE AND SIZE (ALL RESTROOMS)

### FINISHES - DOOR & WINDOW FRAMES


- PT-8 - PAINT- INTERIOR DOOR FRAMES - SHERWIN WILLIAMS PROMAR 200 INTERIOR ALKYD 'DORMER BROWN'

### GROUT

- G-1 (BATHROOM WALL) LATICRETE 'ANTIQUE WHITE' #23
- G-2 (BATHROOM FLOOR) LATICRETE 'BUTTERCREAM' #81

### FINISH SECTIONS - MILLWORK



- PL-1 WILSONART 'DESERT ZEPHYR' #4841-60
- PL-2 WILSONART #6257 (419) SATIN BRUSHED NATURAL ALUMINUM
- PL-3 WILSONART #7951K-18 'ASIAN SUN'
- CG-1 CORIAN 'COTTAGE LINE'

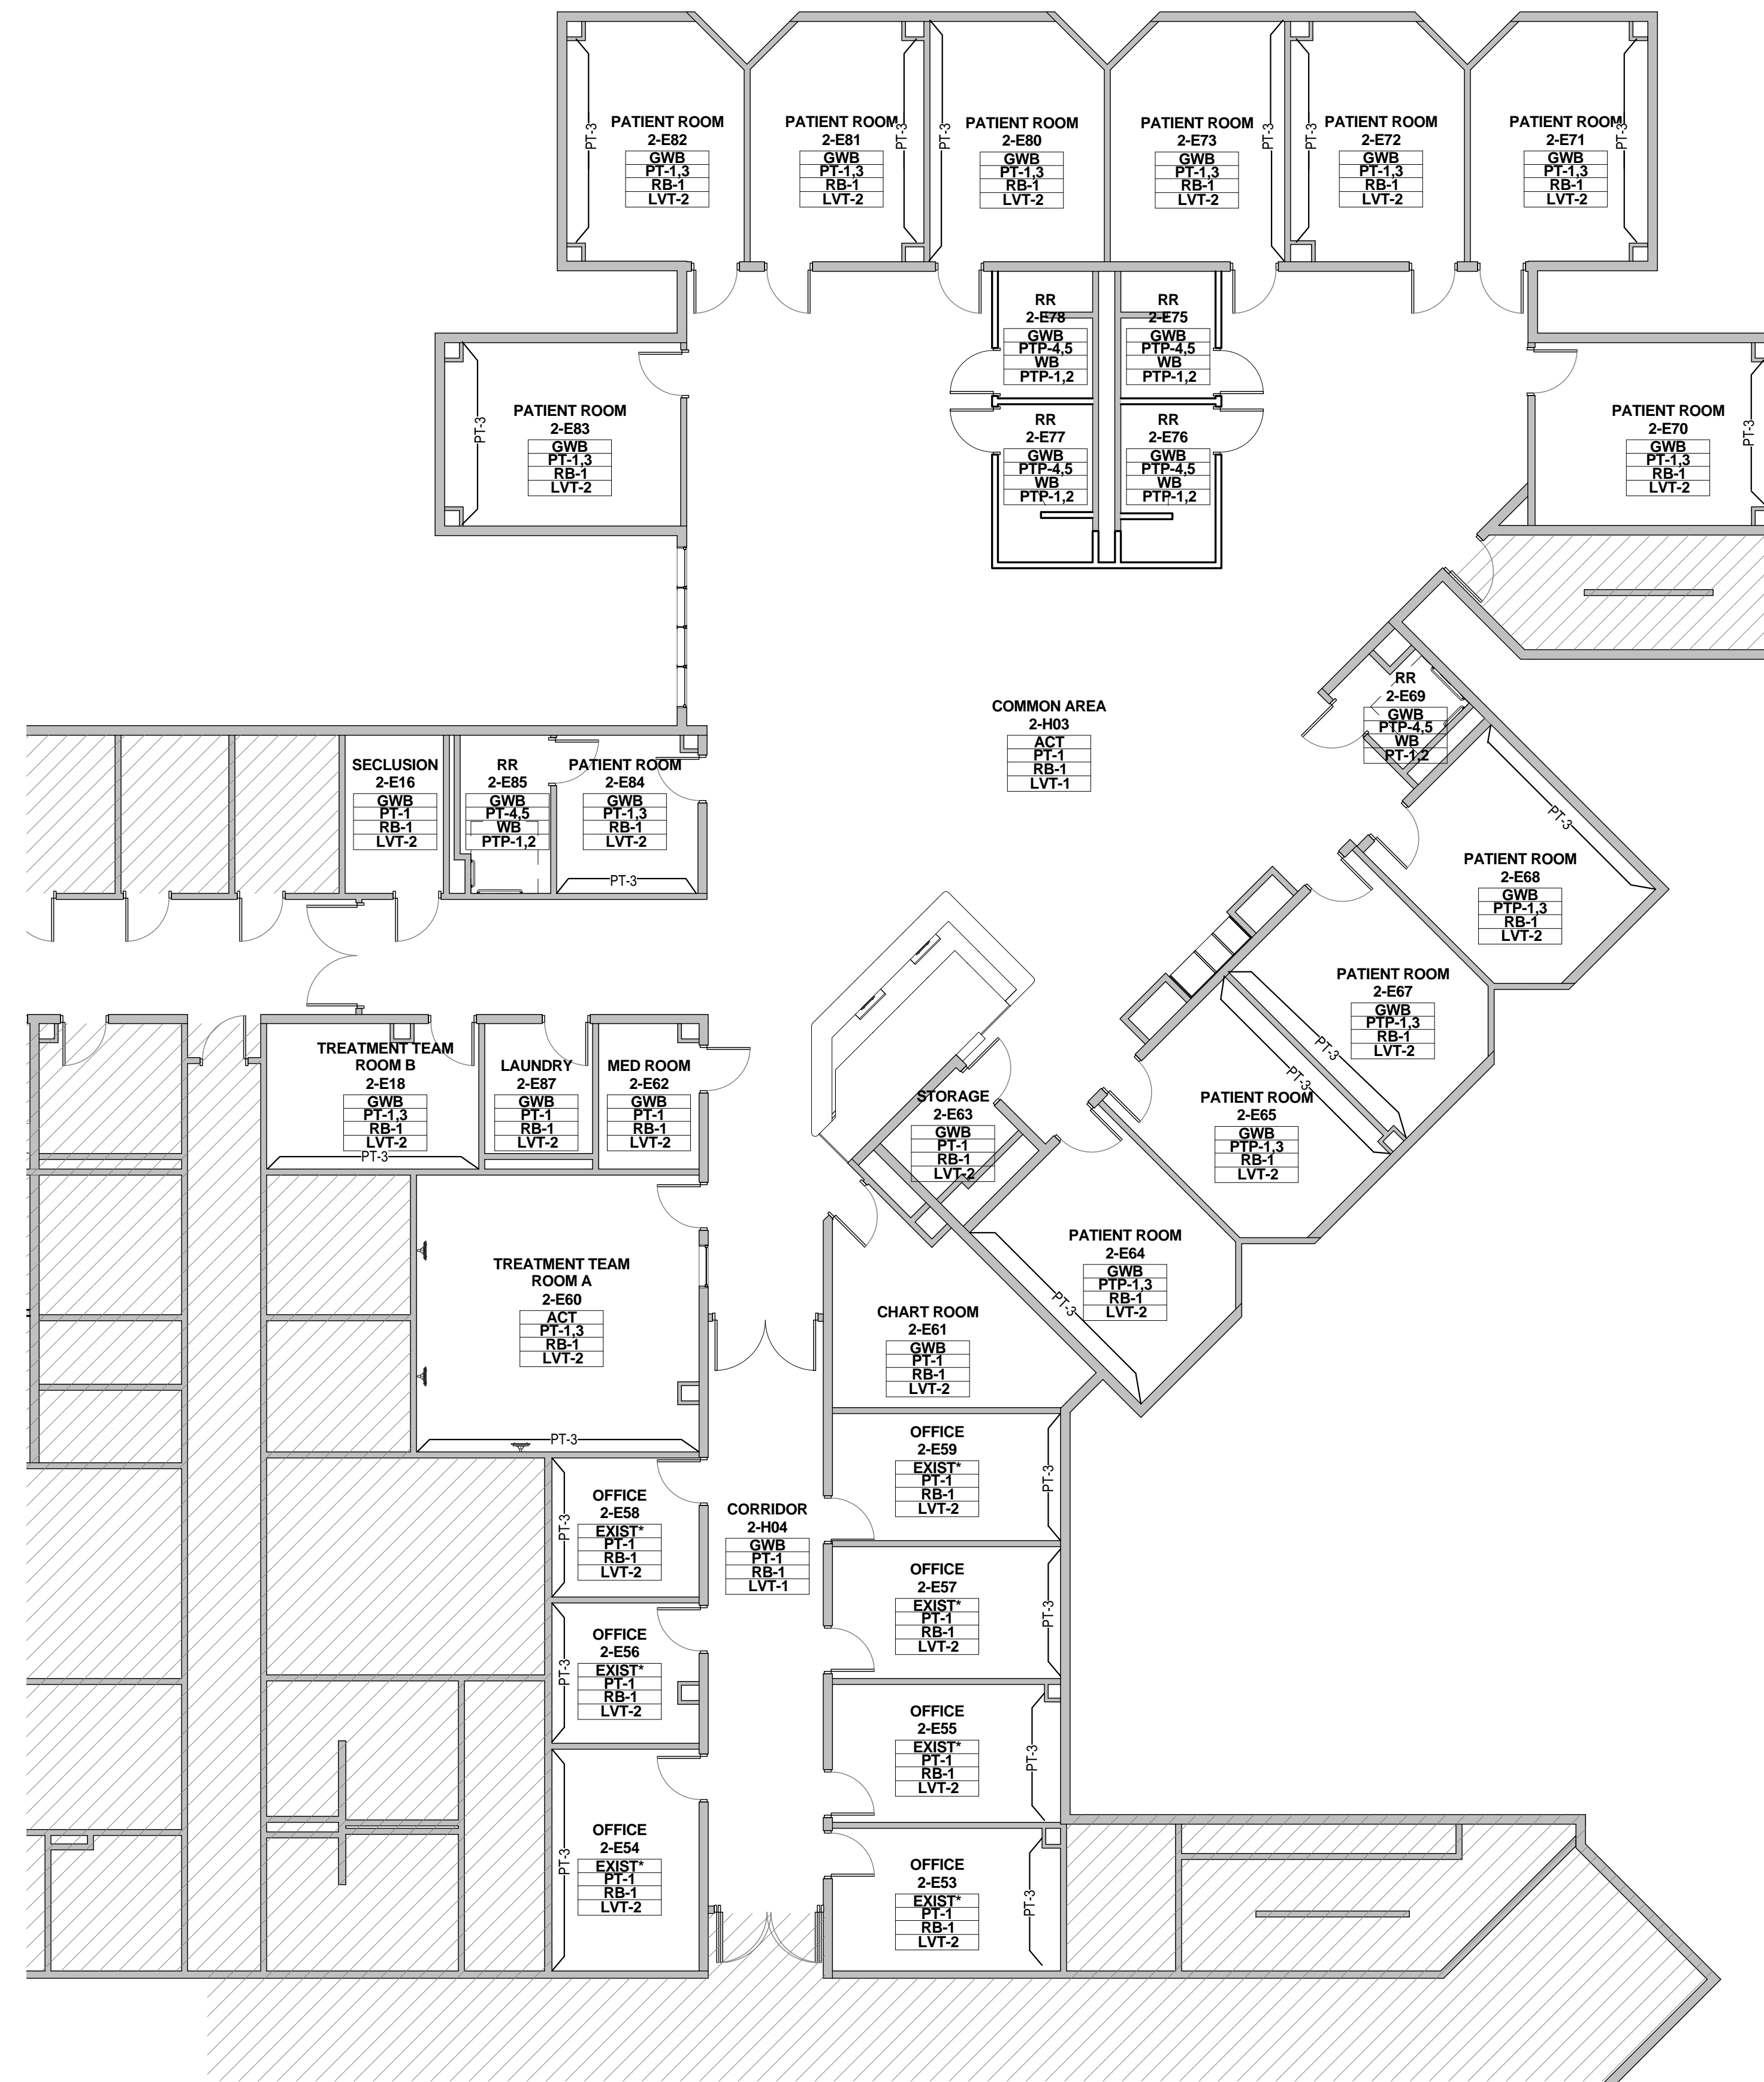

NOTE:  
\*PAINT EXISTING GYP BD WITH NEW PAINT COAT PT-1

\\pbk02\projects\_hou\1616106\Drawings\BIM\REVIT\MODEL\_CENTRALS\ARCH\16106-HCPC-A16\_Central.rvt  
10/13/2016 2:28:17 PM



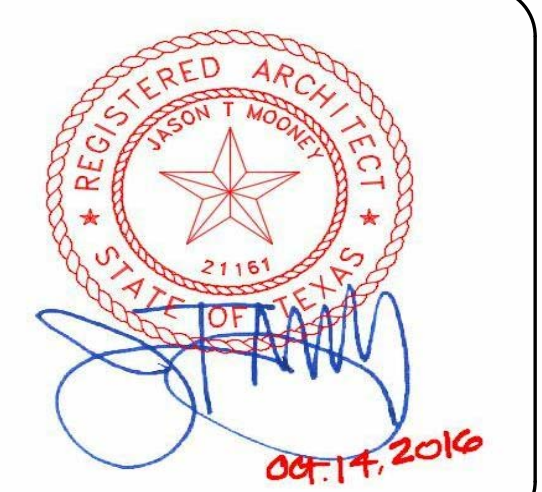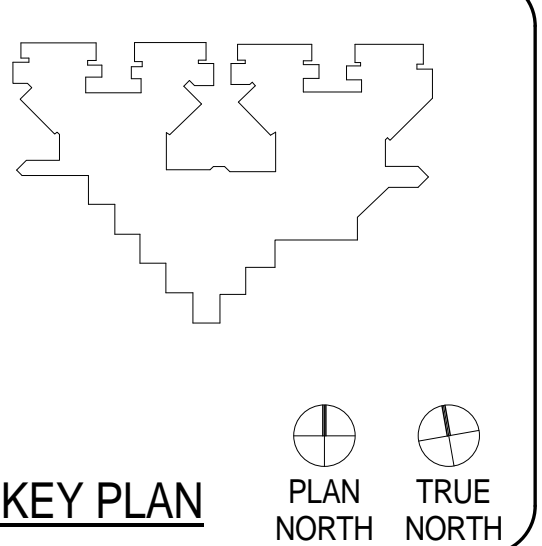

CLIENT		
UT HEALTH		
PROJECT NUMBER		
16106		
DATE:	OCTOBER 14, 2016	
DRAWN BY:	VG/BG	
CHECKED BY:	JM/CS	
REVISIONS		
No.	Description	Date

ISSUE FOR BID  
**THIRD FLOOR FINISH  
 PLAN - UNIT 3B**

**A2.21B**

**GENERAL FINISH PLAN NOTES**

- REFER TO INTERIOR ELEVATIONS, AS REFERENCED ON ARCHITECTURAL PLANS, FOR ADDITIONAL INFORMATION.
- SUBMIT SAMPLES OF ALL SCHEDULED FINISHES FOR APPROVAL PRIOR TO ORDERING.
- ALL INSTALLATION PROCEDURES SHALL BE IN ACCORDANCE WITH EACH MANUFACTURER'S INSTRUCTIONS.
- AFTER PROJECT COMPLETION, ALL FINISHES AND SURFACES TO BE THOROUGHLY CLEANED.
- ALL INTERIOR FINISHES FOR WALLS, CEILINGS AND FLOORS COMPLY WITH IBC 2012 SECTION 803 & 804:  
 \* FLOORING - VINYL FLOORING - FLOORING RADIANT PANEL TEST (ASTM-E-648) PASSES CLASS 1  
 \* WALL BASE - CLASS C  
 \* ACOUSTICAL CEILING - CLASS A
- ALL PAINT FINISHES PT-1 ON WALLS, UNLESS NOTED OTHERWISE.
- ALL NEW OR REPLACEMENT SUSPENDED CEILING TO BE 24x24 ACT, UNLESS NOTED OTHERWISE.

**FINISH PLAN LEGEND**

**ROOM FINISH TAG**

ACT	CEILING FINISH
WVC	WALL FINISH
RB	WALL BASE FINISH
VCT	FLOOR FINISH

**MILLWORK FINISH TAG**

SS-1	COUNTERTOPS, BENCHES / HORIZONTAL SURFACE FINISH
PL-2	MILLWORK IN AND OUT SIDE/ VERTICAL SURFACE FINISH

P1 DENOTES ACCENT WALL PAINT

• DENOTES MULTIPLE FINISHES. REFER TO ENLARGED PLANS AND/OR ELEVATIONS FOR INFORMATION.

1 KEYNOTE

CG PAWLING PRO-TEK MODEL CG-10 CORNER GUARD

SH SILL HEIGHT

**FINISH SECTIONS - CEILINGS**

- |      |   |
|------|---|
| GWB  | GYPSON BOARD CEILING WITH CL-3 FINISH (ALL PATIENT ROOMS & RESTROOMS)   |
| ACT  | 24X24 ACOUSTICAL CEILING SAND MICRO TILES (ALL PUBLIC AREAS AND SUPPORT/STAFF AREAS, REPLACE THROUGHOUT; ALL OTHER EXISTING ACT GRID TO BE PAINTED WHITE) |
| CL-3 | SHERWIN WILLIAMS "EAGLE BEIGE" #7573, EGG SHELL FINISH  |

**FINISH SECTIONS - WALLS**

- |       |   |
|-------|---|
| PT-1  | SHERWIN WILLIAMS - SEMI-GLOSS LATEX ENAMEL "EAGLE BEIGE" # 7573   |
| PT-3  | SHERWIN WILLIAMS - SEMI-GLOSS LATEX ENAMEL "RAIN" # 6219  |
| PTP-4 | (WALL MAIN) AMERICAN OLEAN 10"X14" "DURANGO CREAM" # SC85 BRICK JOINT, VERTICALLY INSTALLED (RESTROOMS)                             |
| PTP-5 | (WALL: ACCENT STRIP) AMERICAN OLEAN - GLASS & NATURAL STONE 3 X RANDOM MOSAIC "COLOR APPEAL: PACIFIC COAST BLEND" #C136 (RESTROOMS) |
| GBL-1 | (PARTIAL WALL SHOWERS) GLASS BLOCKS 12x12x4 PITTSBURGH CORNING - "DECORA LX PATTERN"  |

**FINISH SECTIONS - FLOORING**

- |       |   |
|-------|---|
| LVT-1 | KARDEAN 36" X 6" - "OPUS: PALLEO" # WP312                                   |
| LVT-2 | KARDEAN 36" X 4" - "OPUS: GOLDEN TEAK" # WP513                              |
| PTP-1 | BPI VINTAGEWOOD 6" X 36" PLANKS - "DUNE" # 62-700 (RESTROOM MAIN FLOOR)     |
| PTP-2 | AMERICAN OLEAN 2X2 MOSAIC - "SALCEDO: DURANGO CREAM" # SC85 (INSIDE SHOWER) |
- \*PATTERNS INDICATE DIRECTIONAL FLOOR PATTERN

**FINISH SECTIONS - WALL BASE**

- |      |  |
|------|--|
| RB-1 | 4" RUBBER WALL BASE TO BE STANDARD - FLEXCO - COVE "CAPPUCCINO" # 65   |
| WB   | WALL BASE, COVE TYPE TO MATCH FLOOR TILE TYPE AND SIZE (ALL RESTROOMS) |

**FINISHES - DOOR & WINDOW FRAMES**


- |      |   |
|------|---|
| PT-8 | PAINT- INTERIOR DOOR FRAMES - SHERWIN WILLIAMS PROMAR 200 INTERIOR ALKYD "DORMER BROWN" |
|------|---|

**GROUT**

- |     |   |
|-----|---|
| G-1 | (BATHROOM WALL) LATICRETE "ANTIQUE WHITE" #23 |
| G-2 | (BATHROOM FLOOR) LATICRETE "BUTTERCREAM" #81  |


**FINISH SECTIONS - MILLWORK**

- |      |  |
|------|--|
| PL-1 | WILSONART "DESERT ZEPHYR" #4841-60                   |
| PL-2 | WILSONART #6257 (419) SATIN BRUSHED NATURAL ALUMINUM |
| PL-3 | WILSONART #7951K-18 "ASIAN SUN"                      |
| CO-1 | CORIAN "COTTAGE LINE"                                |

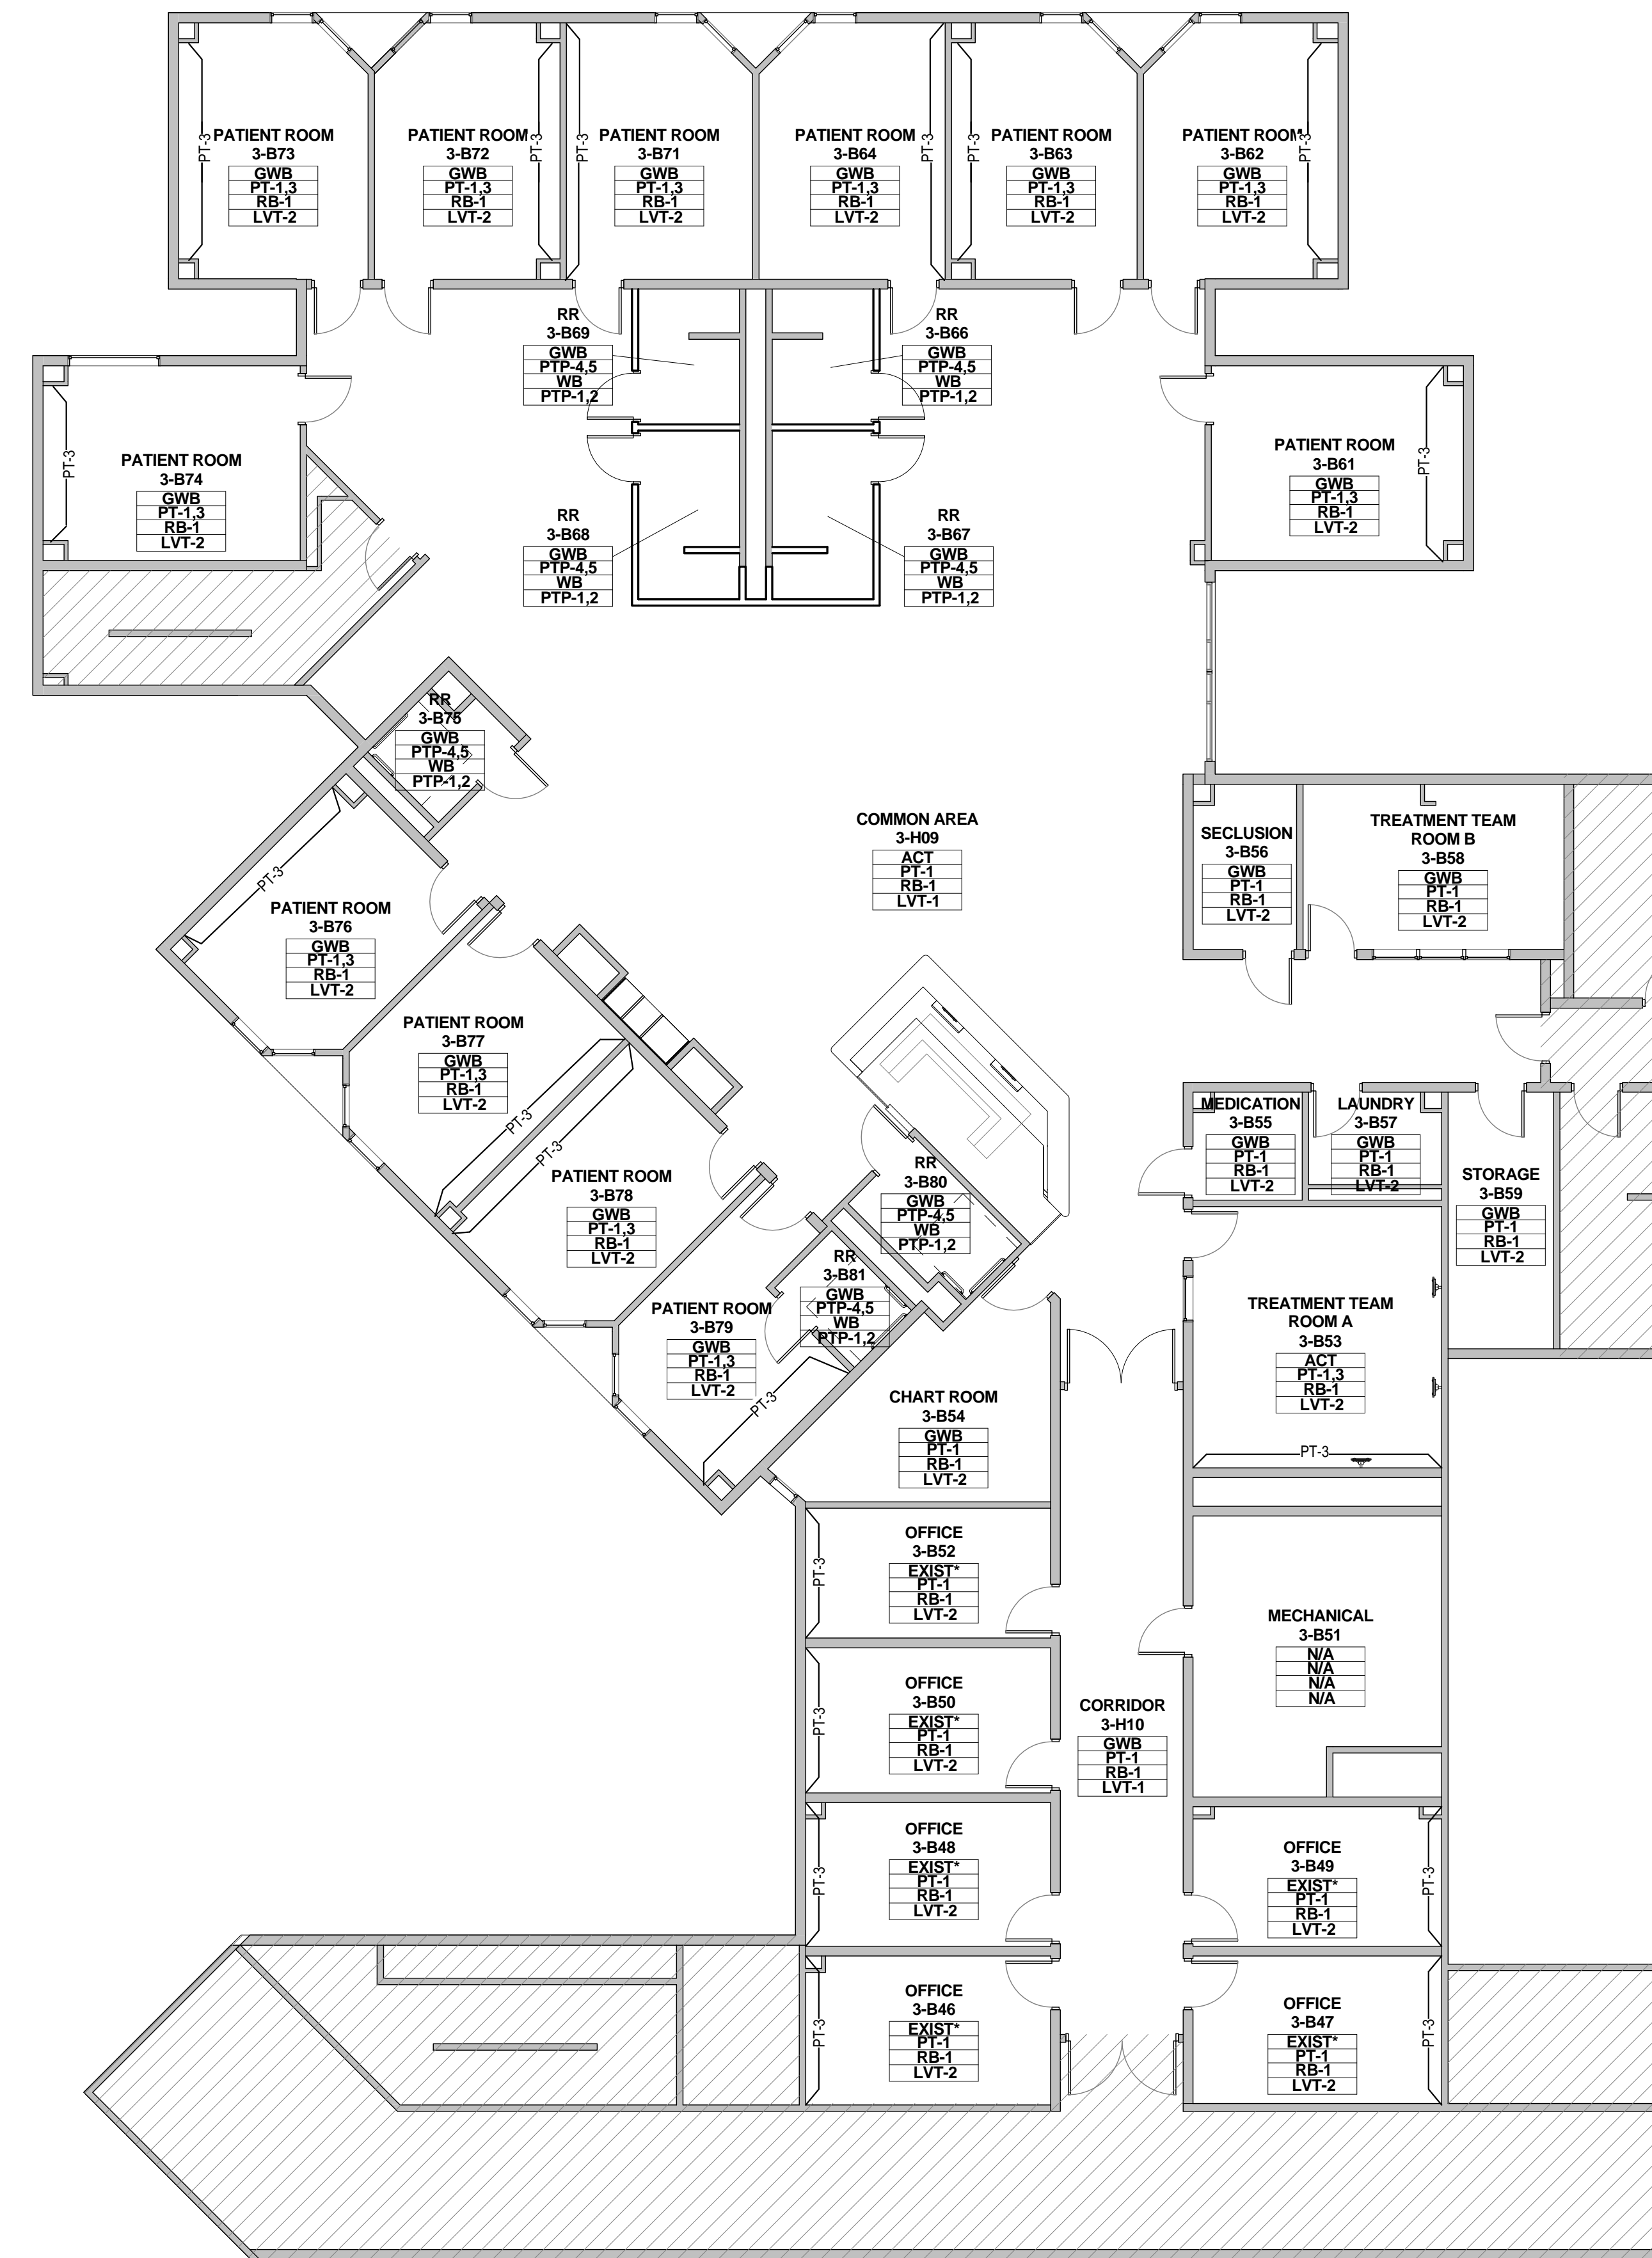

NOTE:  
 \*PAINT EXISTING GYP BD WITH NEW PAINT COAT PT-1



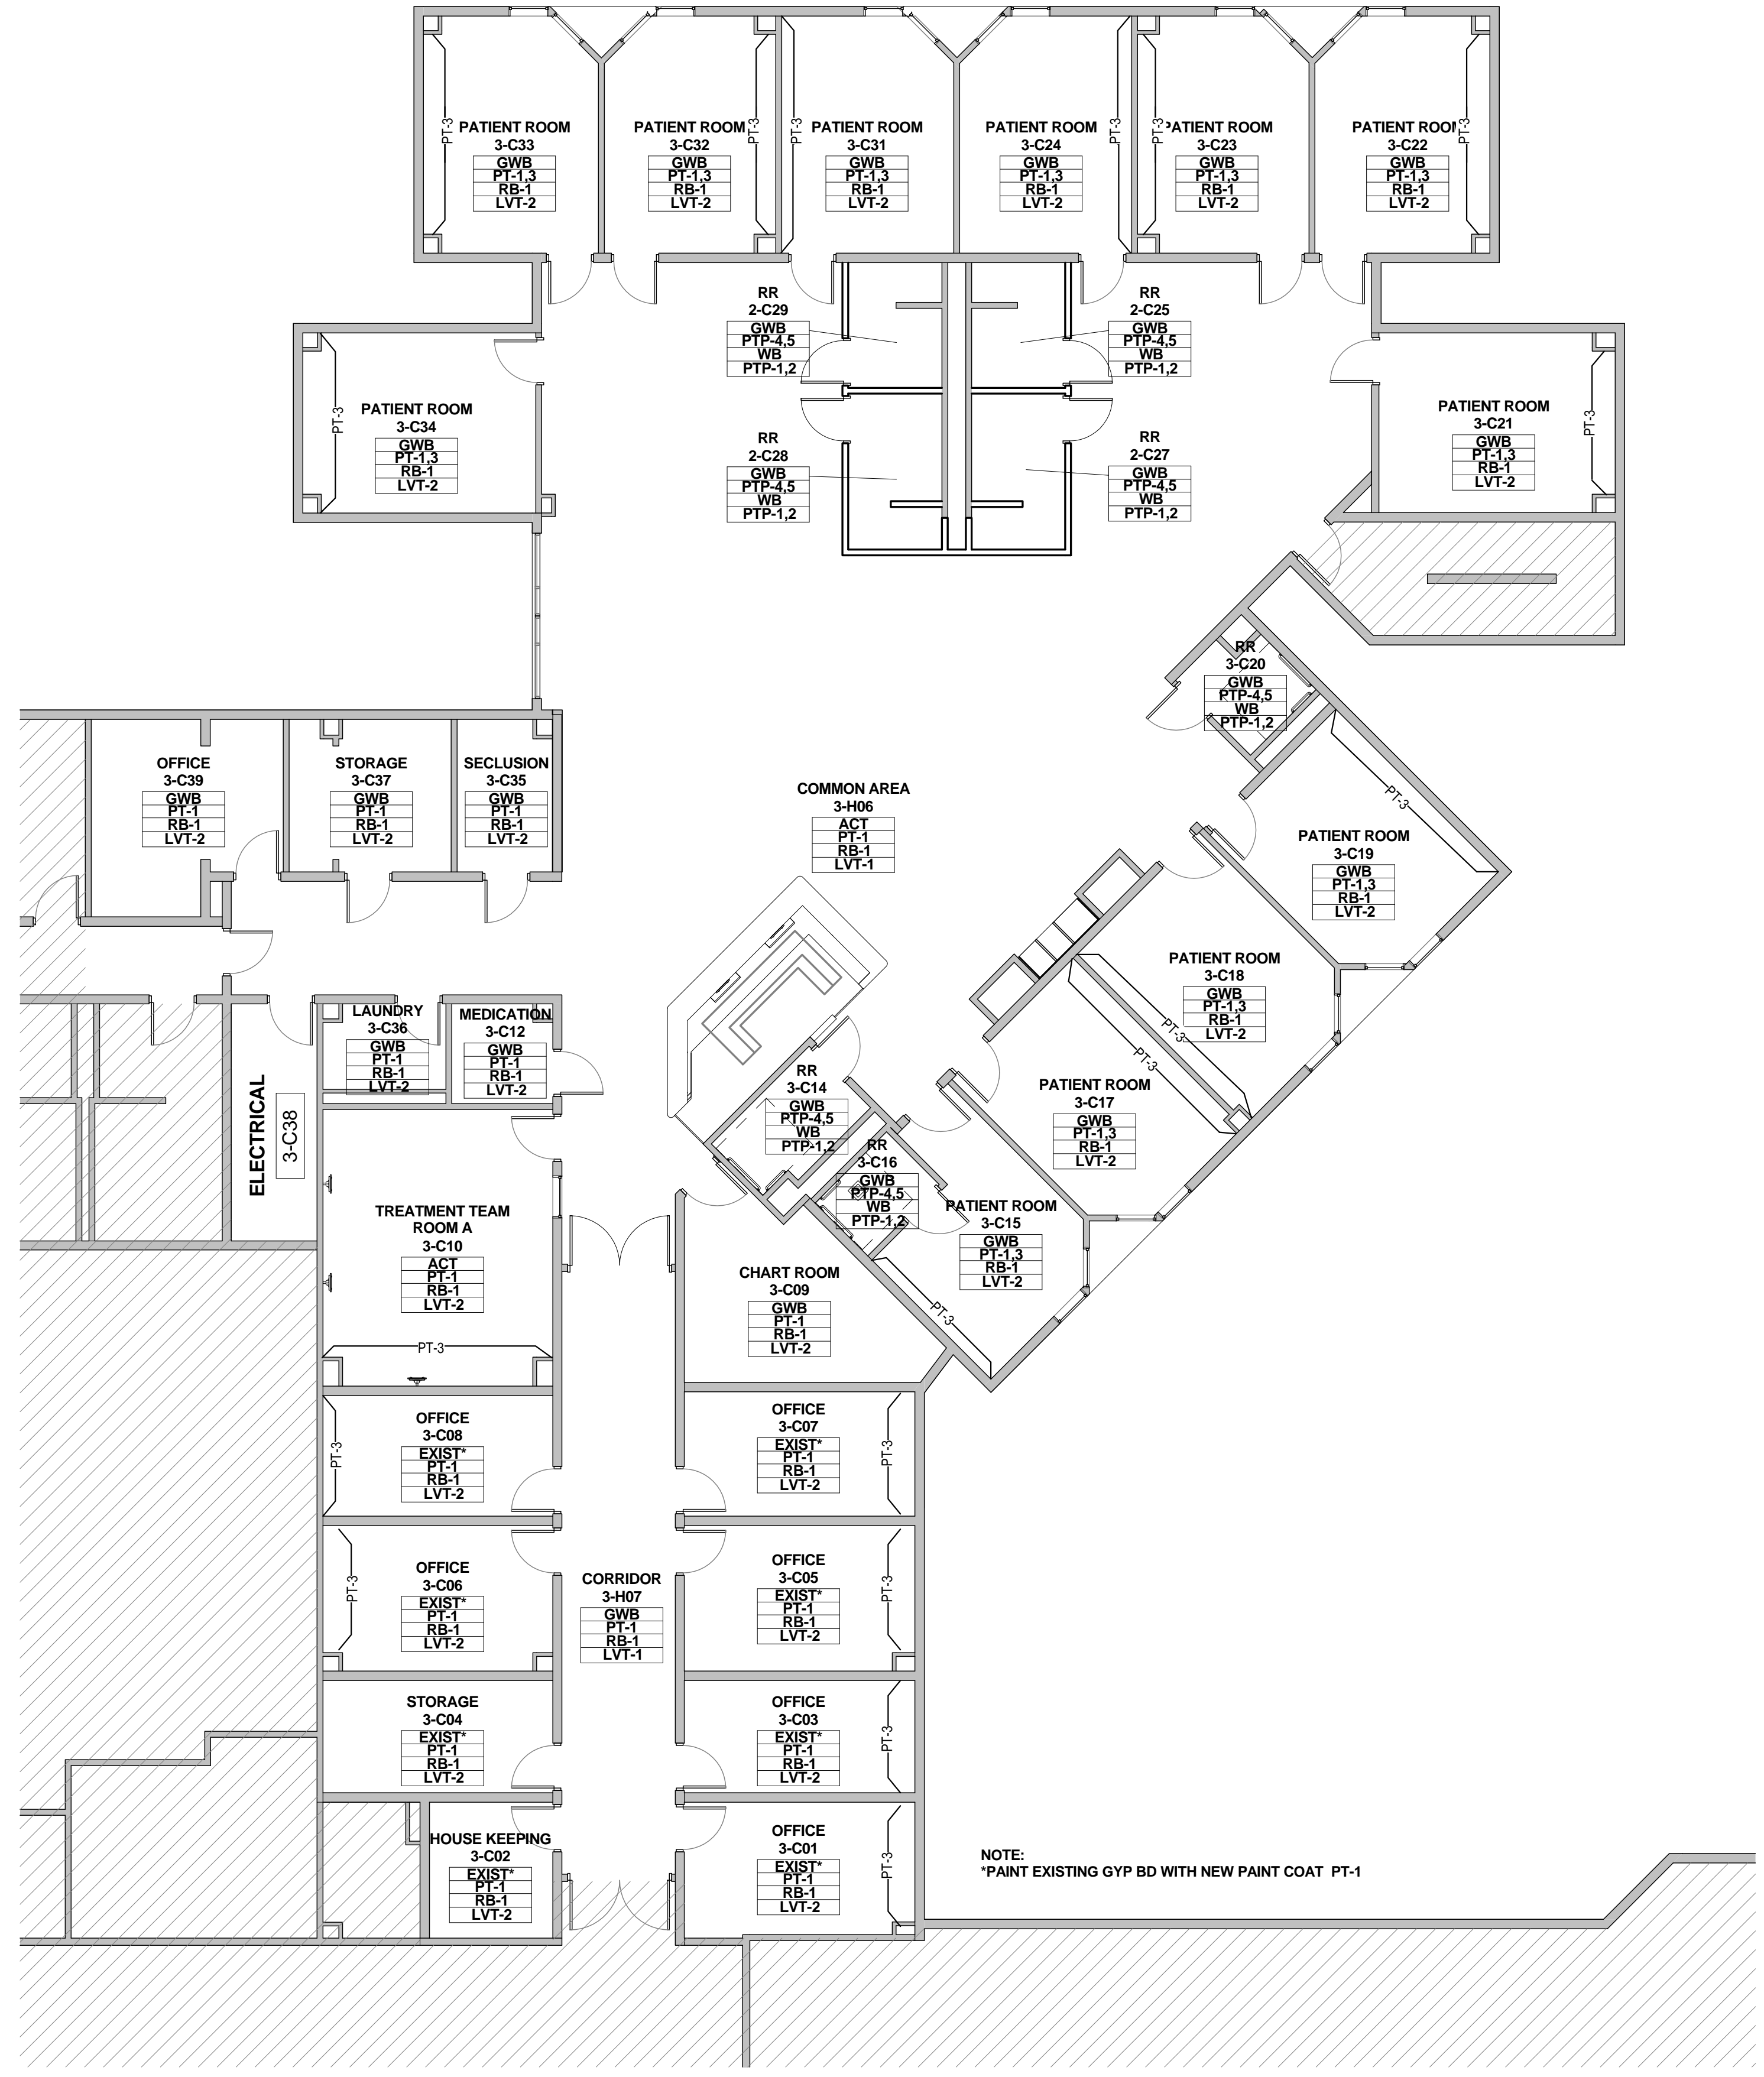

**GENERAL FINISH PLAN NOTES**

- REFER TO INTERIOR ELEVATIONS, AS REFERENCED ON ARCHITECTURAL PLANS, FOR ADDITIONAL INFORMATION.
- SUBMIT SAMPLES OF ALL SCHEDULED FINISHES FOR APPROVAL, PRIOR TO ORDERING.
- ALL INSTALLATION PROCEDURES SHALL BE IN ACCORDANCE WITH EACH MANUFACTURER'S INSTRUCTIONS.
- AFTER PROJECT COMPLETION, ALL FINISHES AND SURFACES TO BE THOROUGHLY CLEANED.
- ALL INTERIOR FINISHES FOR WALLS, CEILINGS AND FLOORS COMPLY WITH IBC 2012 SECTION 803 & 804:  
 \* FLOORING - VINYL FLOORING - FLOORING RADIANT PANEL TEST (ASTM-E-648) PASSES CLASS 1  
 \* WALL BASE - CLASS C  
 \* ACOUSTICAL CEILING - CLASS A
- ALL PAINT FINISHES PT-1 ON WALLS, UNLESS NOTED OTHERWISE.
- ALL NEW OR REPLACEMENT SUSPENDED CEILING TO BE 24x24 ACT, UNLESS NOTED OTHERWISE.

**FINISH PLAN LEGEND**

**ROOM FINISH TAG**

ACT	CEILING FINISH
WVC	WALL FINISH
RB	WALL BASE FINISH
VCT	FLOOR FINISH

**MILLWORK FINISH TAG**

SS-1	COUNTERTOPS, BENCHES / HORIZONTAL SURFACE FINISH
PL-2	MILLWORK IN AND OUT SIDE/ VERTICAL SURFACE FINISH

P1 DENOTES ACCENT WALL PAINT

• DENOTES MULTIPLE FINISHES. REFER TO ENLARGED PLANS AND/OR ELEVATIONS FOR INFORMATION.

1 KEYNOTE

CG PAWLING PRO-TEK MODEL CG-10 CORNER GUARD

SH SILL HEIGHT

**FINISH SECTIONS - CEILINGS**

GWB	GYPSON BOARD CEILING WITH CL-3 FINISH (ALL PATIENT ROOMS & RESTROOMS)
ACT	24X24 ACOUSTICAL CEILING SAND MICRO TILES (ALL PUBLIC AREAS AND SUPPORT/STAFF AREAS; REPLACE THROUGHOUT; ALL OTHER EXISTING ACT GRID TO BE PAINTED WHITE)
CL-3	SHERWIN WILLIAMS "EAGLET BEIGE" #7573, EGG SHELL FINISH

**FINISH SECTIONS - WALLS**

PT-1	SHERWIN WILLIAMS - SEMI-GLOSS LATEX ENAMEL "EAGLET BEIGE" # 7573
PT-3	SHERWIN WILLIAMS - SEMI-GLOSS LATEX ENAMEL "RAIN" # 6219
PTP-4	(WALL MAIN) AMERICAN OLEAN 10"X14" "DURANGO CREAM" # SC85 BRICK JOINT, VERTICALLY INSTALLED (RESTROOMS)
PTP-5	(WALL: ACCENT STRIP) AMERICAN OLEAN - GLASS & NATURAL STONE 3 X RANDOM MOSAIC "COLOR APPEAL: PACIFIC COAST BLEND" #C136 (RESTROOMS)
GBL-1	(PARTIAL WALL SHOWERS) GLASS BLOCKS 12x12x4 PITTSBURGH CORNING - "DECORA LX PATTERN"

**FINISH SECTIONS - FLOORING**

LVT-1	KARNDÉAN 36" X 6" - "OPUS: PALLEO" # WP312
LVT-2	KARNDÉAN 36" X 4" - "OPUS: GOLDEN TEAK" # WP513
PTP-1	BPI VINTAGEWOOD 6" X 36" PLANKS - "DUNE" # 62-700 (RESTROOM MAIN FLOOR)
PTP-2	AMERICAN OLEAN 2X2 MOSAIC - "SALCEDO: DURANGO CREAM" # SC85 (INSIDE SHOWER)

\*PATTERNS INDICATE DIRECTIONAL FLOOR PATTERN

**FINISH SECTIONS - WALL BASE**

RB-1	4" RUBBER WALL BASE TO BE STANDARD - FLEXCO - COVE "CAPPUCCINO" # 65
WB	WALL BASE: COVE TYPE TO MATCH FLOOR TILE TYPE AND SIZE (ALL RESTROOMS)

**FINISHES - DOOR & WINDOW FRAMES**

PT-8	PAINT- INTERIOR DOOR FRAMES - SHERWIN WILLIAMS PROMAR 200 INTERIOR ALKYD "DORMER BROWN"
------	---

**GROUT**

G-1	(BATHROOM WALL) LATICRETE "ANTIQUE WHITE" #23
G-2	(BATHROOM FLOOR) LATICRETE "BUTTERCREAM" #81

**FINISH SECTIONS - MILLWORK**



PL-1	WILSONART "DESERT ZEPHYR" #4841-60
PL-2	WILSONART #6257 (419) SATIN BRUSHED NATURAL ALUMINUM
PL-3	WILSONART #7951K-18 "ASIAN SUN"
CO-1	CORIAN "COTTAGE LINE"



ARCHITECTURE  
 PBK ARCHITECTS  
 11 Greenway Plaza, 22nd Floor  
 Houston, TX 77046  
 713.965.0659 P  
 713.961.4571 F  
 TX Firm F-33709  
 PBK.com

MEP  
 SHAH SMITH AND ASSOCIATES  
 2825 S Wilcrest Dr #300  
 HOUSTON, TX 77042  
 (713) 790 - 7963

**HARRIS COUNTY PSYCHIATRIC  
 CENTER RENOVATION UNITS: 1C,  
 2E, 3B, 3C, 3D & 3E**

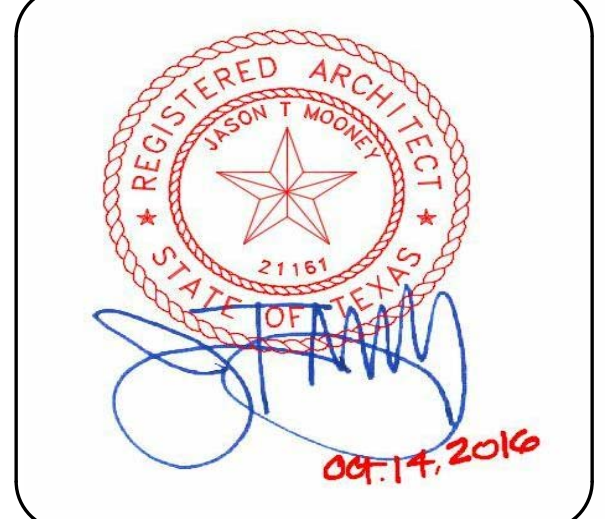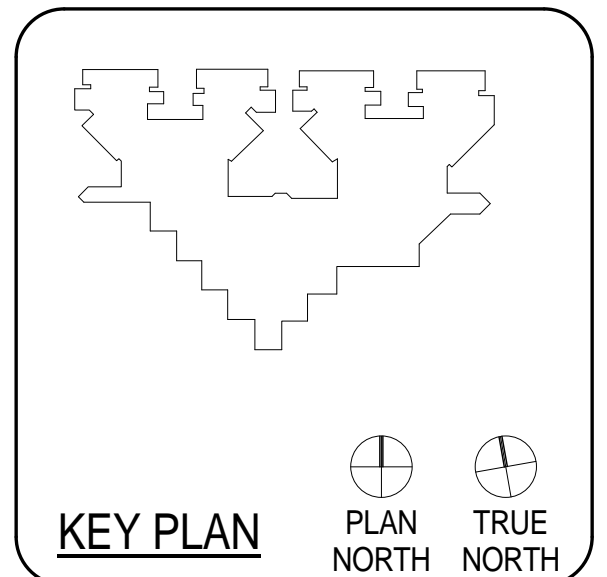

CLIENT	UT HEALTH	
PROJECT NUMBER	16106	
DATE:	OCTOBER 14, 2016	
DRAWN BY:	VG/BG	
CHECKED BY:	JM/JCS	
REVISIONS		
No.	Description	Date



ISSUE FOR BID

**THIRD FLOOR FINISH  
 PLAN - UNIT 3C**

**A2.22C**

\\pbk02\projects\_hou\1616106\Drawings\BIM\REV\T\MODEL\_CENTRALS\ARCH\16106-HCPC-A16\_Central.rvt  
 10/13/2016 2:28:42 PM



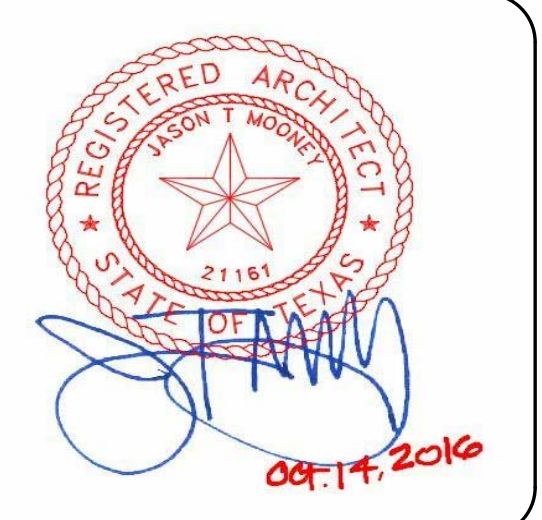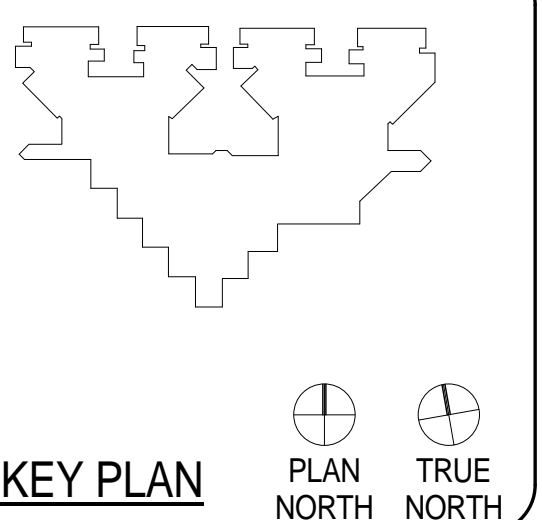

CLIENT		
UT HEALTH		
PROJECT NUMBER		
16106		
DATE:	OCTOBER 14, 2016	
DRAWN BY:	VG/BG	
CHECKED BY:	JM/CS	
REVISIONS		
No.	Description	Date

ISSUE FOR BID  
**THIRD FLOOR FINISH  
PLAN - UNIT 3D**

**A2.23D**

### GENERAL FINISH PLAN NOTES

- REFER TO INTERIOR ELEVATIONS, AS REFERENCED ON ARCHITECTURAL PLANS, FOR ADDITIONAL INFORMATION.
- SUBMIT SAMPLES OF ALL SCHEDULED FINISHES FOR APPROVAL, PRIOR TO ORDERING.
- ALL INSTALLATION PROCEDURES SHALL BE IN ACCORDANCE WITH EACH MANUFACTURER'S INSTRUCTIONS.
- AFTER PROJECT COMPLETION, ALL FINISHES AND SURFACES TO BE THOROUGHLY CLEANED.
- ALL INTERIOR FINISHES FOR WALLS, CEILINGS AND FLOORS COMPLY WITH IBC 2012 SECTION 803 & 804.  
\* FLOORING - VINYL FLOORING - FLOORING RADIANT PANEL TEST (ASTM-E-648) - PASSES CLASS 1  
\* WALL BASE - CLASS C  
\* ACOUSTICAL CEILING - CLASS A
- ALL PAINT FINISHES PT-1 ON WALLS; UNLESS NOTED OTHERWISE.
- ALL NEW OR REPLACEMENT SUSPENDED CEILING TO BE 24x24 ACT, UNLESS NOTED OTHERWISE.

### FINISH PLAN LEGEND

- ROOM FINISH TAG**
- ACT - CEILING FINISH
  - WVC - WALL FINISH
  - RB - WALL BASE FINISH
  - VCT - FLOOR FINISH
- MILLWORK FINISH TAG**
- SS-1 - COUNTERTOPS, BENCHES / HORIZONTAL SURFACE FINISH
  - PL-2 - MILLWORK IN AND OUT SIDE/ VERTICAL SURFACE FINISH
  - P1 - DENOTES ACCENT WALL PAINT
  - - DENOTES MULTIPLE FINISHES. REFER TO ENLARGED PLANS AND/OR ELEVATIONS FOR INFORMATION.
  - I - KEYNOTE
  - CG - PAWLING PRO-TEK MODEL CG-10 CORNER GUARD
  - SH - SILL HEIGHT

### FINISH SECTIONS - CEILINGS

- GWB - GYPSUM BOARD CEILING WITH CL-3 FINISH (ALL PATIENT ROOMS & RESTROOMS)
- ACT - 24X24 ACOUSTICAL CEILING SAND MICRO TILES (ALL PUBLIC AREAS AND SUPPORT/STAFF AREAS, REPLACE THROUGHOUT; ALL OTHER EXISTING ACT GRID TO BE PAINTED WHITE)
- CL-3 - SHERWIN WILLIAMS "EAGLET BEIGE" #7573, EGGSHELL FINISH

### FINISH SECTIONS - WALLS

- PT-1 - SHERWIN WILLIAMS - SEMI-GLOSS LATEX ENAMEL "EAGLET BEIGE" # 7573
- PT-3 - SHERWIN WILLIAMS - SEMI-GLOSS LATEX ENAMEL "RAIN" # 6219
- PTP-4 - (WALL MAIN) AMERICAN OLEAN 10"X14" "DURANGO CREAM" # SC85 BRICK JOINT, VERTICALLY INSTALLED (RESTROOMS)
- PTP-5 - (WALL: ACCENT STRIP) AMERICAN OLEAN - GLASS & NATURAL STONE 3 X RANDOM MOSAIC "COLOR APPEAL: PACIFIC COAST BLEND" #C136 (RESTROOMS)
- GBL-1 (PARTIAL WALL SHOWERS) GLASS BLOCKS 12x12x4 PITTSBURGH CORNING - "DECORA LX PATTERN"

### FINISH SECTIONS - FLOORING

- LVT-1 : KARNDUAN 36" X 6" - "OPUS: PALLEO" # WP312
  - LVT-2 : KARNDUAN 36" X 4" - "OPUS: GOLDEN TEAK" # WP513
  - PTP-1 : BPI VINTAGEWOOD 6" X 36" PLANKS - "DUNE" # 62-700 (RESTROOM MAIN FLOOR)
  - PTP-2 : AMERICAN OLEAN 2X2 MOSAIC - "SALCEDO: DURANGO CREAM" # SC85 (INSIDE SHOWER)
- \* PATTERNS INDICATE DIRECTIONAL FLOOR PATTERN

### FINISH SECTIONS - WALL BASE

- RB-1 4" RUBBER WALL BASE TO BE STANDARD - FLEXCO - COVE "CAPPUCCINO" # 65
- WB WALL BASE: COVE TYPE TO MATCH FLOOR TILE TYPE AND SIZE (ALL RESTROOMS)

### FINISHES - DOOR & WINDOW FRAMES


- PT-8 PAINT- INTERIOR DOOR FRAMES - SHERWIN WILLIAMS PROMAR 200 INTERIOR ALKYD "DORMER BROWN"

### GROUT

- G-1 (BATHROOM WALL) LATICRETE "ANTIQUE WHITE" #23
- G-2 (BATHROOM FLOOR) LATICRETE "BUTTERCREAM" #81



### FINISH SECTIONS - MILLWORK

- PL-1 WILSONART "DESERT ZEPHYR" #4841-60
- PL-2 WILSONART #6257 (419) SATIN BRUSHED NATURAL ALUMINUM
- PL-3 WILSONART #7951K-18 "ASIAN SUN"
- CO-1 CORIAN "COTTAGE LINE"

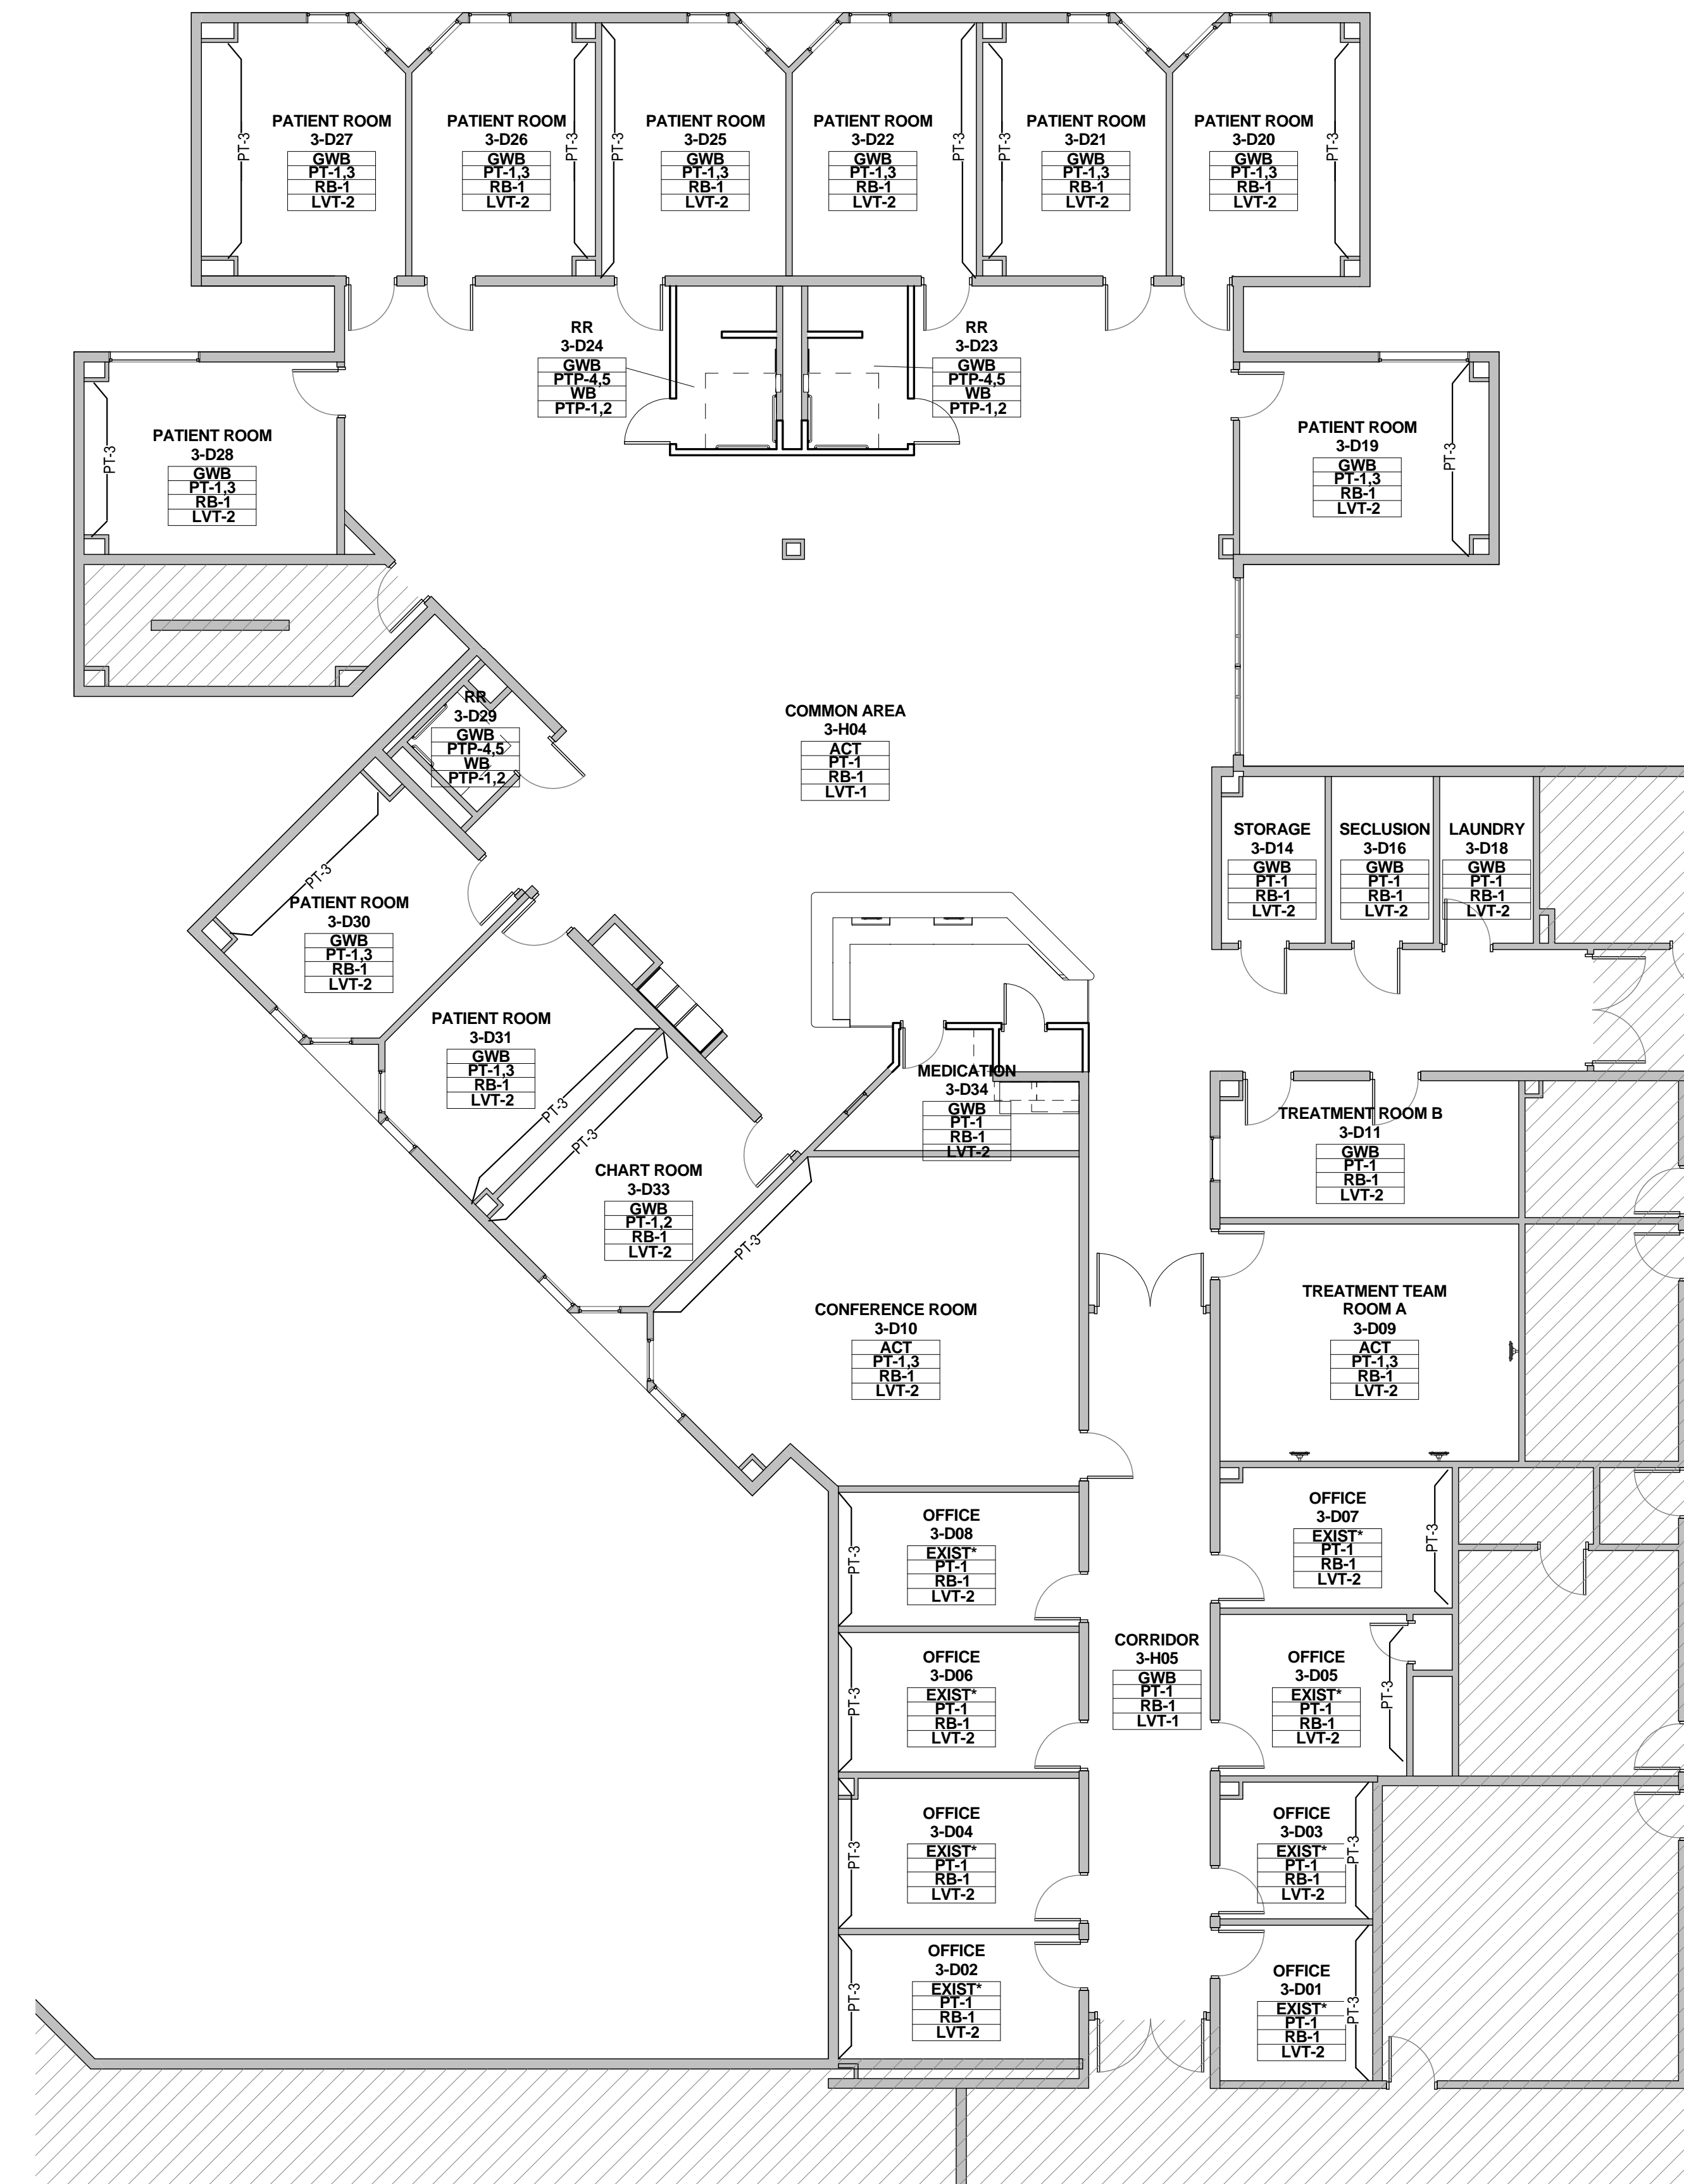

NOTE:  
\*PAINT EXISTING GYP BD WITH NEW PAINT COAT PT-1



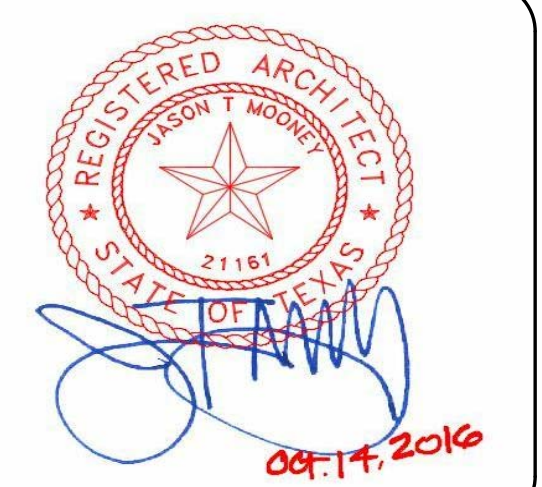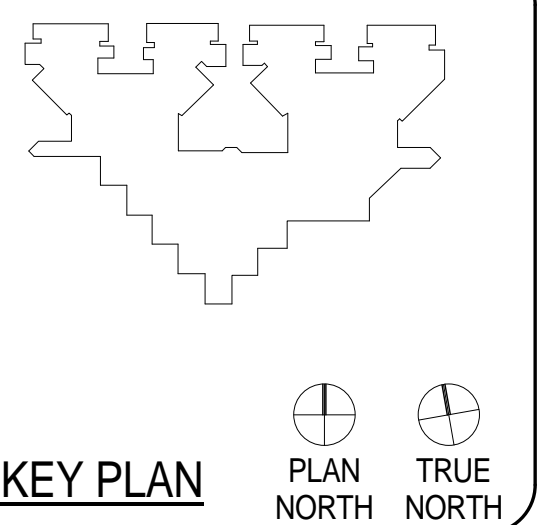

CLIENT	UT HEALTH	
PROJECT NUMBER	16106	
DATE:	OCTOBER 14, 2016	
DRAWN BY:	VG/BG	
CHECKED BY:	JM/CS	
REVISIONS		
No.	Description	Date

ISSUE FOR BID

**THIRD FLOOR FINISH  
PLAN - UNIT 3E**

**A2.24E**

**GENERAL FINISH PLAN NOTES**

- REFER TO INTERIOR ELEVATIONS, AS REFERENCED ON ARCHITECTURAL PLANS, FOR ADDITIONAL INFORMATION.
- SUBMIT SAMPLES OF ALL SCHEDULED FINISHES FOR APPROVAL, PRIOR TO ORDERING.
- ALL INSTALLATION PROCEDURES SHALL BE IN ACCORDANCE WITH EACH MANUFACTURER'S INSTRUCTIONS.
- AFTER PROJECT COMPLETION, ALL FINISHES AND SURFACES TO BE THOROUGHLY CLEANED.
- ALL INTERIOR FINISHES FOR WALLS, CEILINGS AND FLOORS COMPLY WITH IBC 2012 SECTION 803 & 804:  
\* FLOORING - VINYL FLOORING - FLOORING RADIANT PANEL TEST (ASTM-E-648) PASSES CLASS 1  
\* WALL BASE - CLASS C  
\* ACOUSTICAL CEILING - CLASS A
- ALL PAINT FINISHES PT-1 ON WALLS, UNLESS NOTED OTHERWISE.
- ALL NEW OR REPLACEMENT SUSPENDED CEILING TO BE 24x24 ACT, UNLESS NOTED OTHERWISE.

**FINISH PLAN LEGEND**

- ROOM FINISH TAG**
- ACT CEILING FINISH
  - WB WALL FINISH
  - RB WALL BASE FINISH
  - LVT FLOOR FINISH
- MILLWORK FINISH TAG**
- SS-1 COUNTERTOPS, BENCHES / HORIZONTAL SURFACE FINISH
  - PL-2 MILLWORK IN AND OUT SIDE/ VERTICAL SURFACE FINISH
- P1 DENOTES ACCENT WALL PAINT
- DENOTES MULTIPLE FINISHES. REFER TO ENLARGED PLANS AND/OR ELEVATIONS FOR INFORMATION.
- 1 KEYNOTE
- CG PAWLING PRO-TEK MODEL CG-10 CORNER GUARD
- SH SILL HEIGHT

**FINISH SECTIONS - CEILINGS**

- GWB GYPSUM BOARD CEILING WITH CL-3 FINISH (ALL PATIENT ROOMS & RESTROOMS)
- ACT 24X24 ACOUSTICAL CEILING SAND MICRO TILES (ALL PUBLIC AREAS AND SUPPORT/STAFF AREAS; REPLACE THROUGHOUT; ALL OTHER EXISTING ACT GRID TO BE PAINTED WHITE)
- CL-3 SHERWIN WILLIAMS 'EAGLET BEIGE' #7573, EGGSELL FINISH

**FINISH SECTIONS - WALLS**

- PT-1 SHERWIN WILLIAMS - SEMI-GLOSS LATEX ENAMEL 'EAGLET BEIGE' # 7573
- PT-3 SHERWIN WILLIAMS - SEMI-GLOSS LATEX ENAMEL 'RAIN' # 6219
- PTP-4 (WALL MAIN) AMERICAN OLEAN 10'X14" 'DURANGO CREAM' # SC85 BRICK JOINT, VERTICALLY INSTALLED (RESTROOMS)
- PTP-5 (WALL: ACCENT STRIP) AMERICAN OLEAN - GLASS & NATURAL STONE 3 X RANDOM MOSAIC 'COLOR APPEAL: PACIFIC COAST BLEND' #C136 (RESTROOMS)
- GBL-1 (PARTIAL WALL SHOWERS) GLASS BLOCKS 12x12x4 PITTSBURGH CORNING - 'DECORA LX PATTERN'

**FINISH SECTIONS - FLOORING**

- LVT-1: KARNDIAN 36" X 6" - 'OPUS: PALLEO' # WP312
  - LVT-2: KARNDIAN 36" X 4" - 'OPUS: GOLDEN TEAK' # WP513
  - PTP-1: BPI VINTAGEWOOD 6" X 36" PLANKS - 'DUNE' # 62-700 (RESTROOM MAIN FLOOR)
  - PTP-2: AMERICAN OLEAN 2X2 MOSAIC - 'SALCEDO: DURANGO CREAM' # SC85 (INSIDE SHOWER)
- \*PATTERNS INDICATE DIRECTIONAL FLOOR PATTERN

**FINISH SECTIONS - WALL BASE**

- RB-1 4" RUBBER WALL BASE TO BE STANDARD - FLEXCO - COVE 'CAPPUCCINO' # 65
- WB WALL BASE: COVE TYPE TO MATCH FLOOR TILE TYPE AND SIZE (ALL RESTROOMS)

**FINISHES - DOOR & WINDOW FRAMES**


- PT-8 PAINT- INTERIOR DOOR FRAMES - SHERWIN WILLIAMS PROMAR 200 INTERIOR ALKYD 'DORMER BROWN'

**GROUT**

- G-1 (BATHROOM WALL) LATICRETE 'ANTIQUE WHITE' #23
- G-2 (BATHROOM FLOOR) LATICRETE 'BUTTERCREAM' #81

**FINISH SECTIONS - MILLWORK**

- PL-1 WILSONART 'DESERT ZEPHYR' #4841-60
- PL-2 WILSONART #6257 (419) SATIN BRUSHED NATURAL ALUMINUM
- PL-3 WILSONART #7951K-18 'ASIAN SUN'
- CO-1 CORIAN 'COTTAGE LINE'

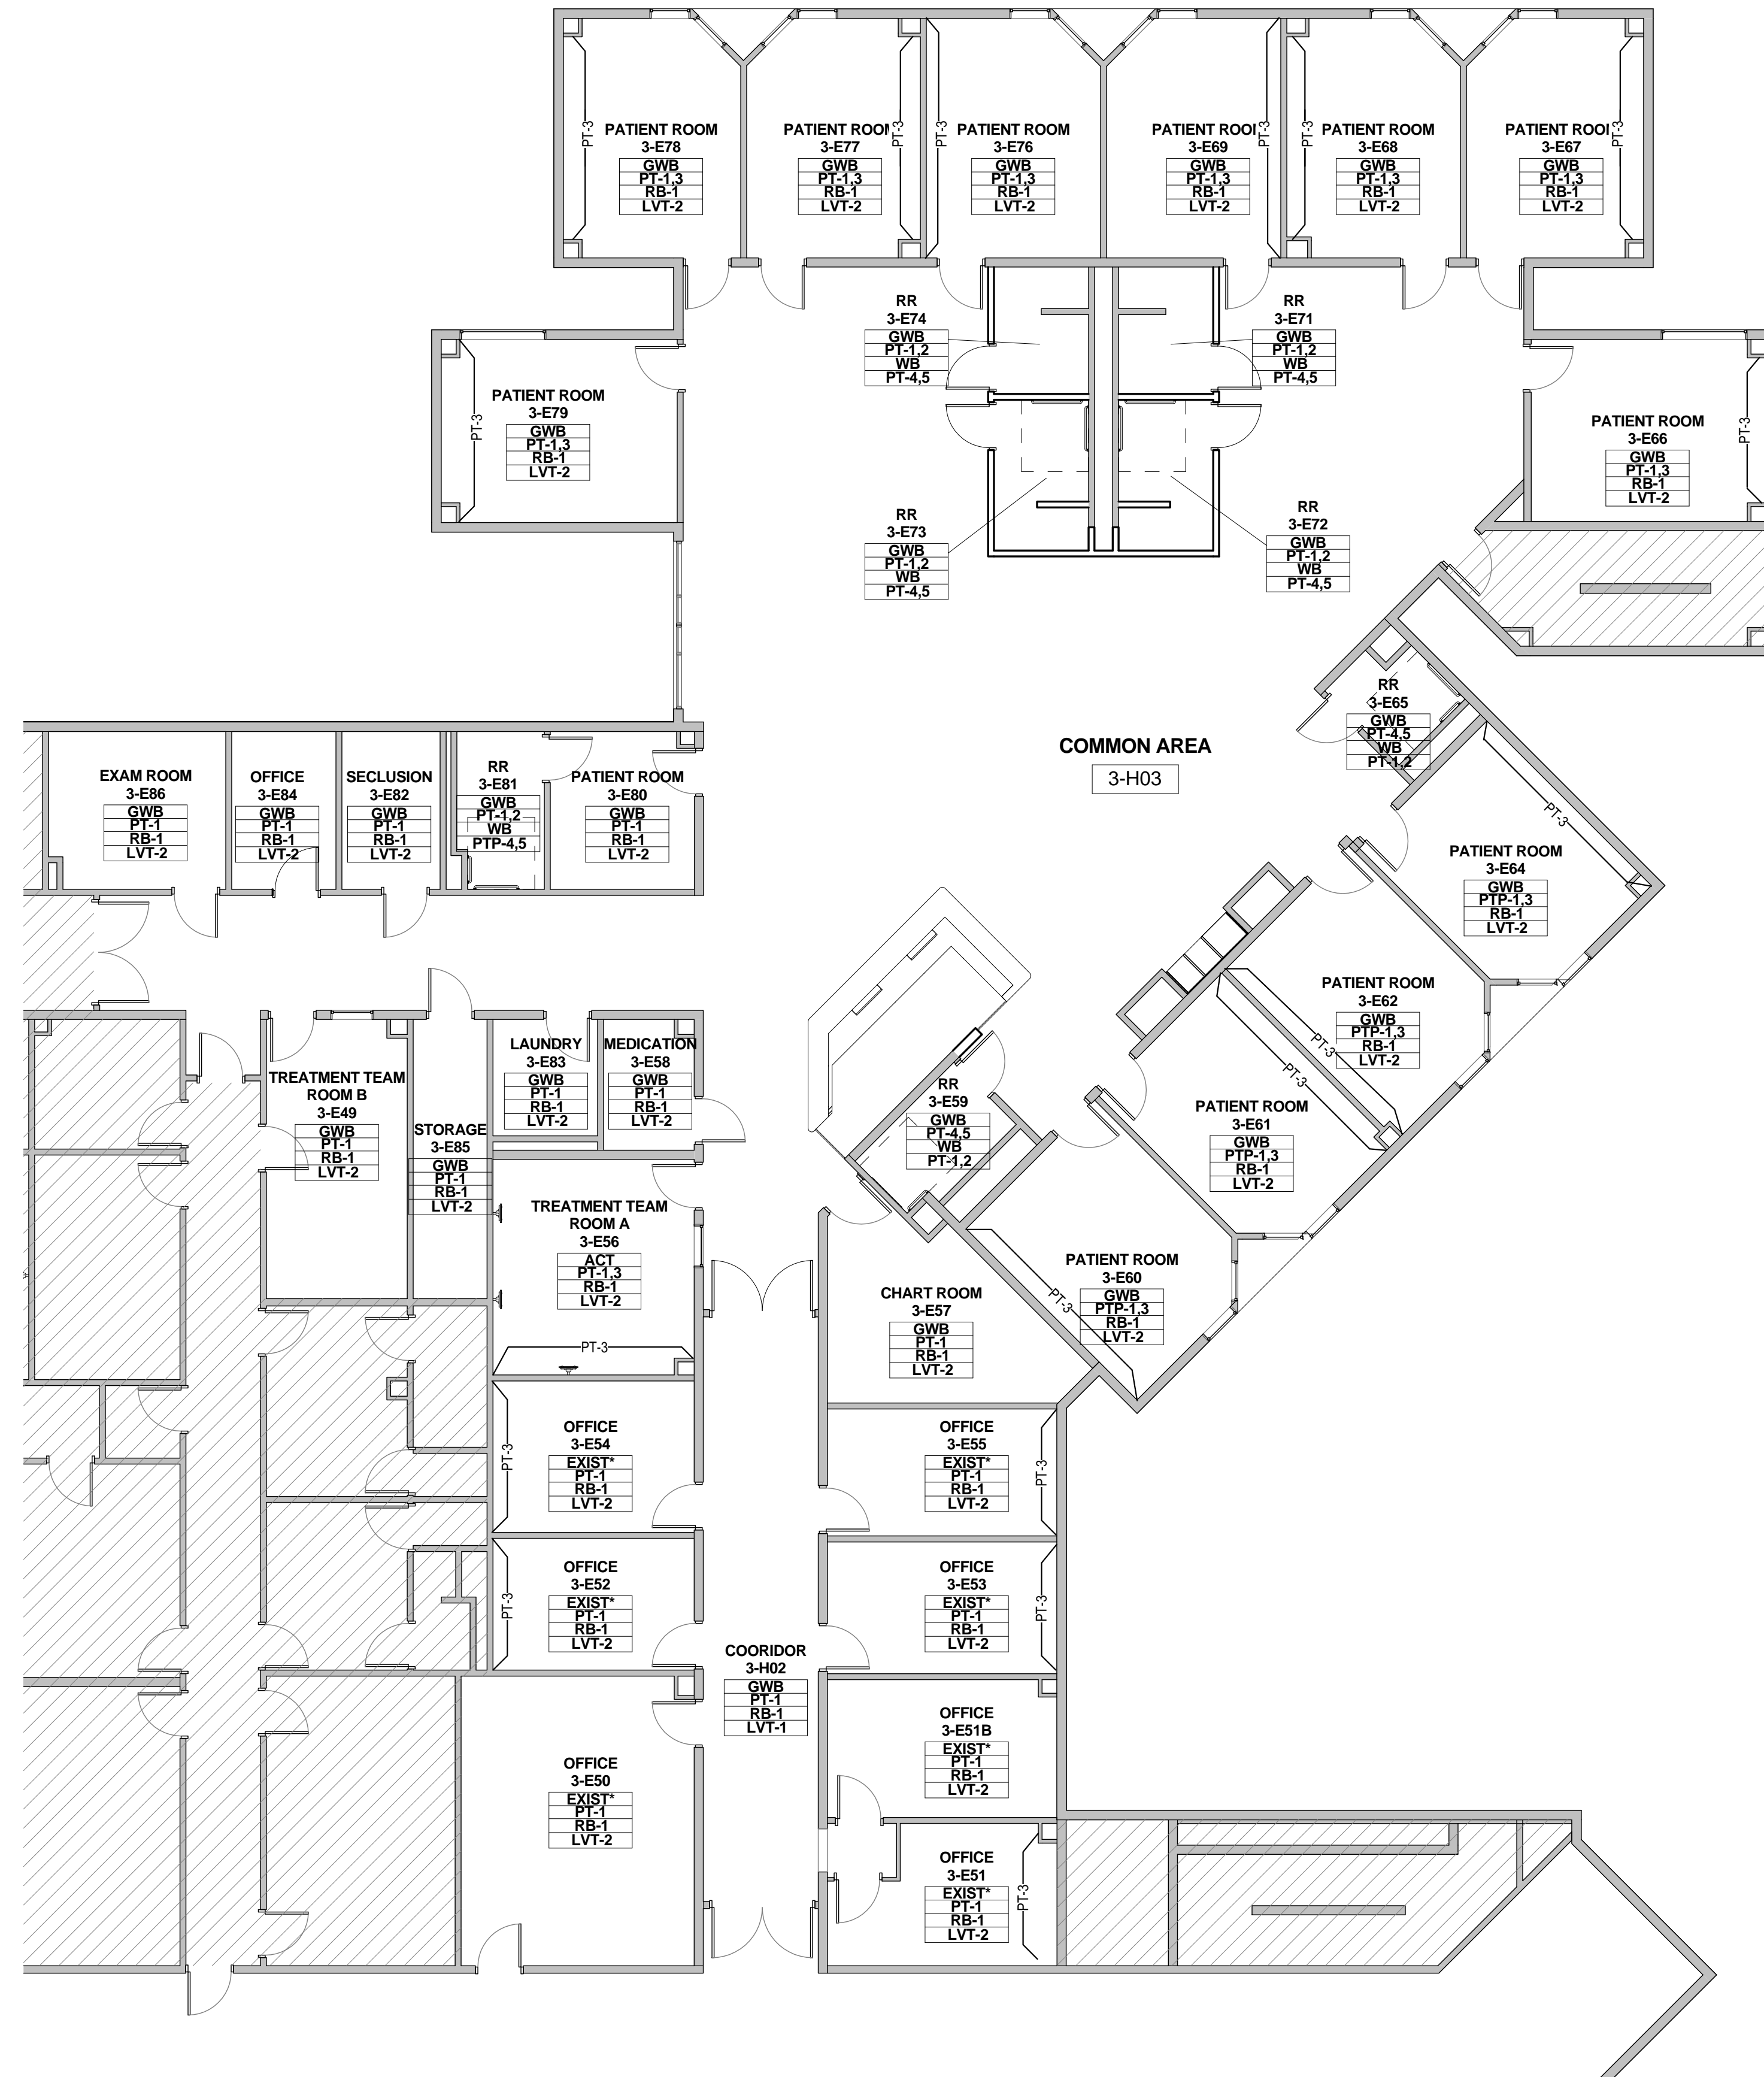

NOTE:  
\*PAINT EXISTING GYP BD WITH NEW PAINT COAT PT-1



**GENERAL NOTES**

1. VERIFY DIMENSIONS AND EXISTING CONDITIONS BEFORE COMMENCING WORK. REPORT DISCREPANCIES TO THE ARCHITECT PRIOR TO PROCEEDING WITH AFFECTED WORK.
2. REFLECTING CEILING PLAN DIMENSIONS ARE REFERENCED FROM FINISHED SURFACES UNLESS NOTED OTHERWISE. CEILING HEIGHTS ARE DIMENSIONED FROM FLOOR TO FINISHED CEILING HEIGHT.
3. DIMENSIONS NOTED AS "FIELD VERIFY" SHALL BE CHECKED AT THE SITE BY THE CONTRACTOR AND REVIEWED WITH THE ARCHITECT BEFORE INCORPORATING INTO THE WORK.
4. DO NOT SCALE DRAWING. WRITTEN DIMENSIONS TAKE PRECEDENCE. IF CLARIFICATION IS REQUIRED IN ORDER TO DETERMINE THE INTENT OF THE CONTRACT DOCUMENTS, CONTACT THE ARCHITECT.
5. NOTES OR DIMENSIONS LABELED "TYPICAL" SHALL APPLY TO SITUATIONS THAT ARE THE SAME OR SIMILAR.
6. ALL INTERIOR PARTITIONS SHALL BE KEYS AS REFERENCE SHEET A7.00 FOR PARTITION TYPES.
7. ALL DIMENSIONS ARE TO FACE OF FINISHED WALL UNLESS NOTED OTHERWISE.
8. ALL SPACES WITH FLOOR DRAINS TO HAVE FINISHED FLOORS SLOPED TO DRAIN NOT TO EXCEED ONE IN FIFTY.
9. ALL FLOOR FINISH CHANGES SHALL OCCUR AT THE CENTERLINE OF DOORS UNLESS NOTED OTHERWISE. ALL FLOOR FINISH CHANGES SHALL HAVE THRESHOLDS OR REDUCER STRIPS.
10. ALL DOORS IN INTERIOR GYP. BD STUD WALLS SHALL BE SET 4" OFF THE PERP. ADJ. WALL ON THE HINGE SIDE OF THE DOOR UNLESS NOTED OTHERWISE. THE CONTRACTOR SHALL CONTACT THE ARCHITECT IF ANY CONFLICT OCCURS.
11. PROVIDE VINYL REDUCERS AT ALL DISSIMILAR FLOOR MATERIALS UNLESS OTHERWISE NOTED.
12. UNLESS OTHERWISE NOTED, ALL ELECTRICAL AND MECHANICAL OPERABLE DEVICES SHALL BE MOUNTED WITH THE HIGHEST OPERABLE CONTROL AT 42" AFF.
13. ALL REQUIRED CLEARANCES, AS DESCRIBED IN THE TEXAS ACCESSIBILITY STANDARDS (TAS) OF THE ARCHITECTURAL BARRIERS ACT (LEI) 9102, TEXAS CIVIL STATUTES (2012) FOR COUNTERTOPS, ALL PLUMBING FIXTURES INCLUDING DRINKING FOUNTAINS, LAVATORIES, URINALS, AND TOILETS WILL BE STRICTLY ENFORCED.

**DEMOLITION - KEYED NOTES**


- NOTE: REFER TO ENLARGED PLANS FOR ADDITIONAL KEYED NOTE LOCATIONS IF NOT VISIBLE ON THIS SHEET.
- 01 TYPICAL: REMOVE EXISTING MILLWORK AND/OR TRASH UNIT AND STORE FOR REINSTALLATION; COORDINATE EXACT REQUIREMENTS IN FIELD.
  - 02 REMOVE ALL EXISTING FLOORING, WALL FINISHES, FIXTURES AND ACCESSORIES; REFER TO MEP DRAWINGS FOR ADDITIONAL INFO PERTAINING TO FIXTURES; PREP EXISTING SUBSTRATES TO REMAIN FOR RECEIPT OF NEW FINISHES.
  - 03 REMOVE EXISTING DOOR AND FRAME, SALVAGE DOORS AND RETURN TO BUILDING STOCK; RE: RENOVATION PLAN
  - 04 TYPICAL: REMOVE ALL WALL-MOUNTED ACCESSORIES (IE, BULLETIN BOARDS, SIGNAGE, ETC.) AND STORE FOR REINSTALLATION; COORDINATE EXACT REQUIREMENTS IN FIELD.
  - 05 REMOVE EXISTING VINYL OR TILE FLOORING AND WALL BASE; PREP EXISTING SUBSTRATE FOR RECEIPT OF NEW FINISHES; RE: FINISH PLANS; COORDINATE TEMPORARY REMOVAL OF ANY FURNITURE AND EQUIPMENT WITH OWNER.
  - 06 DEMOLISH EXISTING NURSE STATION
  - 07 DEMOLISH EXISTING WALLS WHERE INDICATED DASHED; COORDINATE EXACT REQUIREMENTS IN FIELD
  - 08 EXISTING CHASE WALL TO REMAIN; REMOVE FINISHES ONLY
  - 09 REMOVE EXISTING NOURISHMENT STATION/DOORS, NOURISHMENT STATION TO REMAIN; PROTECT IN PLACE
  - 10 EXISTING TELEPHONE BANK/MILLWORK TO REMAIN; PROTECT IN PLACE
  - 11 COORDINATE WITH OWNER TEMPORARY REMOVAL OF EXISTING SIGNAGE, WALL-MOUNTED ACCESSORIES AND WALL-MOUNTED DEVICES TO PREPARE FOR APPLICATION OF NEW WALL FINISHES, TYPICAL THROUGHOUT
  - 12 REMOVE EXISTING FLOORING ONLY
  - 13 ALTERNATE NO.
  - 14 EXISTING FLOORING AND WALL BASE TO REMAIN
  - 15 REMOVE EXISTING FLOORING AND WALL BASE; PREP EXISTING SUBSTRATE FOR RECEIPT OF NEW FINISHES; RE: FINISH PLANS; COORDINATE TEMPORARY REMOVAL OF ANY FURNITURE AND EQUIPMENT WITH OWNER
  - 16 ALTERNATE NO.

**RENOVATION - KEYED NOTES**


- NOTE: REFER TO ENLARGED PLANS FOR ADDITIONAL KEYED NOTE LOCATIONS IF NOT VISIBLE ON THIS SHEET.
- 01 INSTALL SCHEDULED FLOORING & BASE; RE: FINISH PLAN
  - 02 APPLY SCHEDULED WALL FINISH THROUGHOUT; RE: FINISH PLAN
  - 03 REINSTALL EXISTING MILLWORK, WALL-MOUNTED DEVICES, AND EQUIPMENT AS NEEDED; COORDINATE WITH OWNER IN FIELD
  - 04 INSTALL NEW CEILING, WALL FINISHES, PLUMBING FIXTURES AND FLOORING FINISHES
  - 05 RE-PAINT ALL EXISTING WALLS WITHIN THIS AREA WITH PT-1; EXISTING FLOORING IS ALSO TO BE REMOVED AS PART OF BASE SCOPE OF WORK; FLOORING REPLACEMENT AND WALL PAINTING SHALL BOTH OCCUR OVER THE COURSE OF ONE WEEKEND (FRIDAY THROUGH SUNDAY); COORDINATE REMOVAL AND REINSTALLATION OF ANY FURNITURE, FIXTURES, AND EQUIPMENT ITEMS IN FIELD WITH OWNER.
  - 06 IN LIEU OF TYPICAL WALL PAINT, APPLY CHALKBOARD PAINT TO EXISTING WALL OPPOSITE FROM PATIENT BEDS IN THE ROOM (CONFIRM IN FIELD); CHALKBOARD PAINT IS TO EXTEND FROM EXISTING DESK HEIGHT TO ALIGN WITH THE TOP OF THE EXISTING DOOR FRAME AND FOR THE FULL LENGTH OF THE WALL
  - 07 ALTERNATE NO.
  - 08 ALTERNATE NO.
  - 09 REMOVE THE EXISTING NURSE STATION AND REPLACE WITH A NEW NURSE STATION TO MATCH THE CONFIGURATION AND FINISHES AS BUILT IN UNITS 1D AND 2B WITH EXCEPTIONS AS NOTED AND DEPICED IN DETAILS WITHIN MODIFY EXISTING CORING WITHIN THE FLOOR SLAB AS NEEDED TO ACCOMMODATE THE NEW NURSE STATION CONFIGURATION; EXISTING CEILING IS TO REMAIN IN THIS AREA. NO FURR-DOWNS ARE TO BE INSTALLED ABOVE THE NEW NURSE STATION
  - 10 ALTERNATE NO.
  - 11 RE: INTERIOR ELEVATIONS FOR EXISTING NOURISHMENT STATION MODIFICATIONS
  - 12 ALTERNATE NO.

**GENERAL DEMOLITION NOTES:**


1. THE DEMOLITION PLAN OUTLINES SOME OF THE SCOPE OF THE WORK INVOLVED FOR THE DEMOLITION PHASE OF THIS PROJECT. CONTRACTOR SHALL REVIEW ALL SHEETS FOR ADDITIONAL DEMO SCOPE.
2. CONTRACTOR SHALL VERIFY EXISTING SITE AND BUILDING CONDITIONS AND DIMENSIONS IN THE FIELD PRIOR TO COMMENCING DEMOLITION ACTIVITIES. CONTRACTOR SHALL NOT SCALE DRAWINGS. CONTRACTOR WILL NOTIFY ARCHITECT OF ANY DISCREPANCIES IN WRITING.
3. AFTER AWARD OF THE CONTRACT, CHANGE ORDER REQUESTS FOR ADDITIONAL MONEY WILL NOT BE APPROVED IF THE WORK COULD HAVE BEEN ANTICIPATED DURING A SITE VISIT BY THE CONTRACTOR.
4. CONTRACTOR WILL BE REQUIRED TO REPAIR, REPLACE, OR PATCH EXISTING BUILDINGS, DRIVEWAYS, SIDEWALKS, CANOPIES, AND/OR PARKING AREAS DISTURBED BY DEMOLITION.
5. CONTRACTOR WILL BE REQUIRED TO REGRADE AND HYDROMULCH AREAS AFFECTED BY DEMOLITION.
6. ALL FURNITURE WILL BE REMOVED OR RELOCATED BY THE OWNER AS NECESSARY PRIOR TO THE DEMOLITION WORK OF THIS PROJECT. CONTRACTOR SHALL COORDINATE WITH OWNER AS REQUIRED.
7. REMOVE EXISTING CONSTRUCTION TO THE EXTENT INDICATED ON THE DRAWINGS. SHOULD ANY DAMAGE OCCUR TO ANY EXISTING CONSTRUCTION TO REMAIN, THE CONTRACTOR SHALL REPAIR THE DAMAGE TO MATCH EXISTING ADJACENT CONSTRUCTION.
8. CONTRACTOR IS TO VERIFY THE EXACT LOCATION OF ALL EXISTING UTILITIES PRIOR TO DEMOLITION ACTIVITIES.
9. CONTRACTOR SHALL REMOVE DEBRIS REGULARLY AS NECESSARY TO ELIMINATE INTERFERENCE WITH ROADS, STREET, WALKS, AND ALL OTHER ADJACENT FACILITIES.
10. CONTRACTOR IS RESPONSIBLE FOR CONSTRUCTION OF TEMPORARY DUST AND/OR SOUND PARTITIONS BETWEEN CONSTRUCTION AREA AND AREAS NOT IN SCOPE AS NECESSARY. DEMOLITION ACTIVITIES SHALL BE PERFORMED SO AS TO PRODUCE MINIMAL DISTURBANCE TO EXISTING FACILITY AND OCCUPANTS (I.E. MINIMIZE EXCESSIVE AND PROLONGED NOISE LEVELS AND DUST).
11. NOTIFY THE BUILDING OWNER OF ANY MATERIALS, FIXTURES, ETC. TO BE REMOVED THAT ARE DEEMED SALVAGEABLE. TURN OVER ANY REQUESTED ITEMS TO THE BUILDING OWNER IN GOOD CONDITION.
12. THE CONTRACTOR SHALL REMOVE ALL TRASH AND DEBRIS FROM THE SITE ON A DAILY BASIS.
13. MAINTAIN THE INTEGRITY OF ALL EXISTING RATED WALLS, FIRE SEAL ANY PENETRATIONS WITH U.L. APPROVED ASSEMBLY.
14. WHEN UNANTICIPATED MECHANICAL, ELECTRICAL, OR STRUCTURAL ELEMENTS THAT CONFLICT WITH THE INTENDED FUNCTION OR DESIGN ARE ENCOUNTERED, DETERMINE THE NATURE AND EXTENT OF THE CONFLICT AND NOTIFY THE ARCHITECT IMMEDIATELY FOR RESOLUTION.
15. CONTRACTOR SHALL PROVIDE TRAFFIC HANDLING MEASURES AS NECESSARY TO PROTECT THE GENERAL PUBLIC AT ALL TIMES, AND AS REQUIRED BY GOVERNING AUTHORITIES.
16. DO NOT INTERRUPT EXISTING UTILITIES, EXCEPT WHEN AUTHORIZED IN WRITING BY AUTHORITIES HAVING JURISDICTION. PROVIDE TEMPORARY SERVICES DURING INTERRUPTIONS TO EXISTING UTILITIES, AS ACCEPTABLE TO GOVERNING AUTHORITIES.
17. WHEN UTILITY SERVICES ARE REQUIRED TO BE REMOVED, RELOCATED, OR ABANDONED, PROVIDE BYPASS CONNECTIONS TO MAINTAIN CONTINUITY OF SERVICE BEFORE PROCEEDING WITH DEMOLITION.
18. PRIOR TO COMMENCEMENT WITH ANY DEMOLITION WORK, CONTRACTOR SHALL IDENTIFY ALL ELECTRICAL CIRCUITS SERVICING THE AREA INVOLVED WITH THIS DEMOLITION. THOSE CIRCUITS SHALL THEN BE LOCKED OUT AND TAGGED OUT IF THEY DO NOT SERVE ANY OF THE REMAINING BUILDING. THOSE CIRCUITS WHICH ARE IDENTIFIED TO SERVE BOTH THE AREA TO BE DEMOLISHED AND THE REMAINING BUILDING SHALL BE SPLIT SO AS TO KILL ALL ELECTRICAL POWER TO THE AREA TO BE DEMOLISHED WHILE MAINTAINING POWER TO THE REMAINDER OF THE BUILDING.
19. CONTRACTOR TO RE-LOCATE UTILITIES & EQUIPMENT AS REQUIRED TO ACCOMMODATE NEW PLUMBING REQUIREMENTS FOR NEW RENOVATION WORK.
20. REFER TO DEMOLITION PLAN FOR EXISTING CONCRETE SLAB TO BE REMOVED AND REPLACED FOR UNDER FLOOR PIPING INSTALLATION.
21. EXISTING WALLS OR PORTIONS OF WALLS TO BE REMOVED SHALL BE CUT FLUSH WHERE INTERSECTING WITH WALLS TO REMAIN. REMAINING WALLS TO BE PATCHED AND FINISHED SMOOTH.
22. NEW OPENING TO BE CUT IN EXISTING WALLS SHALL BE SAW-CUT AT LOCATIONS INDICATED TO THE HEIGHT AND WIDTH INDICATED. NEW LINTELS SHALL BE INSTALLED TO SUPPORT EXISTING WALL CONSTRUCTION ABOVE AS INDICATED ON THE DRAWINGS, OR IF NOT INDICATED, AS REQUIRED FOR NEW WALL CONSTRUCTION PER STRUCTURAL DRAWINGS, IF PROVIDED.
23. WHERE EXISTING INTERIOR WALLS ARE REPLACED OR REMOVED, REMOVE MEP SYSTEMS BACK TO PANEL OR MECHANICAL ROOM OR FARTHEST POSSIBLE POINT WITHOUT DISTURBING EXISTING CONSTRUCTION. REMOVE EXISTING MECHANICAL EQUIPMENT, RELOCATE POWER PER MEP DRAWINGS.
24. REFER TO MEP DRAWINGS FOR DEMOLITION OF MEP SYSTEMS. IDENTIFY WORK REQUIRED BY THIS CONTRACTOR WHICH MAY AFFECT DEMOLITION AND/OR REPAIRS OF ARCHITECTURAL FINISHES. COORDINATE WITH RELATED SUBS THE EXTENT OF ALL DEMOLITION WORK.
25. PATCH FLOORS, WALLS CEILINGS WHICH REMAIN AT LOCATIONS WHERE PIPES, CONDUITS, ETC. ARE REMOVED AS REQUIRED TO MATCH EXISTING CONDITIONS OR TO RECEIVE NEW FINISHES. WHERE EXISTING FINISH FLOOR IS REMOVED, PREPARE SURFACE TO RECEIVE NEW FLOORING.
26. NOTIFY ARCHITECT & OWNER OF ANY POSSIBLE ASBESTOS CONTAINING MATERIALS DISCOVERED BEFORE PROCEEDING WITH WORK, PROTECT INTERIOR CONSTRUCTION TO REMAIN DURING DEMOLITION AND CONSTRUCTION.
27. CONTRACTOR TO OBTAIN ALL NECESSARY PERMITS BEFORE COMMENCING WORK.
28. CONTRACTOR TO PROVIDE ALL NECESSARY SHORING FOR PROTECTION OF EXISTING STRUCTURE AND FOUNDATION TO REMAIN.
29. ALL DASHED LINES ARE DEMOLITION LINES UNLESS NOTED OTHERWISE.
30. REMOVE ALL CARPET WAHNSCOAT FROM ALL LOCATIONS IN EACH UNIT.

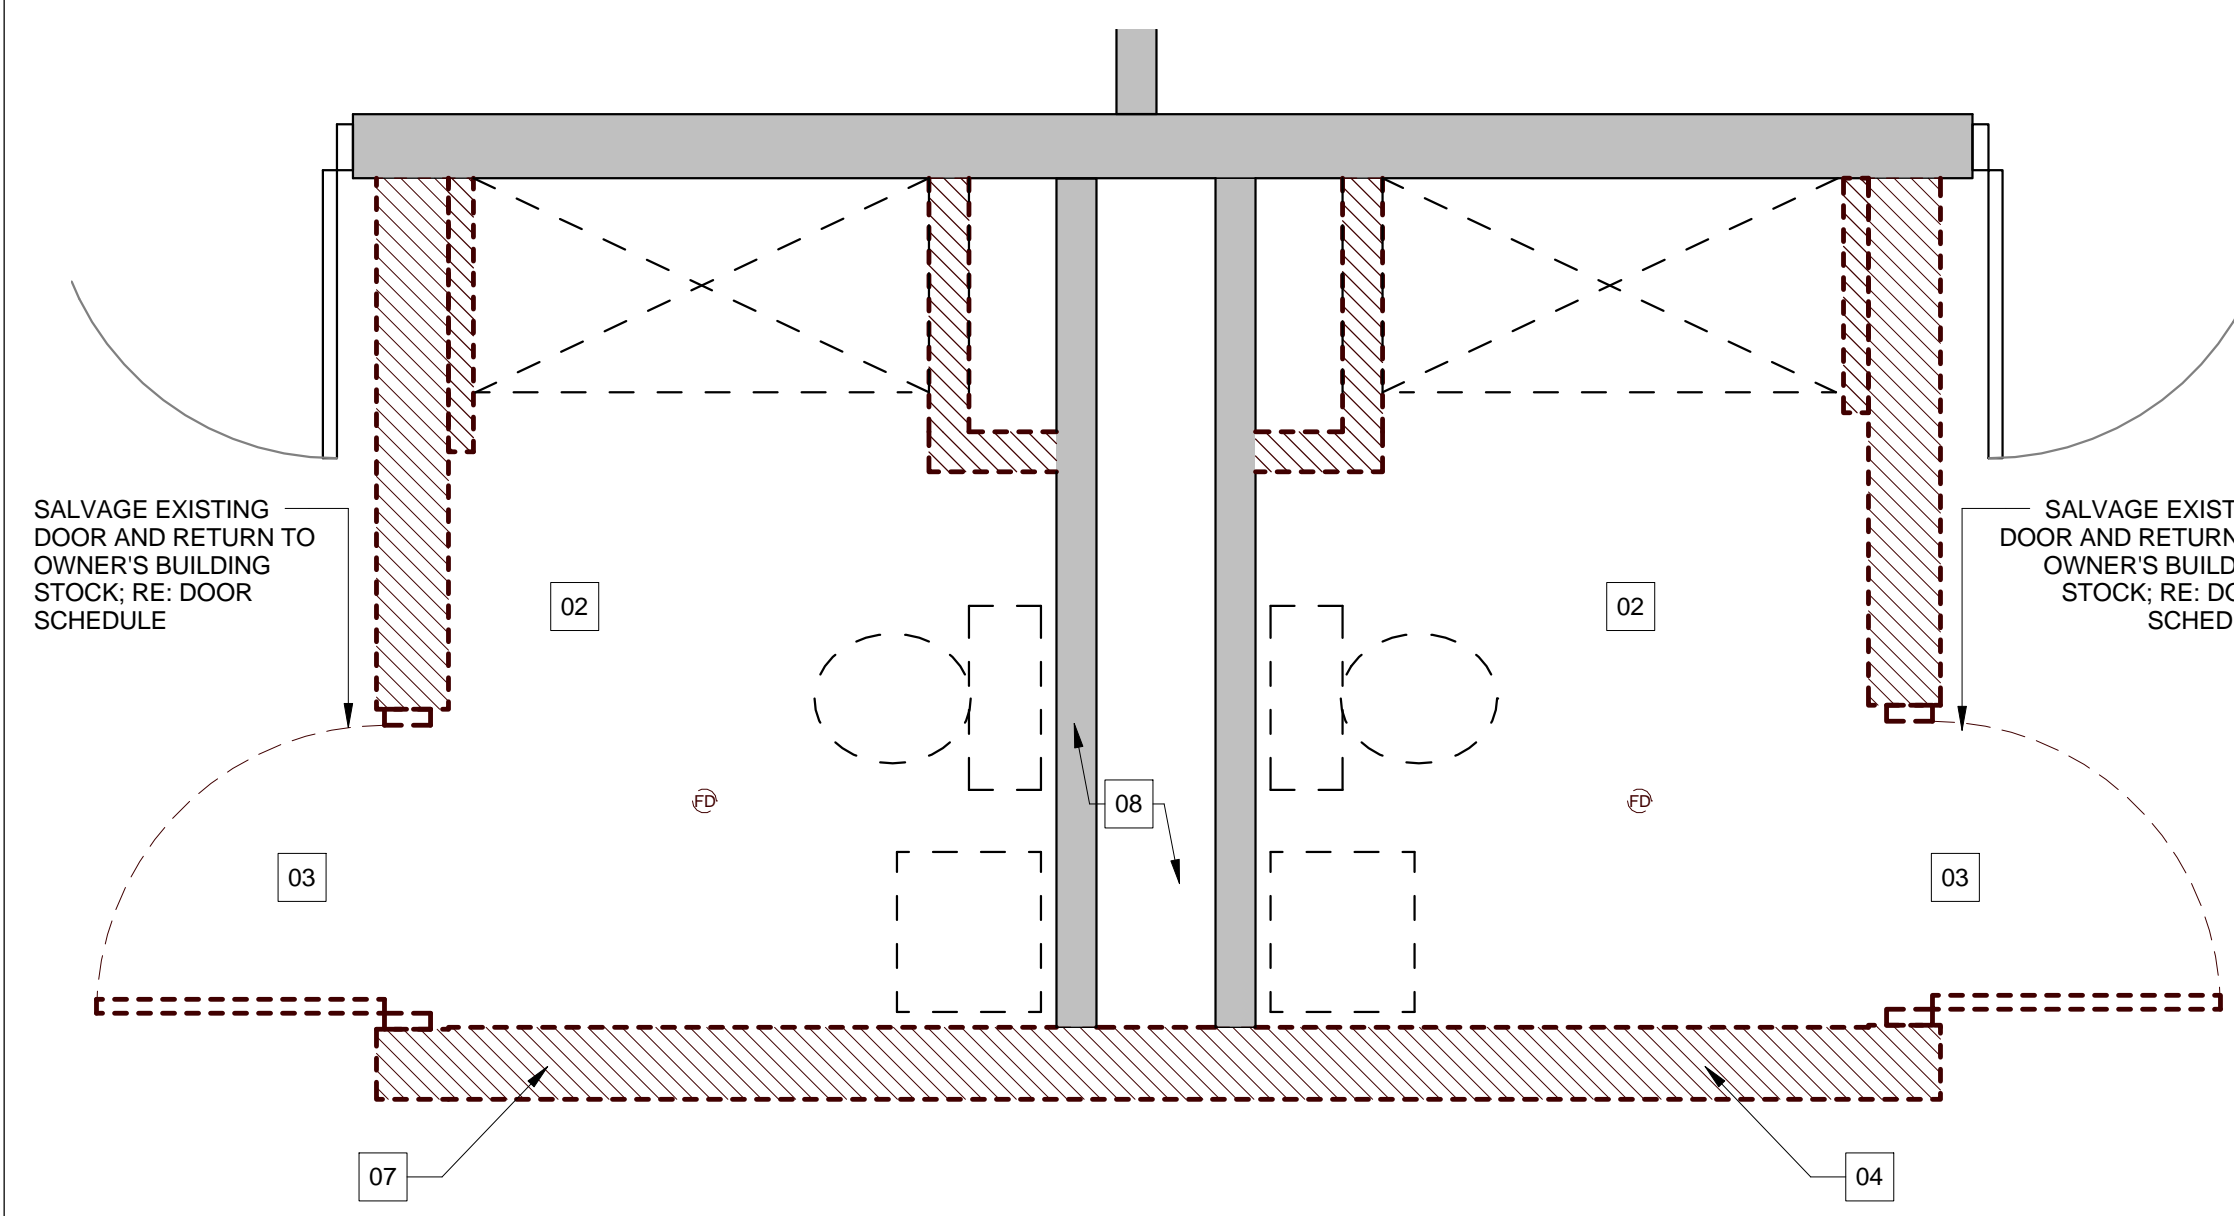


**28 ENLARGED DEMOLITION RESTROOM PLAN - UNIT 3D**  
1/2" = 1'-0"

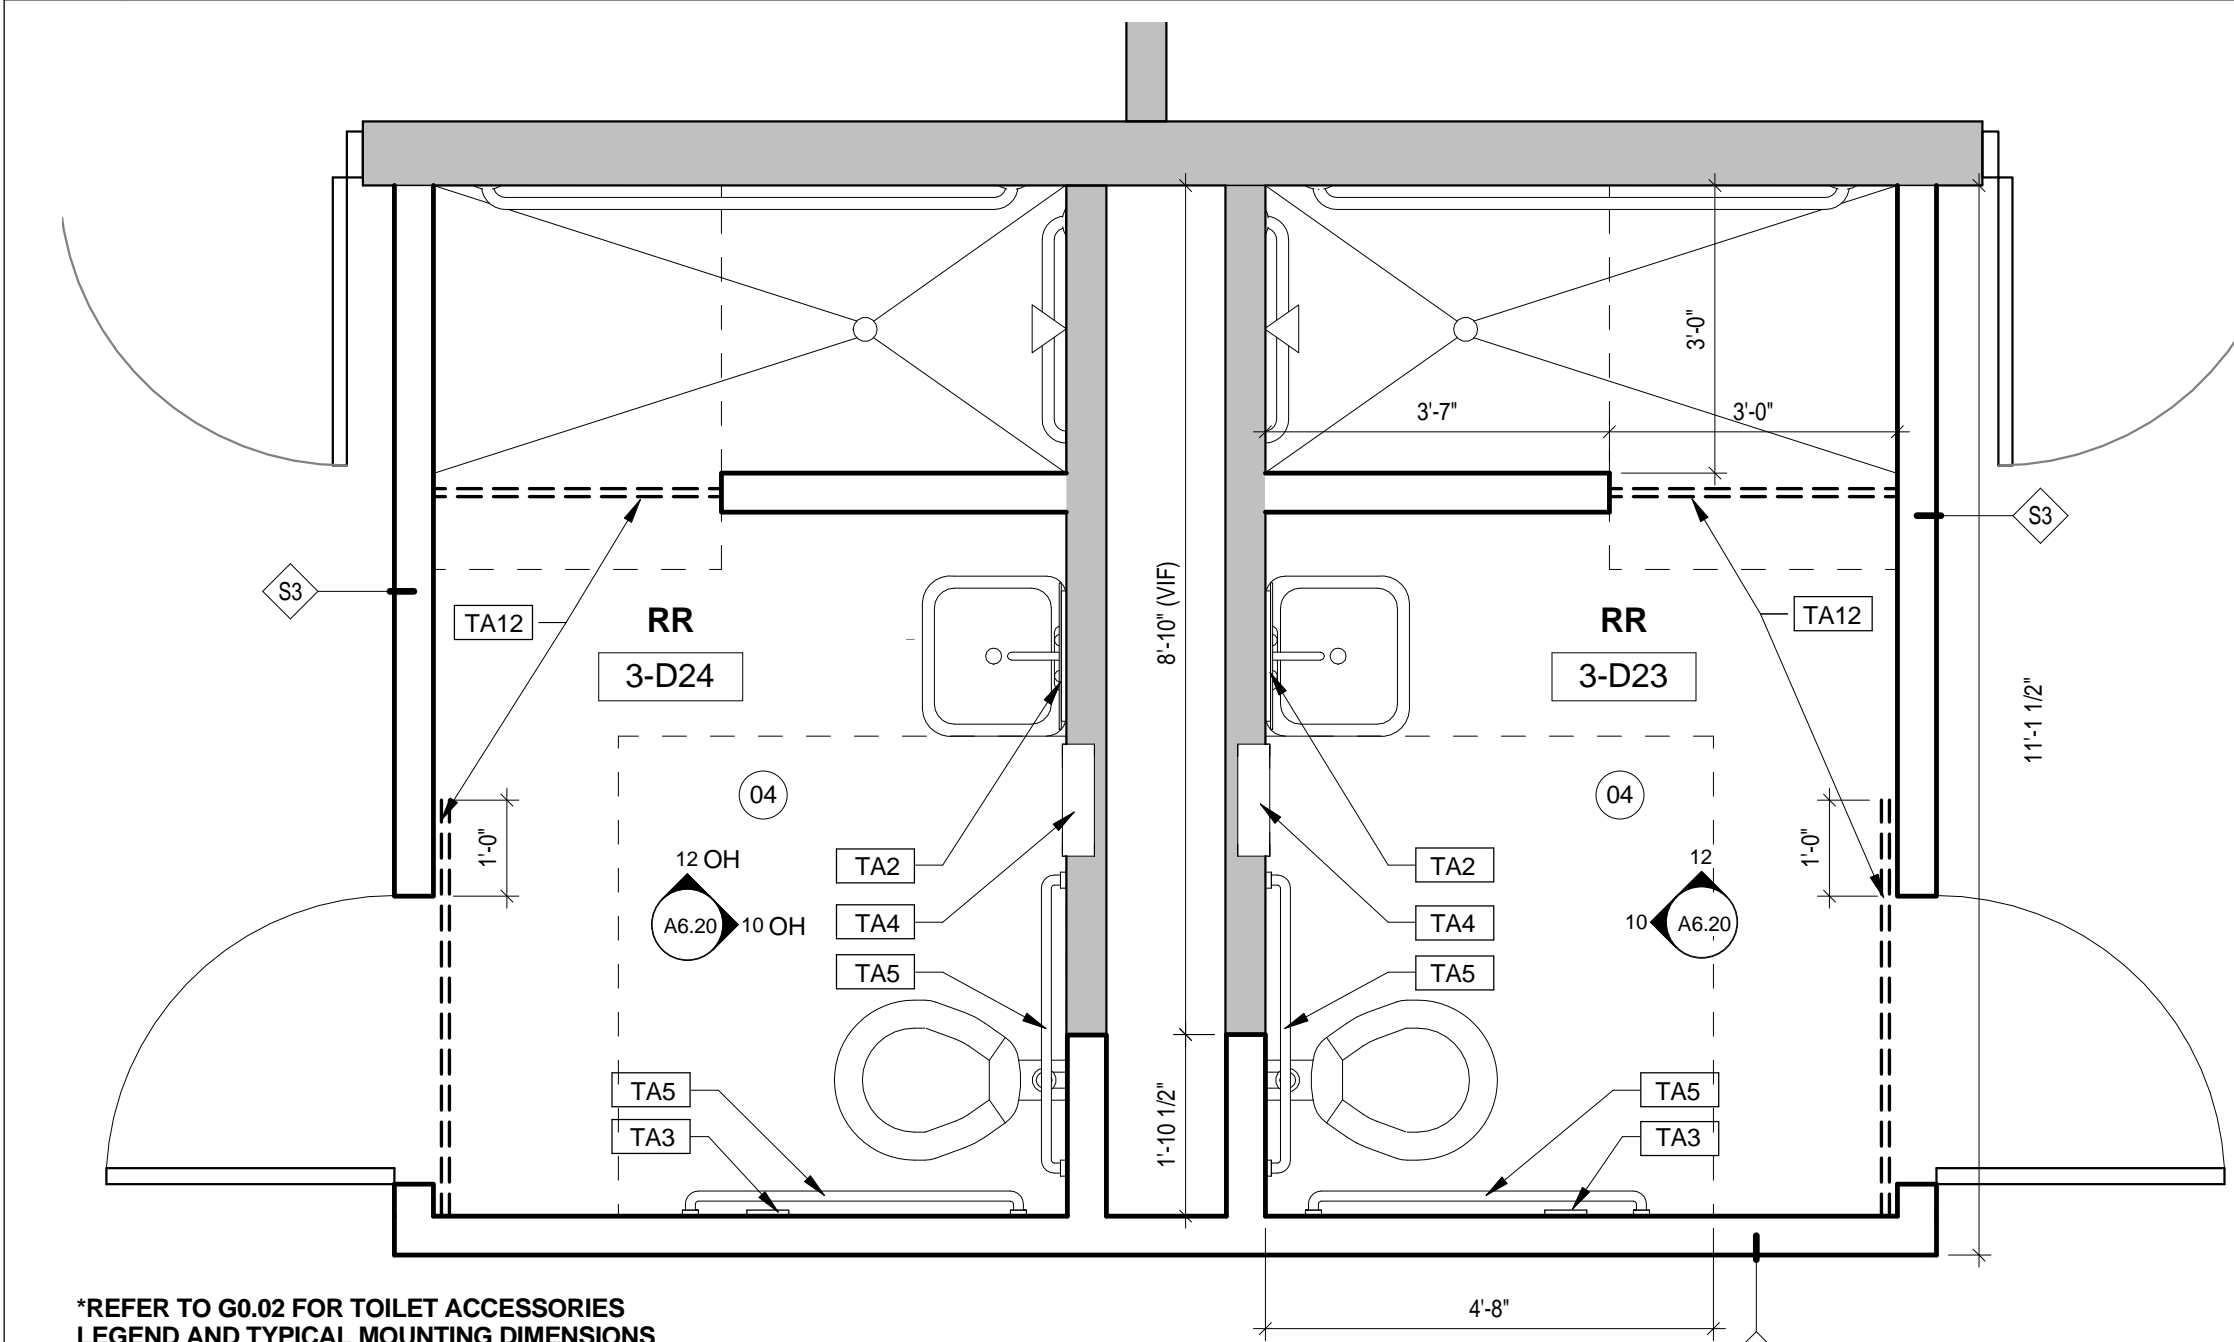


**16 ENLARGED RENOVATION RESTROOM PLAN - UNIT 3D**  
1/2" = 1'-0"

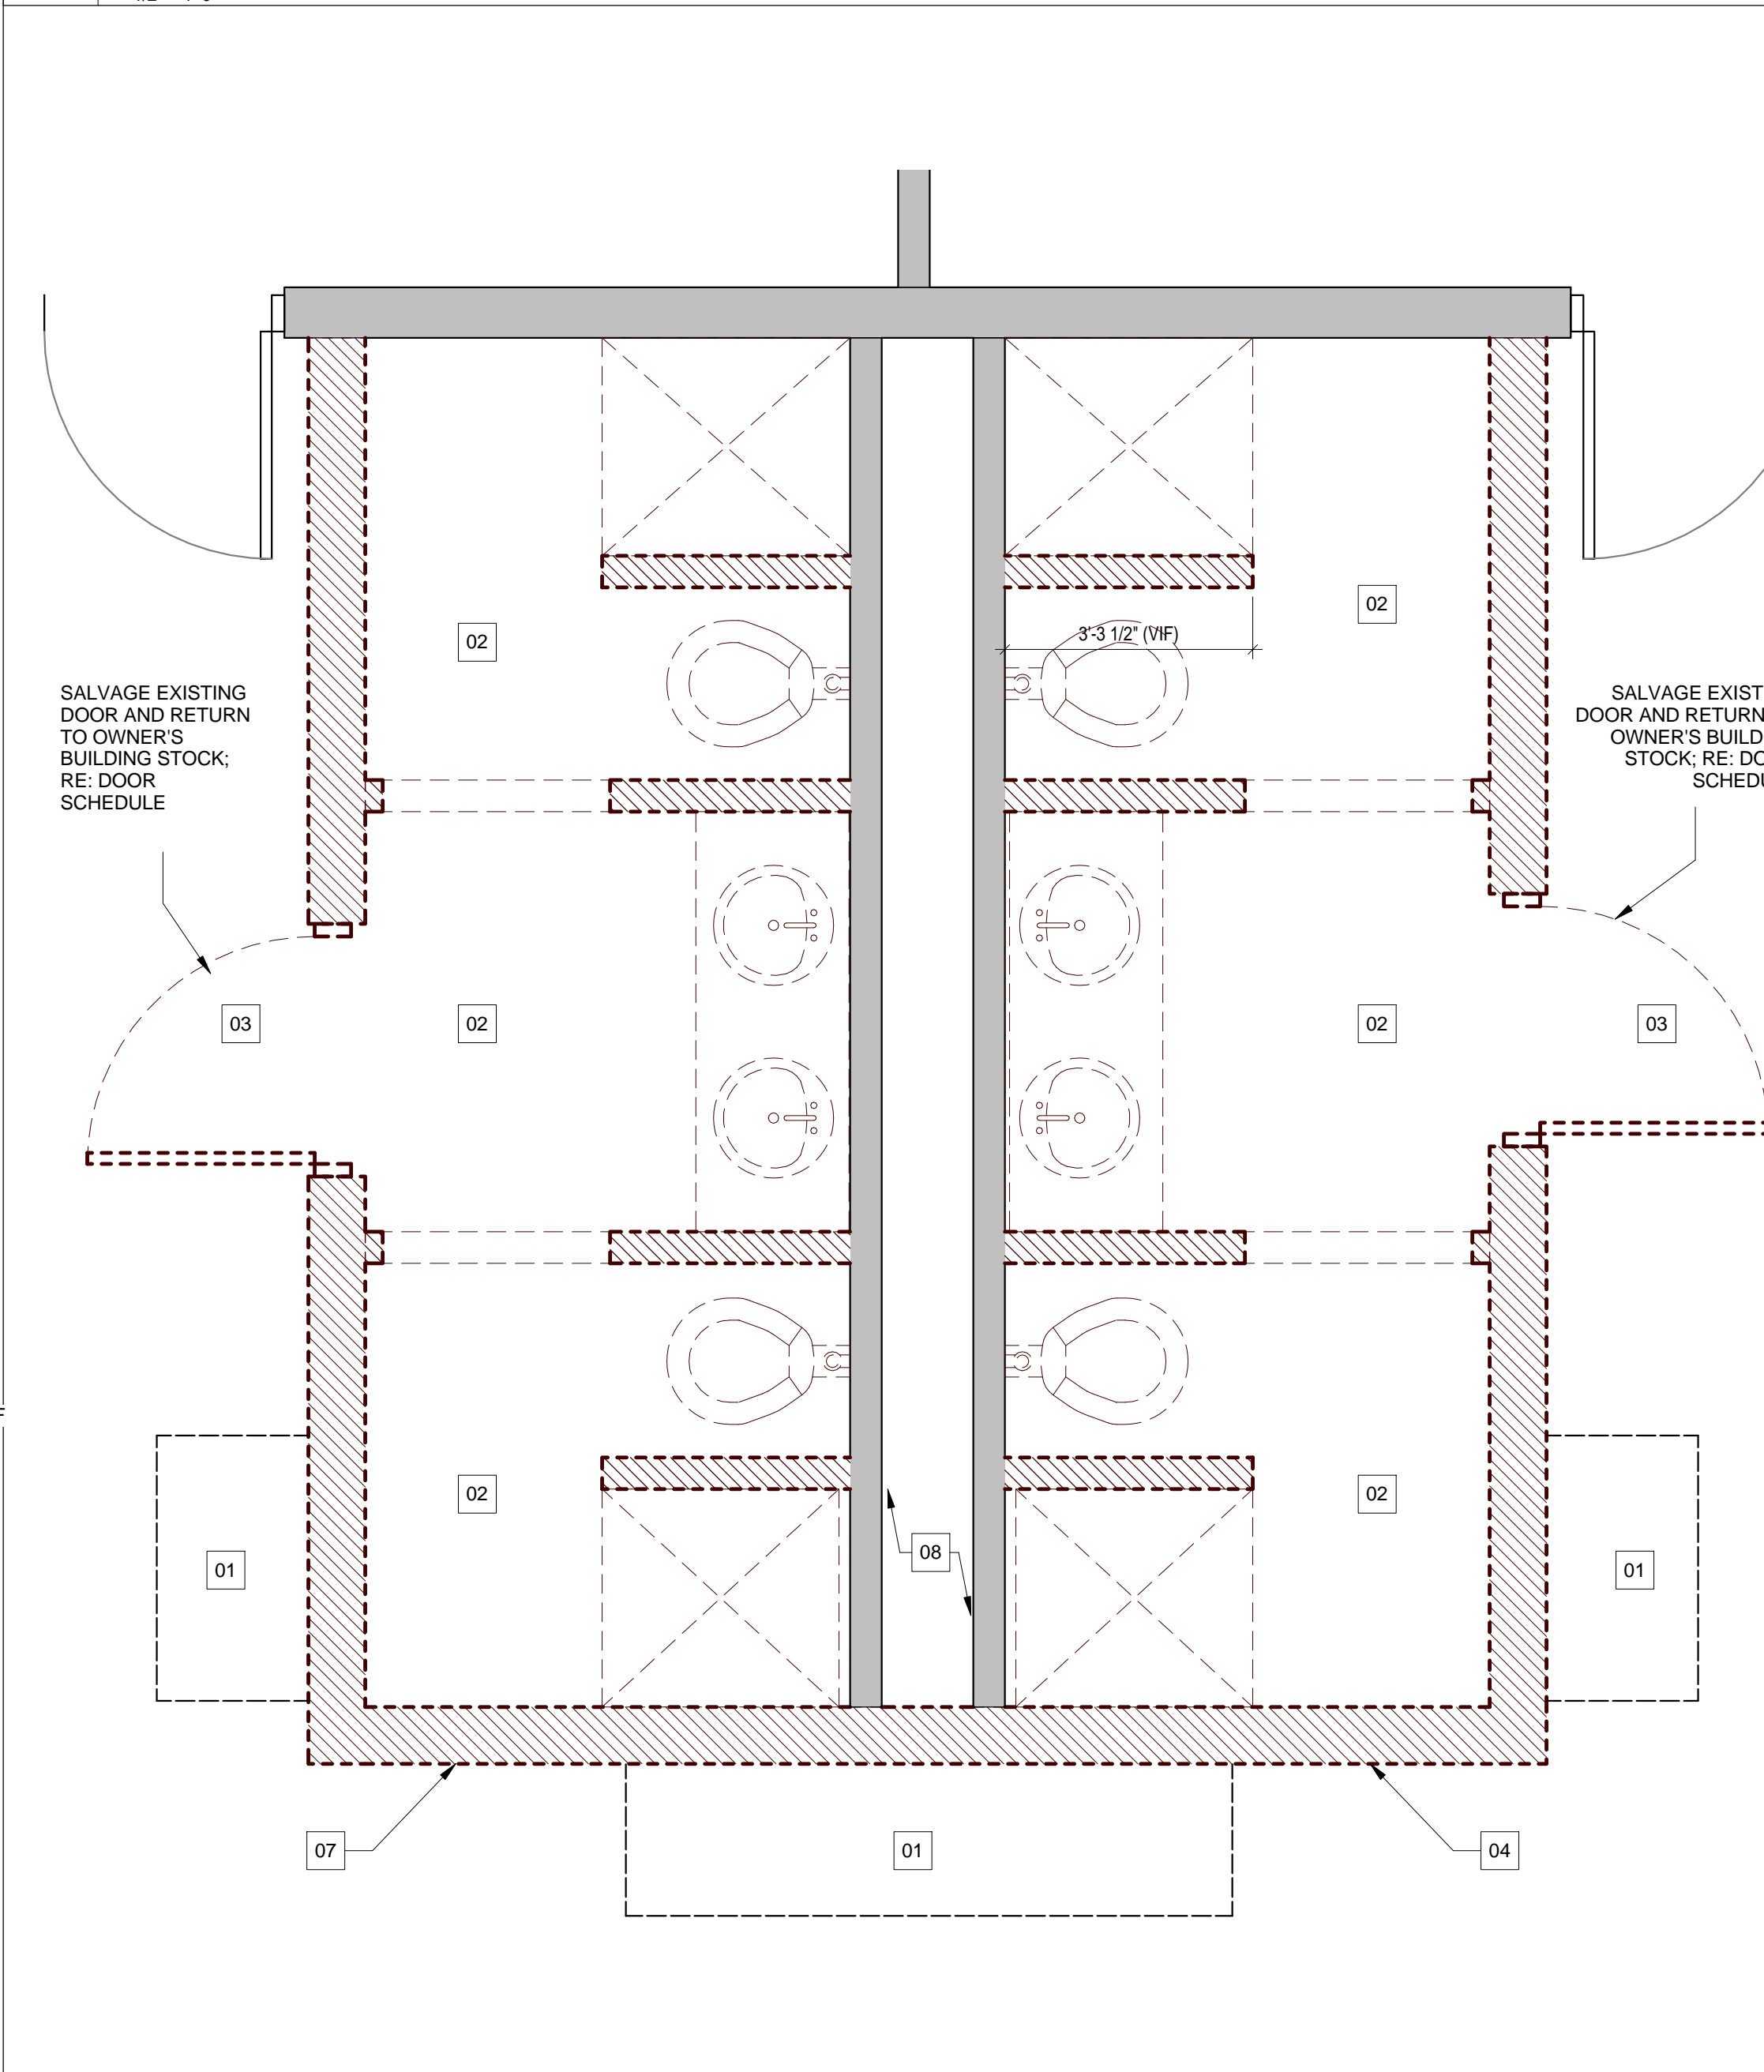

**4 ENLARGED DEMOLITION RESTROOM PLAN - TYPICAL**  
1/2" = 1'-0"

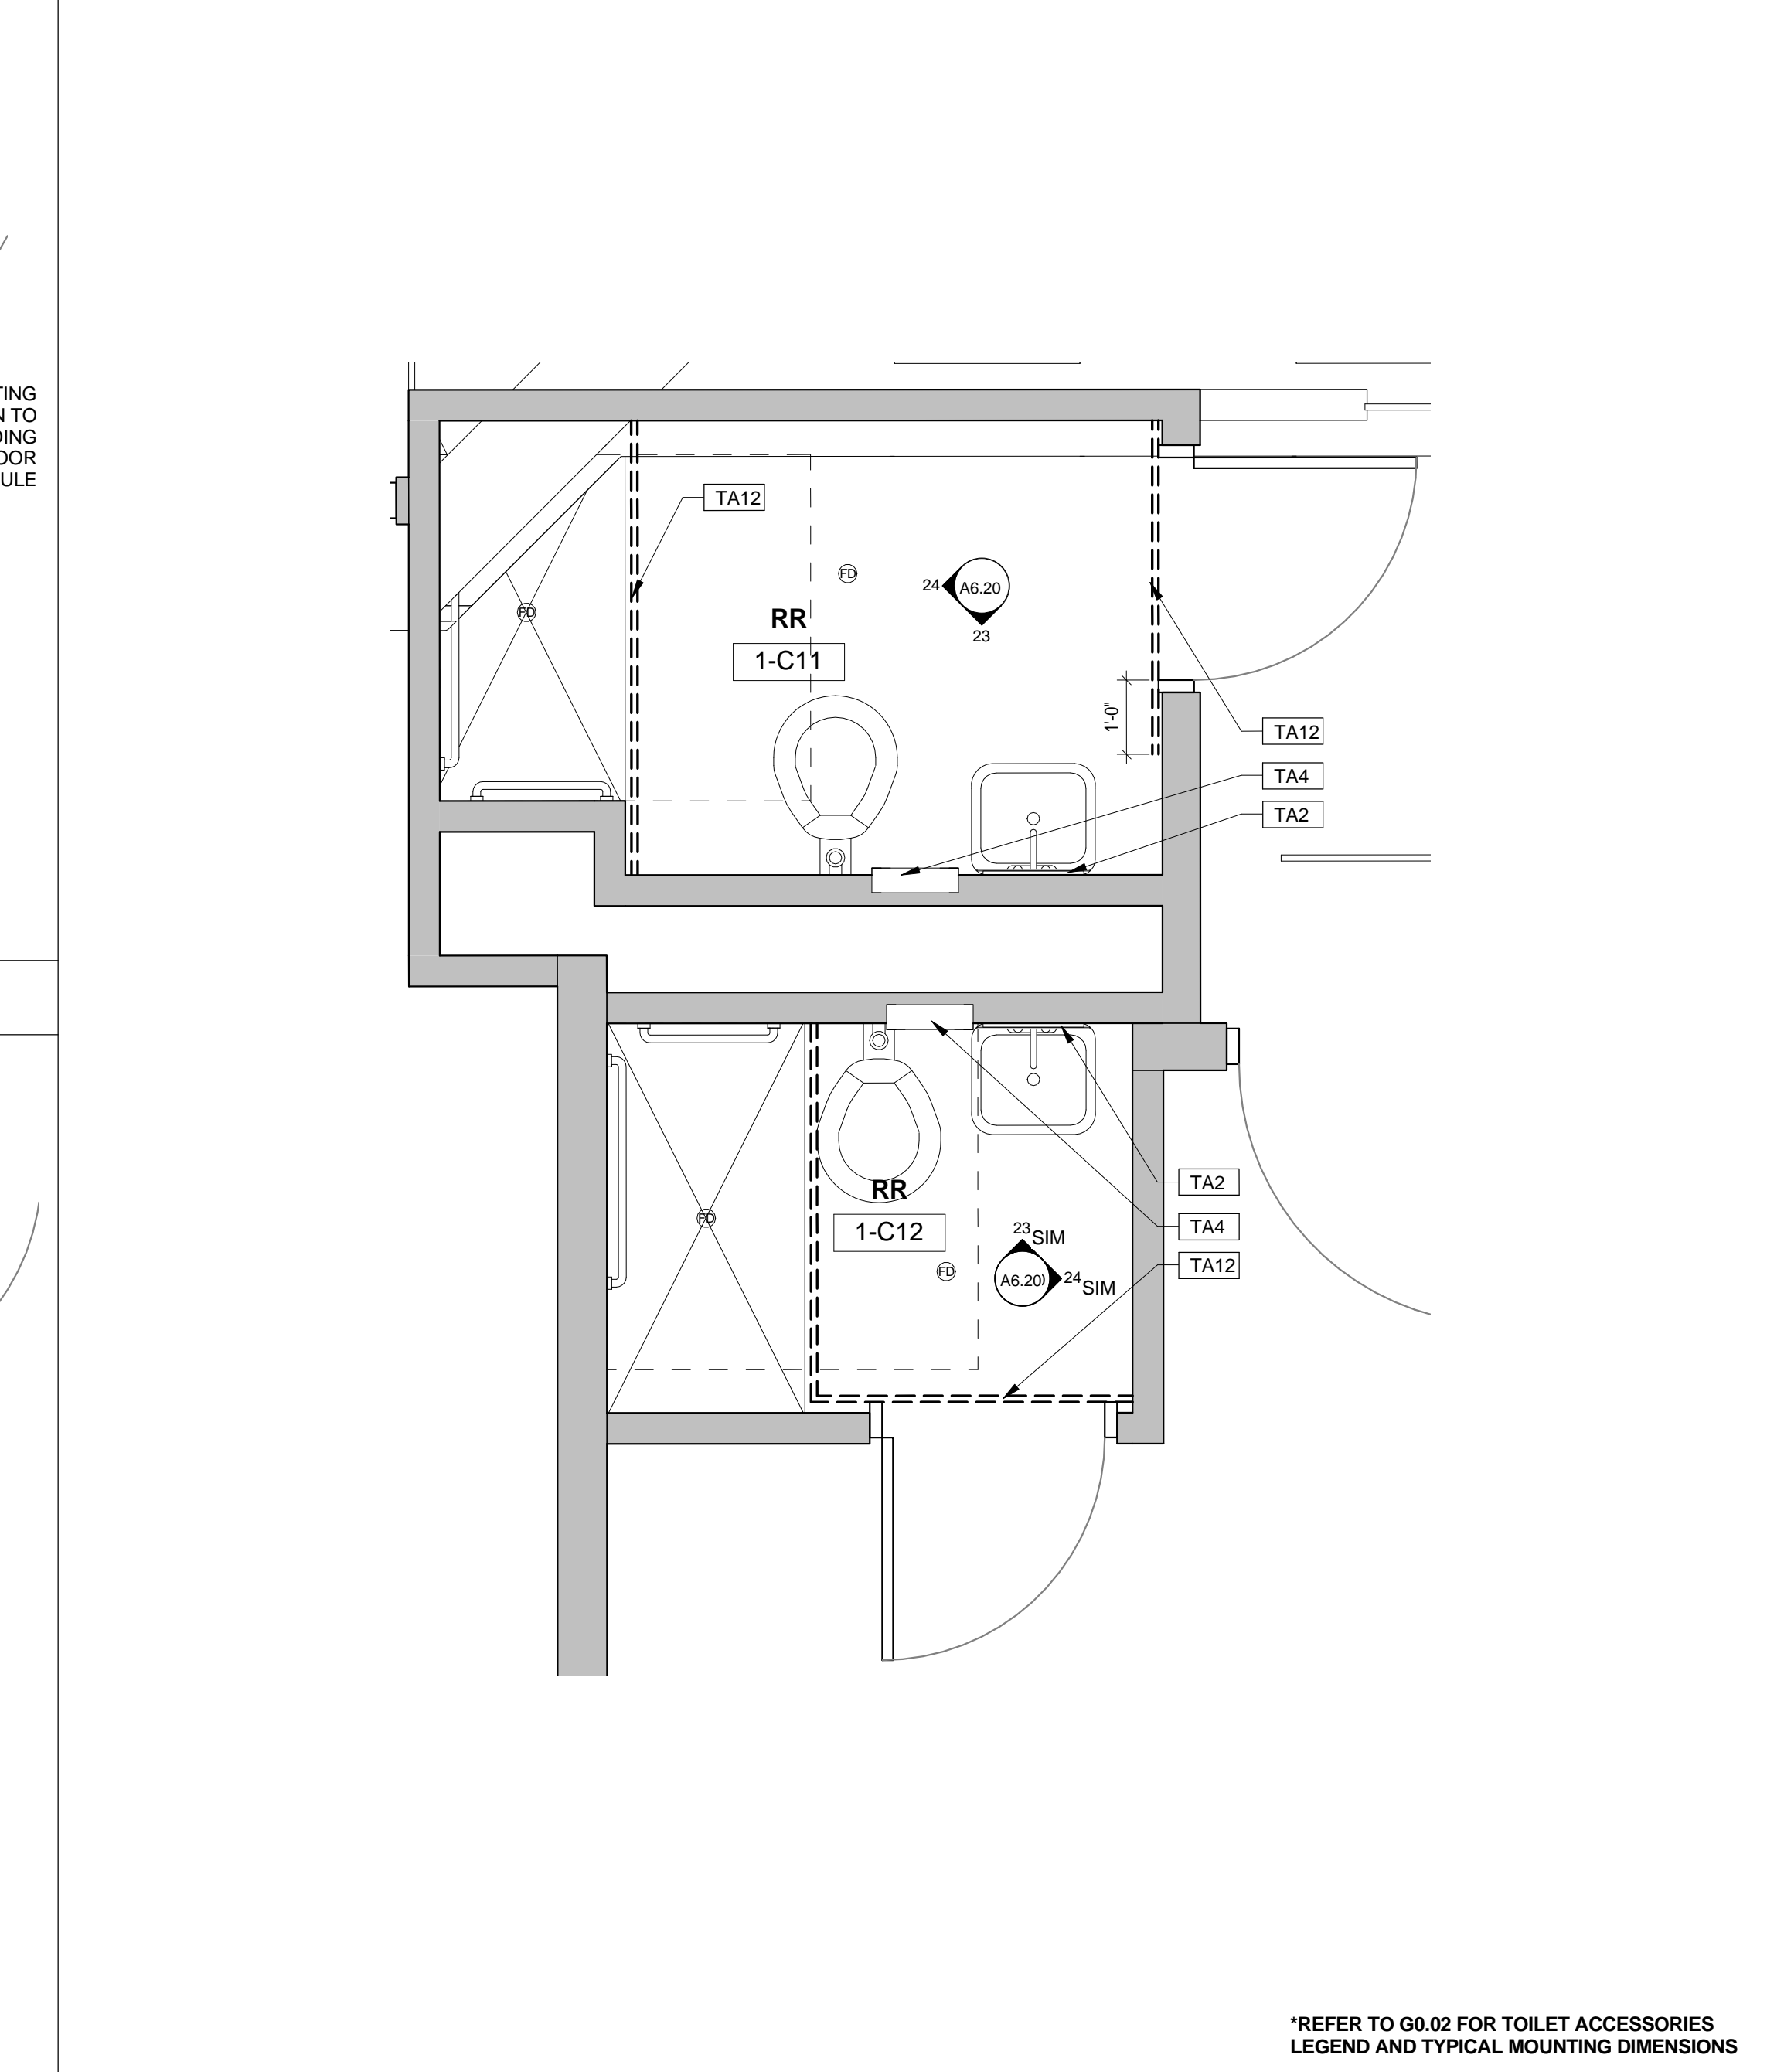

**14 ENLARGED SINGLE/PRIVATE RESTROOMS - TYPICAL**  
1/2" = 1'-0"

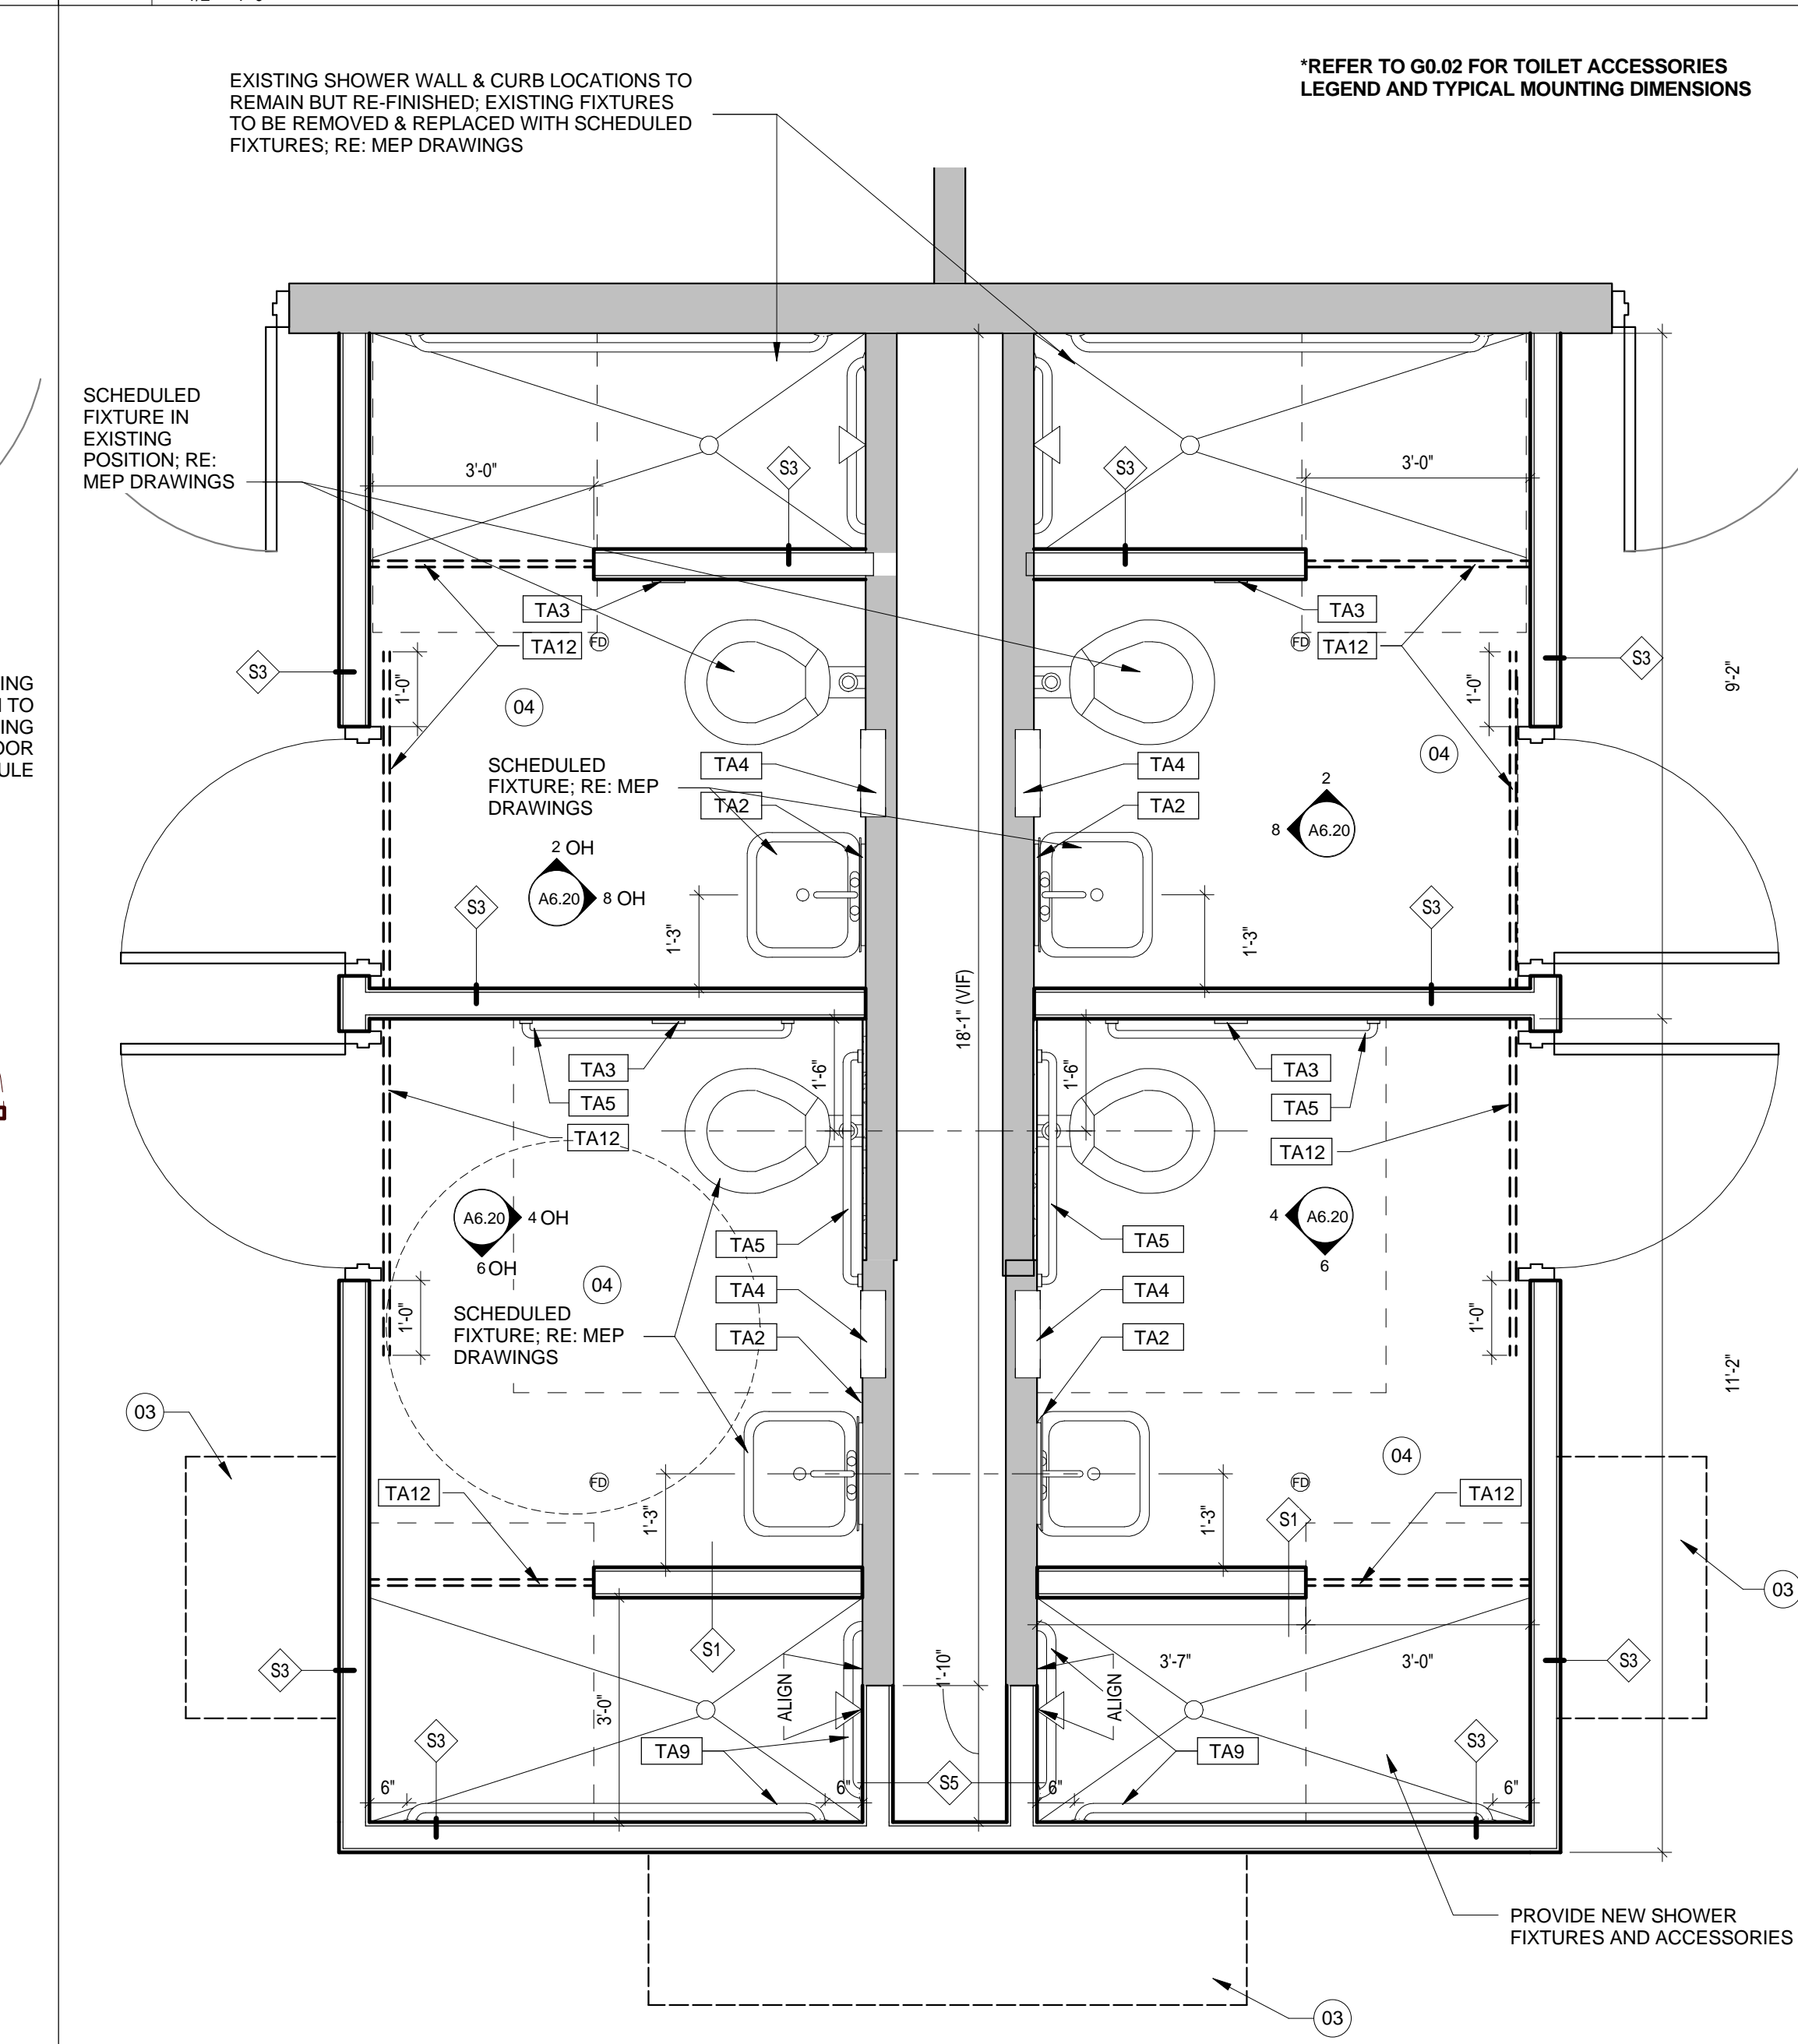



**2 ENLARGED RENOVATION RESTROOM PLAN - TYPICAL**  
1/2" = 1'-0"



ARCHITECTURE  
PBK ARCHITECTS  
11 Greenway Plaza, 22nd Floor  
Houston, TX 77046  
713-963-0638 P  
713-961-4571 F  
TX Firm F-3709  
PBK.com

MEP  
SHAH SMITH AND ASSOCIATES  
2825 S Wilshire Dr #300  
HOUSTON, TX 77042  
(713) 790-7963

**HARRIS COUNTY PSYCHIATRIC  
CENTER RENOVATION UNITS: 1C,  
2E, 3B, 3C, 3D & 3E**

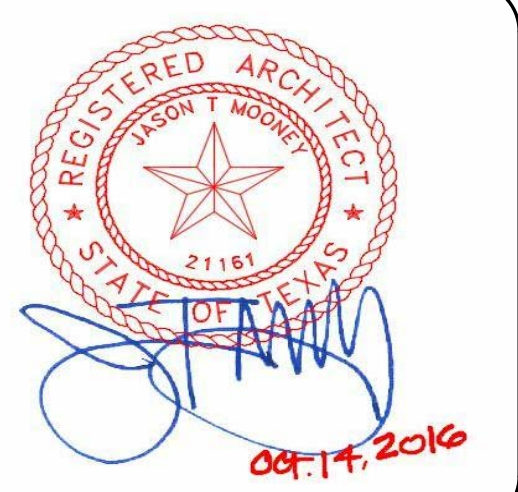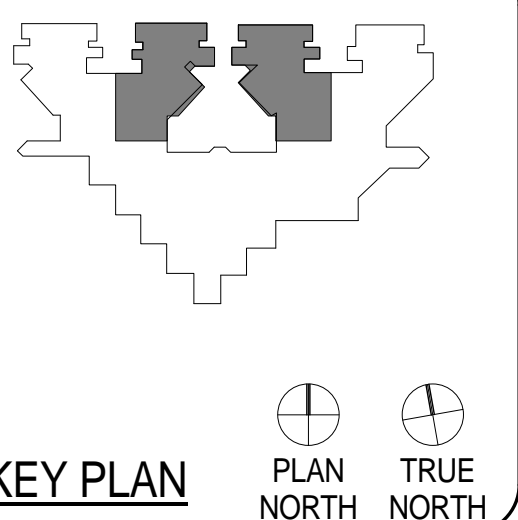




CLIENT UT HEALTH		
PROJECT NUMBER 16106		
DATE: OCTOBER 14, 2016		
DRAWN BY: VJ/BG		
CHECKED BY: JM/CJS		
REVISIONS		
No.	Description	Date

ISSUE FOR BID  
**ENLARGED PLANS**

**A4.01**






NOTE: REFER TO SHEET G0.02 FOR TYPICAL MOUNTING HEIGHTS OF WALL MOUNTED FIXTURES

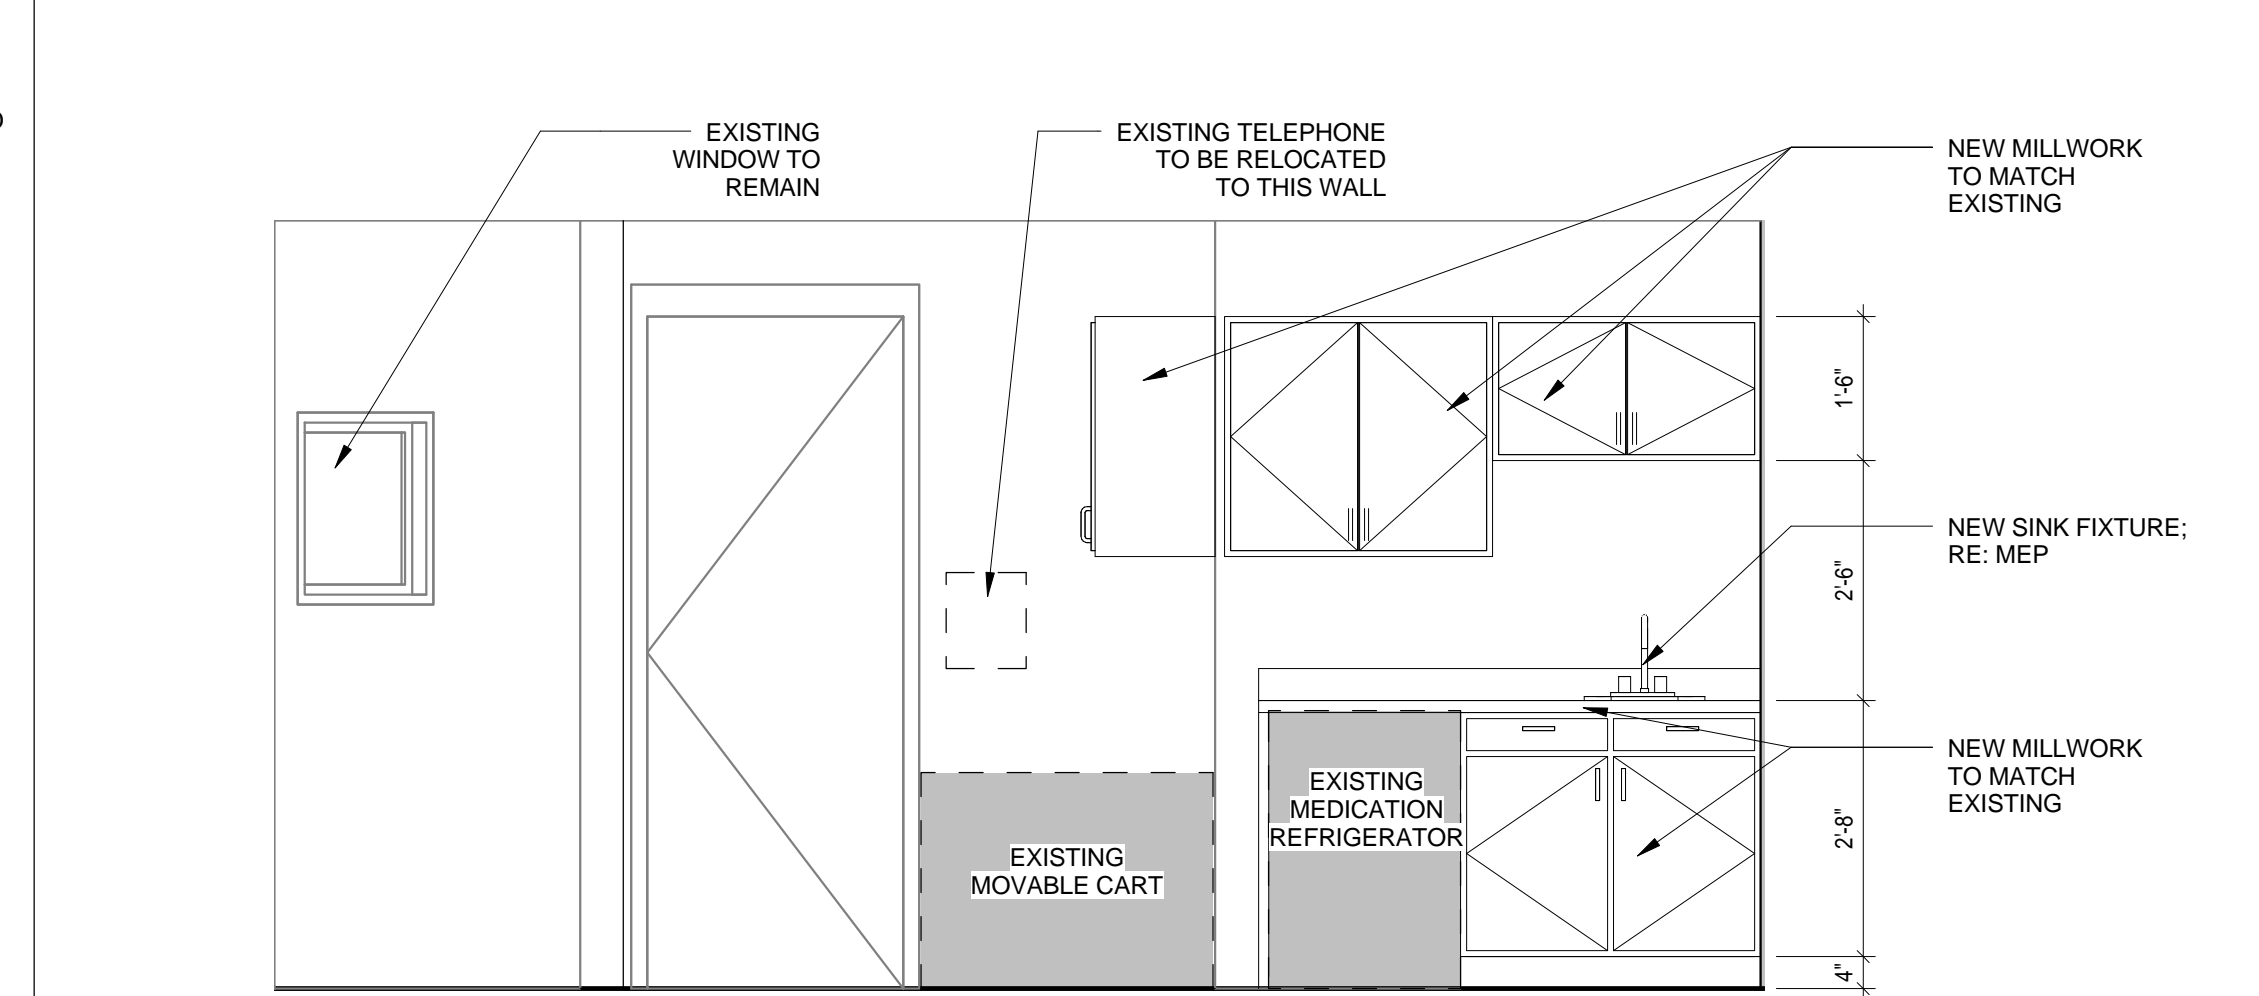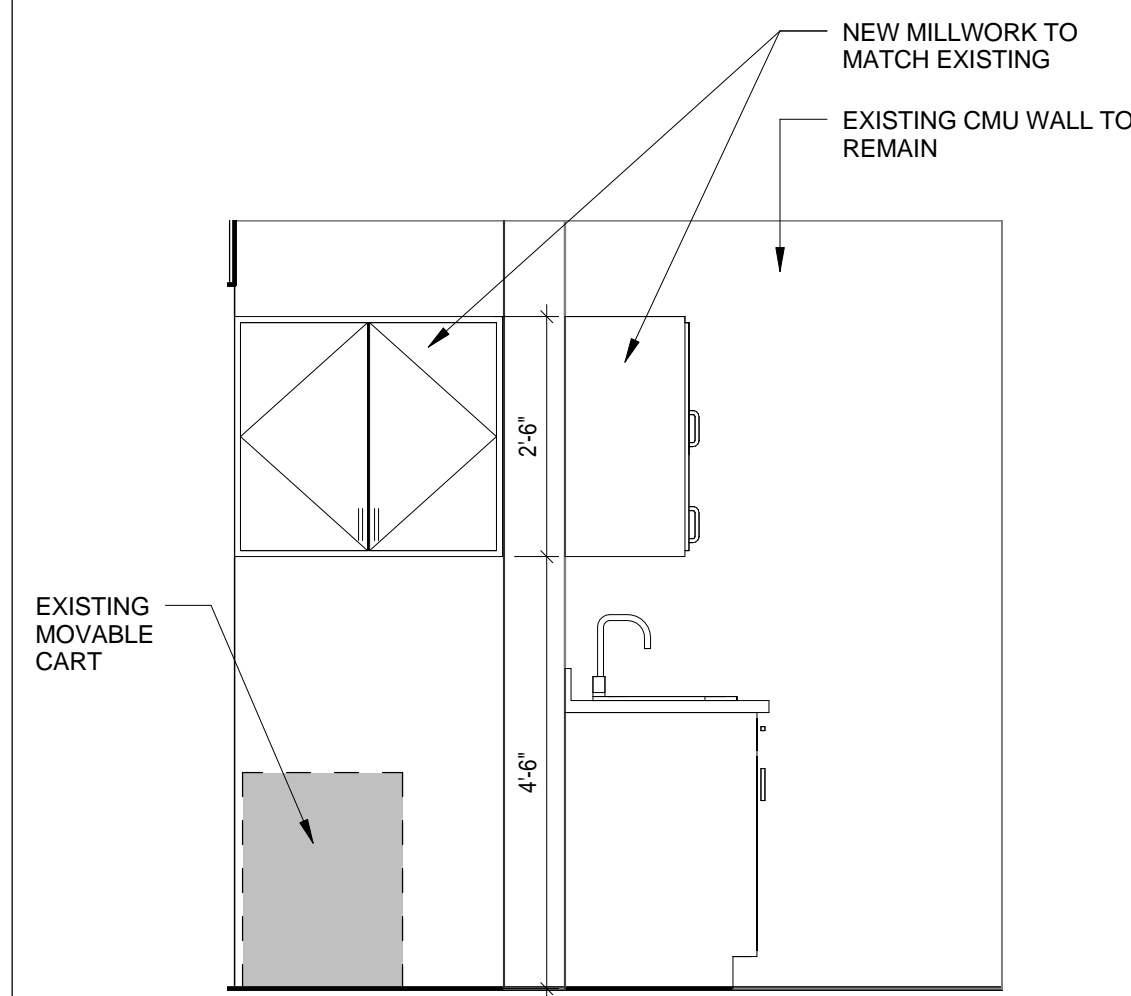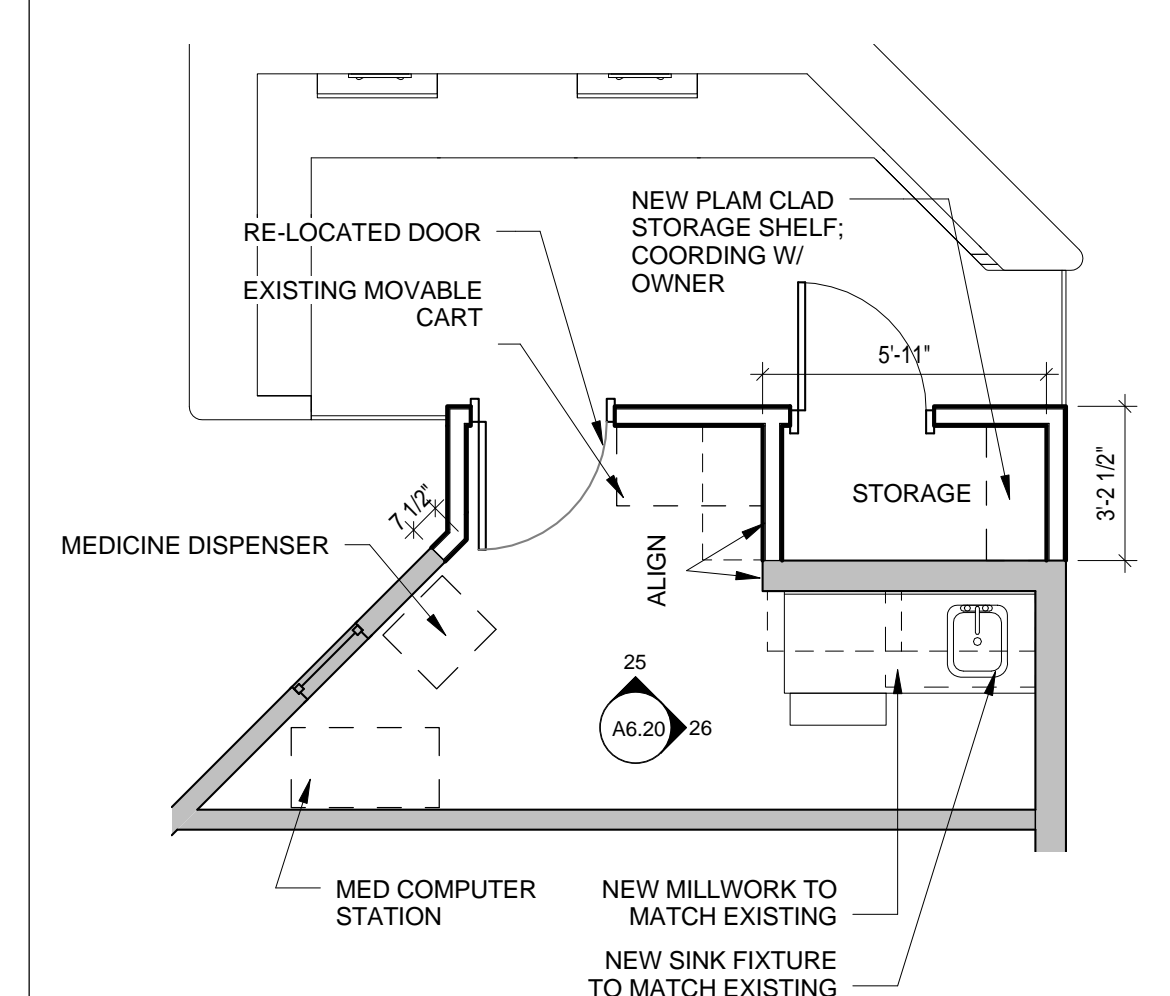

**27 ENLARGED MEDICINE ROOM**  
 1/4" = 1'-0"

**26 MEDICINE ROOM ELEVATION**  
 1/2" = 1'-0"




**25 MEDICINE ROOM ELEVATION**  
 1/2" = 1'-0"

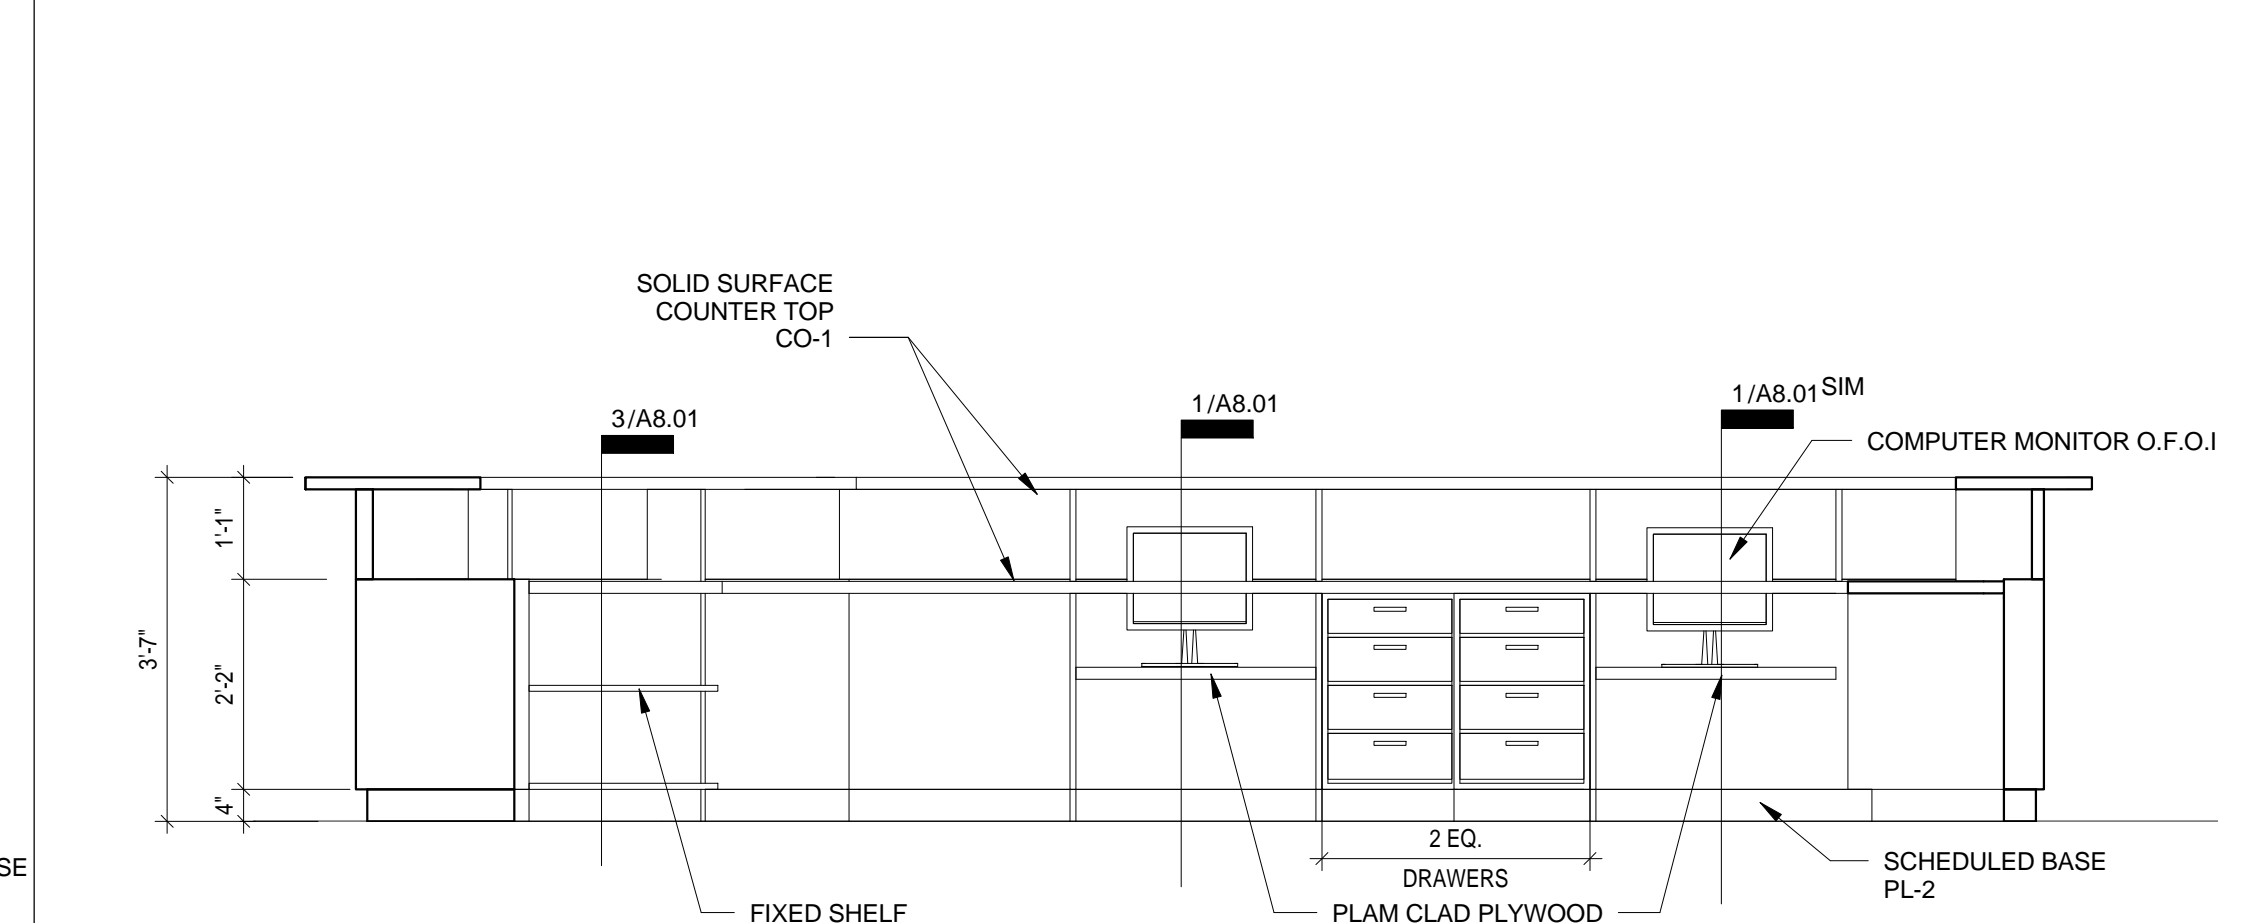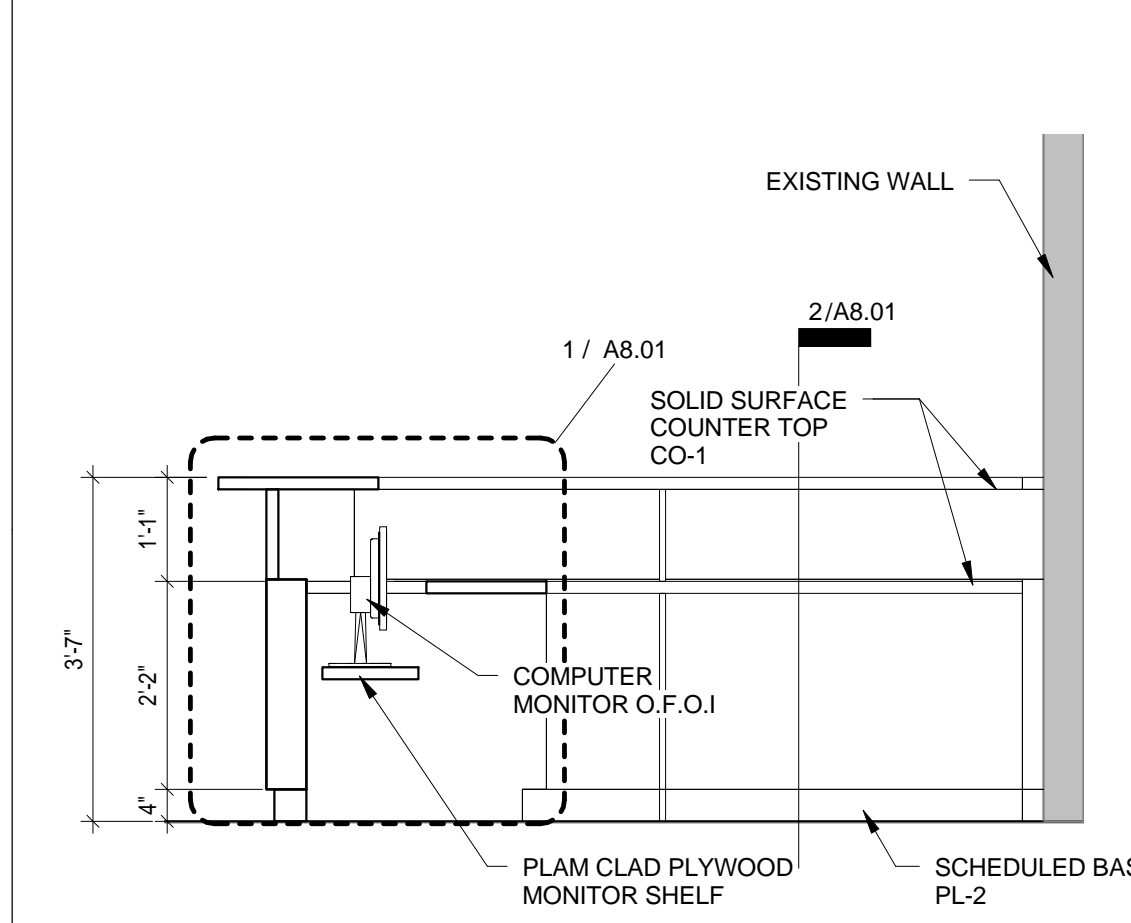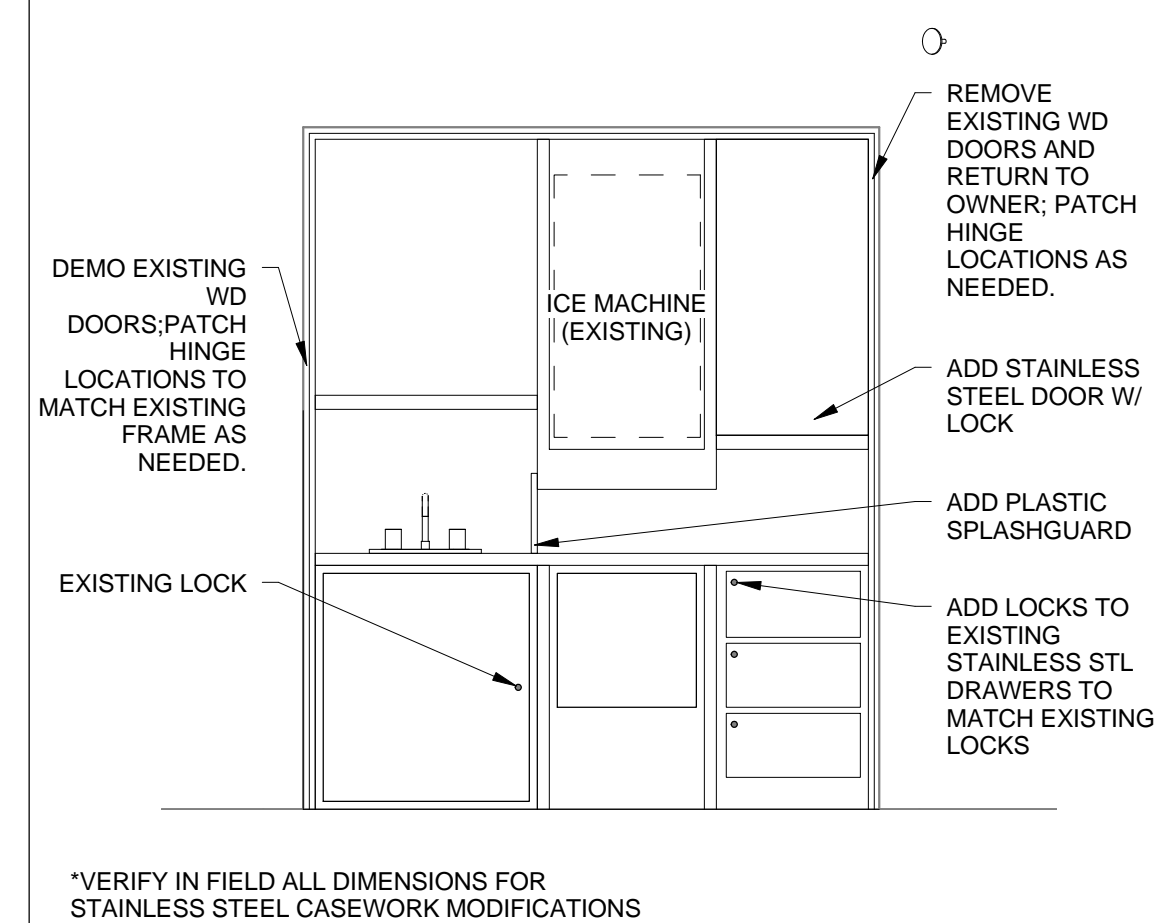

**22 NOURISHMENT STATION**  
 1/2" = 1'-0"

**21 NURSE STATION - INTERIOR**  
 1/2" = 1'-0"




**20 NURSE STATION - INTERIOR**  
 1/2" = 1'-0"

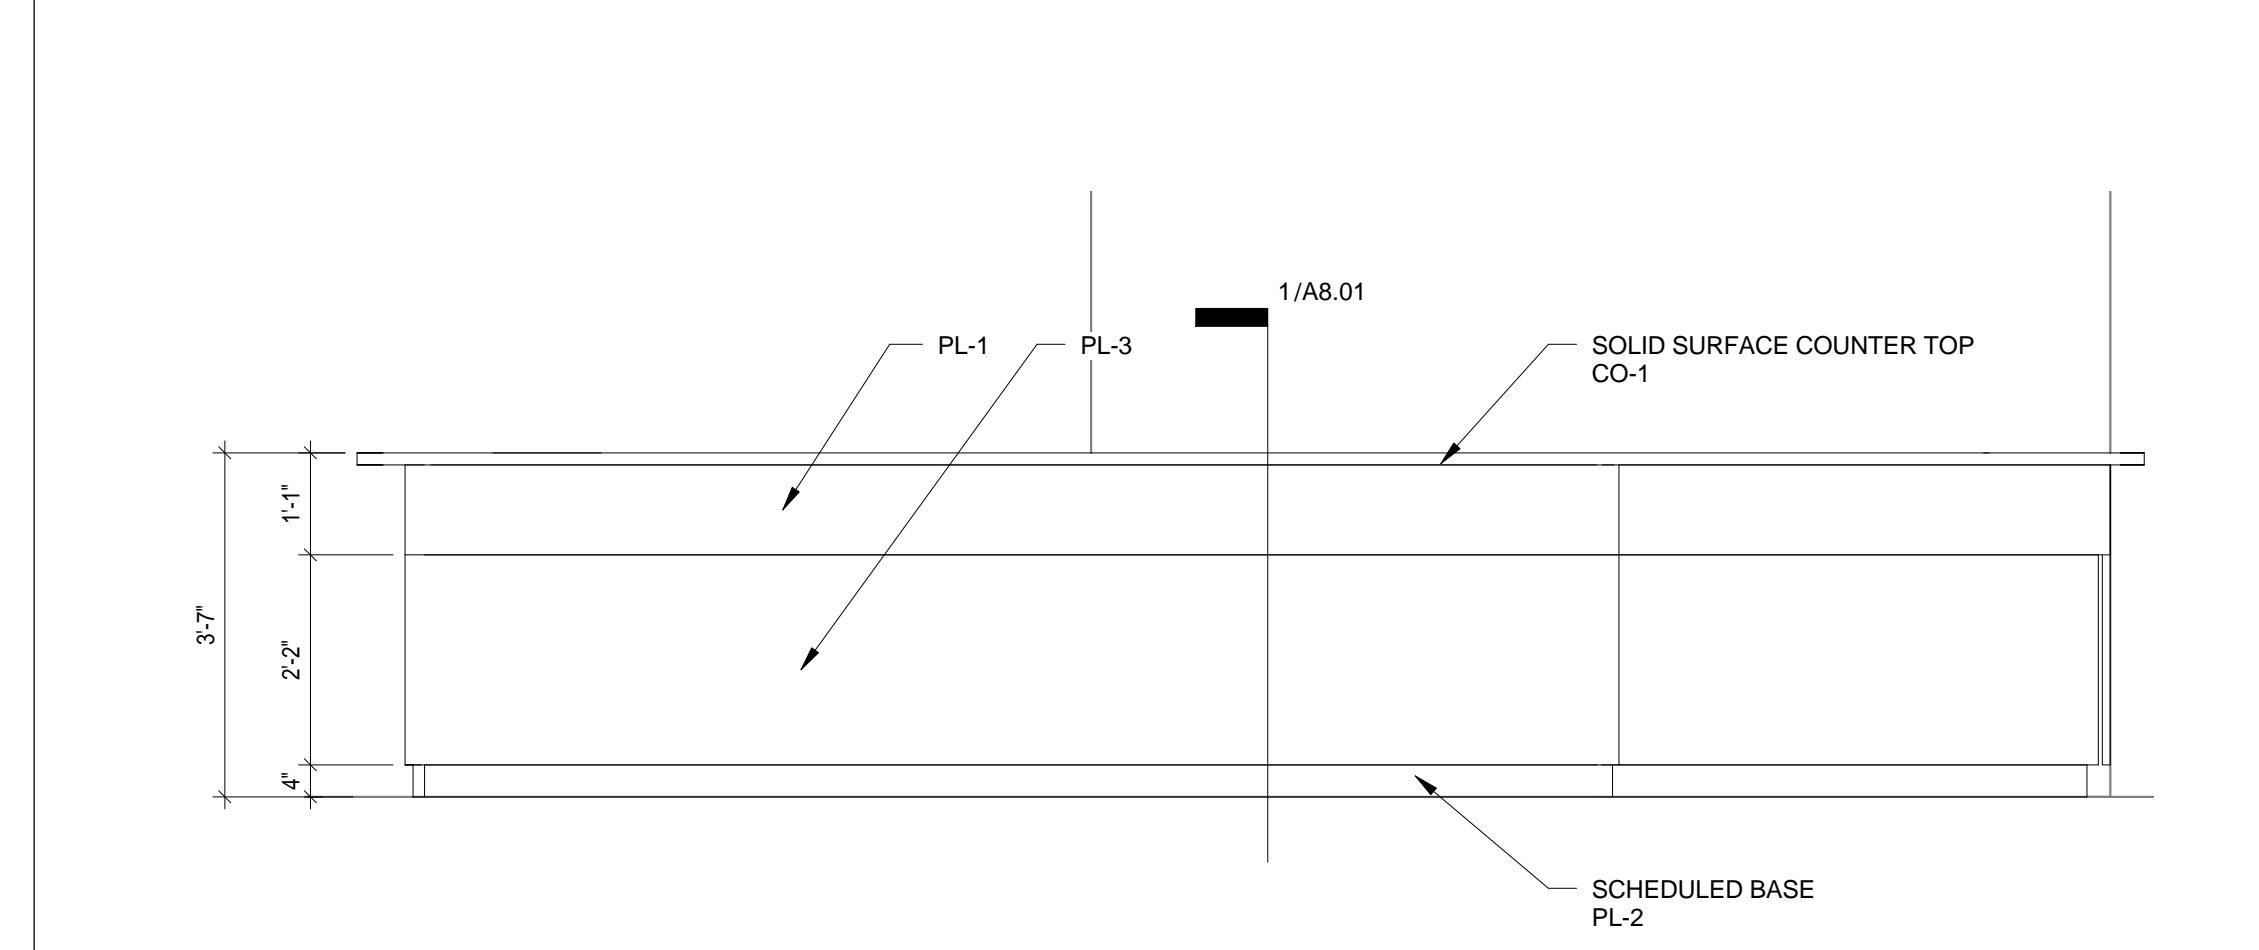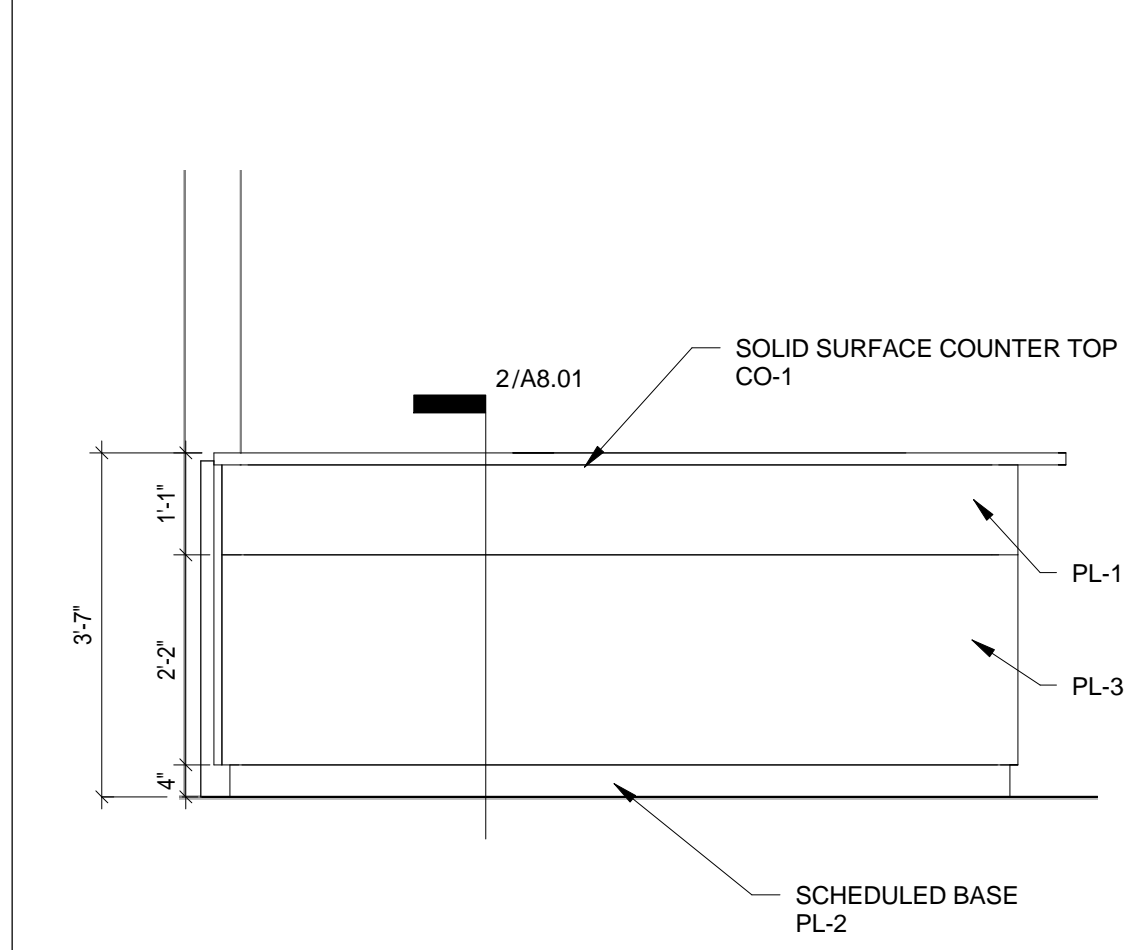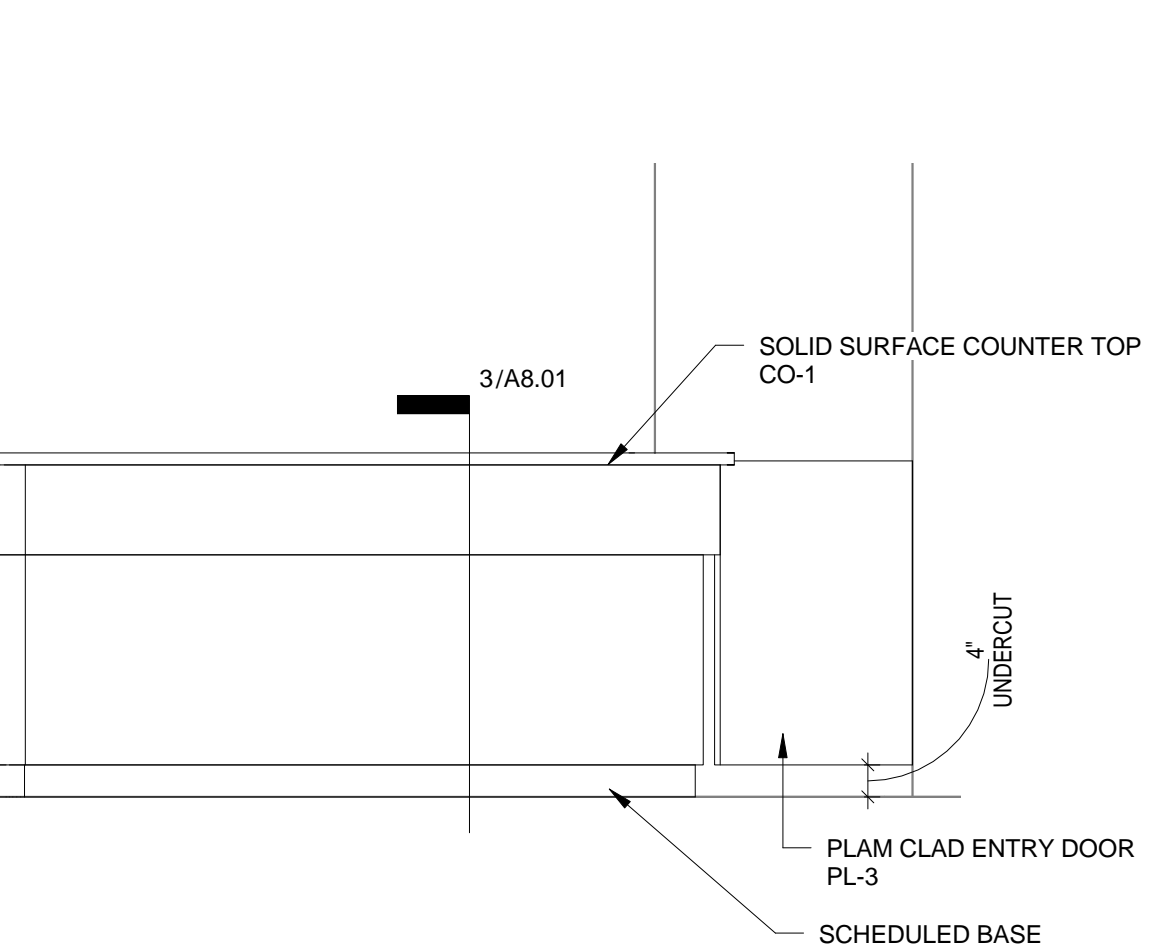

**17 NURSE STATION - EXTERIOR**  
 1/2" = 1'-0"




**15 NURSE STATION - EXTERIOR**  
 1/2" = 1'-0"

**14 NURSE STATION - EXTERIOR**  
 1/2" = 1'-0"

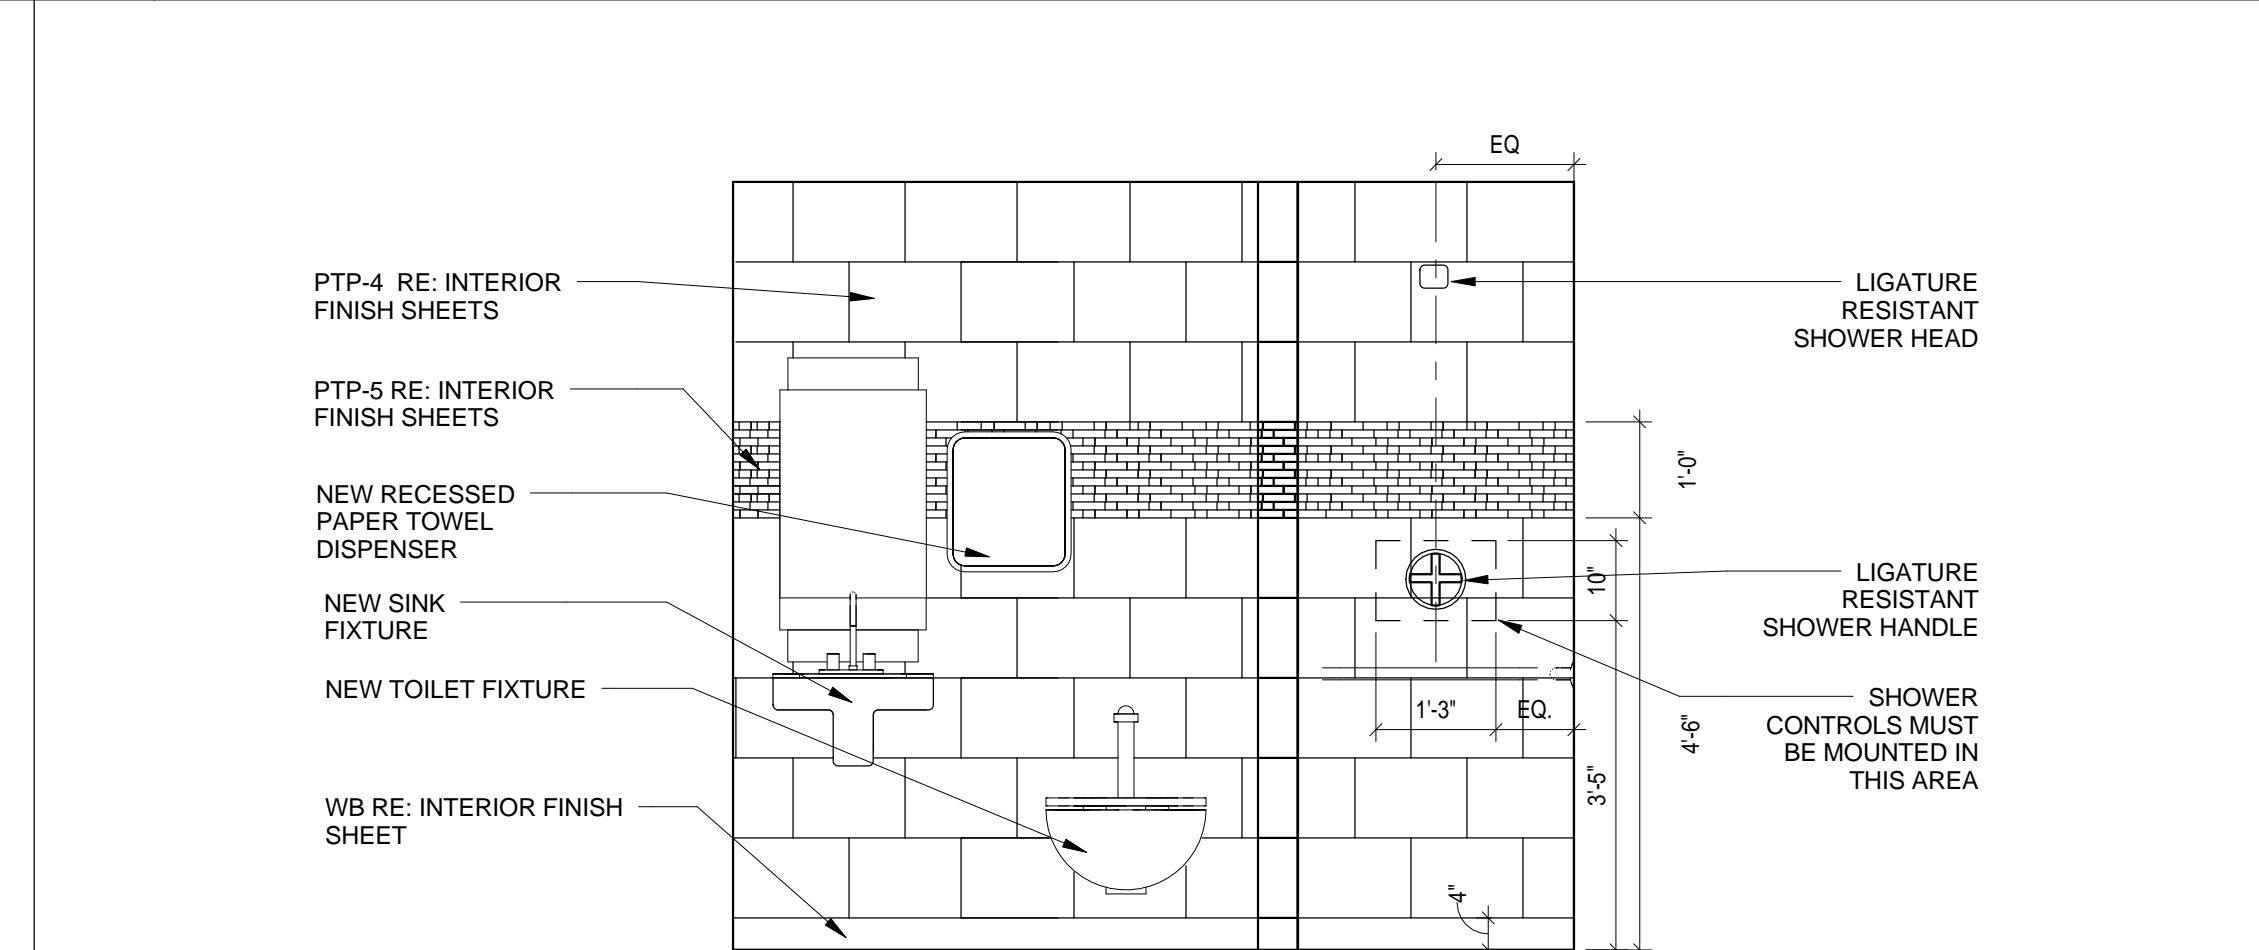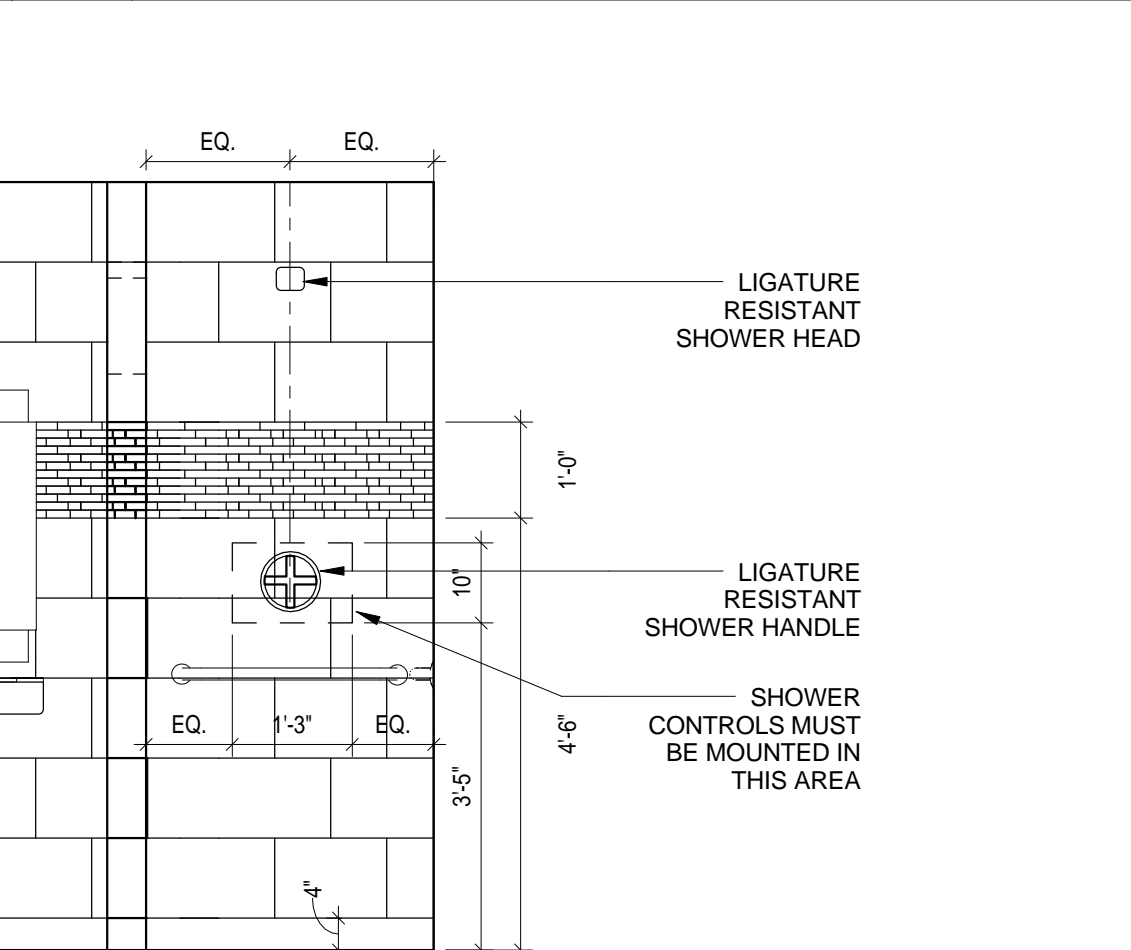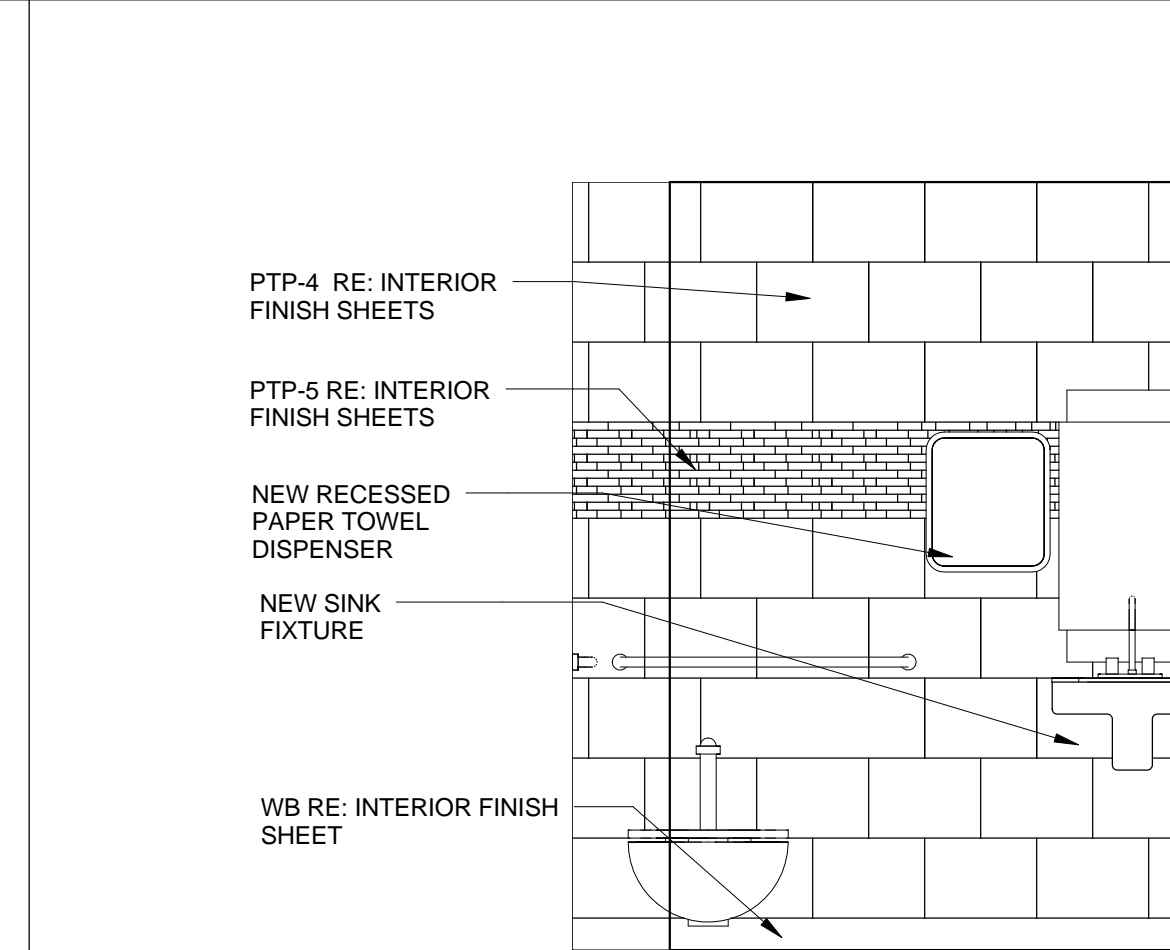

**10 UNIT 3D RESTROOM ELEVATION**  
 1/2" = 1'-0"

**8 TYPICAL RESTROOM ELEVATION**  
 1/2" = 1'-0"

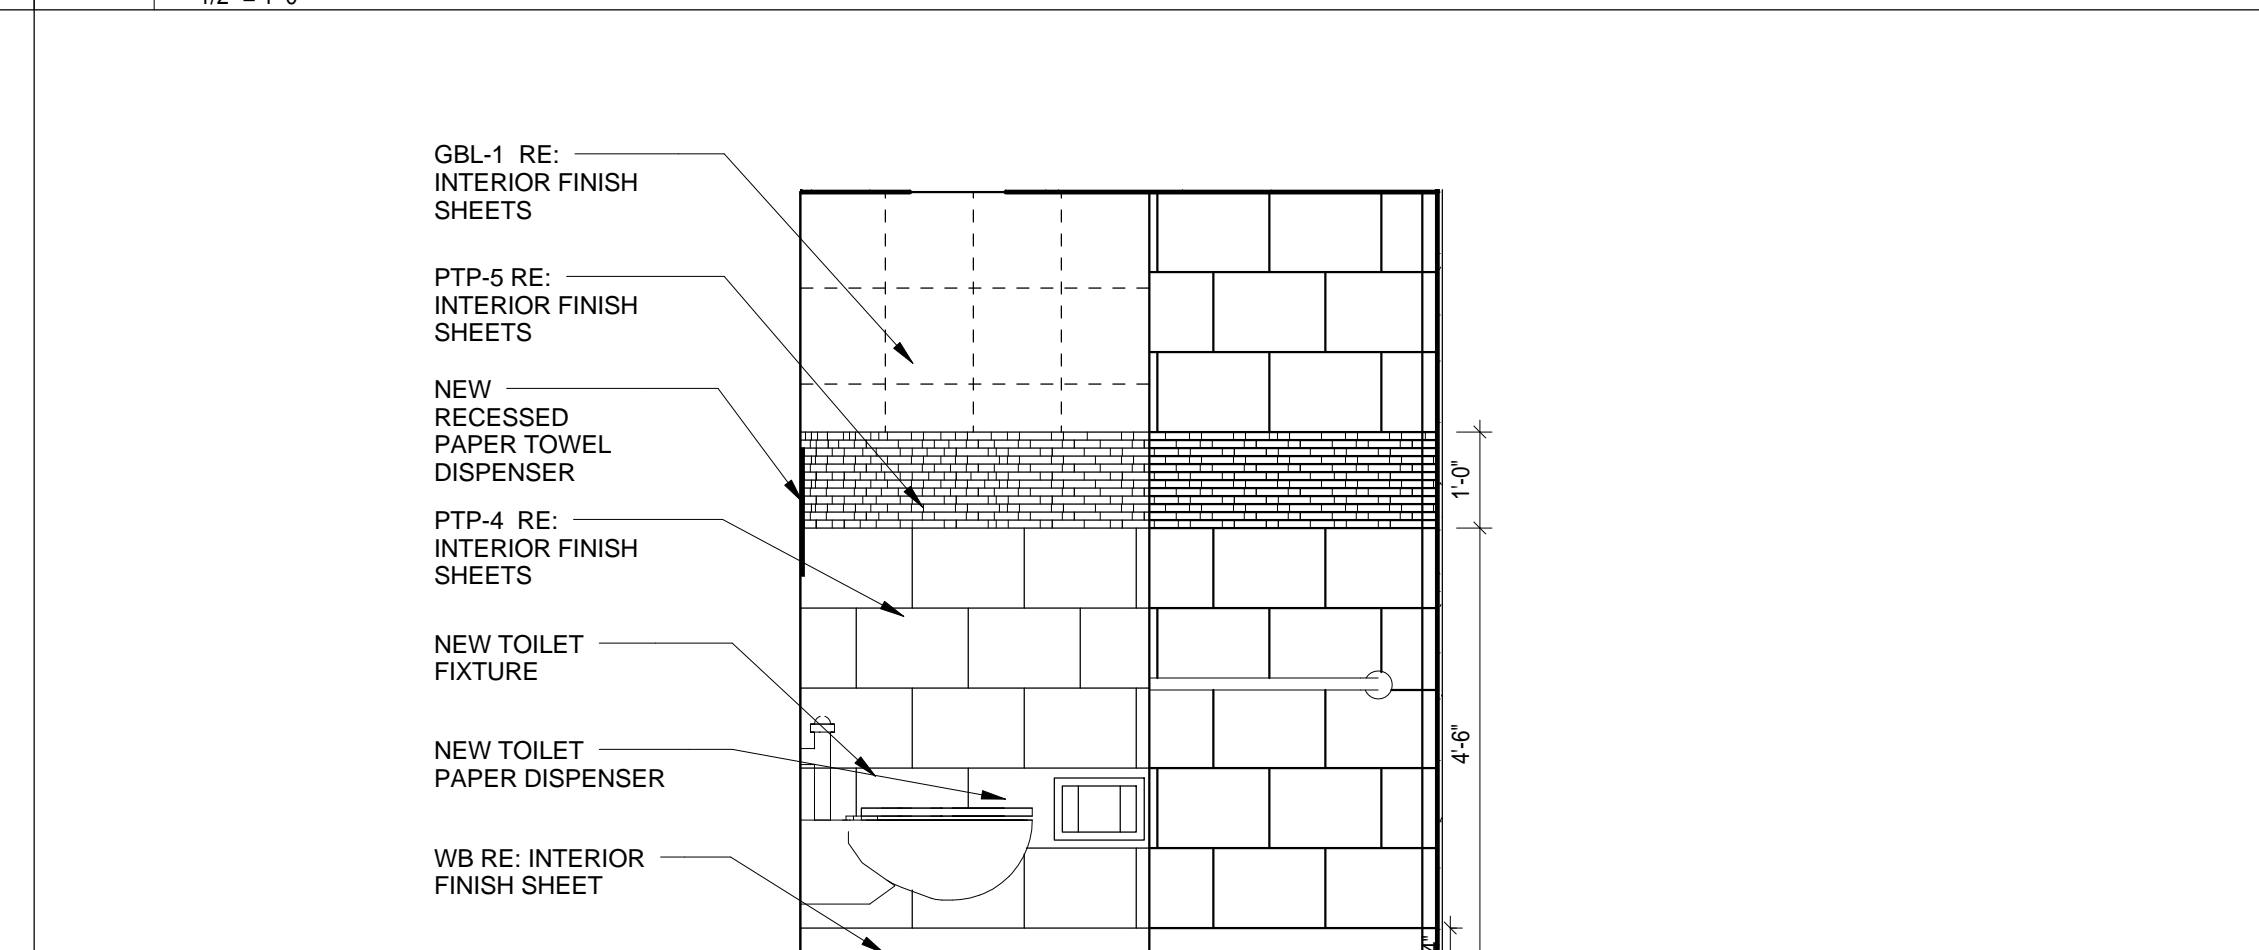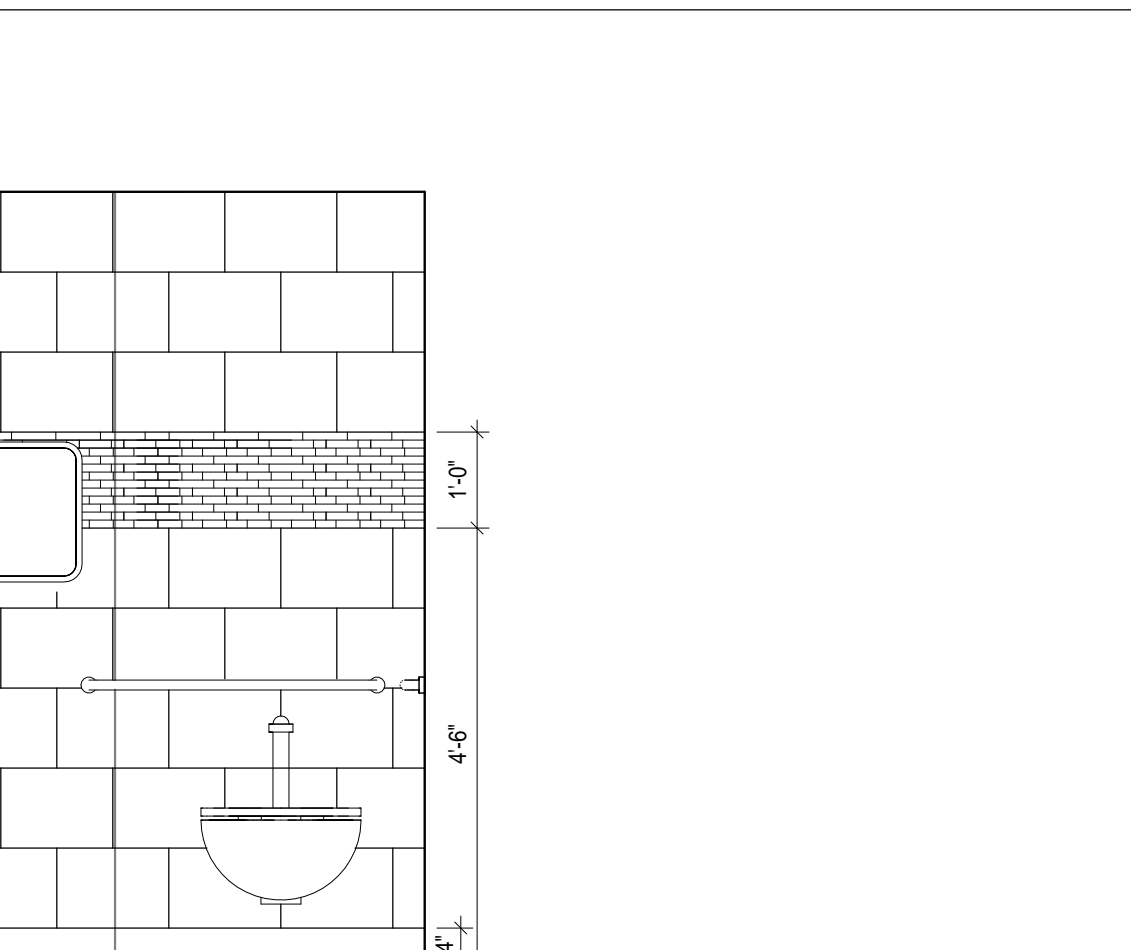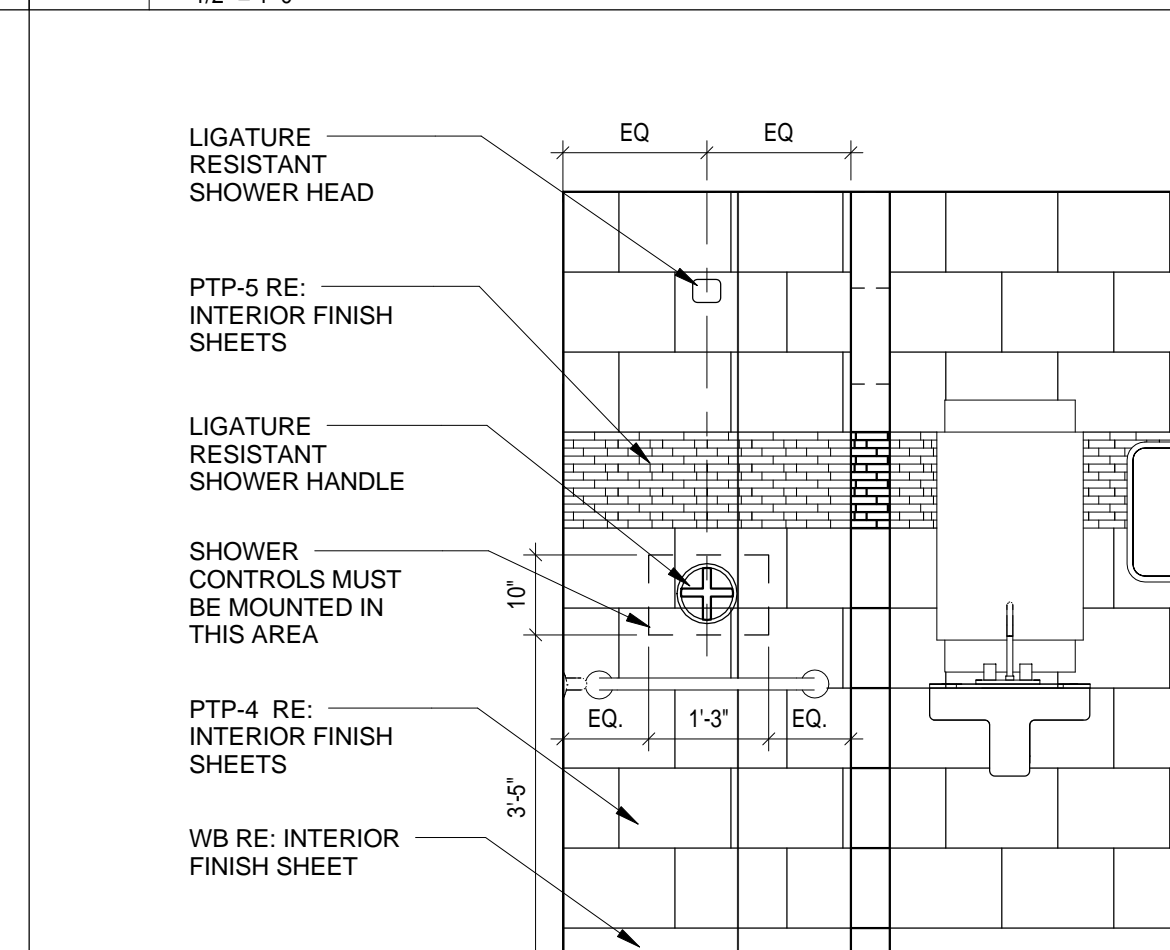

**4 TYPICAL RESTROOM ELEVATION**  
 1/2" = 1'-0"

**2 TYPICAL RESTROOM ELEVATION**  
 1/2" = 1'-0"

**6 TYPICAL RESTROOM ELEVATION**  
 1/2" = 1'-0"

**2 TYPICAL RESTROOM ELEVATION**  
 1/2" = 1'-0"



No.	Description	Date

**BRACING PLAN REQUIREMENTS (INTERIOR WALLS ONLY)**

**BRACE FRAMING FOR 3 5/8" STUDS**

STUD TYPE	STUD PROP.	SPACING	MAX. LENGTH	MISCELLANEOUS
SJ 20 (40 KSI) (20 GA.)	1X = 0.541 IN <sup>4</sup>	4'-0" O.C.	14'-0"	BRACE AT MID-POINT FOR LENGTHS OVER 14'-0"
	α = 1.429 IN			
	A = 0.2136 IN <sup>2</sup>			
	Sx = 0.273 IN <sup>3</sup>			


**BRACE FRAMING FOR 6" STUDS**

STUD TYPE	STUD PROP.	SPACING	MAX. LENGTH	MISCELLANEOUS
SJ 20 (40 KSI) (20 GA.)	1X = 1.787 IN <sup>4</sup>	4'-0" O.C.	20'-0"	BRACE AT MID-POINT FOR LENGTHS OVER 20'-0"
	α = 2.253 IN			
	A = 0.2148 IN <sup>2</sup>			
	Sx = 0.539 IN <sup>3</sup>			

**LIMITING HEIGHT OF METAL STUDS**

STUD SIZE	SPACING	25 GA.	20 GA.
2 1/2"	16"	11'-3"	12'-10"
3 5/8"	16"	14'-4"	16'-5"
6"	16"	19'-9"	24'-6"

**NOTE:** THE TABLE INDICATED ABOVE IS BASED ON "DIETRICH" LIMITING HEIGHT CHART AND IS TO BE USED AS A GUIDE FOR INTERIOR WALL CONSTRUCTION. THE TABLE IS BASED WITH SHEATHING BOARD ON BOTH SIDES OF PARTITION.

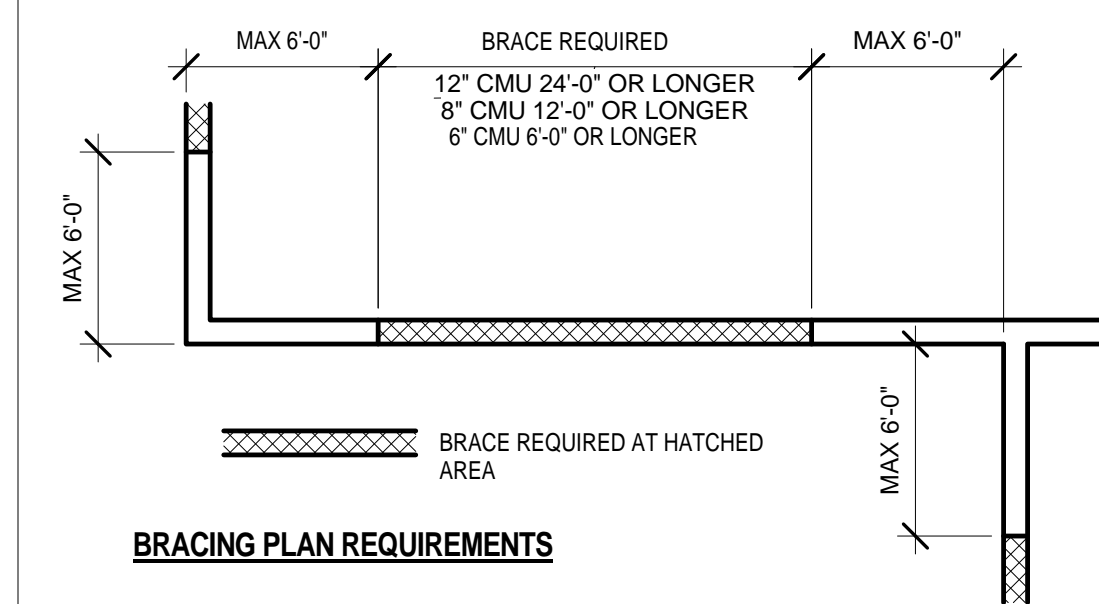

**NON-LOAD BEARING WALL BRACES.** BRACING AT THE TOP OF MASONRY WALLS IS REQUIRED ON STRAIGHT RUNS OF WALL MORE THAN SIX FEET FROM A CORNER OR INTERSECTING WALL.

**25 PARTITION TYPES-TYP. CMU WALL BRACING**  
1/2" = 1'-0"

**BRACING NOTES:**

- AT WALLS THAT TERMINATE ABOVE CEILING, CONTRACTOR MAY CONTINUE METAL STUD FRAMED WALLS TO UNDERSIDE OF METAL DECK AND OMIT DIAGONAL BRACING IF HEIGHT DOES NOT EXCEED LIMITING HEIGHT OF METAL STUD AS INDICATED ON CHART BELOW.
- PROVIDE INTERMEDIATE BRACING AT ALL PARTITIONS THAT EXCEED LIMITING HEIGHT OF METAL STUDS AS INDICATED ON CHART BELOW.
- ALL BRACING SHALL BE AT STUD POINTS.
- HERE BRACING METHODS BETWEEN THIS SHEET AND STRUCTURE CONFLICT, STRUCTURE SHALL OVERRIDE. NOTIFY ARCHITECT.

**TERMINATION NOTES:**

- AT ALL RATED PARTITIONS, FILL VOIDS IN METAL DECK AT TOP OF PARTITIONS WITH FIRESAFING.

**GYPSUM WALLBOARD PARTITION NOTES:**


- ALL METAL STUD PARTITIONS ARE 25 GAUGE METAL STUDS AT 16" O.C. UNLESS NOTED OTHERWISE. IF THE LIMITING HEIGHT FOR A PARTITION IS EXCEEDED, INCREASE GAUGE OF STUDS AS INDICATED ON LIMITING HEIGHT OF METAL STUDS TABLE BELOW. NOTIFY ARCHITECT PRIOR TO INSTALLATION.
- PROVIDE 20 GAUGE METAL STUDS IN LIEU OF 25 GAUGE METAL STUDS AT STUD WALL CERAMIC TILE LOCATIONS.
- SET ALL FLOOR TRACKS ON A CONTINUOUS RIBBON OF SEALANT.
- AT PARTITIONS DESIGNATED TO HAVE SOUND ATTENUATION BLANKETS:
  - PROVIDE 3-1/2" OR 6" THICK (MATCH STUD SIZE) SOUND ATTENUATION BLANKETS OR BATTS FULL HEIGHT OF PARTITION, UNLESS NOTED OTHERWISE.
  - FILL ALL DECK VOIDS WITH SOUND ATTENUATION MATERIAL.
  - SEAL PARTITION PERIMETER AND ALL PENETRATIONS WITH ACOUSTICAL SEALANT.
  - TAPE AND BED OR CAULK ALL JOINTS BETWEEN FIRST AND SECOND LAYERS OF GYPSUM BOARD AND AT ALL SOUND RATED WALLS TAKEN THROUGH THE CEILING.
  - PROVIDE CONTINUOUS ACOUSTICAL SEALANT AT BOTTOM OF PARTITION ON BOTH SIDES AT NON-RATED PARTITIONS AND PROVIDE CONTINUOUS FIRE RATED SEALANT AT FIRE-RATED PARTITIONS.
- PROVIDE TILE BACKER BOARD ON WALLS BEHIND AND ADJACENT TO PLUMBING FIXTURES, AND BEHIND ALL CERAMIC TILE AT ALL DAMP LOCATIONS AT GYPSUM BOARD PARTITIONS.
- RIGIDLY BRACE ALL DOOR JAMBS AT THE HEAD, HINGE AND STRIKE SIDES AND WINDOW AT THE HEAD, SILL AND JAMBS.
- LOCATE CONTROL JOINTS IN GYPSUM BOARD PARTITIONS AS FOLLOWS:
  - PARTITIONS OR FLURRING RUNS EXCEEDING 30'-0"
  - WHERE A PARTITION ABUTS A STRUCTURAL ELEMENT OR DISSIMILAR WALL
  - CONSTRUCTION CHANGES WITHIN PLANE OF PARTITION
  - AT EXPANSION OR CONTROL JOINTS THROUGHOUT THE BUILDING
  - AT BOTH JAMBS OF INTERIOR AND EXTERIOR DOOR AND WINDOW FRAMES, ABOVE AND BELOW FULL HEIGHT OF WALL
- FIRE RATED PARTITIONS:
  - PROVIDE TYPE "X" FIRE RESISTIVE GYPSUM BOARD, 5/8" THICK UNLESS NOTED OTHERWISE.
  - FILL ALL VOIDS AT DECK WITH FOAM FIRESTOP SEALANT
  - SEAL PARTITION PERIMETER AND ALL PENETRATIONS WITH RATED SEALANT
  - REFER TO UL MANUAL FOR RATED PARTITION DESCRIPTIONS AND DETAILED CONSTRUCTION NOTES.
  - PROVIDE DEFLECTION TRACK AT ALL STUD CONNECTIONS AT BOTTOM OF DECK AND FILL VOIDS AS REQUIRED.
  - EXTEND GYPSUM BOARD ABOVE ADJACENT FINISHED CEILING MINIMUM OF SIX INCHES (6").

**HOW TO USE THIS SHEET:**


- NOT EVERY PARTITION TYPE SHOWN IS NECESSARILY INTENDED FOR THE USE ON THIS PROJECT. REFER TO FLOOR PLANS FOR REFERENCE MARKS INDICATING APPLICABLE PARTITION TYPES.
- REFER TO BRACING DETAILS FOR SUPPORT OF THE TOP OF EACH PARTITION TYPE AND BRACING OF PARTITIONS THAT EXCEED LIMITING HEIGHT OF PARTITION TYPES.
- REFER TO FINISH SCHEDULES FOR APPLIED FINISHES TO BOTH SIDES OF WALLS.
- COORDINATE TOPS OF FINISHED WALLS WITH ADJACENT CEILING HEIGHTS PER SCHEDULES, SECTIONS AND/OR DETAILS.
- CONSULT ARCHITECT FOR ANY DISCREPANCIES OR QUESTIONS REGARDING PARTITIONS PRIOR TO INSTALLATION.

**20 PARTITION TYPES-BRACING CHART**  
1/2" = 1'-0"

**BRACING PLAN REQUIREMENTS**

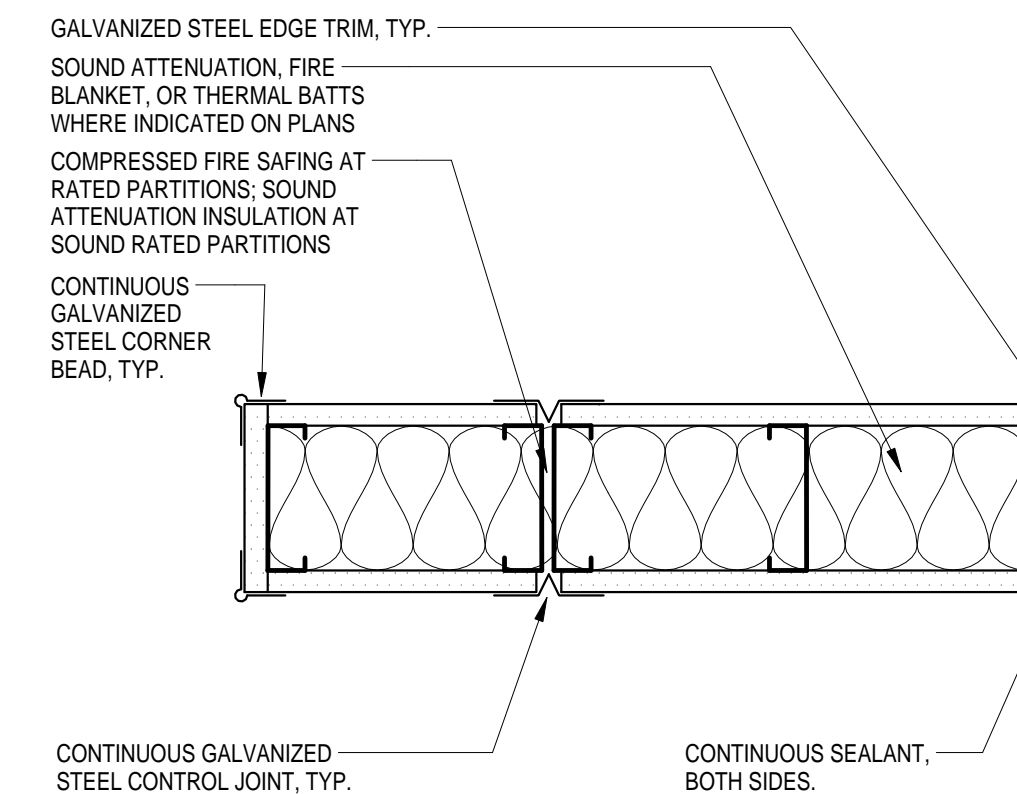


**PLAN (TERMINATIONS, ENDS AND JOINTS)**

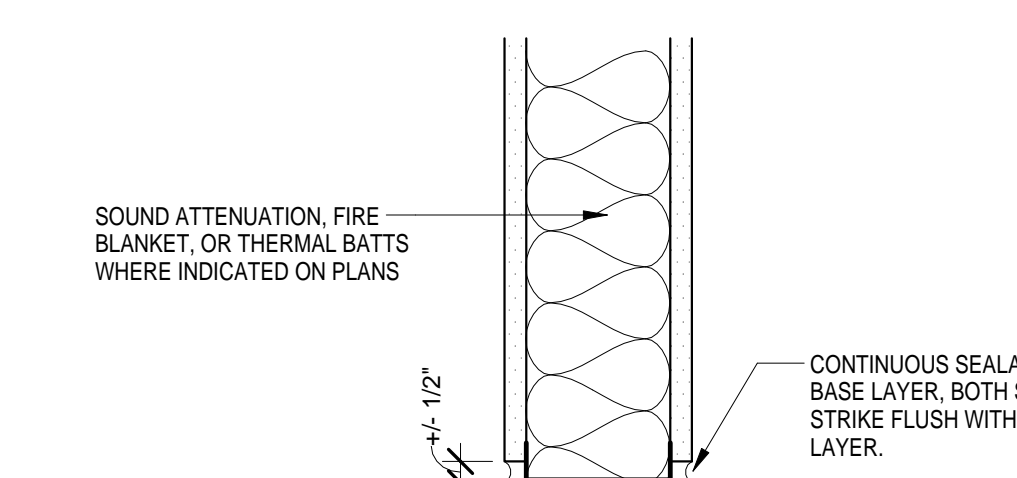


**BASE TERMINATION**

**18 PARTITION TYPES-TYPICAL DETAILS**  
1/2" = 1'-0"

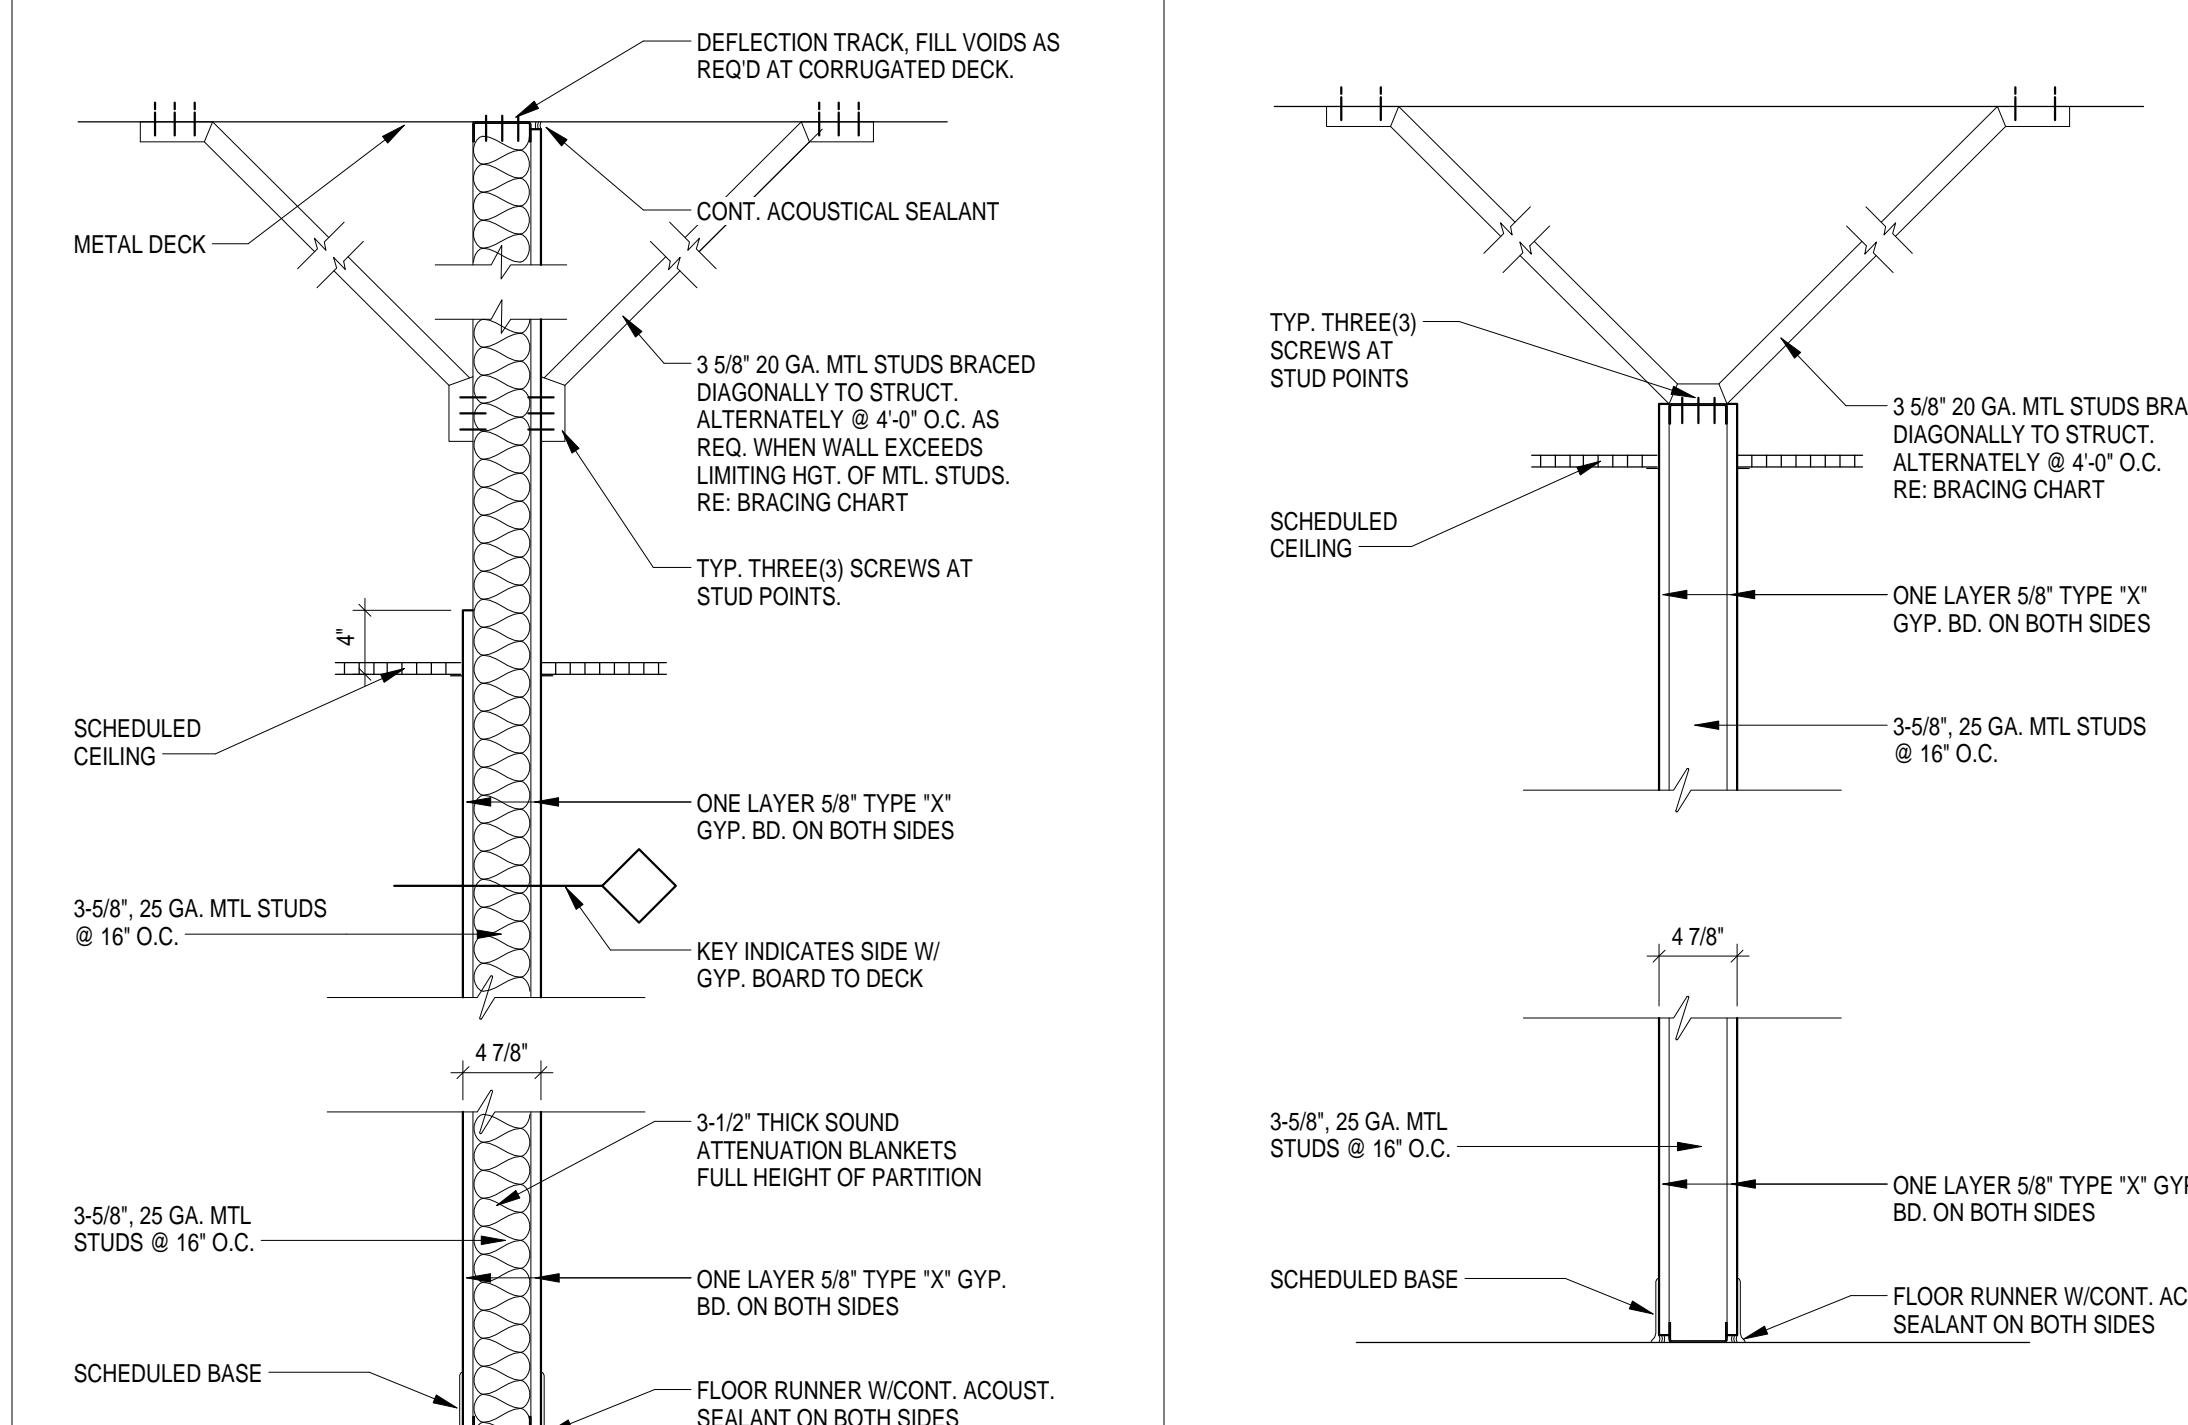

TYPE	FIRE RATG	DESCRIPTION
S1	NONE	W/ 3 1/2" SOUND ATTENUATION INSULATION
S1A	ONE HOUR	W/ 3 1/2" SOUND ATTENUATION INSULATION WITH FIRE RATED CEILING

**1 PARTITION TYPE S1**  
1" = 1'-0"

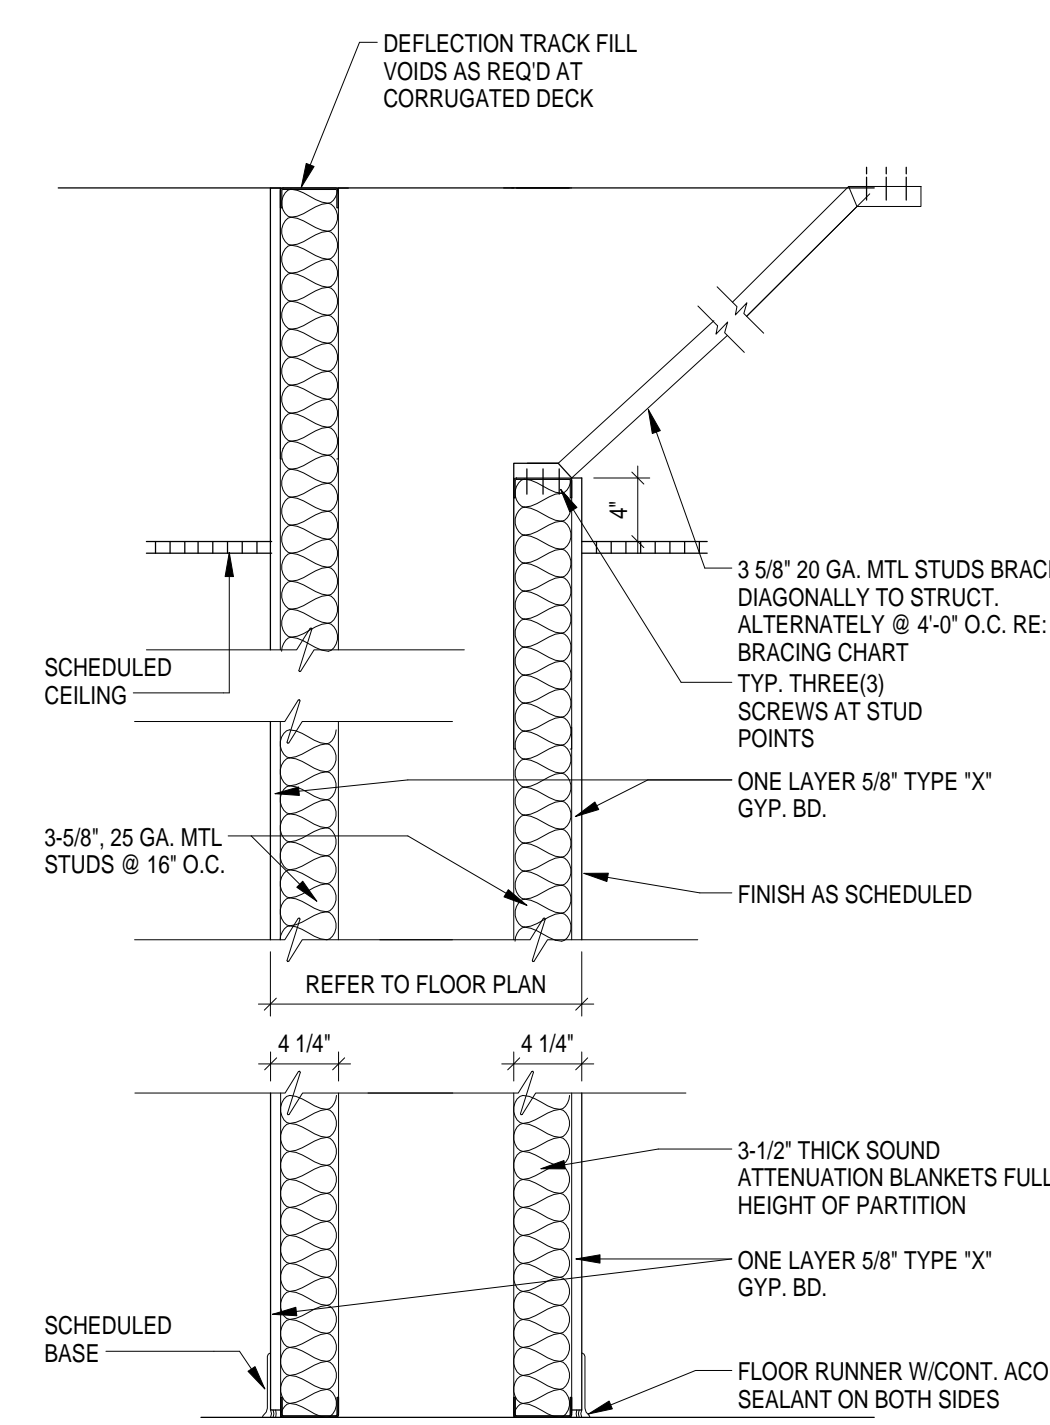


TYPE	FIRE RATG	DESCRIPTION
S3	NONE	3-5/8" METAL STUDS TO DECK
S3A	ONE HOUR	3-5/8" METAL STUDS TO DECK WITH FIRE RATED CEILING

**3 PARTITION TYPE S5**  
1" = 1'-0"


TYPE	FIRE RATG	DESCRIPTION
S5	NONE	3-5/8" MTL. STUD TO DECK ONE SIDE



**HARRIS COUNTY PSYCHIATRIC  
 CENTER RENOVATION UNITS: 1C,  
 2E, 3B, 3C, 3D & 3E**

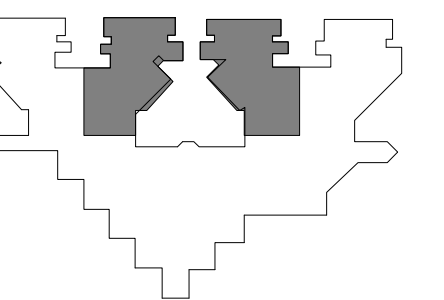

KEY PLAN  
 PLAN NORTH  
 TRUE NORTH

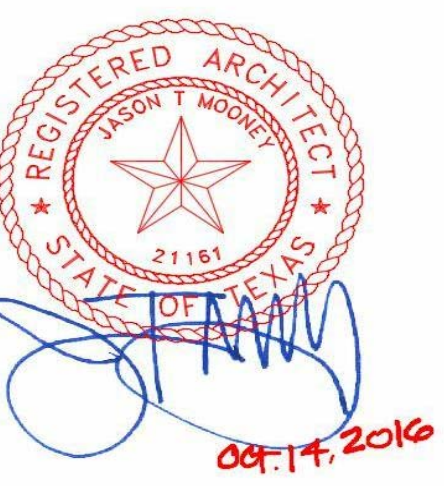


CLIENT	UT HEALTH
PROJECT NUMBER	16106
DATE:	OCTOBER 14, 2016
DRAWN BY:	VG
CHECKED BY:	JM
REVISIONS	


No.	Description	Date

ISSUE FOR BID  
**MILLWORK SECTIONS**


**A8.01**

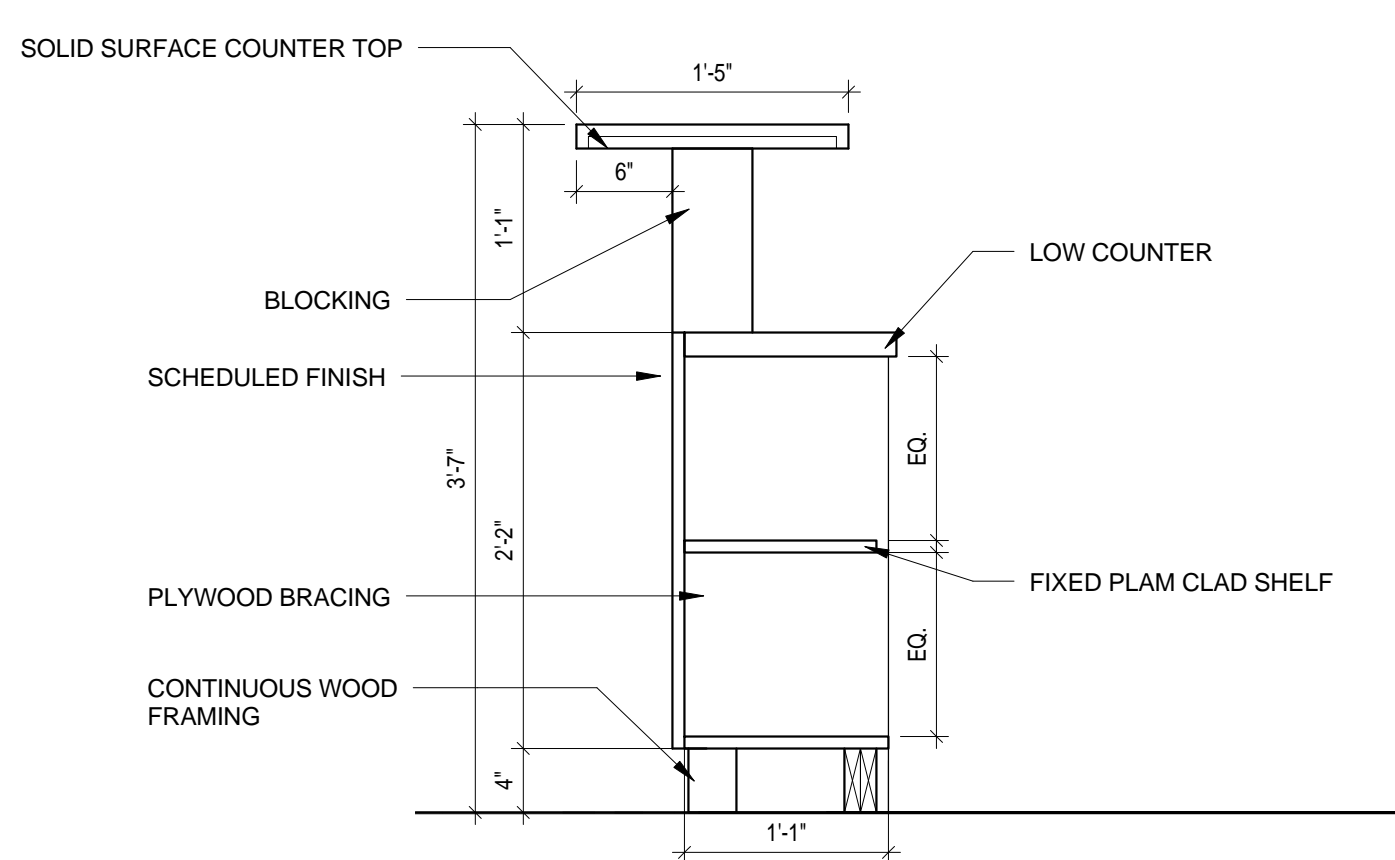

**3** MILLWORK SECTION  
 1" = 1'-0"

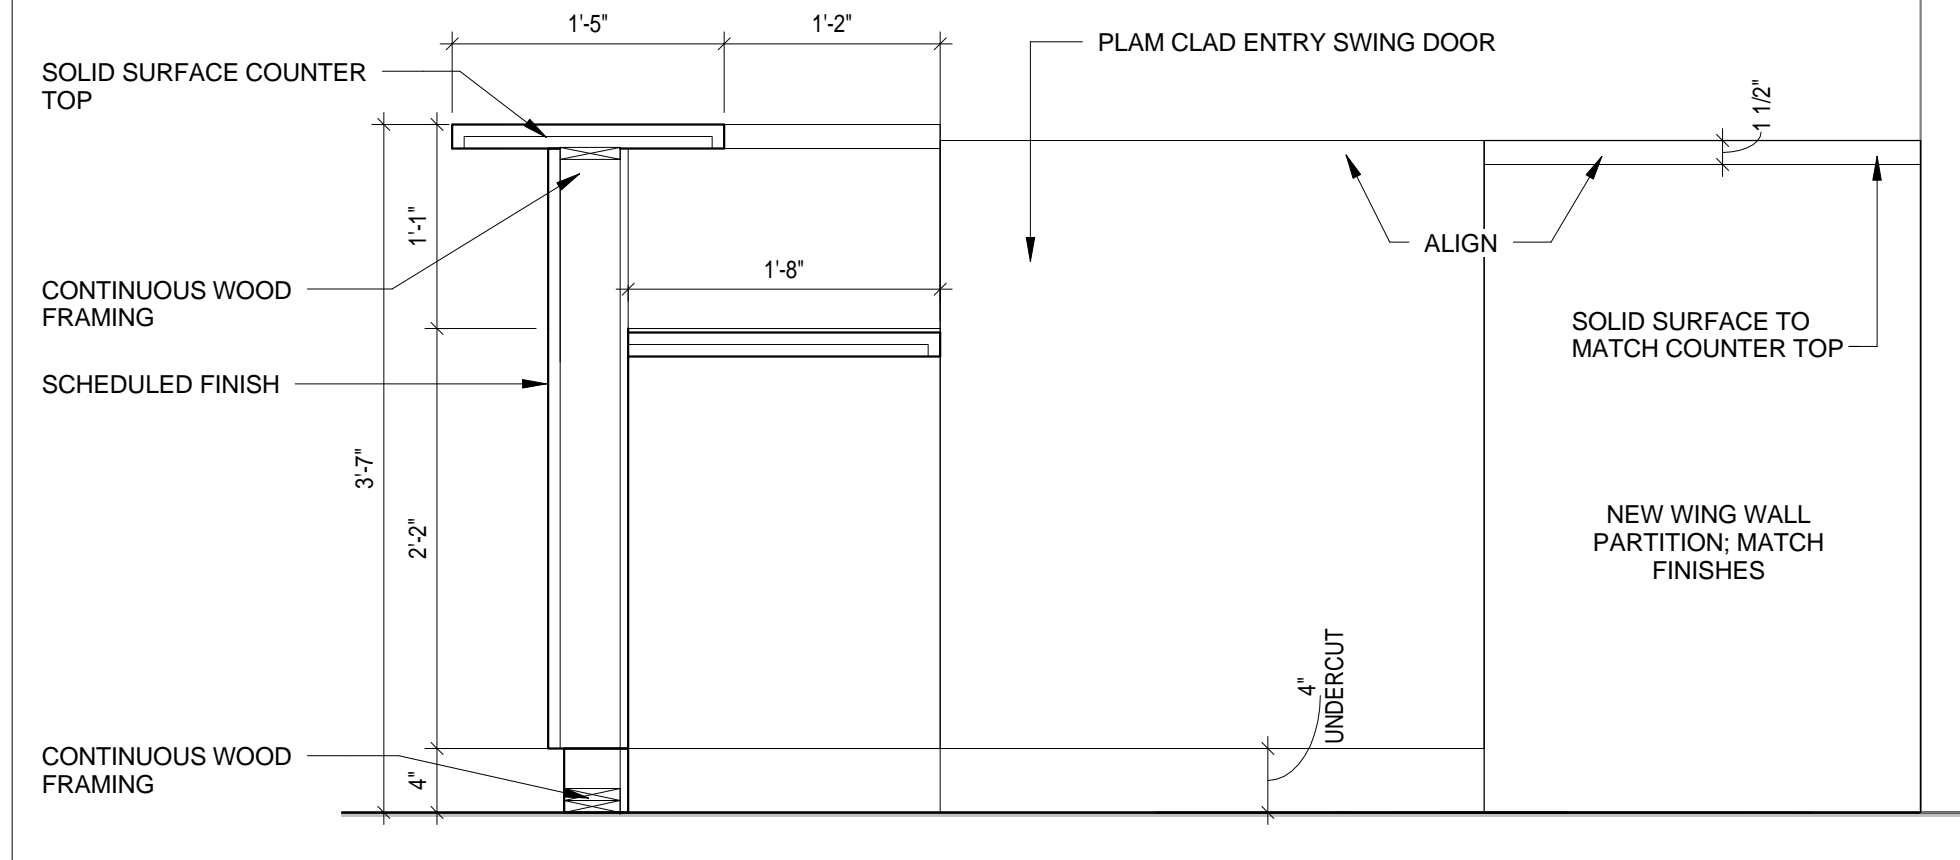

**2** MILLWORK SECTION  
 1" = 1'-0"

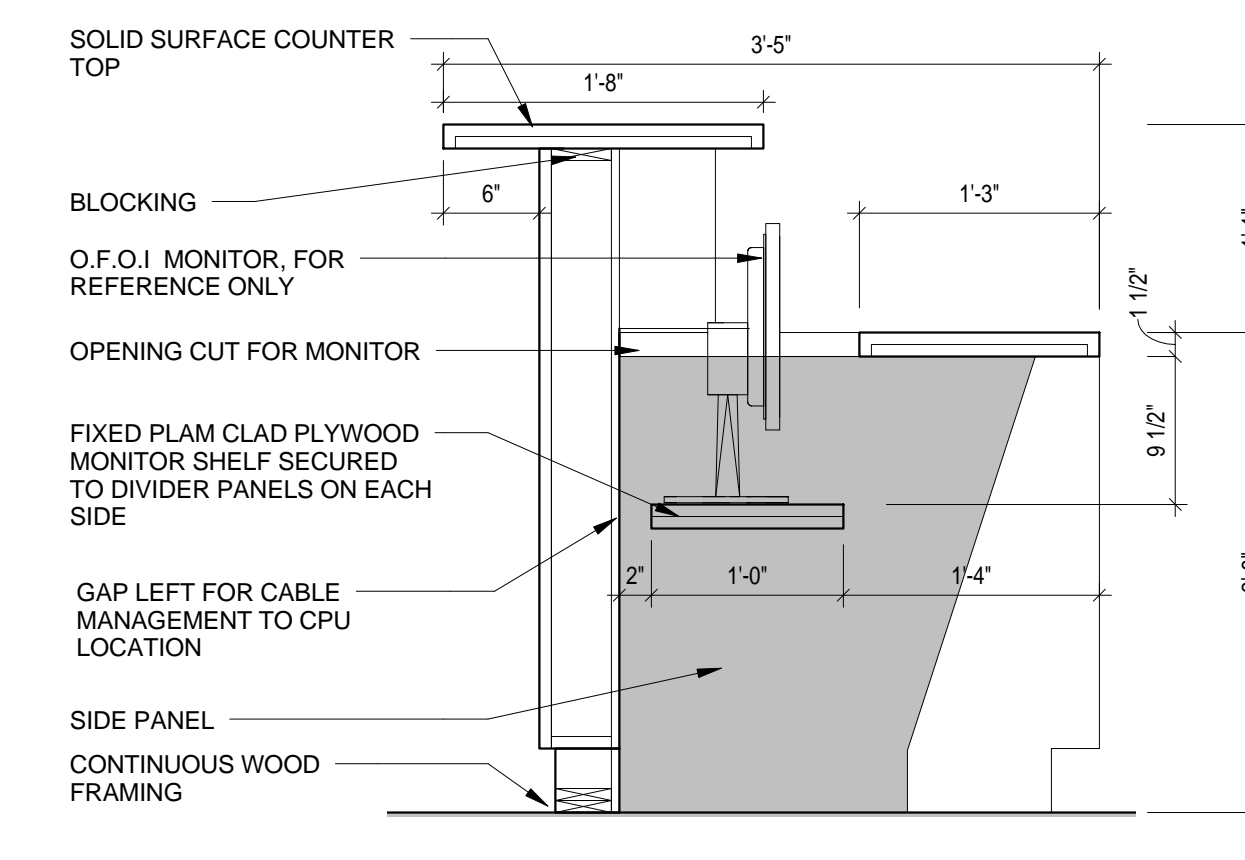

**1** MILLWORK SECTION  
 1" = 1'-0"



**GENERAL REFLECTED CEILING PLAN NOTES**


- THE CONTRACTOR SHALL COMPARE THIS REFLECTED CEILING PLAN WITH INDICATED ELECTRICAL LIGHTING PLANS, MECHANICAL SUPPLY, RETURN AND EXHAUST PLANS, MECHANICAL FIXTURES ARE NOT INDICATED ON THIS PLAN, RE: MEP. THE CONTRACTOR SHALL REPORT ANY OMISSIONS OR INCONSISTENCIES TO THE ARCHITECT.
- SEE ELECTRICAL DRAWINGS FOR THE LOCATIONS OF CEILING MOUNTED SMOKE DETECTORS, PEAKERS, EXIT SIGNAGE AND FIRE ALARM DEVICES, ETC. ALSO SEE ELECTRICAL FOR LOCATIONS OF WALL MOUNTED EXIT LIGHTS.
- SPRINKLER HEADS ARE NOT SHOWN ON ARCHITECTURAL REFLECTED CEILING PLANS. CONTRACTOR TO INSTALL SUFFICIENT HEADS IN ALL SPACES TO PROVIDE 100% COVERAGE AS REQUIRED UNDER NFPA 13 AND OWNERS' INSURANCE COMPANIES REQUIREMENTS. CENTER ALL SPRINKLER HEADS IN CEILING TILES AND GYPSUM BOARD CEILINGS.
- CEILING ACCESS PANELS ARE NOT SHOWN ON ARCHITECTURAL REFLECTED CEILING PLANS. THE CONTRACTOR SHALL VERIFY THAT ACCESS PANELS OF TYPE SPECIFIED ARE INSTALLED IN NON-ACCESSIBLE TYPE CEILINGS WHERE SERVICE OR ADJUSTMENT TO MECHANICAL, PLUMBING, OR ELECTRICAL ITEMS MAY BE REQUIRED. ACCESS PANELS SHALL BE EQUAL TO THE RATING OF THE WALL OR CEILING IN WHICH THEY OCCUR.
- 18" MINIMUM VERTICAL CLEARANCE SHALL BE MAINTAINED BETWEEN THE BOTTOM OF THE EXTENDED SPRINKLER HEADS AND THE TOP OF ANY FILES, SHELVING, LOCKERS, ETC.
- PRE-MANUFACTURED SHOWER UNITS ARE PROVIDED WITH LIGHT FIXTURES (RE: ELECTRICAL FOR CONNECTION).
- ALL CEILING ELEMENTS TO BE PLACED IN THE CENTER OF CEILING TILE OR CENTER OF GYP. BOARD CEILING AREA U.N.O.
- ALL CEILING GRIDS TO BE CENTERED BETWEEN WALLS U.N.O.
- V.I.F. CEILING HEIGHT. ALL ACOUSTICAL CEILINGS TO MATCH EXISTING CEILING HEIGHT UNLESS NOTED OTHERWISE.
- SAW CUT AND REMOVE EXISTING SLAB AND FLOOR FINISHES AS REQUIRED TO INSTALL NEW PLUMBING LINES, FLOOR DRAINS, FIXTURES OR ELECTRICAL ITEMS. SPLICE NEW REINFORCING BARS DOWELED INTO EXISTING CONCRETE AND PROVIDE NEW VAPOR RETARDER AND WATERSTOPS. PATCH WITH A MINIMUM OF 300 PSI CONCRETE AFTER INSTALLATION OF UTILITIES AND FIXTURES. PREPARE CONCRETE TO RECEIVE NEW FINISH.
- ALL EXISTING CEILING DEVICES TO REMAIN; COORDINATE REMOVAL AND RE-INSTALLATION WITH OWNER.

**GENERAL REFLECTED CEILING PLAN LEGEND**

- SUSPENDED 2' X 2' ACOUSTICAL CEILING SYSTEM (APC)
- 2X4 FLORESCENT
- 2X2 FLORESCENT
- 1 x 4 LIGHT FIXTURE
- RECESSED CAN LIGHT FIXTURE
- SUPPLY AIR GRILLE  
CLEAN ALL EXISTING GRILLES AT ALL HARD CEILING LOCATIONS; RE-PAINT ALL OTHER EXISTING GRILLES IN LAY-IN CEILING LOCATIONS; G.C. TO FIELD VERIFY
- RETURN AIR GRILLE  
CLEAN ALL EXISTING GRILLES AT ALL HARD CEILING LOCATIONS; RE-PAINT ALL OTHER EXISTING GRILLES IN LAY-IN CEILING LOCATIONS; G.C. TO FIELD VERIFY
- CEILING DETAIL TAG
- CEILING TYPE  
9'-0" AFF  
CEILING HEIGHT DESIGNATION PER AREA
- GYP. BOARD CEILING
- EXIT LIGHT
- ONLY FISK ELECTRIC TO REMOVE EXISTING CAMERAS PRIOR TO DEMOLITION AND STORE DEVICES WITHIN HOURS OR REWOTE LOCATION AS COORDINATED WITH OWNER. FISK ELECTRIC TO REINSTALL CAMERA AND COMPLETION OF PROJECT.
- PROVIDE NEW PATIENT MONITORING CAMERA WHERE SHOWN; COORDINATE FINAL POSITION W/ OWNER. ALTERNATE NO. 1C-04; RE: SPECS
- CURTAIN TRACK MOUNTED TO CEILING AT THIS LOCATION WITH PRIVACY CURTAIN WITH BREAK AWAY MESH
- EXISTING SPEAKER
- EXISTING FIRE SPRINKLER

**REFLECTED CEILING PLAN KEY NOTES**

- (01) REPAINT EXISTING CEILING;
- (02) PAINT EXISTING CEILING GRID WHITE THROUGHOUT AND PATCH/REPAIR AS NEEDED; REPLACE ALL CEILING TILES
- (03) REPLACE EXISTING LIGHT FIXTURES WITH NEW SCHEDULED FIXTURES; RE: MEP DRAWINGS
- (04) RE-WORK CEILING TILE AND GRID AS NEEDED TO MATCH EXISTING
- (05) RE-LAMP EXISTING FIXTURES AND CLEAN LENSES
- (06) RE-LAMP EXISTING FIXTURES AND CLEAN LENSES; RELOCATE EXISTING FIXTURES CONFLICTING WITH NEW PARTITION
- (07) REPAINT EXISTING CEILING; REFER TO FINISH PLAN (A2.19C - A2.24E) FOR ADDITIONAL INFORMATION; RE-LAMP EXISTING LIGHT FIXTURES AND CLEAN LENSES
- (08) ALTERNATE NO. 1C-04; RE: SPECS

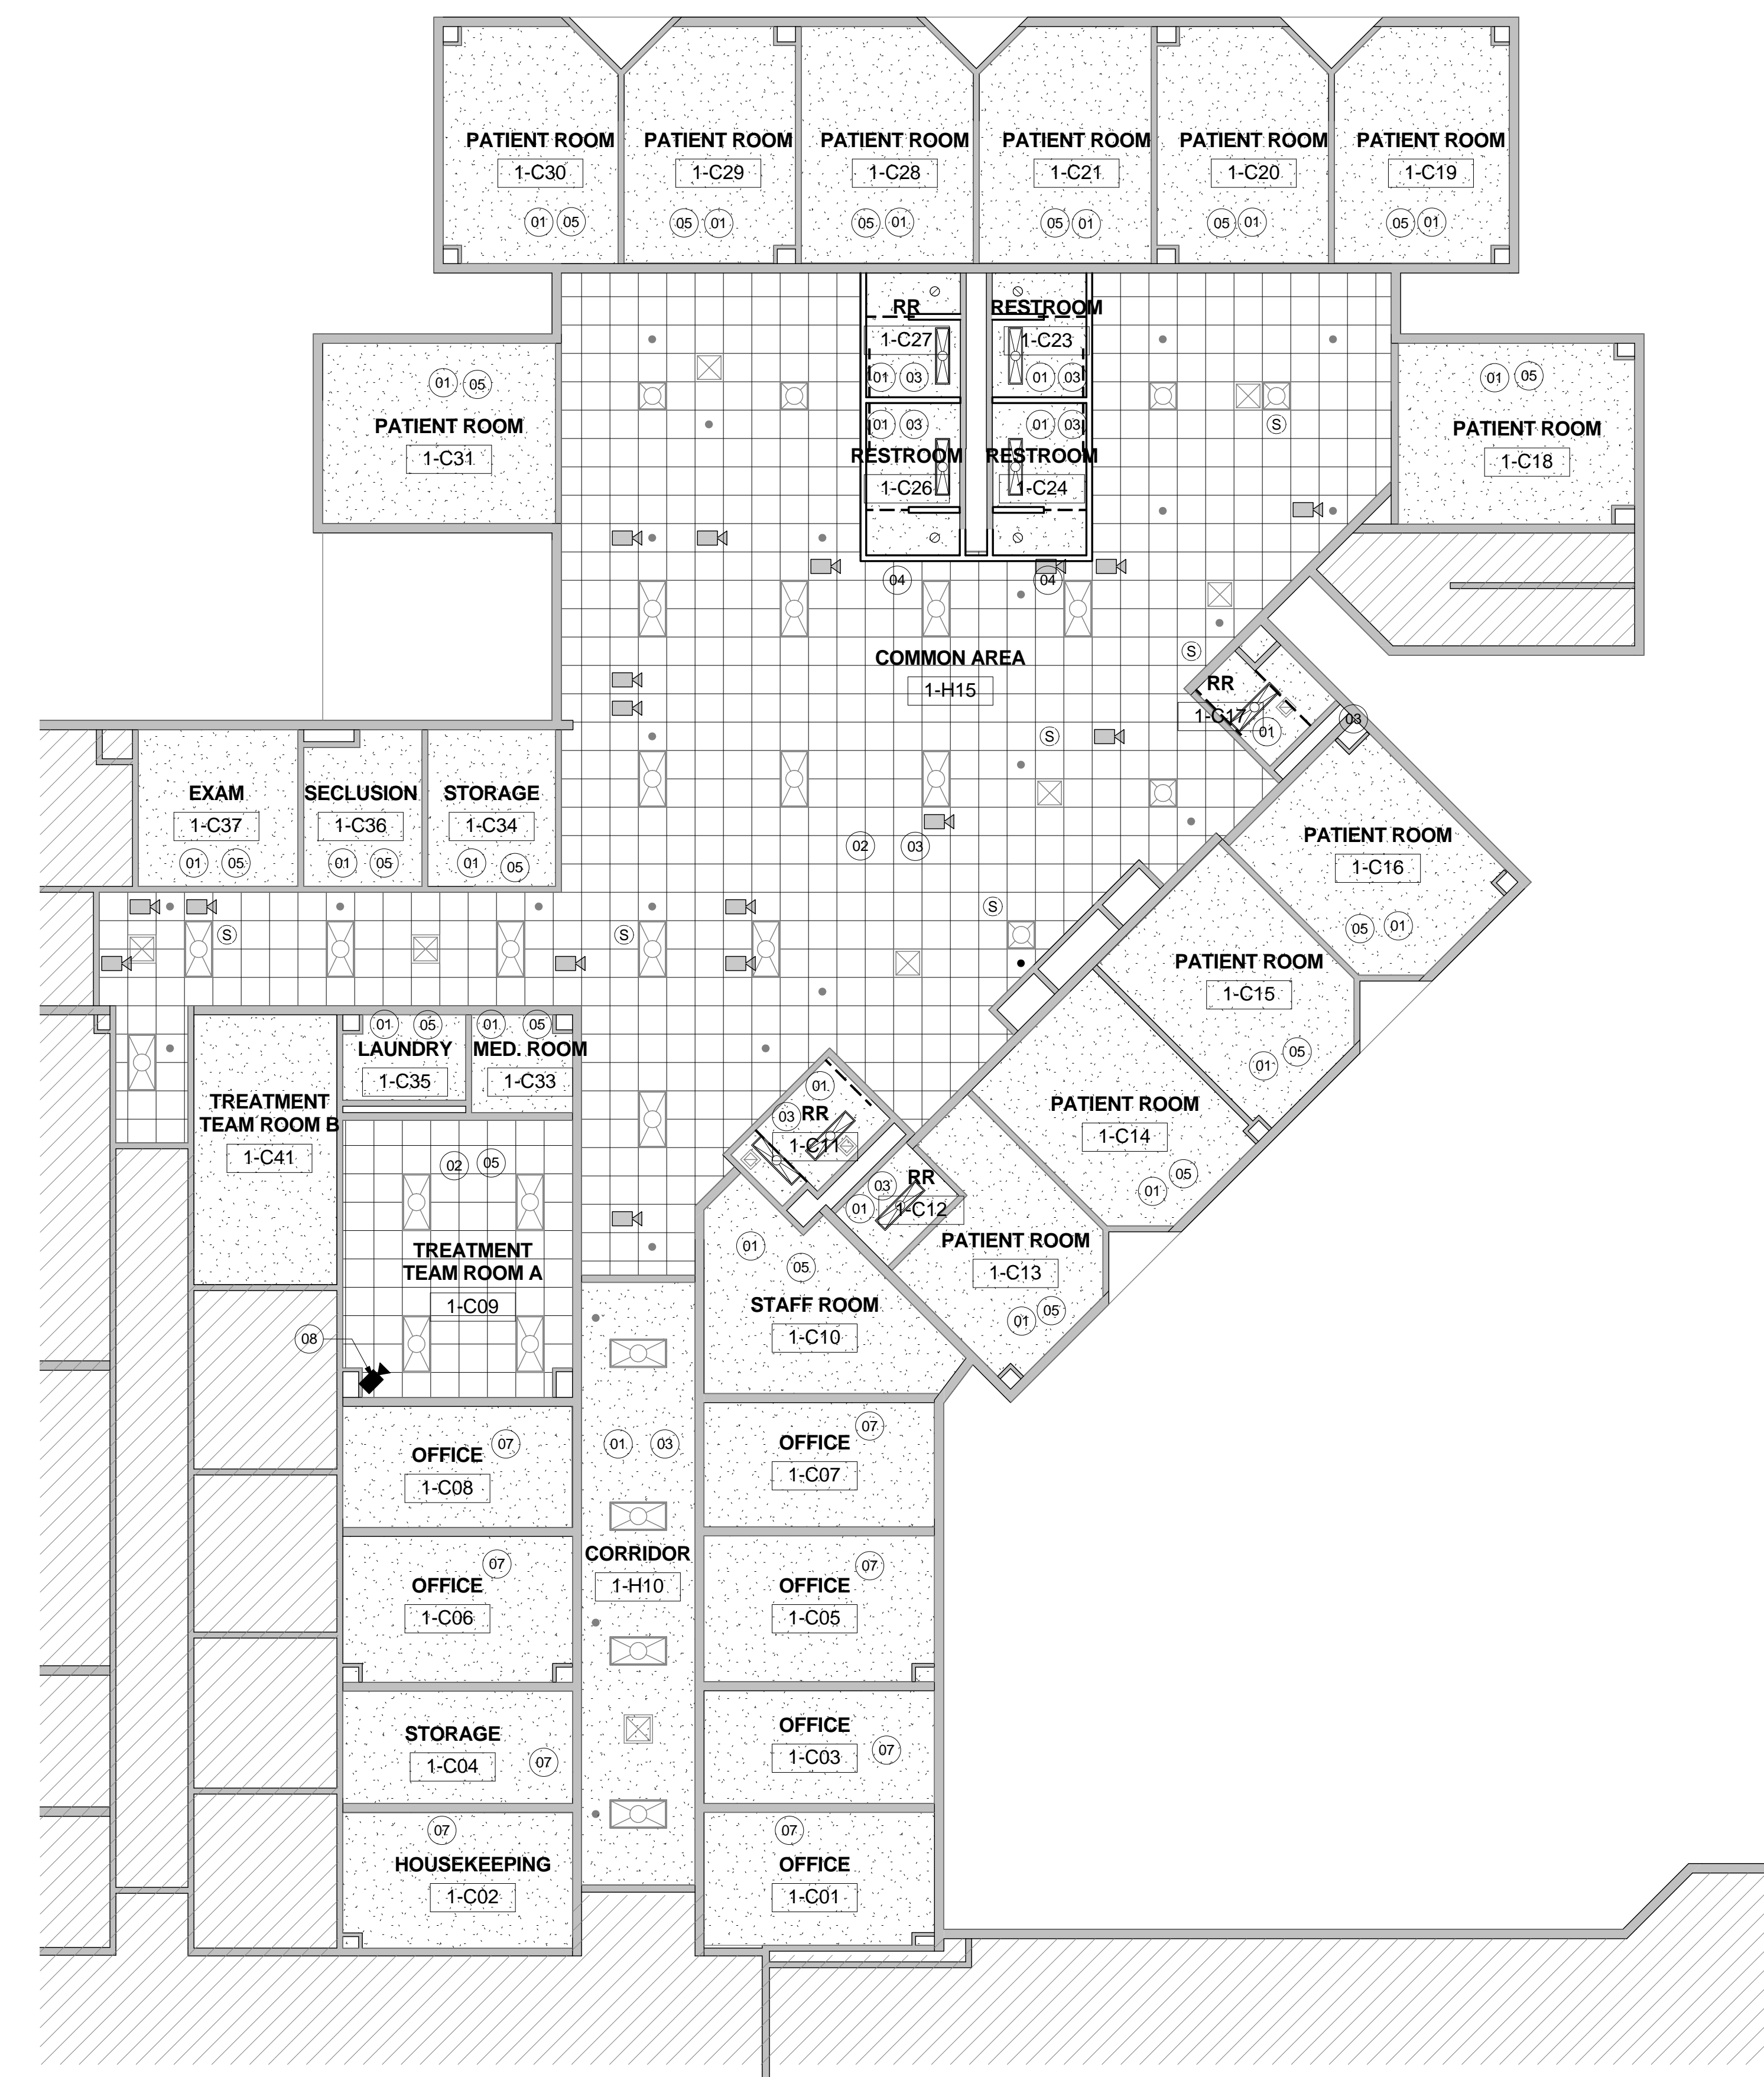







No.	Description	Date

ISSUE FOR BID

REFLECTED CEILING  
PLAN - UNIT 3B  
THIRD FLOOR

A10.03

GENERAL REFLECTED CEILING PLAN NOTES


- THE CONTRACTOR SHALL COMPARE THIS REFLECTED CEILING PLAN WITH INDICATED ELECTRICAL LIGHTING PLANS, MECHANICAL SUPPLY, RETURN AND EXHAUST PLANS, MECHANICAL FIXTURES ARE NOT INDICATED ON THIS PLAN, RE: MEP. THE CONTRACTOR SHALL REPORT ANY OMISSIONS OR INCONSISTENCIES TO THE ARCHITECT.
- SEE ELECTRICAL DRAWINGS FOR THE LOCATIONS OF CEILING MOUNTED SMOKE DETECTORS, PEAKERS, EXIT SIGNAGE AND FIRE ALARM DEVICES, ETC. ALSO SEE ELECTRICAL FOR LOCATIONS OF WALL MOUNTED EXIT LIGHTS.
- SPRINKLER HEADS ARE NOT SHOWN ON ARCHITECTURAL REFLECTED CEILING PLANS. CONTRACTOR TO INSTALL SUFFICIENT HEADS IN ALL SPACES TO PROVIDE 100% COVERAGE AS REQUIRED UNDER NFPA 13 AND OWNERS' INSURANCE COMPANIES' REQUIREMENTS. CENTER ALL SPRINKLER HEADS IN CEILING TILES AND GYPSUM BOARD CEILINGS.
- CEILING ACCESS PANELS ARE NOT SHOWN ON ARCHITECTURAL REFLECTED CEILING PLANS. THE CONTRACTOR SHALL VERIFY THAT ACCESS PANELS OF TYPE SPECIFIED ARE INSTALLED IN NON-ACCESSIBLE TYPE CEILINGS WHERE SERVICE OR ADJUSTMENT TO MECHANICAL, PLUMBING, OR ELECTRICAL ITEMS MAY BE REQUIRED. ACCESS PANELS SHALL BE EQUAL TO THE RATING OF THE WALL OR CEILING IN WHICH THEY OCCUR.
- 18" MINIMUM VERTICAL CLEARANCE SHALL BE MAINTAINED BETWEEN THE BOTTOM OF THE EXTENDED SPRINKLER HEADS AND THE TOP OF ANY FILES, SHELVING, LOCKERS, ETC.
- PRE-MANUFACTURED SHOWER UNITS ARE PROVIDED WITH LIGHT FIXTURES (RE: ELECTRICAL FOR CONNECTION).
- ALL CEILING ELEMENTS TO BE PLACED IN THE CENTER OF CEILING TILE OR CENTER OF GYP. BOARD CEILING AREA U.N.O.
- ALL CEILING GRIDS TO BE CENTERED BETWEEN WALLS U.N.O.
- V.I.F CEILING HEIGHT. ALL ACOUSTICAL CEILINGS TO MATCH EXISTING CEILING HEIGHT UNLESS NOTED OTHERWISE.
- SAW CUT AND REMOVE EXISTING SLAB AND FLOOR FINISHES AS REQUIRED TO INSTALL NEW PLUMBING LINES, FLOOR DRAINS, FIXTURES OR ELECTRICAL ITEMS. SPLICE NEW REINFORCING BARS DOWN INTO EXISTING CONCRETE AND PROVIDE NEW VAPOR BARRIER AND WATERSTOPS. PATCH WITH A MINIMUM OF 3000 PSI CONCRETE AFTER INSTALLATION OF UTILITIES AND FIXTURES. PREPARE CONCRETE TO RECEIVE NEW FINISH.
- ALL EXISTING CEILING DEVICES TO REMAIN; COORDINATE REMOVAL AND RE-INSTALLATION WITH OWNER.

GENERAL REFLECTED CEILING PLAN LEGEND

- SUSPENDED 2' X 2' ACOUSTICAL CEILING SYSTEM (APC)
- 2X4 FLORESCENT
- 2X2 FLORESCENT
- 1 x 4 LIGHT FIXTURE
- RECESSED CAN LIGHT FIXTURE
- SUPPLY AIR GRILLE  
CLEAN ALL EXISTING GRILLES AT ALL HARD CEILING LOCATIONS; RE-PAINT ALL OTHER EXISTING GRILLES IN LAY-IN CEILING LOCATIONS; G.C. TO FIELD VERIFY.
- RETURN AIR GRILLE  
CLEAN ALL EXISTING GRILLES AT ALL HARD CEILING LOCATIONS; RE-PAINT ALL OTHER EXISTING GRILLES IN LAY-IN CEILING LOCATIONS; G.C. TO FIELD VERIFY.
- CEILING DETAIL TAG
- CEILING TYPE  
9'-0" AFF
- GYP. BOARD CEILING
- EXIT LIGHT
- ONLY FISK ELECTRIC TO REMOVE EXISTING CAMERAS PRIOR TO DEMOLITION AND STORE DEVICES WITHIN HCPC OR REMOTE LOCATION AS COORDINATED WITH OWNER. FISK ELECTRIC TO REINSTALL CAMERA AND COMPLETION OF PROJECT.
- PROVIDE NEW PATIENT MONITORING CAMERA WHERE SHOWN; COORDINATE FINAL POSITION W/ OWNER. ALTERNATE NO. 3B-04; RE: SPECS
- CURTAIN TRACK MOUNTED TO CEILING AT THIS LOCATION WITH PRIVACY CURTAIN WITH BREAK AWAY MESH
- EXISTING SPEAKER
- EXISTING FIRE SPRINKLER

REFLECTED CEILING PLAN KEY NOTES

- 01 REPAINT EXISTING CEILING.
- 02 PAINT EXISTING CEILING GRID WHITE THROUGHOUT AND PATCH/REPAIR AS NEEDED; REPLACE ALL CEILING TILES
- 03 REPLACE EXISTING LIGHT FIXTURES WITH NEW SCHEDULED FIXTURES. RE: MEP DRAWINGS
- 04 RE-WORK CEILING TILE AND GRID AS NEEDED TO MATCH EXISTING
- 05 RE-LAMP EXISTING FIXTURES AND CLEAN LENSES
- 06 RE-LAMP EXISTING FIXTURES AND CLEAN LENSES; RELOCATE EXISTING FIXTURES CONFLICTING WITH NEW PARTITION
- 07 REPAINT EXISTING CEILING; REFER TO FINISH PLAN (A2.19C - A2.24E) FOR ADDITIONAL INFORMATION; RE-LAMP EXISTING LIGHT FIXTURES AND CLEAN LENSES
- 08 ALTERNATE NO. 3B-04; RE: SPECS

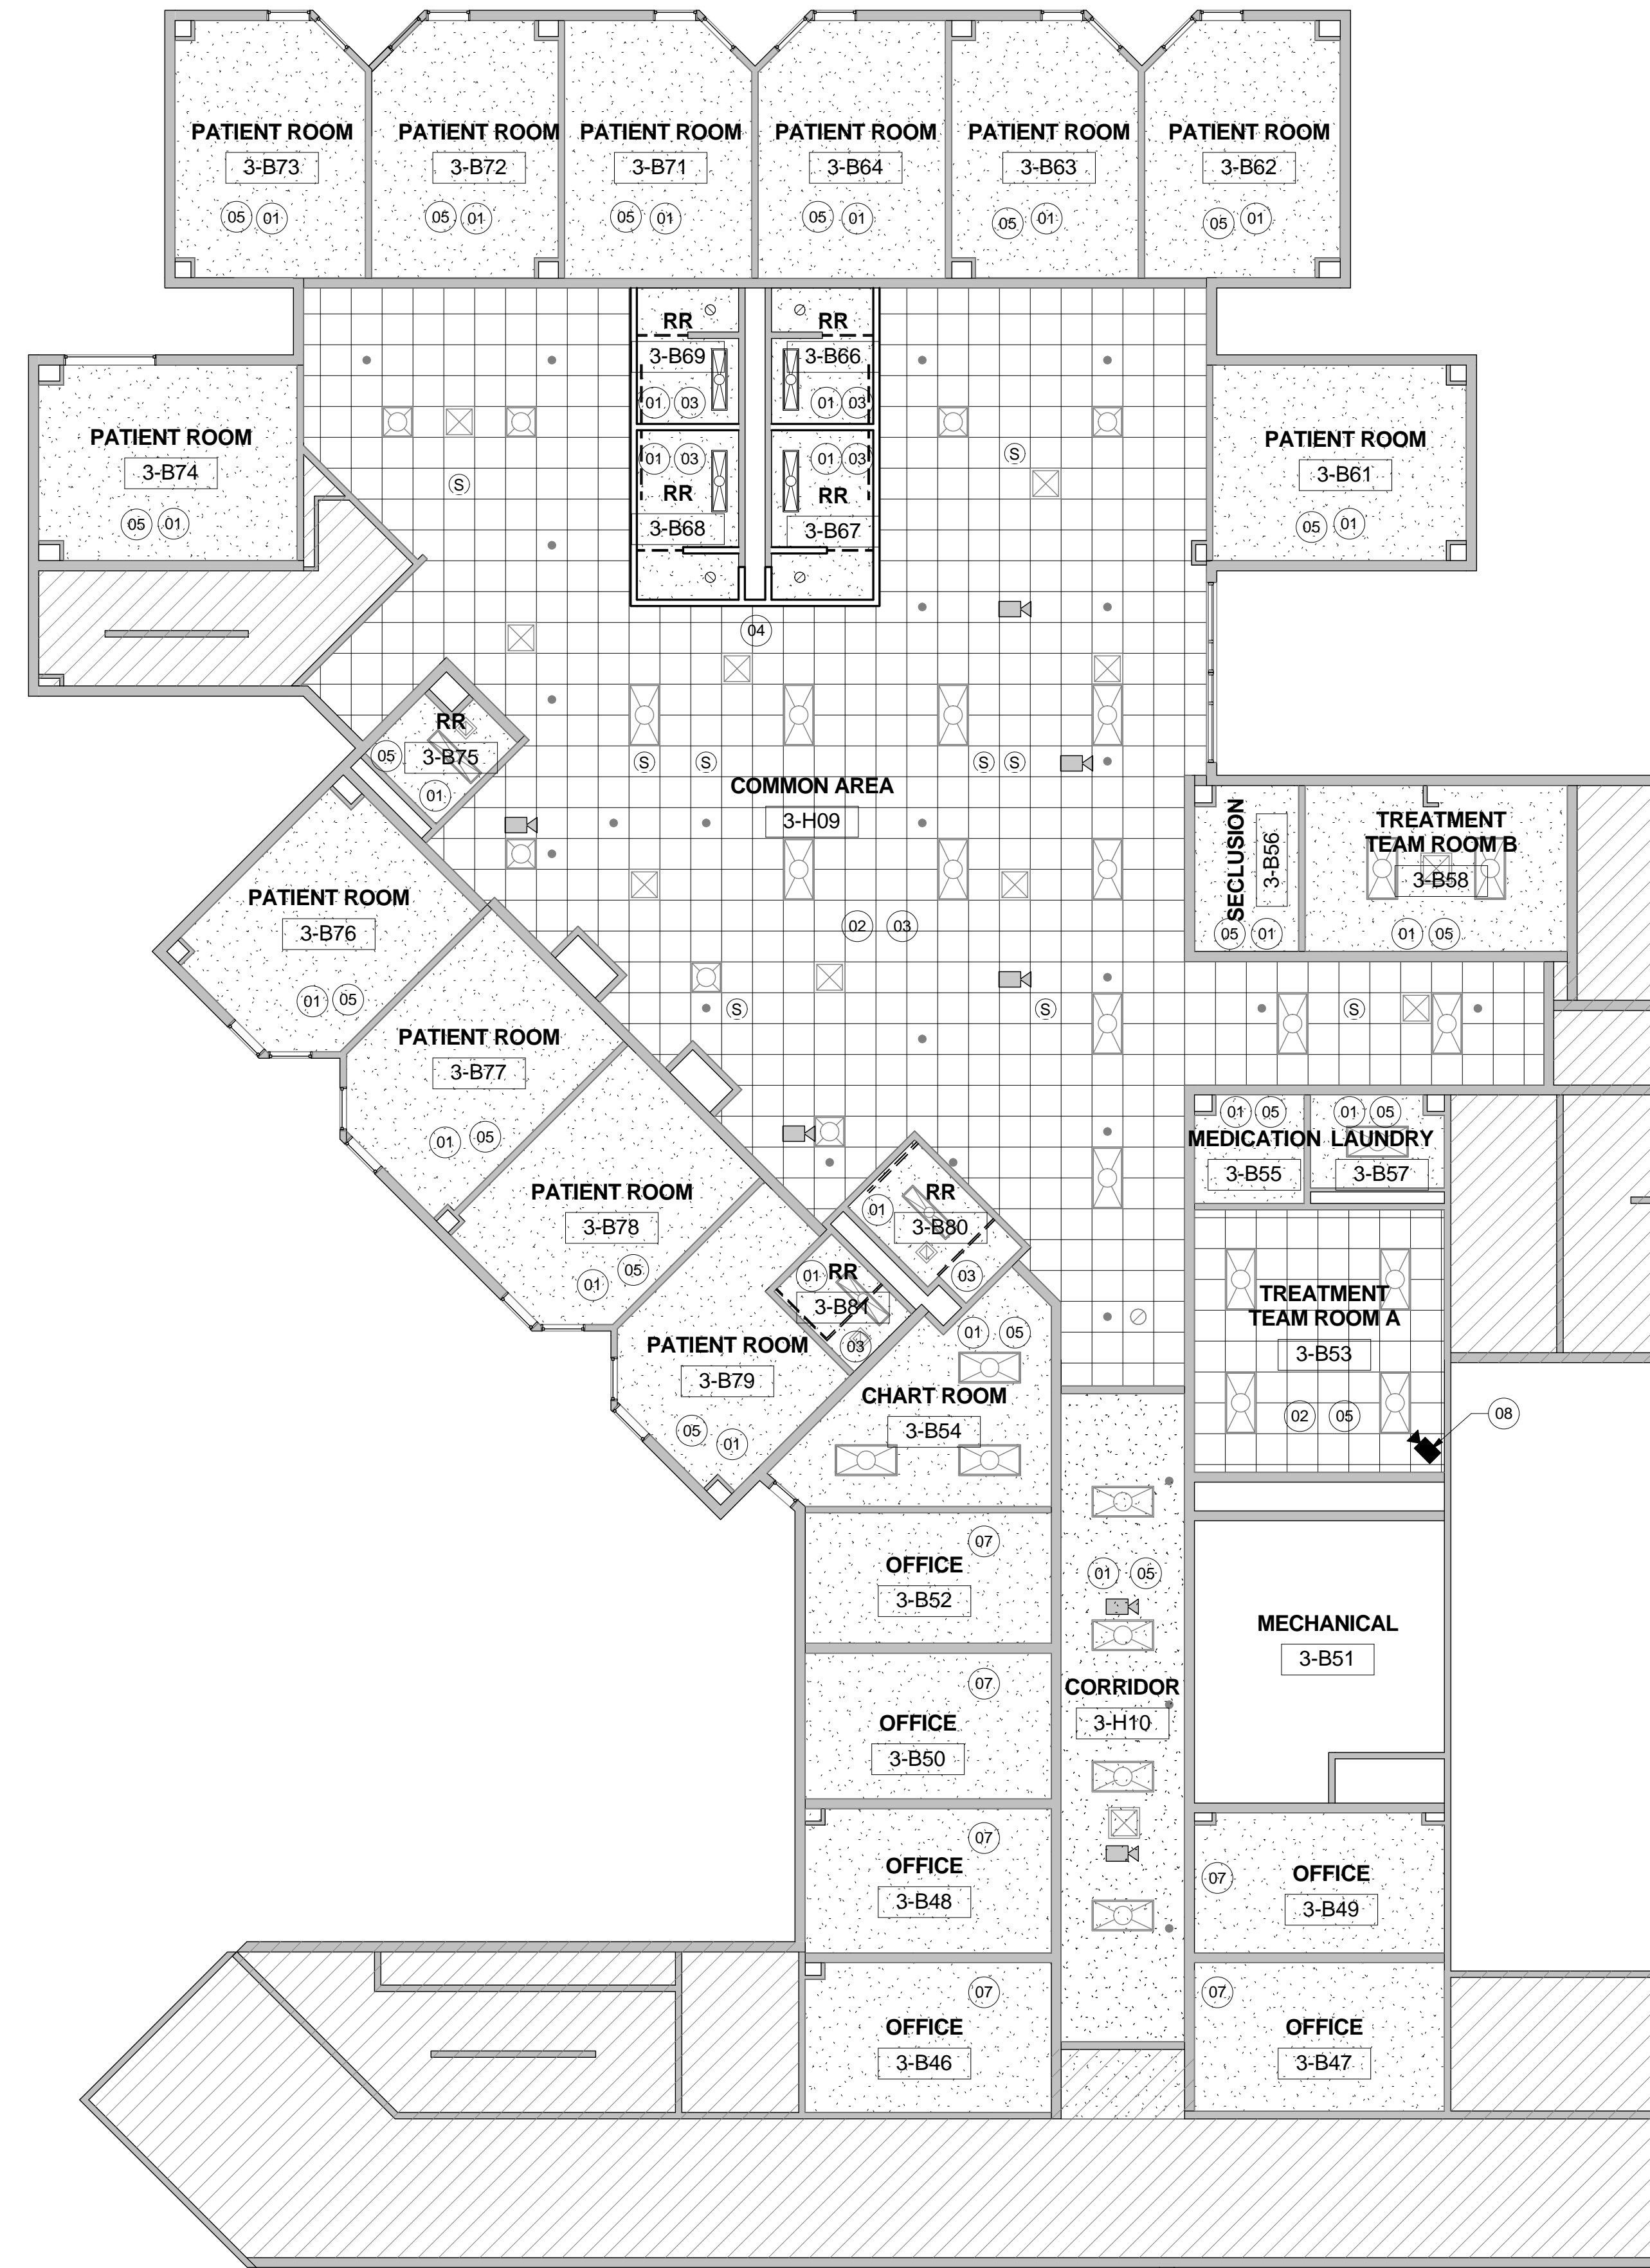











No.	Description	Date

**GENERAL REFLECTED CEILING PLAN NOTES**


- THE CONTRACTOR SHALL COMPARE THIS REFLECTED CEILING PLAN WITH INDICATED ELECTRICAL LIGHTING PLANS, MECHANICAL SUPPLY, RETURN AND EXHAUST PLANS, MECHANICAL FIXTURES ARE NOT INDICATED ON THIS PLAN, RE: MEP. THE CONTRACTOR SHALL REPORT ANY OMISSIONS OR INCONSISTENCIES TO THE ARCHITECT.
- SEE ELECTRICAL DRAWINGS FOR THE LOCATIONS OF CEILING MOUNTED SMOKE DETECTORS, PEAKERS, EXIT SIGNAGE AND FIRE ALARM DEVICES, ETC. ALSO SEE ELECTRICAL FOR LOCATIONS OF WALL MOUNTED EXIT LIGHTS.
- SPRINKLER HEADS ARE NOT SHOWN ON ARCHITECTURAL REFLECTED CEILING PLANS. CONTRACTOR TO INSTALL SUFFICIENT HEADS IN ALL SPACES TO PROVIDE 100% COVERAGE AS REQUIRED UNDER NFPA 13 AND OWNERS' INSURANCE COMPANIES' REQUIREMENTS. CENTER ALL SPRINKLER HEADS IN CEILING TILES AND GYPSUM BOARD CEILINGS.
- CEILING ACCESS PANELS ARE NOT SHOWN ON ARCHITECTURAL REFLECTED CEILING PLANS. THE CONTRACTOR SHALL VERIFY THAT ACCESS PANELS OF TYPE SPECIFIED ARE INSTALLED IN NON-ACCESSIBLE TYPE CEILINGS WHERE SERVICE OR ADJUSTMENT TO MECHANICAL, PLUMBING, OR ELECTRICAL ITEMS MAY BE REQUIRED. ACCESS PANELS SHALL BE EQUAL TO THE RATING OF THE WALL OR CEILING IN WHICH THEY OCCUR.
- 18" MINIMUM VERTICAL CLEARANCE SHALL BE MAINTAINED BETWEEN THE BOTTOM OF THE EXTENDED SPRINKLER HEADS AND THE TOP OF ANY FILES, SHELVING, LOCKERS, ETC.
- PRE-MANUFACTURED SHOWER UNITS ARE PROVIDED WITH LIGHT FIXTURES (RE: ELECTRICAL FOR BOARD CEILING AREA U.N.O.)
- ALL CEILING ELEMENTS TO BE PLACED IN THE CENTER OF CEILING TILE OR CENTER OF GYP. BOARD CEILING AREA U.N.O.
- ALL CEILING GRIDS TO BE CENTERED BETWEEN WALLS U.N.O.
- V.I.F. CEILING HEIGHT. ALL ACOUSTICAL CEILINGS TO MATCH EXISTING CEILING HEIGHT UNLESS NOTED OTHERWISE.
- SAW CUT AND REMOVE EXISTING SLAB AND FLOOR FINISHES AS REQUIRED TO INSTALL NEW PLUMBING LINES, FLOOR DRAINS, FIXTURES OR ELECTRICAL ITEMS. SPLICE NEW REINFORCING BARS DOVELED INTO EXISTING CONCRETE AND PROVIDE NEW VAPOR RETARDER AND WATERSTOP, PATCH WITH A MINIMUM OF 300 PSI CONCRETE AFTER INSTALLATION OF UTILITIES AND FIXTURES. PREPARE CONCRETE TO RECEIVE NEW FINISH.
- ALL EXISTING CEILING DEVICES TO REMAIN; COORDINATE REMOVAL AND RE-INSTALLATION WITH OWNER.

**GENERAL REFLECTED CEILING PLAN LEGEND**

- SUSPENDED 2' X 2' ACOUSTICAL CEILING SYSTEM (APC)
- 2X4 FLORESCENT
- 2X2 FLORESCENT
- 1 x 4 LIGHT FIXTURE
- RECESSED CAN LIGHT FIXTURE
- SUPPLY AIR GRILLE  
CLEAN ALL EXISTING GRILLES AT ALL HARD CEILING LOCATIONS; RE-PAINT ALL OTHER EXISTING GRILLES IN LAY-IN CEILING LOCATIONS; G.C. TO FIELD VERIFY
- RETURN AIR GRILLE  
CLEAN ALL EXISTING GRILLES AT ALL HARD CEILING LOCATIONS; RE-PAINT ALL OTHER EXISTING GRILLES IN LAY-IN CEILING LOCATIONS; G.C. TO FIELD VERIFY
- CEILING DETAIL TAG
- CEILING TYPE  
9'-0" AFF
- GYP. BOARD CEILING
- EXIT LIGHT
- ONLY FISK ELECTRIC TO REMOVE EXISTING CAMERAS PRIOR TO DEMOLITION AND STORE DEVICES WITHIN HCPC OR REMOVE LOCATION AS COORDINATED WITH OWNER. FISK ELECTRIC TO REINSTALL CAMERA AND COMPLETION OF PROJECT.
- PROVIDE NEW PATIENT MONITORING CAMERA WHERE SHOWN. COORDINATE FINAL POSITION W/ OWNER. ALTERNATE NO. 3E-04; RE: SPECS
- CURTAIN TRACK MOUNTED TO CEILING AT THIS LOCATION WITH PRIVACY CURTAIN WITH BREAK AWAY MESH
- EXISTING SPEAKER
- EXISTING FIRE SPRINKLER

**REFLECTED CEILING PLAN KEY NOTES**

- 01 REPAINT EXISTING CEILING;
- 02 PAINT EXISTING CEILING GRID WHITE THROUGHOUT AND PATCH/REPAIR AS NEEDED; REPLACE ALL CEILING TILES
- 03 REPLACE EXISTING LIGHT FIXTURES WITH NEW SCHEDULED FIXTURES; RE: MEP DRAWINGS
- 04 RE-WORK CEILING TILE AND GRID AS NEEDED TO MATCH EXISTING
- 05 RE-LAMP EXISTING FIXTURES AND CLEAN LENSES
- 06 RE-LAMP EXISTING FIXTURES AND CLEAN LENSES; RELOCATE EXISTING FIXTURES CONFLICTING WITH NEW PARTITION
- 07 REPAINT EXISTING CEILING; REFER TO FINISH PLAN (A2.19C - A2.24E) FOR ADDITIONAL INFORMATION; RE-LAMP EXISTING LIGHT FIXTURES AND CLEAN LENSES
- 08 ALTERNATE NO. 3E-04; RE: SPECS

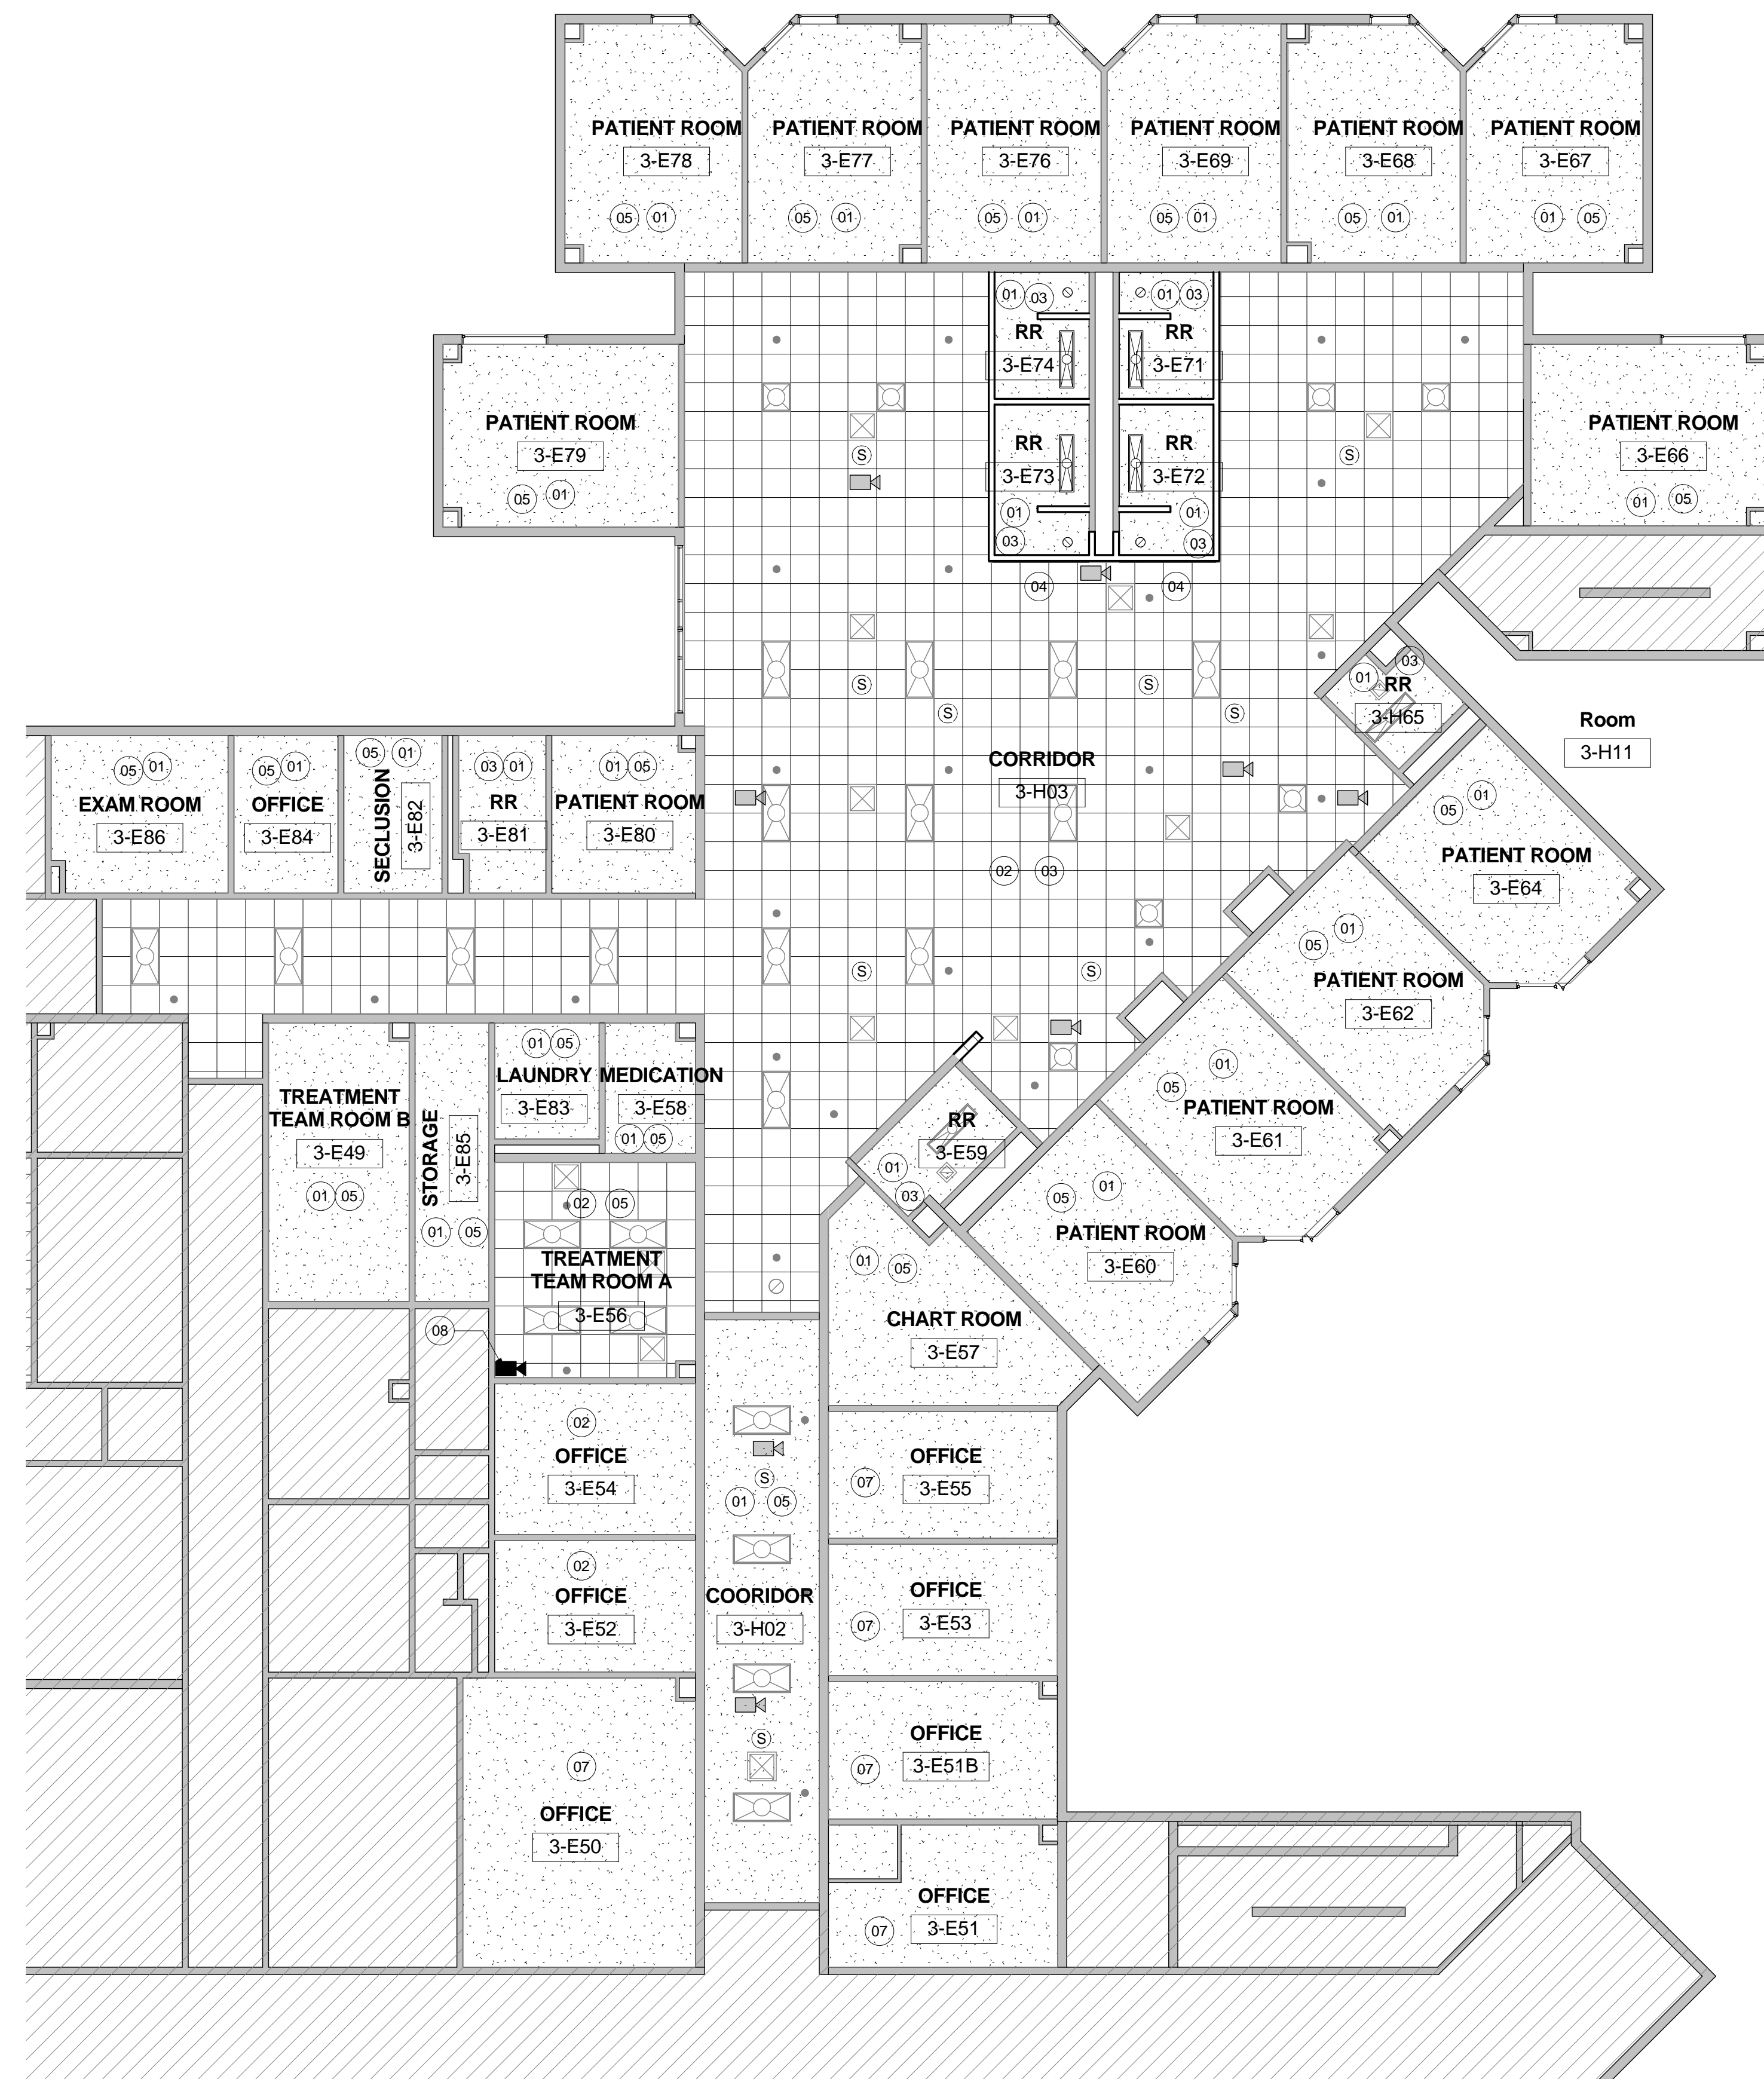











## HARRIS COUNTY PSYCHIATRIC CENTER RENOVATIONS UNITS 1C, 2E, 3B, 3C, 3D & 3E




### GENERAL NOTES - GE1.01C

- A SEE SHEET E0.01 FOR ELECTRICAL LEGEND, SYMBOLS AND ABBREVIATIONS. COORDINATE WITH ARCHITECT FOR FINAL LUMINAIRE LOCATIONS.
- B ALL EMERGENCY LUMINAIRES AND EXIT LIGHTS ARE TO REMAIN UNSWITCHED, UON.
- C LIGHTED EXIT SIGNS ARE SHOWN FOR QUANTITIES AND GENERAL LOCATIONS. COORDINATE WITH ARCHITECT FOR EXACT LOCATION OF LIGHTED EXIT SIGNS.
- D SINGLE-FACE EXIT SIGNS ARE TYPE XA, UON. DOUBLE-FACE SIGNS ARE TYPE XB, UON.
- E COORDINATE ELECTRICAL WORK WITH ARCHITECTURAL, CIVIL, STRUCTURAL, MECHANICAL, AND PLUMBING SO AS TO AVOID INTERFERENCE WITH OR COMPROMISE OF OTHER SYSTEMS.
- F ALL RECEPTACLES ARE MOUNTED 18" UON. VERIFY HEIGHT AND ALIGNMENT OF DEVICES WITH ARCHITECTURAL DRAWINGS. COORDINATE OUTLET/RECEPTACLE LOCATIONS WITH MILL WORK, CASEWORK, ETC.
- G UPDATE PANELBOARD SCHEDULES UPON COMPLETION OF PROJECT TO REFLECT FINAL CIRCUIT NUMBERS AND DESCRIPTIONS.
- H PROVIDE FIRE ALARM SYSTEM IN COMPLIANCE WITH NFPA 72 FIRE ALARM CODE AND NFPA 101 LIFE SAFETY CODE AND SECTIONS 28 31 00.
- I INSTALL FA NOTIFICATION DEVICES PER NFPA 72. MOUNT VISUAL & COMBINATION NOTIFICATION DEVICES IN CEILING PREFERABLY OR WALL WITH ENTIRE LENS BETWEEN 80" & 96" AFF. SEE ELECTRICAL DETAILS.
- J COORDINATE DETECTORS AND DEVICE LOCATIONS IN FINISHED SPACES WITH ARCHITECTURAL REFLECTED CEILING PLAN (RCP). RELOCATE FIRE ALARM DETECTORS AND DEVICES TO RESOLVE INTERFERENCE AND CONFLICTS. FINAL LOCATION SHALL CONFORM TO NFPA 72 AND UL REQUIREMENTS.

### KEYED NOTES - E1.01C


- 1 EXISTING LIGHTING IN THIS SPACE TO REMAIN. CLEAN ALL LENSES AND RELAMP FIXTURE.
- 2 EXISTING LIGHTING IN THIS SPACE TO BE DEMOLISHED. RECONNECT NEW LIGHTING IN DETAIL 2. THIS SHEET TO EXISTING CIRCUIT SERVING LIGHTING IN THE RESTROOM AREA.
- 3 CONNECT RESTROOM LIGHTING TO EXISTING CRITICAL BRANCH POWER CIRCUIT SERVING THIS SPACE. CONNECT TO NEW OR EXISTING SNAP SWITCH FOR CONTROL OF LIGHTING IN EACH SPACE.
- 4 EXISTING ELECTRICAL ROOM.
- 5 CONNECT TO SPARE CIRCUIT BREAKER IN PANEL 1LHCC IN ELECTRICAL ROOM NOTED IN NOTE 4 WITH 2#12, #12G, 3/4"C. THIS WORK IS INCLUDED IN ALTERNATE 1C-02.
- 6 CONNECT TO EXISTING CIRCUIT SERVING POWER TO NURSE STATION.

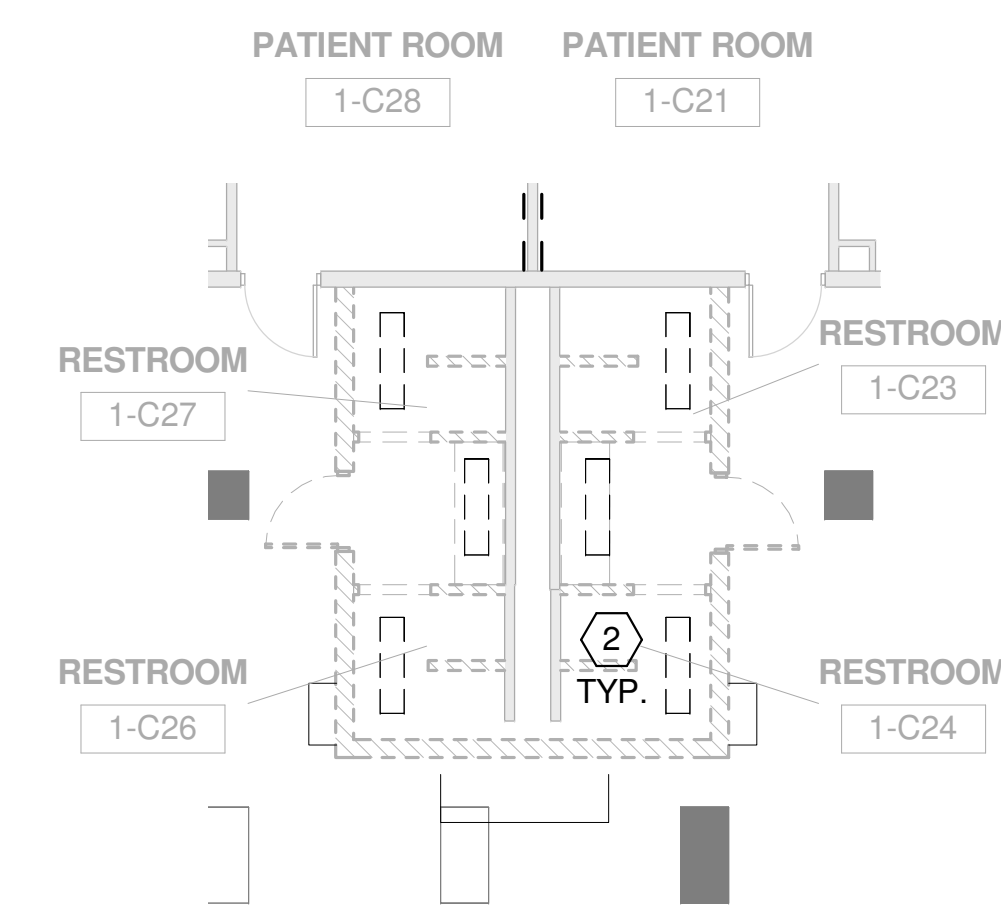


**1 FIRST FLOOR LIGHTING DEMO PLAN - AREA C**  
 1/8" = 1'-0"



**2 FIRST FLOOR LIGHTING AREA C**  
 1/8" = 1'-0"

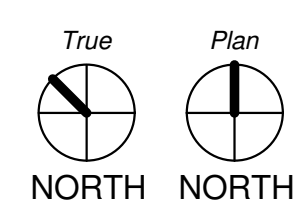

1/8" = 1'-0" 0' 8' 16'

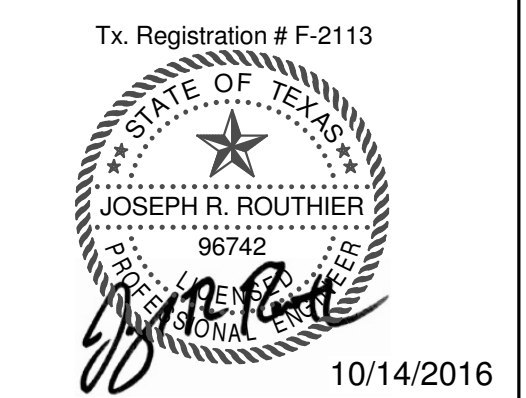

CLIENT UT HEALTH		
PROJECT NUMBER 16103		
DATE:	10/14/2016	
DRAWN BY:	FL	
CHECKED BY:	JRR	
REVISIONS		
No.	Description	Date

Issue for Bid  
**LEVEL 01 LIGHTING PLAN - AREA 1C**

# E1.01C




**GENERAL NOTES - GE1.02E**

- A SEE SHEET E0.01 FOR ELECTRICAL LEGEND, SYMBOLS AND ABBREVIATIONS. COORDINATE WITH ARCHITECT FOR FINAL LUMINAIRE LOCATIONS.
- B ALL EMERGENCY LUMINAIRES AND EXIT LIGHTS ARE TO REMAIN UNSWITCHED, UON.
- C LIGHTED EXIT SIGNS ARE SHOWN FOR QUANTITIES AND GENERAL LOCATIONS. COORDINATE WITH ARCHITECT FOR EXACT LOCATION OF LIGHTED EXIT SIGNS.
- D SINGLE-FACE EXIT SIGNS ARE TYPE XA, UON. DOUBLE-FACE SIGNS ARE TYPE XB, UON.
- E COORDINATE ELECTRICAL WORK WITH ARCHITECTURAL, CIVIL, STRUCTURAL, MECHANICAL, AND PLUMBING SO AS TO AVOID INTERFERENCE WITH OR COMPROMISE OF OTHER SYSTEMS.
- F ALL RECEPTACLES ARE MOUNTED 18" UON. VERIFY HEIGHT AND ALIGNMENT OF DEVICES WITH ARCHITECTURAL DRAWINGS. COORDINATE OUTLET/RECEPTACLE LOCATIONS WITH MILL WORK, CASEWORK, ETC.
- G UPDATE PANELBOARD SCHEDULES UPON COMPLETION OF PROJECT TO REFLECT FINAL CIRCUIT NUMBERS AND DESCRIPTIONS.
- H PROVIDE FIRE ALARM SYSTEM IN COMPLIANCE WITH NFPA 72 FIRE ALARM CODE AND NFPA 101 LIFE SAFETY CODE AND SECTIONS 28 31 00.
- I INSTALL FA NOTIFICATION DEVICES PER NFPA 72. MOUNT VISUAL & COMBINATION NOTIFICATION DEVICES IN CEILING PREFERABLY OR WALL WITH ENTIRE LENS BETWEEN 80" & 96" AFF. SEE ELECTRICAL DETAILS.
- J COORDINATE DETECTORS AND DEVICE LOCATIONS IN FINISHED SPACES WITH ARCHITECTURAL REFLECTED CEILING PLAN (RCP). RELOCATE FIRE ALARM DETECTORS AND DEVICES TO RESOLVE INTERFERENCE AND CONFLICTS. FINAL LOCATION SHALL CONFORM TO NFPA 72 AND UL REQUIREMENTS.


**KEYED NOTES - E1.02E**

- 1 EXISTING LIGHTING IN THIS SPACE TO REMAIN. CLEAN ALL LENSES AND RELAMP FIXTURE.
- 2 EXISTING LIGHTING IN THIS SPACE TO BE DEMOLISHED. RECONNECT NEW LIGHTING IN DETAIL 2. THIS SHEET TO EXISTING CIRCUIT SERVING LIGHTING IN THE RESTROOM AREA.
- 3 CONNECT RESTROOM LIGHTING TO EXISTING CRITICAL BRANCH POWER CIRCUIT SERVING THIS SPACE. CONNECT TO NEW OR EXISTING SNAP SWITCH FOR CONTROL OF LIGHTING IN EACH SPACE.
- 4 EXISTING ELECTRICAL ROOM.
- 5 CONNECT TO SPARE CIRCUIT BREAKER IN PANEL 2LSTA OR 2LSTB IN ELECTRICAL ROOM NOTED IN NOTE 4 WITH 2#12, #12S, 3/4" C. THIS WORK IS INCLUDED IN ALTERNATE 2E-02.
- 6 CONNECT TO EXISTING CIRCUIT SERVING POWER TO NURSE STATION.

**1 SECOND FLOOR LIGHTING DEMO PLAN - AREA E**  
 1/8" = 1'-0"

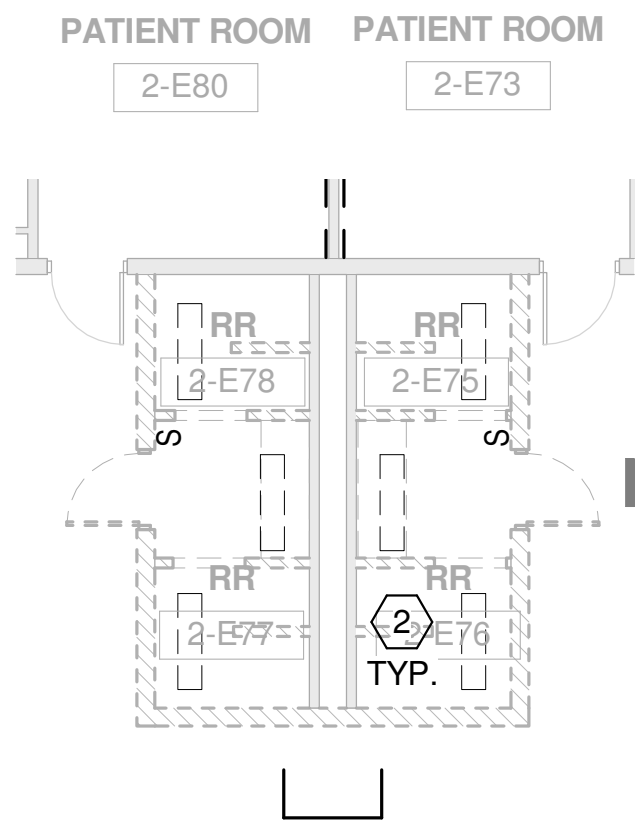

**2 SECOND FLOOR LIGHTING AREA E**  
 1/8" = 1'-0"

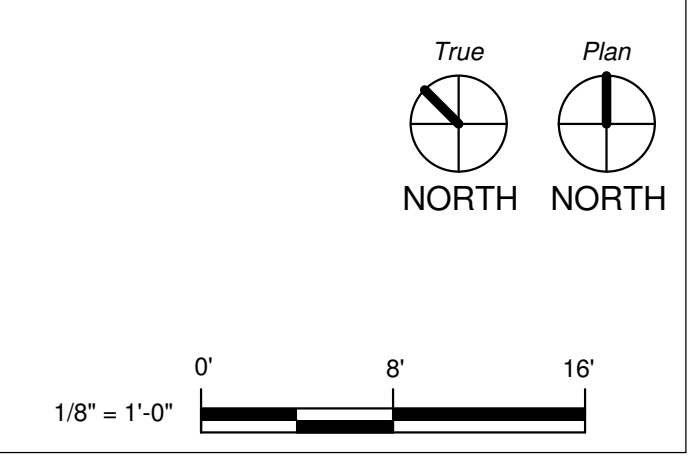








No.	Description	Date

**GENERAL NOTES - GE1.03C**

- A SEE SHEET E0.01 FOR ELECTRICAL LEGEND, SYMBOLS AND ABBREVIATIONS. COORDINATE WITH ARCHITECT FOR FINAL LUMINAIRE LOCATIONS.
- B ALL EMERGENCY LUMINAIRES AND EXIT LIGHTS ARE TO REMAIN UNSWITCHED, UON.
- C LIGHTED EXIT SIGNS ARE SHOWN FOR QUANTITIES AND GENERAL LOCATIONS. COORDINATE WITH ARCHITECT FOR EXACT LOCATION OF LIGHTED EXIT SIGNS.
- D SINGLE-FACE EXIT SIGNS ARE TYPE XA, UON. DOUBLE-FACE SIGNS ARE TYPE XB, UON.
- E COORDINATE ELECTRICAL WORK WITH ARCHITECTURAL, CIVIL, STRUCTURAL, MECHANICAL, AND PLUMBING SO AS TO AVOID INTERFERENCE WITH OR COMPROMISE OF OTHER SYSTEMS.
- F ALL RECEPTACLES ARE MOUNTED 18" UON. VERIFY HEIGHT AND ALIGNMENT OF DEVICES WITH ARCHITECTURAL DRAWINGS. COORDINATE OUTLET/RECEPTACLE LOCATIONS WITH MILL WORK, CASEWORK, ETC.
- G UPDATE PANELBOARD SCHEDULES UPON COMPLETION OF PROJECT TO REFLECT FINAL CIRCUIT NUMBERS AND DESCRIPTIONS.
- H PROVIDE FIRE ALARM SYSTEM IN COMPLIANCE WITH NFPA 72 FIRE ALARM CODE AND NFPA 101 LIFE SAFETY CODE AND SECTIONS 28.31.00.
- I INSTALL FA NOTIFICATION DEVICES PER NFPA 72. MOUNT VISUAL & COMBINATION NOTIFICATION DEVICES IN CEILING PREFERABLY OR WALL WITH ENTIRE LENS BETWEEN 80" & 96" AFF. SEE ELECTRICAL DETAILS.
- J COORDINATE DETECTORS AND DEVICE LOCATIONS IN FINISHED SPACES WITH ARCHITECTURAL REFLECTED CEILING PLAN (RCP). RELOCATE FIRE ALARM DETECTORS AND DEVICES TO RESOLVE INTERFERENCE AND CONFLICTS. FINAL LOCATION SHALL CONFORM TO NFPA 72 AND UL REQUIREMENTS.

**KEYED NOTES - E1.03C**

- 1 EXISTING LIGHTING IN THIS SPACE TO REMAIN. CLEAN ALL LENSES AND RELAMP FIXTURE.
- 2 EXISTING LIGHTING IN THIS SPACE TO BE DEMOLISHED. RECONNECT NEW LIGHTING IN DETAIL 2, THIS SHEET TO EXISTING CIRCUIT SERVING LIGHTING IN THE RESTROOM AREA.
- 3 CONNECT RESTROOM LIGHTING TO EXISTING CRITICAL BRANCH POWER CIRCUIT SERVING THIS SPACE. CONNECT TO NEW OR EXISTING SNAP SWITCH FOR CONTROL OF LIGHTING IN EACH SPACE.
- 4 EXISTING ELECTRICAL ROOM.
- 5 CONNECT TO SPARE CIRCUIT BREAKER IN PANEL 3LHCA OR 3LHCB IN ELECTRICAL ROOM NOTED IN NOTE 4 WITH 2#12, #12C, 3/4" C. THIS WORK IS INCLUDED IN ALTERNATE 3C-02.
- 6 CONNECT TO EXISTING CIRCUIT SERVING POWER TO NURSE STATION.

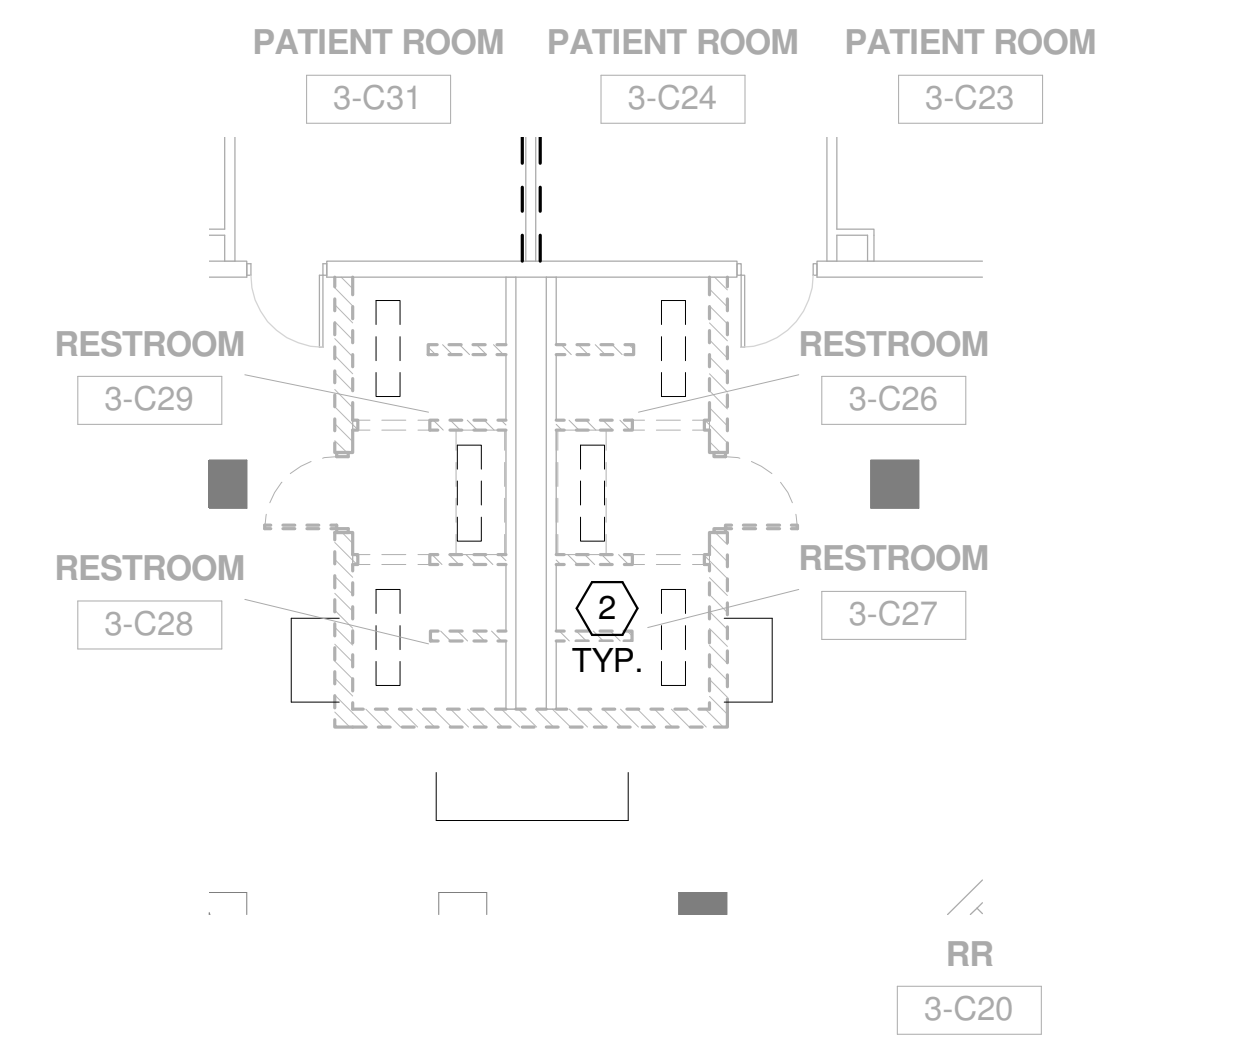


**THIRD FLOOR LIGHTING DEMO PLAN - AREA C**

1  
1/8" = 1'-0"



**2 THIRD FLOOR LIGHTING AREA C**

1/8" = 1'-0"

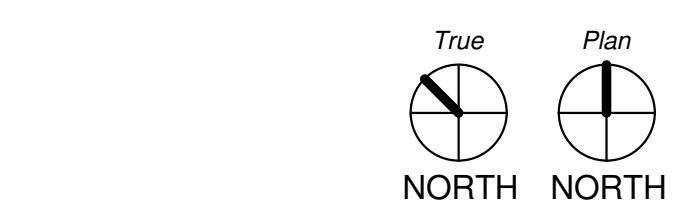



**GENERAL NOTES - GE1.03D**

- A SEE SHEET E0.01 FOR ELECTRICAL LEGEND, SYMBOLS AND ABBREVIATIONS. COORDINATE WITH ARCHITECT FOR FINAL LUMINAIRE LOCATIONS.
- B ALL EMERGENCY LUMINAIRES AND EXIT LIGHTS ARE TO REMAIN UNSWITCHED, UON.
- C LIGHTED EXIT SIGNS ARE SHOWN FOR QUANTITIES AND GENERAL LOCATIONS. COORDINATE WITH ARCHITECT FOR EXACT LOCATION OF LIGHTED EXIT SIGNS.
- D SINGLE-FACE EXIT SIGNS ARE TYPE XA, UON. DOUBLE-FACE SIGNS ARE TYPE XB, UON.
- E COORDINATE ELECTRICAL WORK WITH ARCHITECTURAL, CIVIL, STRUCTURAL, MECHANICAL, AND PLUMBING SO AS TO AVOID INTERFERENCE WITH OR COMPROMISE OF OTHER SYSTEMS.
- F ALL RECEPTACLES ARE MOUNTED 18" UON. VERIFY HEIGHT AND ALIGNMENT OF DEVICES WITH ARCHITECTURAL DRAWINGS. COORDINATE OUTLET/RECEPTACLE LOCATIONS WITH MILL WORK, CASEWORK, ETC.
- G UPDATE PANELBOARD SCHEDULES UPON COMPLETION OF PROJECT TO REFLECT FINAL CIRCUIT NUMBERS AND DESCRIPTIONS.
- H PROVIDE FIRE ALARM SYSTEM IN COMPLIANCE WITH NFPA 72 FIRE ALARM CODE AND NFPA 101 LIFE SAFETY CODE AND SECTIONS 28 31 00.
- I INSTALL FA NOTIFICATION DEVICES PER NFPA 72. MOUNT VISUAL & COMBINATION NOTIFICATION DEVICES IN CEILING PREFERABLY OR WALL WITH ENTIRE LENS BETWEEN 80" & 96" AFF. SEE ELECTRICAL DETAILS.
- J COORDINATE DETECTORS AND DEVICE LOCATIONS IN FINISHED SPACES WITH ARCHITECTURAL REFLECTED CEILING PLAN (RCP). RELOCATE FIRE ALARM DETECTORS AND DEVICES TO RESOLVE INTERFERENCE AND CONFLICTS. FINAL LOCATION SHALL CONFORM TO NFPA 72 AND UL REQUIREMENTS.


**KEYED NOTES - E1.03D**

- 1 EXISTING LIGHTING IN THIS SPACE TO REMAIN. CLEAN ALL LENSES AND RELAMP FIXTURE.
- 2 EXISTING LIGHTING IN THIS SPACE TO BE DEMOLISHED. RECONNECT NEW LIGHTING IN DETAIL 2, THIS SHEET TO EXISTING CIRCUIT SERVING LIGHTING IN THE RESTROOM AREA.
- 3 CONNECT RESTROOM LIGHTING TO EXISTING CRITICAL BRANCH POWER CIRCUIT SERVING THIS SPACE. CONNECT TO NEW OR EXISTING SNAP SWITCH FOR CONTROL OF LIGHTING IN EACH SPACE.
- 4 EXISTING ELECTRICAL ROOM.
- 5 CONNECT TO SPARE CIRCUIT BREAKER IN PANEL 3LSTA OR 3LSTB IN ELECTRICAL ROOM NOTED IN NOTE 4 WITH #12, #12G, 3/4" C. THIS WORK IS INCLUDED IN ALTERNATE 3D-02.
- 6 CONNECT TO EXISTING CIRCUIT SERVING POWER TO NURSE STATION.
- 7 EXISTING LIGHT FIXTURE TO BE ROTATED IN CEILING TO NEW LOCATION AS INDICATED. EXISTING CIRCUIT AND LIGHTING CONTROL FOR FIXTURE TO REMAIN.



**1 THIRD FLOOR LIGHTING DEMO PLAN - AREA D**  
 1/8" = 1'-0"

**2 THIRD FLOOR LIGHTING AREA D**  
 1/8" = 1'-0"

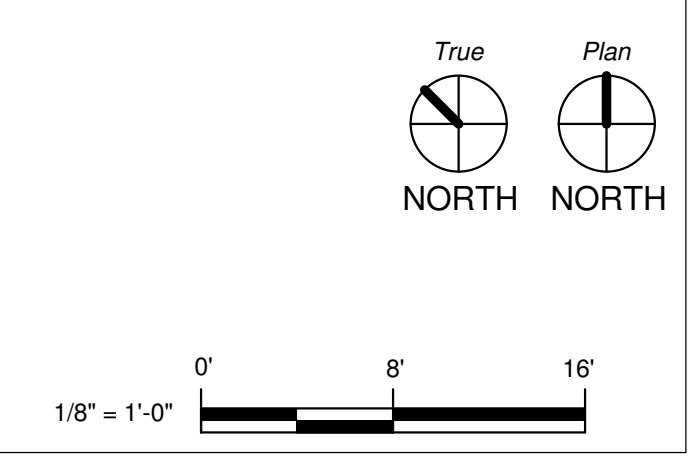




**GENERAL NOTES - GE1.03E**

- A SEE SHEET E0.01 FOR ELECTRICAL LEGEND, SYMBOLS AND ABBREVIATIONS. COORDINATE WITH ARCHITECT FOR FINAL LUMINAIRE LOCATIONS.
- B ALL EMERGENCY LUMINAIRES AND EXIT LIGHTS ARE TO REMAIN UNSWITCHED, UON.
- C LIGHTED EXIT SIGNS ARE SHOWN FOR QUANTITIES AND GENERAL LOCATIONS. COORDINATE WITH ARCHITECT FOR EXACT LOCATION OF LIGHTED EXIT SIGNS.
- D SINGLE-FACE EXIT SIGNS ARE TYPE XA, UON. DOUBLE-FACE SIGNS ARE TYPE XB, UON.
- E COORDINATE ELECTRICAL WORK WITH ARCHITECTURAL, CIVIL, STRUCTURAL, MECHANICAL, AND PLUMBING SO AS TO AVOID INTERFERENCE WITH OR COMPROMISE OF OTHER SYSTEMS.
- F ALL RECEPTACLES ARE MOUNTED 18" UON. VERIFY HEIGHT AND ALIGNMENT OF DEVICES WITH ARCHITECTURAL DRAWINGS. COORDINATE OUTLET/RECEPTACLE LOCATIONS WITH MILL WORK, CASEWORK, ETC.
- G UPDATE PANELBOARD SCHEDULES UPON COMPLETION OF PROJECT TO REFLECT FINAL CIRCUIT NUMBERS AND DESCRIPTIONS.
- H PROVIDE FIRE ALARM SYSTEM IN COMPLIANCE WITH NFPA 72 FIRE ALARM CODE AND NFPA 101 LIFE SAFETY CODE AND SECTIONS 28 31 00.
- I INSTALL FA NOTIFICATION DEVICES PER NFPA 72. MOUNT VISUAL & COMBINATION NOTIFICATION DEVICES IN CEILING PREFERABLY OR WALL WITH ENTIRE LENS BETWEEN 80" & 96" AFF. SEE ELECTRICAL DETAILS.
- J COORDINATE DETECTORS AND DEVICE LOCATIONS IN FINISHED SPACES WITH ARCHITECTURAL REFLECTED CEILING PLAN (RCP). RELOCATE FIRE ALARM DETECTORS AND DEVICES TO RESOLVE INTERFERENCE AND CONFLICTS. FINAL LOCATION SHALL CONFORM TO NFPA 72 AND UL REQUIREMENTS.

**KEYED NOTES - E1.03E**


- 1 EXISTING LIGHTING IN THIS SPACE TO REMAIN. CLEAN ALL LENSES AND RELAMP FIXTURE.
- 2 EXISTING LIGHTING IN THIS SPACE TO BE DEMOLISHED. RECONNECT NEW LIGHTING IN DETAIL 2, THIS SHEET TO EXISTING CIRCUIT SERVING LIGHTING IN THE RESTROOM AREA.
- 3 CONNECT RESTROOM LIGHTING TO EXISTING CRITICAL BRANCH POWER CIRCUIT SERVING THIS SPACE. CONNECT TO NEW OR EXISTING SNAP SWITCH FOR CONTROL OF LIGHTING IN EACH SPACE.
- 4 EXISTING ELECTRICAL ROOM.
- 5 CONNECT TO SPARE CIRCUIT BREAKER IN PANEL 3LSTA OR 3LSTB IN ELECTRICAL ROOM NOTED IN NOTE 4 WITH 2#12, #12G, 3/4" C. THIS WORK IS INCLUDED IN ALTERNATE 3E-02.
- 6 CONNECT TO EXISTING CIRCUIT SERVING POWER TO NURSE STATION.

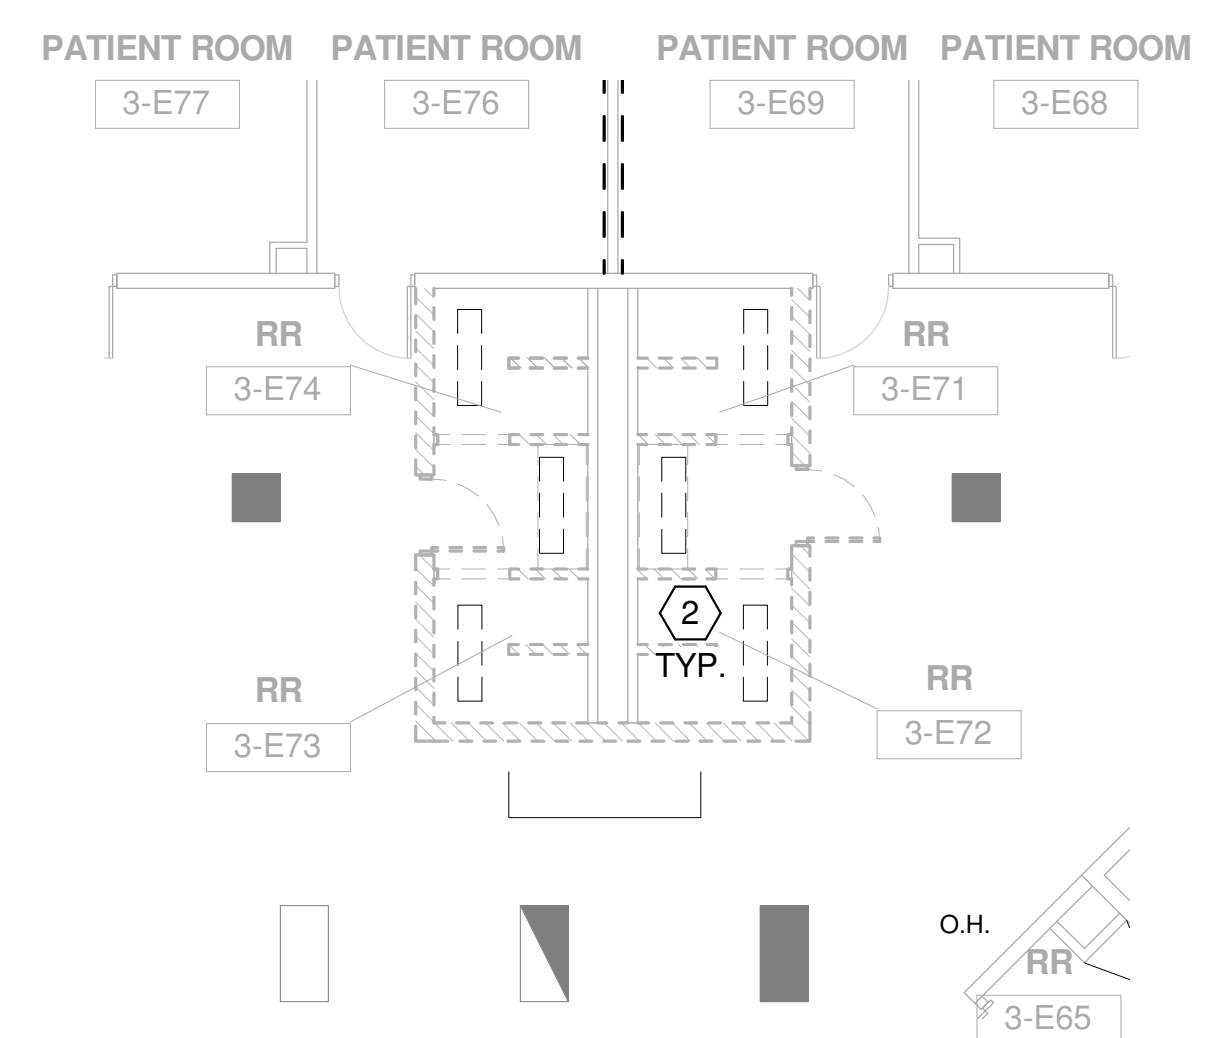

**1 THIRD FLOOR LIGHTING DEMO PLAN - AREA E**  
 1/8" = 1'-0"



**2 THIRD FLOOR LIGHTING AREA E**  
 1/8" = 1'-0"

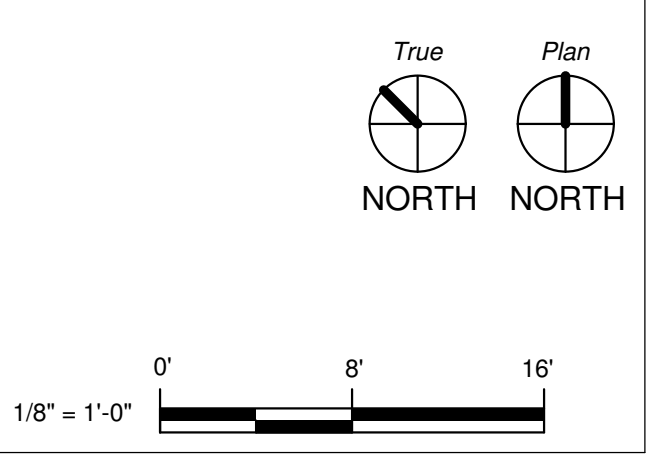




## GENERAL NOTES


- PRIOR TO WORK CONTRACTOR SHALL TIGHTLY COORDINATE PLUMBING WORK WITH OTHER TRADES.
- PROVIDE A UNION DOWNSTREAM FROM EACH THREADED VALVE.
- PROVIDE A SEPARATE P-TRAP AT EACH PLUMBING FIXTURE, UNLESS TRAP IS BUILT INTO FIXTURE.
- REFER TO ARCHITECTURAL DRAWINGS FOR PLUMBING FIXTURE MOUNTING HEIGHTS.
- MAKE ROUGH-IN AND FINAL CONNECTION TO ALL PLUMBING FIXTURES.
- ALL NEW WORK SHALL CONFORM TO THE 2012 EDITION OF THE INTERNATIONAL PLUMBING CODE UNLESS OTHERWISE NOTED OR SHOWN.
- DRAWINGS ARE DIAGRAMMATIC IN NATURE. NOT ALL REQUIRED PIPE ELBOWS, TEES, AND ASSOCIATED FITTINGS ARE SHOWN. CONTRACTOR SHALL PROVIDE A COMPLETE WORKING PLUMBING SYSTEM PER THE SPECIFICATIONS AND PLUMBING CODE.
- FIRE PROTECTION PIPING SHALL BE COORDINATED AROUND OTHER TRADES, SUCH AS PLUMBING, HVAC AND ELECTRICAL.
- A SUPERVISORY SWITCH (TAMPER SWITCH) SHALL BE PROVIDED ON EACH VALVE USED FOR CONTROLLING THE FIRE PROTECTION SYSTEM FOR THE STANDPIPE AND SPRINKLER SYSTEM, AS SPECIFIED.
- CONTRACTOR SHALL OBTAIN ARCHITECT/ENGINEER APPROVAL FOR ALL ACCESS PANEL LOCATIONS.
- PROVIDE AN ISOLATION VALVE FOR EACH SINGLE PLUMBING FIXTURE, OR WHERE FIXTURES ARE GROUPED ONE VALVE PER GROUP, REFER TO FLOOR PLANS.

PLUMBING LEGEND					
SYMBOL	ABBREV.	DESCRIPTION	SYMBOL	ABBREV.	DESCRIPTION
—SAN—	SAN	SANITARY WASTE	— —		UNION
----		SANITARY VENT	— ⊕ —		BALL VALVE
----	DCW	DOMESTIC COLD WATER		AFF	ABOVE FINISHED FLOOR
----	DHW	DOMESTIC HOT WATER		AP	ACCESS PANEL
				FPS	FEET PER SECOND
				GPM	GALLONS PER MINUTE
				WCO	WALL CLEANOUT
				BOP	BOTTOM OF PIPE


PLUMBING PIPE MATERIALS SPECIFICATION		
NOTE: REFER TO DIVISION 22 SPECIFICATIONS FOR MORE DETAILED SPECIFICATIONS OF PIPE AND FITTINGS.		
SERVICE	PIPE	FITTING
EQUIPMENT DRAINS AND OVERFLOWS	TYPE "L" HARD DRAWN COPPER (ASTM B88)	SOLDERED (95-5) WROUGHT COPPER, ANSI B16.22.
SANITARY DRAINAGE AND VENT ABOVE GRADE INCLUDING CRAWL SPACE	SERVICE WEIGHT CAST IRON, CISPI 301	SERVICE WEIGHT DWV NO-HUB FITTINGS, HEAVY WEIGHT NO-HUB, 4-BAND COUPLINGS FOR SIZES 4" & LESS AND 6-BAND COUPLINGS FOR PIPES SIZES OVER 4". CONFORMING TO CISPI 310 MANUF. BY ANACO "HUSKEY", 2000, MIFAB MI-XHUB OR CLAMP-ALL 125. NO-HUB CISPI 310 COUPLINGS. ALL COUPLINGS WITH STAINLESS STEEL BANDS AND NEOPRENE GASKETS
SANITARY DRAINAGE AND VENT BELOW GRADE	SERVICE WEIGHT CAST IRON, CISPI 301	SERVICE WEIGHT BELL & SPIGOT DWV FITTINGS WITH NEOPRENE GASKETS, ASTM C564.
DOMESTIC WATER, ABOVE GRADE	TYPE "L" HARD DRAWN COPPER (ASTM B88)	ANSI B16.22 WROUGHT COPPER WITH 95-5 SOLDER LEAD-FREE JOINTS, ASTM B32.
UNIONS: CLASS 150, 300 POUND WATER-OIL-GAS SERVICE BRONZE. UNION WITH GROUND JOINT AND BRASS SEAT, ANSI B16.39.		

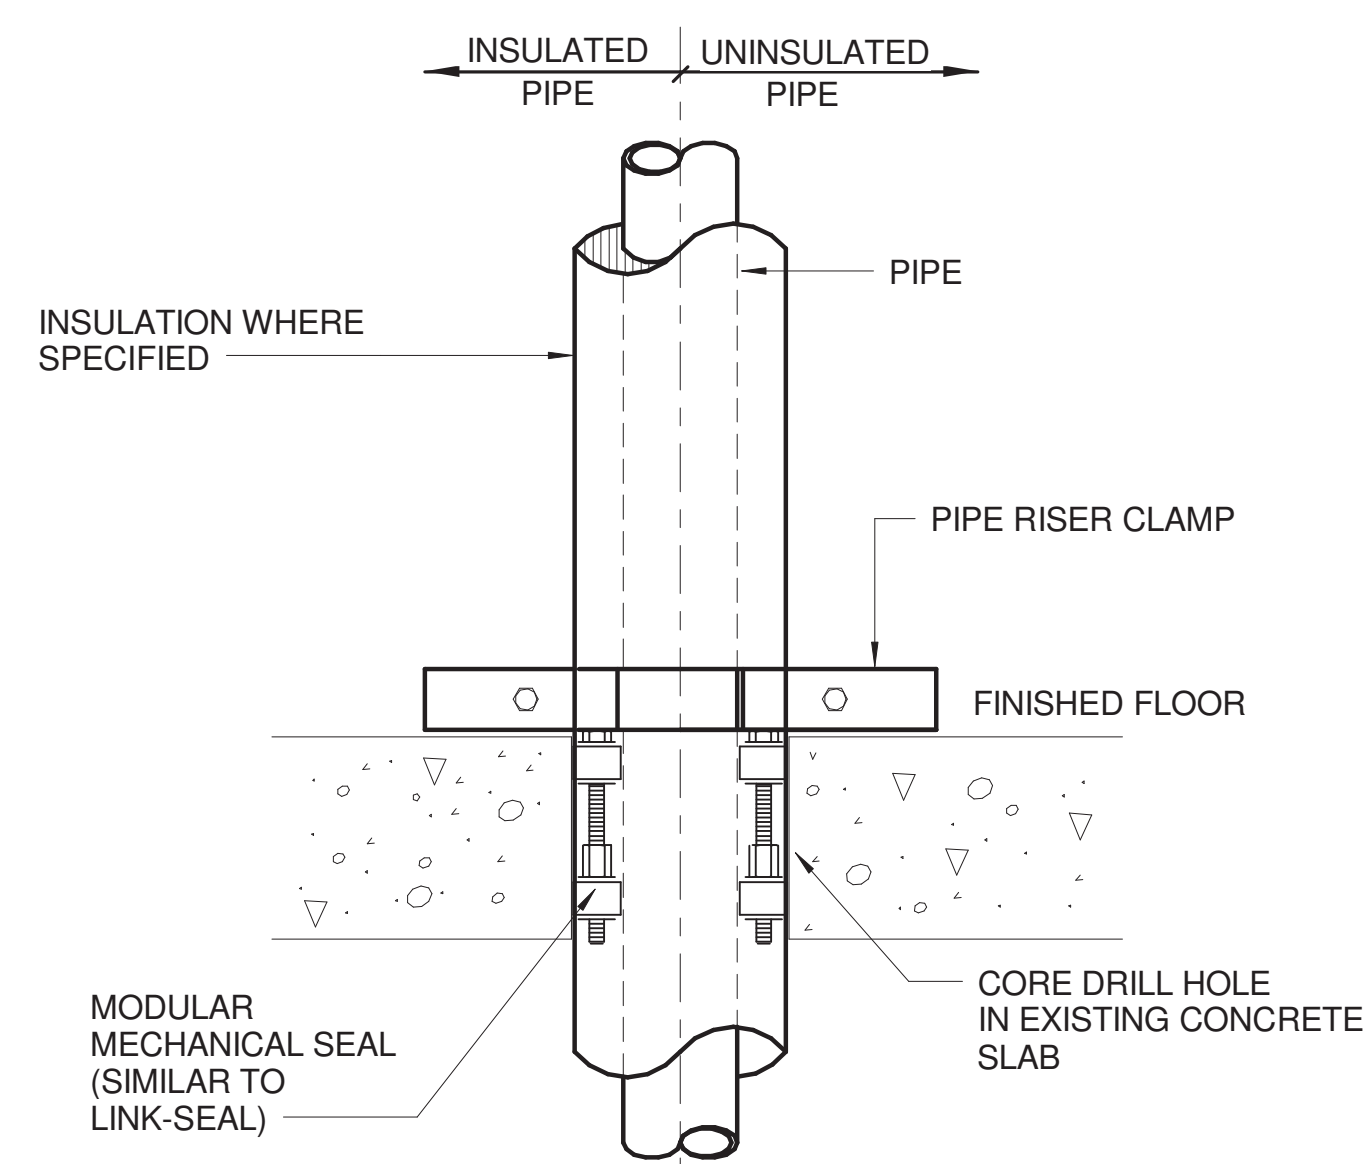

**3** PIPE PENETRATION THRU EXISTING ELEVATED SLAB DETAIL  
12" = 1'-0"

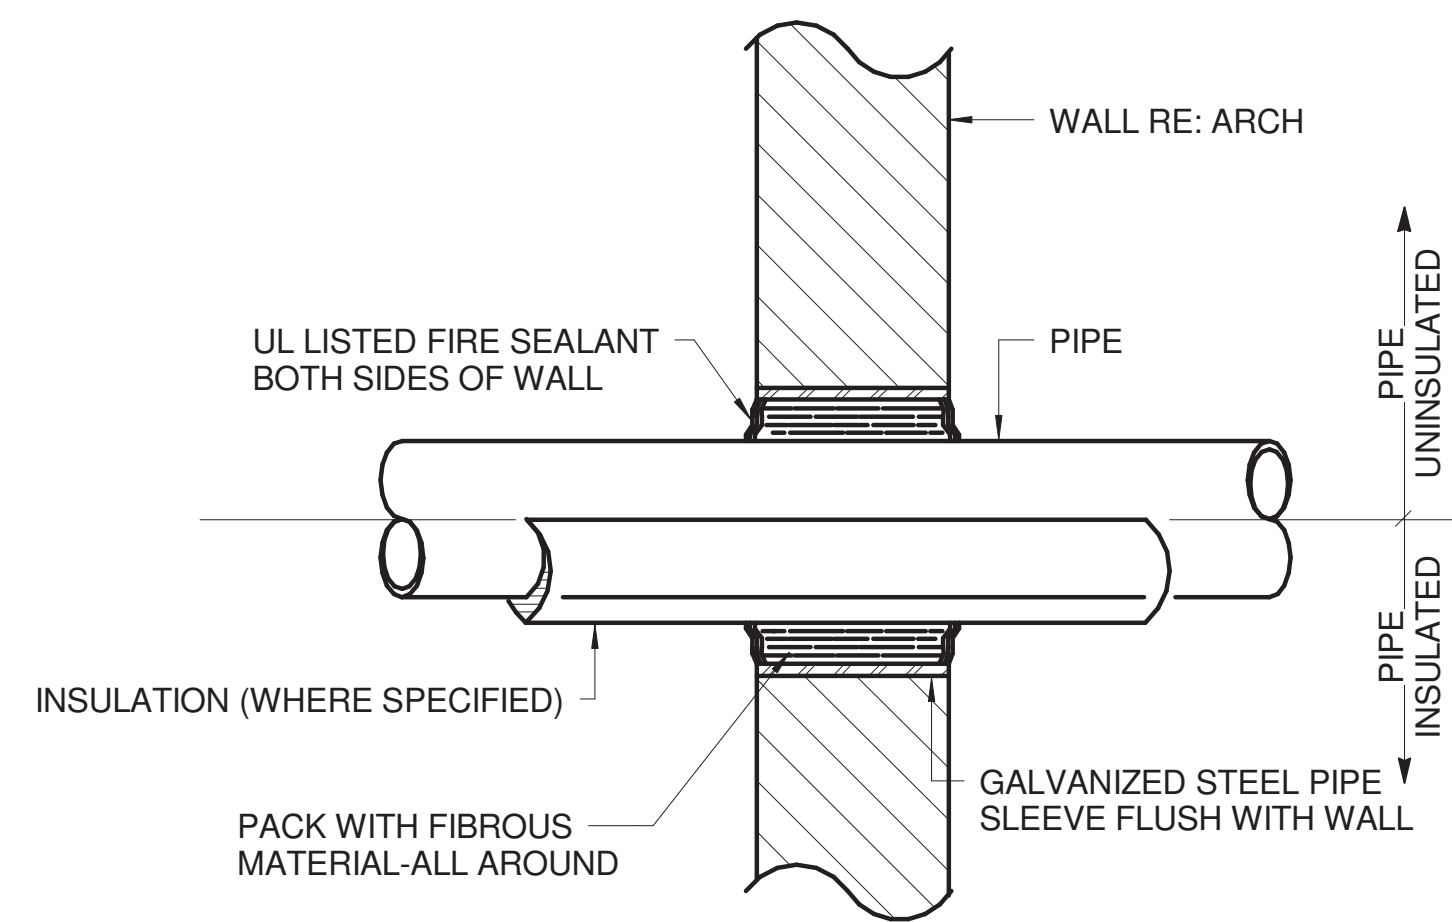


**4** PIPE PENETRATION THRU FIRE-RATED WALL  
12" = 1'-0"

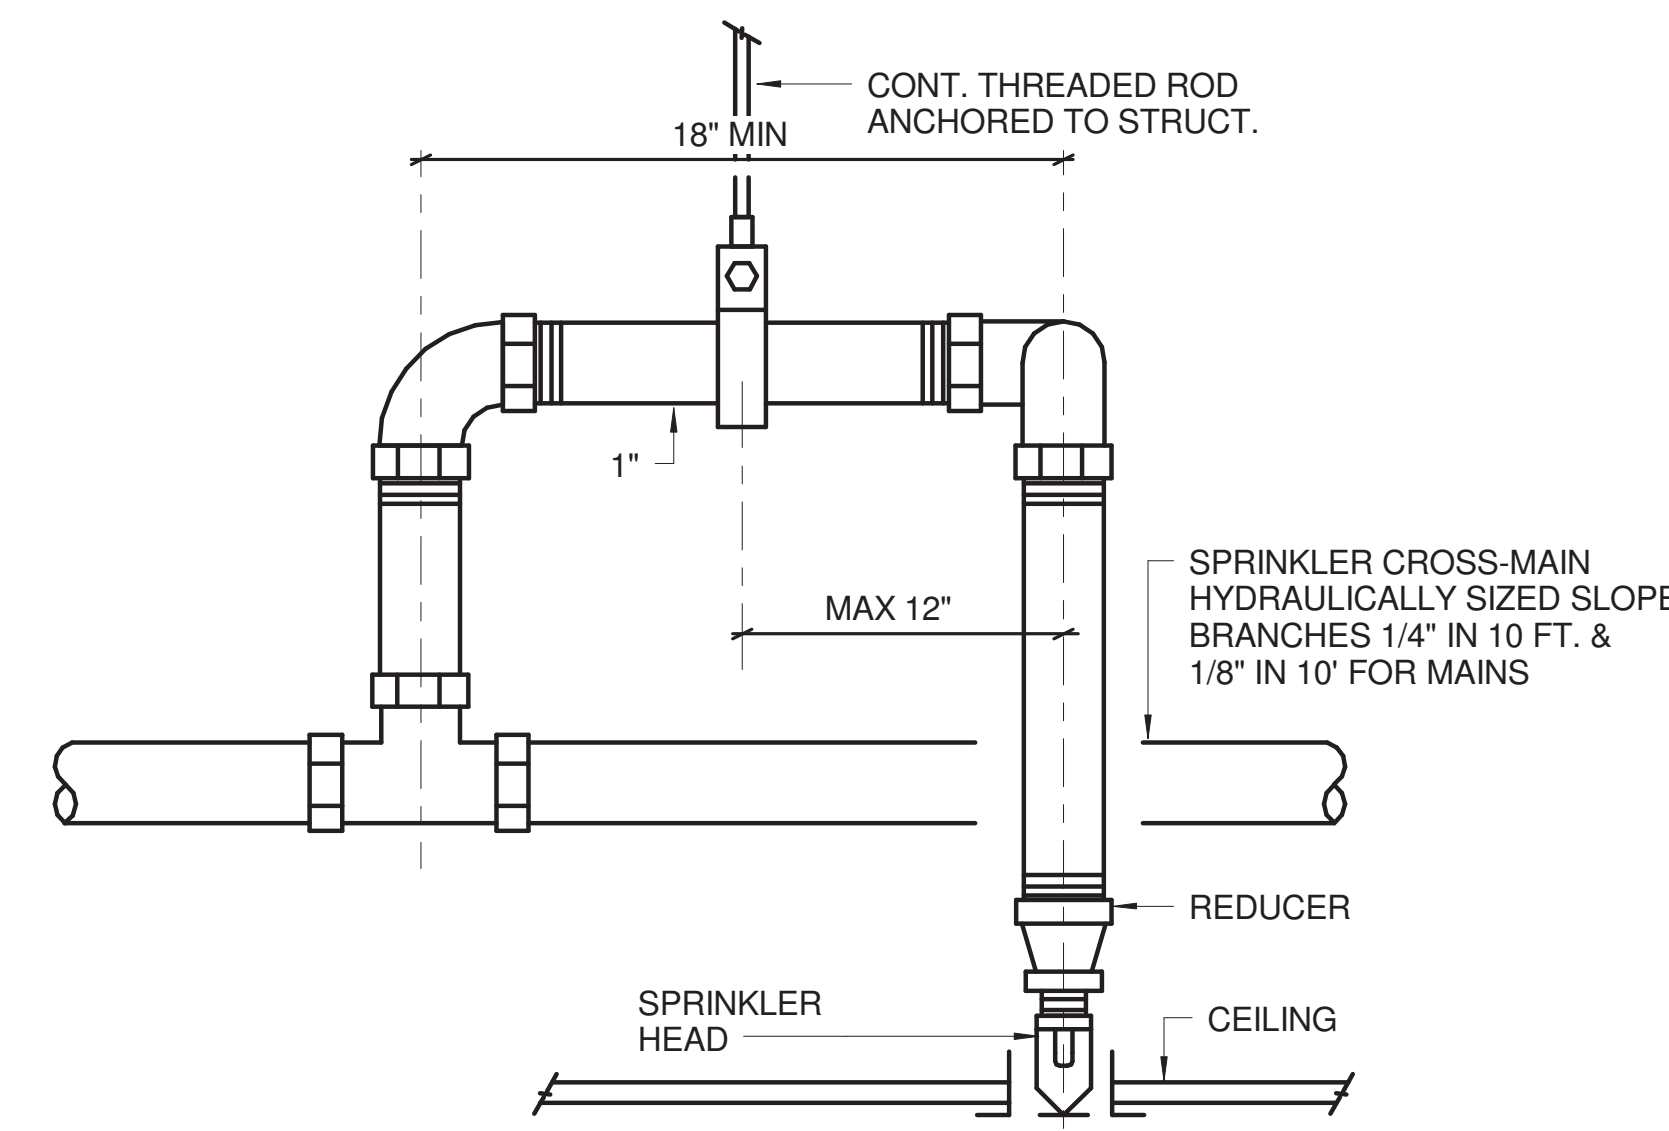

NOTE:  
INSTALL SPRINKLER HEADS IN EXACT CENTER OF LAY-IN CEILING TILES. THIS DETAIL APPLIES IN ALL LOCATIONS WHERE SPRINKLER HEADS ARE LOCATED IN SUSPENDED CEILINGS.

**1** SPRINKLER IN CEILING DETAIL  
12" = 1'-0"

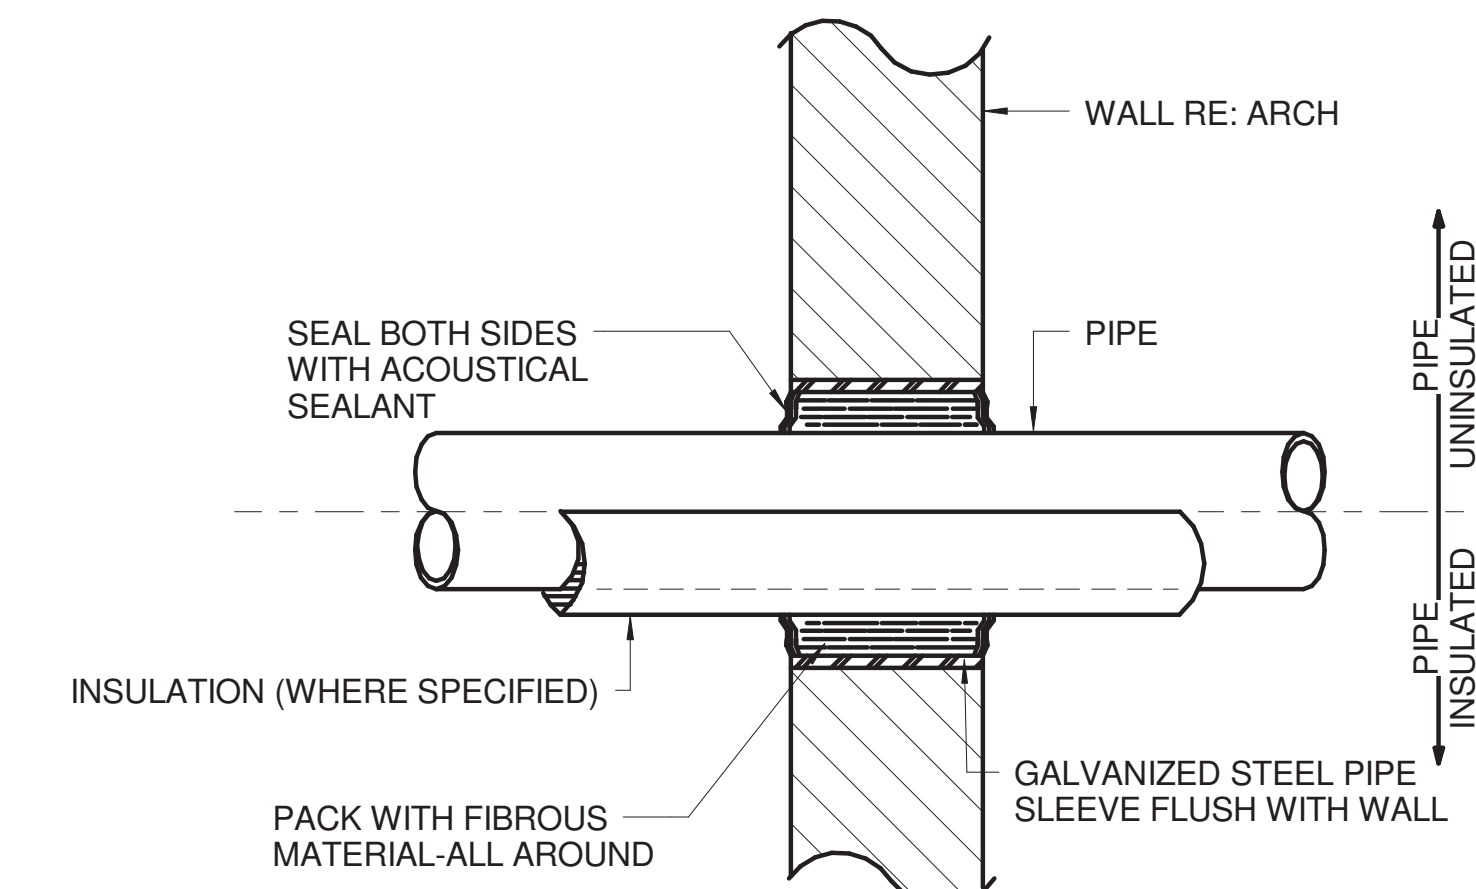

**5** PIPE PENETRATION THRU NON-RATED WALL  
12" = 1'-0"

## PLUMBING FIXTURE SPECIFICATIONS

### LAVATORY (L-1)

- BOWL: WALL MOUNTED BATHROOM SINK, AMERICAN STANDARD "MURRO", 22" X 18" X 34" WITH OVERFLOW, WHITE VITREOUS CHINA WITH SINGLE HOLE PLUGGED. ADA COMPLIANT. WITH VITREOUS CHINA SHROUD, 0059.02EC.
- FAUCET: SLOAN MODEL BASYS IR SERIES EFX 800-200-1000 CP SENSOR METERING HANDWASHING FAUCET WALL MOUNTED SET TO 10 SECOND PROGRAMMABLE RUN TIME PER EACH USE. ADA COMPLIANT. .5 GPM FLOW CONTROL, BATTERY OPERATED CHROME FINISH WITH ASSE 1070 THERMOSTATIC MIXING VALVE IN WALL.
- SUPPLIES: CHICAGO NO. 1006.CP. SUPPLY WITH ESCUTCHEON 1/2" OD X 12" BULLNOSE FLEX SUPPLY RISER, 1/2" NPT FEMALE THREADED INLET & LOOSE KEY ANGLE STOP, CHROME PLATED FINISH, COMPRESSION CONNECTIONS NOT ALLOWED.
- P-TRAP: KOHLER K-8998, CHROME PLATED 1 1/2" ADJUSTABLE CAST BRASS P-TRAP WITH TUBING TO WALL, GROUND SWIVEL JOINT CLEANOUT PLUG WITH CAST BRASS ESCUTCHEON, ALL CHROME PLATED AND CONCEALED WITHIN LAVATORY.
- DRAIN: ELKAY MODEL LK18B WITH ELKAY MODEL LKADOS. TYPE 304 STAINLESS STEEL STRAINER WITH OFFSET TAILPIECE.
- INSULATION KIT: TRUEBRO, FULLY MOLDED CLOSED SELL VINYL, ADA APPROVED INSULATION KIT COMPLETE WITH INTERLOCKING TRAP ASSEMBLY, HOT AND COLD-WATER ANGLE VALVE ASSEMBLY AND FACTORY-SUPPLIED FASTENERS.

### WATER CLOSET (WC-1)

- ZURN Z5647-BWL, FLOOR MOUNTED BACK OUTLET WATER CLOSET WITH BACK SPUD WATER INLET CONNECTION, ELONGATED FLUSH VALVE TOILET, VITREOUS CHINA, 1.28 GPF, SIPHON JET FLUSH, EQUIP WITH CHURCH #9500C OPEN FRONT SEAT, EQUIP WITH CONCEALED MANUAL OPERATED FLUSH VALVE ZURN ZH615AV-HET-MB-WP AQUAVANTAGE WITH HYDRAULIC PUSH BUTTON ACTUATION AT 1.28 GPF, OR APPROVED EQUAL WITH SPUD COUPLING AND FLANGE FOR BACK SPUD CONNECTION WITH WALL PLATE FOR FLUSH VALVE. PROVIDE SLOAN WB-1-A WALL BOX WITH PUSH BUTTON ACTUATOR (HY-33-A).

### SHOWER (SH-1)

- SHOWER HEAD: MATCH EXISTING SHOWER HEADS INSTALLED IN PATIENT RESTROOMS OF AREA B OF THIS FACILITY FOR NEW SHOWERS. FOR EXISTING SHOWERS TO BE RENOVATED EXISTING SHOWER HEADS ARE TO REMAIN.
- DRAIN: FOR EXISTING SHOWERS TO BE RENOVATED, REUSE EXISTING DRAIN. FOR NEW SHOWERS, PROVIDE MI-Fab No. F1100C-6-1, CAST IRON FLOOR DRAIN WITH FLASHING COLLAR, SEEPAGE FLANGE, NICKEL BRONZE 6 INCH ROUND ADJUSTABLE STRAINER WITH SQUARE HOLES.
- SHOWER VALVE: SPEAKMAN BEHAVIORAL SAFETY PRODUCTS #SV220. SHOWER VALVE WITH ANTI-LIGATURE HANDLE AND ESCUTCHEON PLATE. ANTI-SCALD PROTECTION CHROME PLATED WITH INTEGRAL STOPS. ADA COMPLIANT.

### SINK (SK-1)

- BOWL: SINGLE COMPARTMENT SINK, ELKAY LRAD-1517. 15"X17-1/2"X5-1/2", ADA COMPLIANT, SELF RIMMING WITH UNDERCOATING, 18 GAUGE, TYPE 302 STAINLESS STEEL WITH 3 HOLES ON 4" CENTERS.
- FAUCET: CHICAGO NO. 786-CP DECK MOUNTED, CHROME PLATED BRASS FAUCET WITH 5-1/2" SWING GOOSENECK SPOUT, INLETS ON 8" CENTERS, CHROME PLATED, ADA COMPLIANT 2" HANDLES, 1/2" INLETS, 1.5 GPM FLOW CONTROL, QUARTER TURN CARTRIDGE, FULLY ADA COMPLIANT.
- SUPPLIES: CHICAGO NO. 1006.CP. SUPPLY WITH ESCUTCHEON 1/2" OD X 12" BULLNOSE FLEX SUPPLY RISER, 1/2" NPT FEMALE THREADED INLET & LOOSE KEY ANGLE STOP, CHROME PLATED FINISH, COMPRESSION CONNECTIONS NOT ALLOWED.
- P-TRAP: MCGUIRE NO. 8912, CHROME PLATED 1 1/2" ADJUSTABLE CAST BRASS P-TRAP WITH TUBING TO WALL. GROUND SWIVEL JOINT CLEANOUT PLUG WITH CAST BRASS ESCUTCHEON, ALL CHROME PLATED.
- DRAIN: ELKAY MODEL LK18B WITH ELKAY MODEL LKADOS. TYPE 304 STAINLESS STEEL STRAINER WITH OFFSET TAILPIECE.
- INSULATION KIT: TRUEBRO, FULLY MOLDED CLOSED SELL VINYL, ADA APPROVED INSULATION KIT COMPLETE WITH INTERLOCKING TRAP ASSEMBLY, HOT AND COLD-WATER ANGLE VALVE ASSEMBLY AND FACTORY-SUPPLIED FASTENERS.

## SHOCK ARRESTOR SCHEDULE

SYMBOL	FIXTURE UNITS	PIPE SIZE	ZURN SHOCK STOP NUMBER
(A)	1-11	1/2"	100
(B)	12-32	3/4"	200
(C)	33-60	1"	300
(D)	61-113	1"	400
(E)	114-154	1"	500
(F)	155-330	1"	600

NOTE:  
WHERE (A) SYMBOL OCCURS ON THE PLUMBING PLANS OR PLUMBING DETAIL SHEETS, REFER TO SHOCK ARRESTOR SCHEDULE ABOVE.

No.	Description	Date



CLIENT UT HEALTH		
PROJECT NUMBER 16103		
DATE:	October 14, 2016	
DRAWN BY:	CH	
CHECKED BY:	CH	
REVISIONS		
No.	Description	Date

ISSUE FOR CONSTRUCTION  
**FIRST FLOOR  
 PLUMBING  
 DEMOLITION PLAN -  
 AREA C**

**PD2.01C**

**KEYED NOTES - PD2.01C**


- 1 REMOVE EXISTING LAVATORY AND LAVATORY TRIM AND ASSOCIATED PLUMBING. CAP SANITARY LINE AND WATER PIPING AND CONCEAL IN WALL.
- 2 REMOVE EXISTING FLOOR MOUNTED WATER CLOSET. CAP SANITARY WASTE BELOW SLAB AND FILL VOID IN FLOOR WITH CONCRETE. MATCH EXISTING SLAB THICKNESS AND FINISH. REFER TO RENOVATION DRAWING P2.01C FOR NEW WATER CLOSET WITH WALL OUTLET.
- 3 REMOVE EXISTING SHOWER HEAD AND TRIM. REMOVE DOW AND DHW PIPING AND CAP ABOVE CEILING FOR CONNECTION TO NEW FIXTURE.
- 4 REMOVE EXISTING BATHTUB.

**GENERAL NOTES**

- A. PLUMBING ITEMS SHOWN LIGHT ARE EXISTING TO REMAIN. ITEMS SHOWN BOLD ARE TO BE REMOVED.
- B. FIELD VERIFY EXISTING CONDITIONS PRIOR TO BEGINNING WORK.
- C. COORDINATE DOWNTIME OF SYSTEMS WITH THE OWNER PRIOR TO BEGINNING WORK.




**FIRST FLOOR - AREA C  
 DEMOLITION PLAN**  
 1/4" = 1'-0"

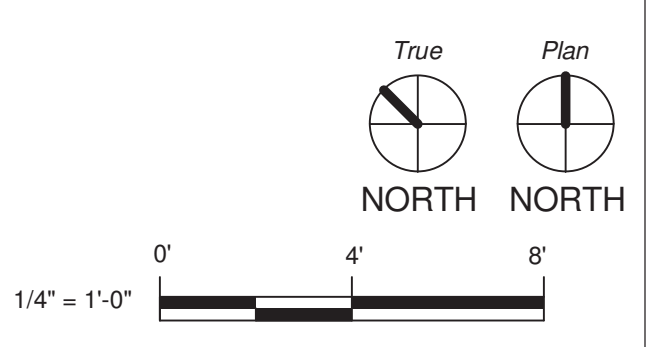



**HARRIS COUNTY PSYCHIATRIC  
 CENTER RENOVATIONS UNITS  
 1C, 2E, 3B, 3C, 3D & 3E**

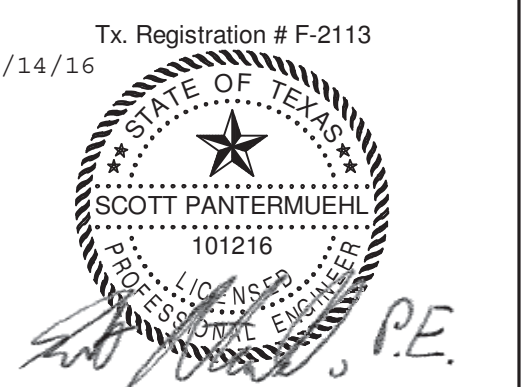

CLIENT	UT HEALTH
PROJECT NUMBER	16103
DATE:	October 14, 2016
DRAWN BY:	CH
CHECKED BY:	CH

No.	Description	Date

ISSUE FOR CONSTRUCTION

**SECOND FLOOR  
 PLUMBING  
 DEMOLITION PLAN -  
 AREA E**

**PD2.02E**

**KEYED NOTES - PD2.02E**

- REMOVE EXISTING LAVATORY AND LAVATORY TRIM AND ASSOCIATED PLUMBING. CAP SANITARY LINE AND WATER PIPING AND CONCEAL IN WALL.
- REMOVE EXISTING FLOOR MOUNTED WATER CLOSET. CAP SANITARY WASTE BELOW SLAB AND FILL VOID IN FLOOR WITH CONCRETE. MATCH EXISTING SLAB THICKNESS AND FINISH. REFER TO RENOVATION DRAWING P2.01C FOR NEW WATER CLOSET WITH WALL OUTLET.
- REMOVE EXISTING SHOWER HEAD AND TRIM. REMOVE DCW AND DHW PIPING AND CAP ABOVE CEILING FOR CONNECTION TO NEW FIXTURE.
- REMOVE EXISTING BATHTUB.
- REMOVE EXISTING LAVATORY AND LAVATORY TRIM AND ASSOCIATED PLUMBING. CAP SANITARY LINE AND WATER PIPING AND CONCEAL IN WALL FOR FUTURE CONNECTION.
- REMOVE EXISTING FLOOR MOUNTED WATER CLOSET. CAP SANITARY WASTE BELOW SLAB AND FILL VOID IN FLOOR WITH CONCRETE. MATCH EXISTING SLAB THICKNESS AND FINISH. CAP DOMESTIC WATER SUPPLY LINE IN CHASE FOR FUTURE CONNECTION. PROVIDE 4" SANITARY CONNECTION IN CHASE AND CAP LINE FOR FUTURE WATER CLOSET CONNECTION.
- REMOVE EXISTING SHOWER HEAD AND TRIM. REMOVE DCW AND DHW PIPING AND CAP IN CHASE FOR FUTURE CONNECTION.

**GENERAL NOTES**

- PLUMBING ITEMS SHOWN LIGHT ARE EXISTING TO REMAIN. ITEMS SHOWN BOLD ARE TO BE REMOVED.
- FIELD VERIFY EXISTING CONDITIONS PRIOR TO BEGINNING WORK.
- COORDINATE DOWNTIME OF SYSTEMS WITH THE OWNER PRIOR TO BEGINNING WORK.



**SECOND FLOOR - AREA E  
 DEMOLITION PLAN**  
 1/4" = 1'-0"



**KEYED NOTES - PD2.03B**

- 1 REMOVE EXISTING LAVATORY AND LAVATORY TRIM AND ASSOCIATED PLUMBING. CAP SANITARY LINE AND WATER PIPING AND CONCEAL IN WALL.
- 2 REMOVE EXISTING FLOOR MOUNTED WATER CLOSET. CAP SANITARY WASTE BELOW SLAB AND FILL VOID IN FLOOR WITH CONCRETE. MATCH EXISTING SLAB THICKNESS AND FINISH. REFER TO RENOVATION DRAWING P2.01C FOR NEW WATER CLOSET WITH WALL OUTLET.
- 3 REMOVE EXISTING SHOWER HEAD AND TRIM. REMOVE DOW AND DHW PIPING AND CAP ABOVE CEILING FOR CONNECTION TO NEW FIXTURE.
- 4 REMOVE EXISTING BATHTUB.


**GENERAL NOTES**

- A. PLUMBING ITEMS SHOWN LIGHT ARE EXISTING TO REMAIN. ITEMS SHOWN BOLD ARE TO BE REMOVED.
- B. FIELD VERIFY EXISTING CONDITIONS PRIOR TO BEGINNING WORK.
- C. COORDINATE DOWNTIME OF SYSTEMS WITH THE OWNER PRIOR TO BEGINNING WORK.




**THIRD FLOOR - AREA B  
 DEMOLITION PLAN**

1/4" = 1'-0"

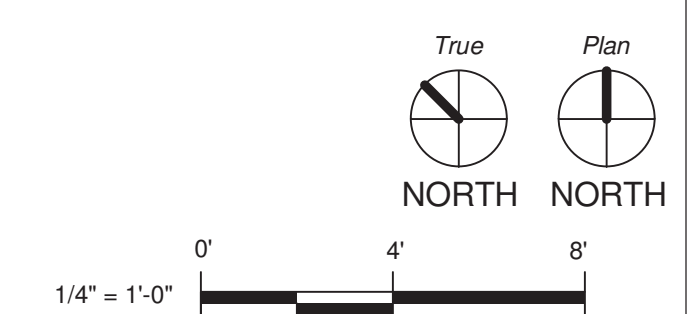



**HARRIS COUNTY PSYCHIATRIC  
 CENTER RENOVATIONS UNITS  
 1C, 2E, 3B, 3C, 3D & 3E**

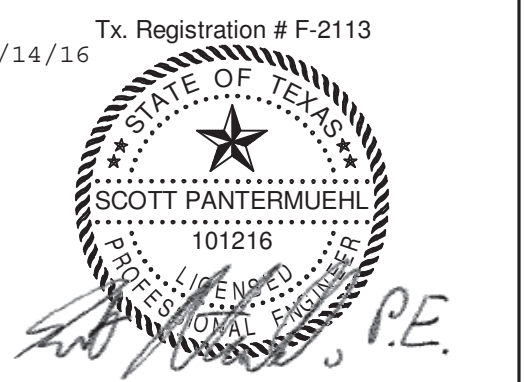

CLIENT UT HEALTH		
PROJECT NUMBER 16103		
DATE:	October 14, 2016	
DRAWN BY:	CH	
CHECKED BY:	CH	
REVISIONS		
No.	Description	Date

ISSUE FOR CONSTRUCTION

**THIRD FLOOR  
 PLUMBING  
 DEMOLITION PLAN -  
 AREA C**

**PD2.03C**

**KEYED NOTES - PD2.03C**


- 1 REMOVE EXISTING LAVATORY AND LAVATORY TRIM AND ASSOCIATED PLUMBING. CAP SANITARY LINE AND WATER PIPING AND CONCEAL IN WALL.
- 2 REMOVE EXISTING FLOOR MOUNTED WATER CLOSET. CAP SANITARY WASTE BELOW SLAB AND FILL VOID IN FLOOR WITH CONCRETE. MATCH EXISTING SLAB THICKNESS AND FINISH. REFER TO RENOVATION DRAWING P2.01C FOR NEW WATER CLOSET WITH WALL OUTLET.
- 3 REMOVE EXISTING SHOWER HEAD AND TRIM. REMOVE DCW AND DHW PIPING AND CAP ABOVE CEILING FOR CONNECTION TO NEW FIXTURE.
- 4 REMOVE EXISTING BATHTUB.

**GENERAL NOTES**

- A. PLUMBING ITEMS SHOWN LIGHT ARE EXISTING TO REMAIN. ITEMS SHOWN BOLD ARE TO BE REMOVED.
- B. FIELD VERIFY EXISTING CONDITIONS PRIOR TO BEGINNING WORK.
- C. COORDINATE DOWNTIME OF SYSTEMS WITH THE OWNER PRIOR TO BEGINNING WORK.




**THIRD FLOOR - AREA C  
 DEMOLITION PLAN**  
 1/4" = 1'-0"

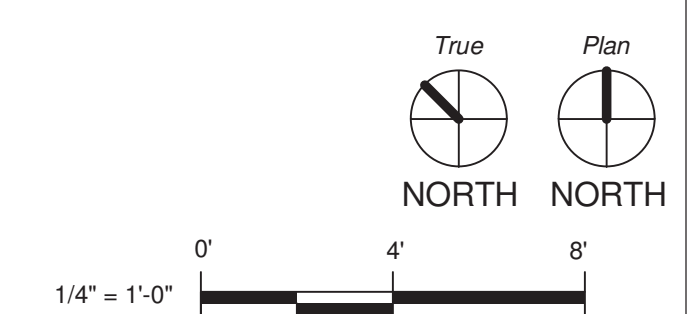



**HARRIS COUNTY PSYCHIATRIC  
CENTER RENOVATIONS UNITS  
1C, 2E, 3B, 3C, 3D & 3E**

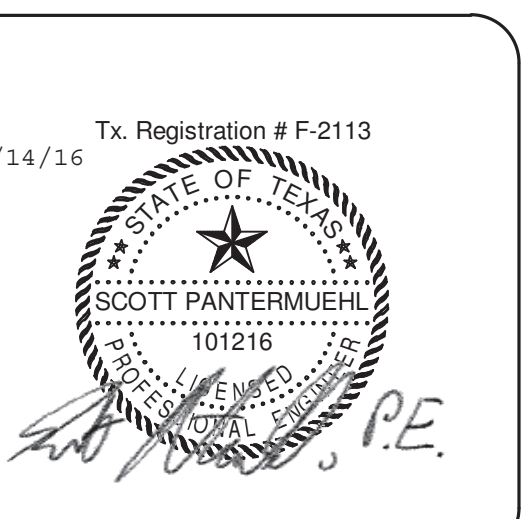

CLIENT		
UT HEALTH		
PROJECT NUMBER		
16103		
DATE:	October 14, 2016	
DRAWN BY:	CH	
CHECKED BY:	CH	
REVISIONS		
No.	Description	Date

ISSUE FOR CONSTRUCTION

**THIRD FLOOR  
PLUMBING  
DEMOLITION PLAN -  
AREA D**

**PD2.03D**

**KEYED NOTES - PD2.03D**

- 1 REMOVE EXISTING LAVATORY AND LAVATORY TRIM AND ASSOCIATED PLUMBING. CAP SANITARY LINE AND WATER PIPING AND CONCEAL IN WALL.
- 2 REMOVE EXISTING FLOOR MOUNTED WATER CLOSET. CAP SANITARY WASTE BELOW SLAB AND FILL VOID IN FLOOR WITH CONCRETE. MATCH EXISTING SLAB THICKNESS AND FINISH. REFER TO RENOVATION DRAWING P2.01C FOR NEW WATER CLOSET WITH WALL OUTLET.
- 3 REMOVE EXISTING SHOWER HEAD AND TRIM. REMOVE DCW AND DHW PIPING AND CAP ABOVE CEILING FOR CONNECTION TO NEW FIXTURE.
- 4 REMOVE EXISTING BATHTUB.
- 5 REMOVE EXISTING SINK AND FAUCET. DCW, DHW AND SANITARY LINES TO BE CAPPED AT WALL FOR CONNECTION TO NEW FIXTURE. REFER TO RENOVATION PLAN P2.03D FOR NEW SINK AND TRIM.


**GENERAL NOTES**

- A. PLUMBING ITEMS SHOWN LIGHT ARE EXISTING TO REMAIN. ITEMS SHOWN BOLD ARE TO BE REMOVED.
- B. FIELD VERIFY EXISTING CONDITIONS PRIOR TO BEGINNING WORK.
- C. COORDINATE DOWNTIME OF SYSTEMS WITH THE OWNER PRIOR TO BEGINNING WORK.




**THIRD FLOOR - AREA D  
DEMOLITION PLAN**

1/4" = 1'-0"

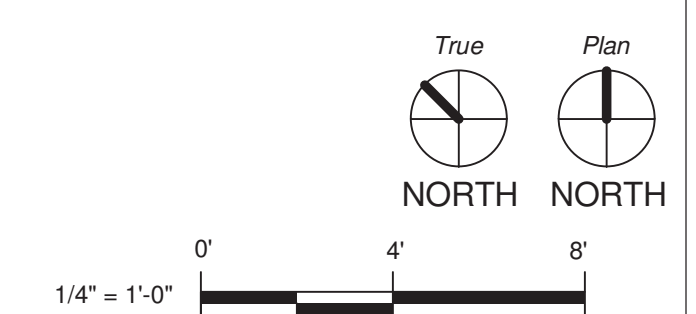



**HARRIS COUNTY PSYCHIATRIC  
CENTER RENOVATIONS UNITS  
1C, 2E, 3B, 3C, 3D & 3E**

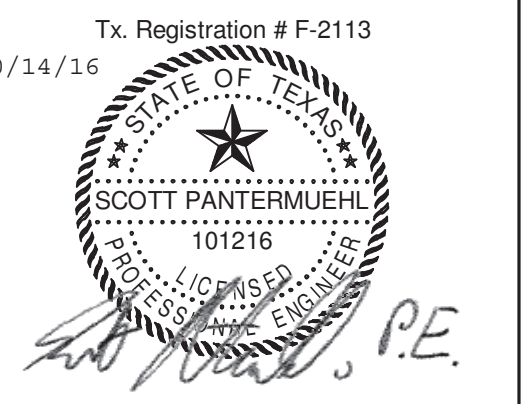

CLIENT UT HEALTH		
PROJECT NUMBER 16103		
DATE:	October 14, 2016	
DRAWN BY:	CH	
CHECKED BY:	CH	
REVISIONS		
No.	Description	Date

**ISSUE FOR CONSTRUCTION  
THIRD FLOOR  
PLUMBING  
DEMOLITION PLAN -  
AREA E**

**PD2.03E**

**KEYED NOTES - PD2.03E**

- 1 REMOVE EXISTING LAVATORY AND LAVATORY TRIM AND ASSOCIATED PLUMBING. CAP SANITARY LINE AND WATER PIPING AND CONCEAL IN WALL.
- 2 REMOVE EXISTING FLOOR MOUNTED WATER CLOSET. CAP SANITARY WASTE BELOW SLAB AND FILL VOID IN FLOOR WITH CONCRETE. MATCH EXISTING SLAB THICKNESS AND FINISH. REFER TO RENOVATION DRAWING P2.01C FOR NEW WATER CLOSET WITH WALL OUTLET.
- 3 REMOVE EXISTING SHOWER HEAD AND TRIM. REMOVE DCW AND DHW PIPING AND CAP ABOVE CEILING FOR CONNECTION TO NEW FIXTURE.
- 4 REMOVE EXISTING BATHTUB.


**GENERAL NOTES**

- A. PLUMBING ITEMS SHOWN LIGHT ARE EXISTING TO REMAIN. ITEMS SHOWN BOLD ARE TO BE REMOVED.
- B. FIELD VERIFY EXISTING CONDITIONS PRIOR TO BEGINNING WORK.
- C. COORDINATE DOWNTIME OF SYSTEMS WITH THE OWNER PRIOR TO BEGINNING WORK.



**THIRD FLOOR - AREA E  
DEMOLITION PLAN**

1/4" = 1'-0"

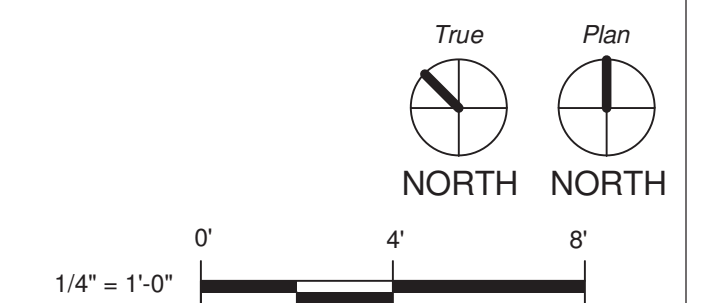



No.	Description	Date

ISSUE FOR CONSTRUCTION

**FIRST FLOOR  
 PLUMBING  
 RENOVATION PLAN -  
 AREA C**

**P2.01C**

**KEYED NOTES - P2.01C**

- 1 PROVIDE NEW LAVATORY WITH WALL MOUNTED SENSOR FAUCET. CONNECT 1/2" DCW AND DHW TO EXISTING DCW AND DHW IN WALL. CONNECT TO EXISTING WASTE AND VENT IN WALL.
- 2 REWORK EXISTING WASTE AND VENT PIPING TO CONNECT TO NEW WATER CLOSET WITH BACK OUTLET. CONNECT 1 1/4" DCW TO EXISTING DCW IN WALL. 4" WASTE THRU WALL AND DOWN TO EXISTING SANITARY LINE.
- 3 PROVIDE 1/2" DCW AND 1/2" DHW TO NEW SHOWER. 2" WASTE WITH P-TRAP FROM FLOOR DRAIN AND CONNECT TO EXISTING SANITARY BELOW SLAB.
- 4 REWORK AND REPLACE EXISTING WET AUTOMATIC SPRINKLER HEADS WHERE RENOVATION WORK OCCURS WITH PENDANT TYPE, QUICK RESPONSE SPRINKLER HEADS, INSTITUTIONAL TYPE, FOR LIGHT HAZARD OCCUPANCY AS OUTLINED IN NFPA 13 AND THE SPECIFICATIONS.
- 5 REWORK AND REPLACE EXISTING SPRINKLER HEADS WHERE NECESSARY WITH CONCEALED TYPE QUICK RESPONSE SPRINKLER HEADS, FOR LIGHT HAZARD OCCUPANCY AS OUTLINED IN NFPA 13 AND THE SPECIFICATIONS.


**GENERAL NOTES**

- A. FIELD VERIFY EXISTING CONDITIONS PRIOR TO BEGINNING WORK.
- B. COORDINATE THE DOWNTIME OF EXISTING SYSTEMS WITH THE OWNER PRIOR TO BEGINNING WORK.
- C. THE FLOOR IS CURRENTLY ENTIRELY PROTECTED BY A WET AUTOMATIC SPRINKLER SYSTEM. WHERE NEW SPRINKLER WORK IS INDICATED, THE EXISTING SPRINKLER HEADS SHALL BE REMOVED AND REPLACED WITH NEW SPRINKLER HEADS AS NOTED. REWORK EXISTING SPRINKLER HEADS TO MATCH NEW ARCHITECTURAL LAYOUT. REFER TO ARCHITECTURE REFLECTED CEILING PLAN FOR COORDINATION WITH LIGHTING AND EXTENT OF CEILING RENOVATION SCOPE OF WORK.
- D. FOR PROTECTION DURING CONSTRUCTION, TURN EXISTING FIRE SPRINKLER HEADS UP WHEN CEILINGS ARE REMOVED AND REPLACE EXISTING SPRINKLER HEADS WITH NEW UPRIGHT PENDANT FAST-RESPONSE SPRINKLER HEADS. TURN EXISTING FIRE SPRINKLER HEAD DROPS BACK DOWN FOR FINAL INSTALLATION WHEN NEW CEILINGS ARE INSTALLED AND REPLACE PENDANT SPRINKLER HEADS WITH NEW CONCEALED FAST-RESPONSE SPRINKLER HEADS IN COMMON AREAS AND NEW SECURITY TYPE FAST-RESPONSE SPRINKLER HEADS IN PATIENT ROOMS AND OTHER SECURE AREAS AS NOTED ON THE DRAWINGS.
- E. REFER TO THE SPECIFICATIONS FOR SPRINKLER HEAD ORIFICE SIZES, TEMPERATURE RATINGS, FINISH ETC.
- F. CLEAN AND RELOCATE EXISTING FLOOR DRAINS ON AN AS NEEDED BASIS TO PROVIDE SUFFICIENT SLOPE FOR POSITIVE DRAINAGE.



**FIRST FLOOR RENOVATION - AREA**

**1C**  
 1/4" = 1'-0"

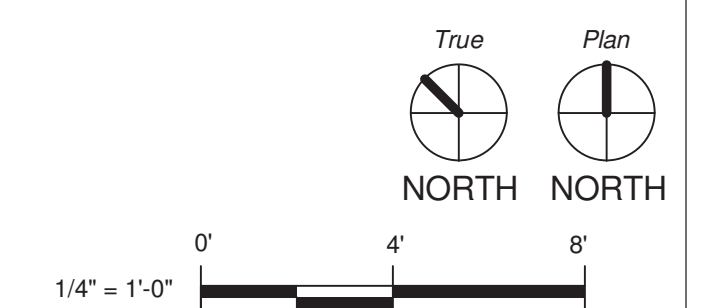



**HARRIS COUNTY PSYCHIATRIC  
 CENTER RENOVATIONS UNITS  
 1C, 2E, 3B, 3C, 3D & 3E**



**KEYED NOTES - P2.02E**

- 1 PROVIDE NEW LAVATORY WITH WALL MOUNTED SENSOR FAUCET. CONNECT 1/2" DCW AND DHW TO EXISTING DCW AND DHW IN WALL. CONNECT TO EXISTING WASTE AND VENT IN WALL.
- 2 REWORK EXISTING WASTE AND VENT PIPING TO CONNECT TO NEW WATER CLOSET WITH BACK OUTLET. CONNECT 1 1/4" DCW TO EXISTING DCW IN WALL. 4" WASTE THRU WALL AND DOWN TO EXISTING SANITARY LINE.
- 3 PROVIDE 1/2" DCW AND 1/2" DHW TO NEW SHOWER. 2" WASTE WITH P-TRAP FROM FLOOR DRAIN AND CONNECT TO EXISTING SANITARY BELOW SLAB.
- 4 REWORK AND REPLACE EXISTING WET AUTOMATIC SPRINKLER HEADS WHERE RENOVATION WORK OCCURS WITH PENDANT TYPE, QUICK RESPONSE SPRINKLER HEADS. INSTITUTIONAL TYPE, FOR LIGHT HAZARD OCCUPANCY AS OUTLINED IN NFPA 13 AND THE SPECIFICATIONS.
- 5 REWORK AND REPLACE EXISTING SPRINKLER HEADS WHERE NECESSARY WITH CONCEALED TYPE QUICK RESPONSE SPRINKLER HEADS. FOR LIGHT HAZARD OCCUPANCY AS OUTLINED IN NFPA 13 AND THE SPECIFICATIONS.

**GENERAL NOTES**



- A. FIELD VERIFY EXISTING CONDITIONS PRIOR TO BEGINNING WORK.
- B. COORDINATE THE DOWNTIME OF EXISTING SYSTEMS WITH THE OWNER PRIOR TO BEGINNING WORK.
- C. THE FLOOR IS CURRENTLY ENTIRELY PROTECTED BY A WET AUTOMATIC SPRINKLER SYSTEM. WHERE NEW SPRINKLER WORK IS INDICATED, THE EXISTING SPRINKLER HEADS SHALL BE REMOVED AND REPLACED WITH NEW SPRINKLER HEADS AS NOTED. REWORK EXISTING SPRINKLER HEADS TO MATCH NEW ARCHITECTURAL LAYOUT. REFER TO ARCHITECTURE REFLECTED CEILING PLAN FOR COORDINATION WITH LIGHTING AND EXTENT OF CEILING RENOVATION SCOPE OF WORK.
- D. FOR PROTECTION DURING CONSTRUCTION, TURN EXISTING FIRE SPRINKLER HEADS UP WHEN CEILINGS ARE REMOVED AND REPLACE EXISTING SPRINKLER HEADS WITH NEW UPRIGHT PENDANT FAST-RESPONSE SPRINKLER HEADS. TURN EXISTING FIRE SPRINKLER HEAD DROPS BACK DOWN FOR FINAL INSTALLATION WHEN NEW CEILINGS ARE INSTALLED AND REPLACE PENDANT SPRINKLER HEADS WITH NEW CONCEALED FAST-RESPONSE SPRINKLER HEADS IN COMMON AREAS AND NEW SECURITY TYPE FAST-RESPONSE SPRINKLER HEADS IN PATIENT ROOMS AND OTHER SECURE AREAS AS NOTED ON THE DRAWINGS.
- E. REFER TO THE SPECIFICATIONS FOR SPRINKLER HEAD ORIFICE SIZES, TEMPERATURE RATINGS, FINISH ETC.
- F. CLEAN AND RELOCATE EXISTING FLOOR DRAINS ON AN AS NEEDED BASIS TO PROVIDE SUFFICIENT SLOPE FOR POSITIVE DRAINAGE.



**SECOND FLOOR RENOVATION -**

**AREA E**

1/4" = 1'-0"

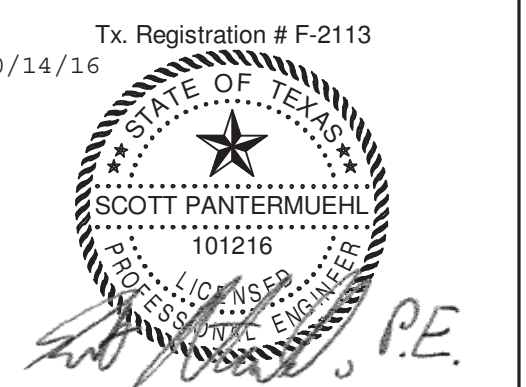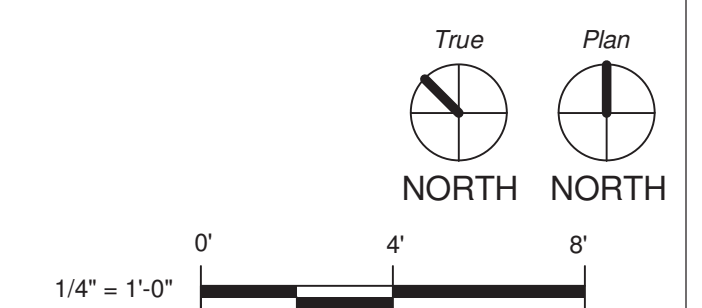

CLIENT	UT HEALTH
PROJECT NUMBER	16103
DATE:	October 14, 2016
DRAWN BY:	CH
CHECKED BY:	CH
REVISIONS	

No.	Description	Date

ISSUE FOR CONSTRUCTION

**SECOND FLOOR  
 PLUMBING  
 RENOVATION PLAN -  
 AREA E**

**P2.02E**



**HARRIS COUNTY PSYCHIATRIC  
 CENTER RENOVATIONS UNITS  
 1C, 2E, 3B, 3C, 3D & 3E**



**KEYED NOTES - P2.03B**

- 1 PROVIDE NEW LAVATORY WITH WALL MOUNTED SENSOR FAUCET. CONNECT 1/2" DCW AND DHW TO EXISTING DCW AND DHW IN WALL. CONNECT TO EXISTING WASTE AND VENT IN WALL.
- 2 REWORK EXISTING WASTE AND VENT PIPING TO CONNECT TO NEW WATER CLOSET WITH BACK OUTLET. CONNECT 1 1/4" DCW TO EXISTING DCW IN WALL. 4" WASTE THRU WALL AND DOWN TO EXISTING SANITARY LINE.
- 3 PROVIDE 1/2" DCW AND 1/2" DHW TO NEW SHOWER. 2" WASTE WITH P-TRAP FROM FLOOR DRAIN AND CONNECT TO EXISTING SANITARY BELOW SLAB.
- 4 REWORK AND REPLACE EXISTING WET AUTOMATIC SPRINKLER HEADS WHERE RENOVATION WORK OCCURS WITH PENDANT TYPE, QUICK RESPONSE SPRINKLER HEADS, INSTITUTIONAL TYPE, FOR LIGHT HAZARD OCCUPANCY AS OUTLINED IN NFPA 13 AND THE SPECIFICATIONS.
- 5 REWORK AND REPLACE EXISTING SPRINKLER HEADS WHERE NECESSARY WITH CONCEALED TYPE QUICK RESPONSE SPRINKLER HEADS, FOR LIGHT HAZARD OCCUPANCY AS OUTLINED IN NFPA 13 AND THE SPECIFICATIONS.



**GENERAL NOTES**

- A. FIELD VERIFY EXISTING CONDITIONS PRIOR TO BEGINNING WORK.
- B. COORDINATE THE DOWNTIME OF EXISTING SYSTEMS WITH THE OWNER PRIOR TO BEGINNING WORK.
- C. THE FLOOR IS CURRENTLY ENTIRELY PROTECTED BY A WET AUTOMATIC SPRINKLER SYSTEM. WHERE NEW SPRINKLER WORK IS INDICATED, THE EXISTING SPRINKLER HEADS SHALL BE REMOVED AND REPLACED WITH NEW SPRINKLER HEADS AS NOTED. REWORK EXISTING SPRINKLER HEADS TO MATCH NEW ARCHITECTURAL LAYOUT. REFER TO ARCHITECTURE REFLECTED CEILING PLAN FOR COORDINATION WITH LIGHTING AND EXTENT OF CEILING RENOVATION SCOPE OF WORK.
- D. FOR PROTECTION DURING CONSTRUCTION, TURN EXISTING FIRE SPRINKLER HEADS UP WHEN CEILINGS ARE REMOVED AND REPLACE EXISTING SPRINKLER HEADS WITH NEW UPRIGHT PENDANT FAST-RESPONSE SPRINKLER HEADS. TURN EXISTING FIRE SPRINKLER HEAD DROPS BACK DOWN FOR FINAL INSTALLATION WHEN NEW CEILINGS ARE INSTALLED AND REPLACE PENDANT SPRINKLER HEADS WITH NEW CONCEALED FAST-RESPONSE SPRINKLER HEADS IN COMMON AREAS AND NEW SECURITY TYPE FAST-RESPONSE SPRINKLER HEADS IN PATIENT ROOMS AND OTHER SECURE AREAS AS NOTED ON THE DRAWINGS.
- E. REFER TO THE SPECIFICATIONS FOR SPRINKLER HEAD ORIFICE SIZES, TEMPERATURE RATINGS, FINISH ETC.
- F. CLEAN AND RELOCATE EXISTING FLOOR DRAINS ON AN AS NEEDED BASIS TO PROVIDE SUFFICIENT SLOPE FOR POSITIVE DRAINAGE.



**THIRD FLOOR RENOVATION -**

**1 AREA B**  
 1/4" = 1'-0"

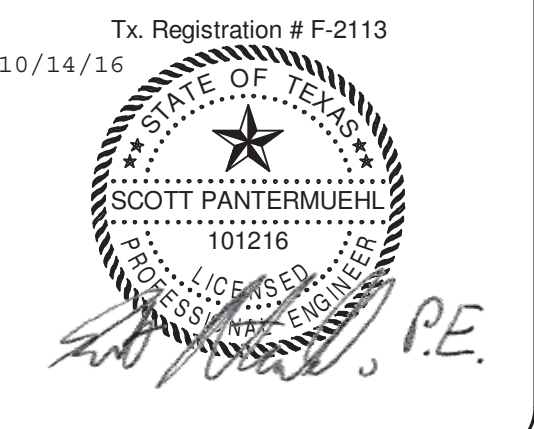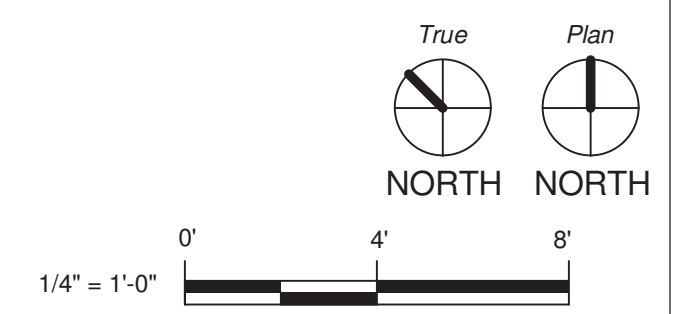

CLIENT		UT HEALTH
PROJECT NUMBER		16103
DATE:	October 14, 2016	
DRAWN BY:	CH	
CHECKED BY:	CH	
REVISIONS		
No.	Description	Date

**ISSUE FOR CONSTRUCTION**  
**THIRD FLOOR  
 PLUMBING  
 RENOVATION PLAN -  
 AREA B**

**P2.03B**



**KEYED NOTES - P2.03C**


- 1 PROVIDE NEW LAVATORY WITH WALL MOUNTED SENSOR FAUCET. CONNECT 1/2" DCW AND DHW TO EXISTING DCW AND DHW IN WALL. CONNECT TO EXISTING WASTE AND VENT IN WALL.
- 2 REWORK EXISTING WASTE AND VENT PIPING TO CONNECT TO NEW WATER CLOSET WITH BACK OUTLET. CONNECT 1 1/4" DCW TO EXISTING DCW IN WALL. 4" WASTE THRU WALL AND DOWN TO EXISTING SANITARY LINE.
- 3 PROVIDE 1/2" DCW AND 1/2" DHW TO NEW SHOWER. 2" WASTE WITH P-TRAP FROM FLOOR DRAIN AND CONNECT TO EXISTING SANITARY BELOW SLAB.
- 4 REWORK AND REPLACE EXISTING WET AUTOMATIC SPRINKLER HEADS WHERE RENOVATION WORK OCCURS WITH PENDANT TYPE, QUICK RESPONSE SPRINKLER HEADS, INSTITUTIONAL TYPE, FOR LIGHT HAZARD OCCUPANCY AS OUTLINED IN NFPA 13 AND THE SPECIFICATIONS.
- 5 REWORK AND REPLACE EXISTING SPRINKLER HEADS WHERE NECESSARY WITH CONCEALED TYPE QUICK RESPONSE SPRINKLER HEADS, FOR LIGHT HAZARD OCCUPANCY AS OUTLINED IN NFPA 13 AND THE SPECIFICATIONS.

**GENERAL NOTES**

- A. FIELD VERIFY EXISTING CONDITIONS PRIOR TO BEGINNING WORK.
- B. COORDINATE THE DOWNTIME OF EXISTING SYSTEMS WITH THE OWNER PRIOR TO BEGINNING WORK.
- C. THE FLOOR IS CURRENTLY ENTIRELY PROTECTED BY A WET AUTOMATIC SPRINKLER SYSTEM. WHERE NEW SPRINKLER WORK IS INDICATED, THE EXISTING SPRINKLER HEADS SHALL BE REMOVED AND REPLACED WITH NEW SPRINKLER HEADS AS NOTED. REWORK EXISTING SPRINKLER HEADS TO MATCH NEW ARCHITECTURAL LAYOUT. REFER TO ARCHITECTURE REFLECTED CEILING PLAN FOR COORDINATION WITH LIGHTING AND EXTENT OF CEILING RENOVATION SCOPE OF WORK.
- D. FOR PROTECTION DURING CONSTRUCTION, TURN EXISTING FIRE SPRINKLER HEADS UP WHEN CEILINGS ARE REMOVED AND REPLACE EXISTING SPRINKLER HEADS WITH NEW UPRIGHT PENDANT FAST-RESPONSE SPRINKLER HEADS. TURN EXISTING FIRE SPRINKLER HEAD DROPS BACK DOWN FOR FINAL INSTALLATION WHEN NEW CEILINGS ARE INSTALLED AND REPLACE PENDANT SPRINKLER HEADS WITH NEW CONCEALED FAST-RESPONSE SPRINKLER HEADS IN COMMON AREAS AND NEW SECURITY TYPE FAST-RESPONSE SPRINKLER HEADS IN PATIENT ROOMS AND OTHER SECURE AREAS AS NOTED ON THE DRAWINGS.
- E. REFER TO THE SPECIFICATIONS FOR SPRINKLER HEAD ORIFICE SIZES, TEMPERATURE RATINGS, FINISH ETC.
- F. CLEAN AND RELOCATE EXISTING FLOOR DRAINS ON AN AS NEEDED BASIS TO PROVIDE SUFFICIENT SLOPE FOR POSITIVE DRAINAGE.



**THIRD FLOOR RENOVATION -  
 AREA C**  
 1  
 1/4" = 1'-0"

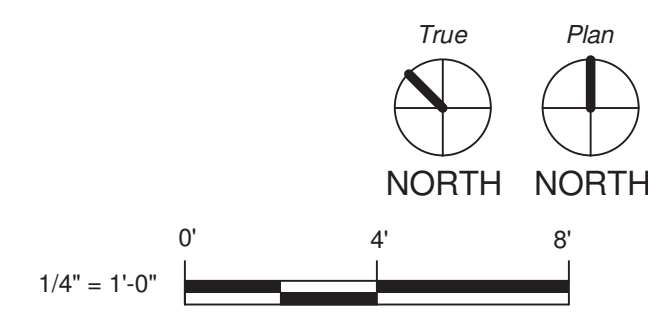



**KEYED NOTES - P2.03D**


- 1 PROVIDE NEW LAVATORY WITH WALL MOUNTED SENSOR FAUCET. CONNECT 1/2" DCW AND DHW TO EXISTING DCW AND DHW IN WALL. CONNECT TO EXISTING WASTE AND VENT IN WALL.
- 2 REWORK EXISTING WASTE AND VENT PIPING TO CONNECT TO NEW WATER CLOSET WITH BACK OUTLET. CONNECT 1 1/4" DCW TO EXISTING DCW IN WALL. 4" WASTE THRU WALL AND DOWN TO EXISTING SANITARY LINE.
- 3 PROVIDE 1/2" DCW AND 1/2" DHW TO NEW SHOWER. 2" WASTE WITH P-TRAP FROM FLOOR DRAIN AND CONNECT TO EXISTING SANITARY BELOW SLAB.
- 4 REWORK AND REPLACE EXISTING WET AUTOMATIC SPRINKLER HEADS WHERE RENOVATION WORK OCCURS WITH PENDANT TYPE, QUICK RESPONSE SPRINKLER HEADS. INSTITUTIONAL TYPE, FOR LIGHT HAZARD OCCUPANCY AS OUTLINED IN NFPA 13 AND THE SPECIFICATIONS.
- 5 REWORK AND REPLACE EXISTING SPRINKLER HEADS WHERE NECESSARY WITH CONCEALED TYPE QUICK RESPONSE SPRINKLER HEADS. FOR LIGHT HAZARD OCCUPANCY AS OUTLINED IN NFPA 13 AND THE SPECIFICATIONS.
- 6 PROVIDE NEW SINK AND FAUCET/TRIM. CONNECT TO EXISTING 1/2" DCW, 1/2" DHW AND 2" SANITARY LINES FROM EXISTING FIXTURE.

**GENERAL NOTES**

- A. FIELD VERIFY EXISTING CONDITIONS PRIOR TO BEGINNING WORK.
- B. COORDINATE THE DOWNTIME OF EXISTING SYSTEMS WITH THE OWNER PRIOR TO BEGINNING WORK.
- C. THE FLOOR IS CURRENTLY ENTIRELY PROTECTED BY A WET AUTOMATIC SPRINKLER SYSTEM. WHERE NEW SPRINKLER WORK IS INDICATED, THE EXISTING SPRINKLER HEADS SHALL BE REMOVED AND REPLACED WITH NEW SPRINKLER HEADS AS NOTED. REWORK EXISTING SPRINKLER HEADS TO MATCH NEW ARCHITECTURAL LAYOUT, REFER TO ARCHITECTURE REFLECTED CEILING PLAN FOR COORDINATION WITH LIGHTING AND EXTENT OF CEILING RENOVATION SCOPE OF WORK.
- D. FOR PROTECTION DURING CONSTRUCTION, TURN EXISTING FIRE SPRINKLER HEADS UP WHEN CEILINGS ARE REMOVED AND REPLACE EXISTING SPRINKLER HEADS WITH NEW UPRIGHT PENDANT FAST-RESPONSE SPRINKLER HEADS. TURN EXISTING FIRE SPRINKLER HEAD DROPS BACK DOWN FOR FINAL INSTALLATION WHEN NEW CEILINGS ARE INSTALLED AND REPLACE PENDANT SPRINKLER HEADS WITH NEW CONCEALED FAST-RESPONSE SPRINKLER HEADS IN COMMON AREAS AND NEW SECURITY TYPE FAST-RESPONSE SPRINKLER HEADS IN PATIENT ROOMS AND OTHER SECURE AREAS AS NOTED ON THE DRAWINGS.
- E. REFER TO THE SPECIFICATIONS FOR SPRINKLER HEAD ORIFICE SIZES, TEMPERATURE RATINGS, FINISH ETC.
- F. CLEAN AND RELOCATE EXISTING FLOOR DRAINS ON AN AS NEEDED BASIS TO PROVIDE SUFFICIENT SLOPE FOR POSITIVE DRAINAGE.



**THIRD FLOOR RENOVATION -  
AREA D**  
1  
1/4" = 1'-0"

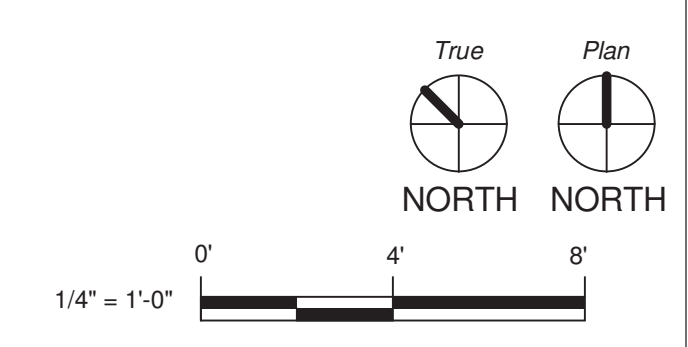



No.	Description	Date

ISSUE FOR CONSTRUCTION

**THIRD FLOOR  
PLUMBING  
RENOVATION PLAN -  
AREA E**

**P2.03E**

**KEYED NOTES - P2.03E**

- 1 PROVIDE NEW LAVATORY WITH WALL MOUNTED SENSOR FAUCET. CONNECT 1/2" DCW AND DHW TO EXISTING DCW AND DHW IN WALL. CONNECT TO EXISTING WASTE AND VENT IN WALL.
- 2 REWORK EXISTING WASTE AND VENT PIPING TO CONNECT TO NEW WATER CLOSET WITH BACK OUTLET. CONNECT 1 1/4" DCW TO EXISTING DCW IN WALL. 4" WASTE THRU WALL AND DOWN TO EXISTING SANITARY LINE.
- 3 PROVIDE 1/2" DCW AND 1/2" DHW TO NEW SHOWER. 2" WASTE WITH P-TRAP FROM FLOOR DRAIN AND CONNECT TO EXISTING SANITARY BELOW SLAB.
- 4 REWORK AND REPLACE EXISTING WET AUTOMATIC SPRINKLER HEADS WHERE RENOVATION WORK OCCURS WITH PENDANT TYPE, QUICK RESPONSE SPRINKLER HEADS, INSTITUTIONAL TYPE, FOR LIGHT HAZARD OCCUPANCY AS OUTLINED IN NFPA 13 AND THE SPECIFICATIONS.
- 5 REWORK AND REPLACE EXISTING SPRINKLER HEADS WHERE NECESSARY WITH CONCEALED TYPE QUICK RESPONSE SPRINKLER HEADS, FOR LIGHT HAZARD OCCUPANCY AS OUTLINED IN NFPA 13 AND THE SPECIFICATIONS.

**GENERAL NOTES**

- A. FIELD VERIFY EXISTING CONDITIONS PRIOR TO BEGINNING WORK.
- B. COORDINATE THE DOWNTIME OF EXISTING SYSTEMS WITH THE OWNER PRIOR TO BEGINNING WORK.
- C. THE FLOOR IS CURRENTLY ENTIRELY PROTECTED BY A WET AUTOMATIC SPRINKLER SYSTEM. WHERE NEW SPRINKLER WORK IS INDICATED, THE EXISTING SPRINKLER HEADS SHALL BE REMOVED AND REPLACED WITH NEW SPRINKLER HEADS AS NOTED. REWORK EXISTING SPRINKLER HEADS TO MATCH NEW ARCHITECTURAL LAYOUT. REFER TO ARCHITECTURE REFLECTED CEILING PLAN FOR COORDINATION WITH LIGHTING AND EXTENT OF CEILING RENOVATION SCOPE OF WORK.
- D. FOR PROTECTION DURING CONSTRUCTION, TURN EXISTING FIRE SPRINKLER HEADS UP WHEN CEILINGS ARE REMOVED AND REPLACE EXISTING SPRINKLER HEADS WITH NEW UPRIGHT PENDANT FAST-RESPONSE SPRINKLER HEADS. TURN EXISTING FIRE SPRINKLER HEAD DROPS BACK DOWN FOR FINAL INSTALLATION WHEN NEW CEILINGS ARE INSTALLED AND REPLACE PENDANT SPRINKLER HEADS WITH NEW CONCEALED FAST-RESPONSE SPRINKLER HEADS IN COMMON AREAS AND NEW SECURITY TYPE FAST-RESPONSE SPRINKLER HEADS IN PATIENT ROOMS AND OTHER SECURE AREAS AS NOTED ON THE DRAWINGS.
- E. REFER TO THE SPECIFICATIONS FOR SPRINKLER HEAD ORIFICE SIZES, TEMPERATURE RATINGS, FINISH ETC.
- F. CLEAN AND RELOCATE EXISTING FLOOR DRAINS ON AN AS NEEDED BASIS TO PROVIDE SUFFICIENT SLOPE FOR POSITIVE DRAINAGE.



**THIRD FLOOR RENOVATION -  
AREA E**

1/4" = 1'-0"

